



STORMWATER MANAGEMENT REPORT

FOR

Sofia By Gomes
525 Northfield Avenue
Lot 1.01, Block 159.04
Township of West Orange
Essex County, New Jersey

Applicant
525 Northfield Ave., LLC
91 KOSSUTH STREET
NEWARK, NJ 07105
pedro@bygomes.com

Prepared by
Jarmel Kizel Architects & Engineers, Inc.

Jarmel Kizel Project No. GOMESGR24-223
Dated: October 22, 2025
Revised January 28, 2026

ARCHITECTURE
ENGINEERING
SPACE PLANNING
INTERIOR DESIGN
IMPLEMENTATION SERVICES

PRINCIPALS
MARVIN JARMEL, IIDA
MATTHEW B. JARMEL, AIA,
MBA
IRWIN H. KIZEL, AIA, PP
RICHARD A. JARMEL, PE

NJ STATE BOARD OF
ARCHITECTS
CERTIFICATE OF
AUTHORIZATION NUMBER 161

NJ STATE BOARD OF
PROFESSIONAL ENGINEERS
AND LAND SURVEYORS
CERTIFICATE OF
AUTHORIZATION NUMBER
GA278177

42 Okner Parkway
Livingston, NJ 07039

TEL: (973) 994-9669
FAX: (973) 994-4069

www.jarmelkizel.com

Anthony Facchino, PE, PLS
Professional Engineer and Land Surveyor
N.J. License No. GE042585

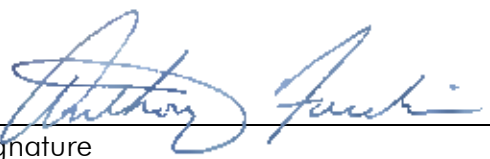

Signature

Table of Contents

Introduction	3
Existing Site Conditions	3
Proposed Site Conditions	3
Groundwater Recharge	4
Water Quality Design	5
Water Quantity Design	5
Soil Erosion and Sediment Control Compliance	8
Collection and Conveyance System Design	8
Conclusion	8

APPENDICES

- A. Existing Runoff Calculations
- B. Proposed Runoff Calculations
- C. Storm Sewer Capacity Calculations
- D. NRCS Soil Mapping Data
- E. Geotechnical Report
- F. Drainage area maps

Introduction

The purpose of this report is to present the stormwater runoff calculations performed for this development and to demonstrate compliance with the Townships Code 25-29 on Stormwater Control and NJDEP Best Management Practices (BMP) specifically regarding the four (4) components of a major development: stormwater quantity, stormwater quality, groundwater recharge, and erosion control.

The project site is located at 525 Northfield Avenue, and is the site of the Essex House restaurant. The property has been designated as Tax Lots 1.01, 1.02 and 1.03, Block 159.04 on the current Township Tax Maps. The site has a total land area of 2.530 acres. The site is located on the corner of Northfield Avenue and Sheridan Avenue in the B-2 zone district, and it backs up to Masson Place and Lenox Terrace. Across the street from the site is the Turtle Back Zoo and the South Mountain Arena in South Mountain Reservation.

Existing Site Conditions

The site is currently occupied by a two-story masonry building with a parking lot for approximately 171 cars. The site is bisected by a 72" diameter concrete culvert pipe that flows east to west. The site's topography is such that the site receives off-site runoff from the residential properties to the northeast. Therefore, the drainage study considers a total area of 3.0609 acres. The site slopes considerably from the northeast corner, southwesterly toward the intersection of Northfield Avenue and Sheridan Avenue. The site has excessive slopes of approximately 50% along its northern boundary. These slopes terminate at the edge of the existing parking lot. The parking lot currently has an average slope of 5%. The site is currently composed of 69.2% impervious areas and 30.8% pervious areas. The pervious areas are, for the most part, located in the rear of the site. The vegetation in this area is mostly woods and shrubs. Access to the site is available from Northfield Avenue and Sheridan Avenue. There is no access to the site from Masson Place and Lenox Terrace because of the steep slopes in that section of the site.

Proposed Site Conditions

The proposed development requires to remove all existing building area, pavement, and site infrastructure for submission for preliminary and final site plans seeking approval to construct a multi-family 105-unit apartment building with an underground parking garage. The 52,940 square foot building will have (84) one-bedroom units, (16) two-bedroom units and (5) three-bedroom units. The building will also have 1,200sf retail space and 5,784sf of outdoor amenity area. The building will also have a total of (200) parking spaces.

The existing property has a total land area of 110,205 square feet (2.53 acres). The proposed conditions will have a reduction in impervious coverage by 3,265sf. Please also note that the proposed 5,784sf of outdoor amenity space has been considered impervious area to provide a conservative approach to our stormwater design. The amenity space will have planter area to infiltrate and absorb runoff. In proposed conditions we are maintaining drainage patterns

as close to existing conditions as possible. Do to the fact that the proposal will disturbance more than 1/2 acre of land, causes the project to meet the definition of a “Major Development” under the State and local regulations Code 25-29.

Soils

From the Natural Resources Conservation Service, one soil type was found at the project site: BouB—Boonton substratum, 0 to 8 percent slopes. The soil is ranked with a hydraulic soil group C. For design purposes Hydrologic Soil Group C will be used for design comparison.

Nonstructural Best Management Practices (Bmps)

Stormwater management is an important aspect of the project, not only for the safety and convenience of potential residents, but for the environment as well. Thus, it has been endeavored to include various stormwater management techniques that include both natural and structural means to accomplish that task.

The following low impact, nonstructural, development approaches to site design have been incorporated into this project as per Township code 25-29.4 and the NJDEP storm water management regulations 7:8-5.3; notably:

25-29.4(a) Land disturbance would be minimized by maintaining as much native vegetation around the site as possible.

25-29.4 (b) A Maintenance plan has been prepared to address ongoing maintenance of the project.

NJDEP 7:8-5.3 (b) 6. Much of the proposed building area has been previously disturbed and/or filled. It is these areas where most of the contemplated soil compaction would take place in order to construct the new buildings, parking areas, and drives. In other locations that have not seen extensive disturbance, rubber tired vehicles would be used to minimize compaction.

NJDEP 7:8-5.3 (b) 7. Extensive, supplemental landscaping would be added throughout the project site in the form of trees, shrubs, and ground cover.

Groundwater Recharge

This section of the report describes the groundwater recharge provisions of the stormwater management system’s design. The site falls within the State’s Planning Area 1 (Metropolitan) and therefore the site can be considered as part of the urban redevelopment area. This groundwater recharge requirement does not apply to areas of the project that have been previously developed. Consequently, pursuant to 25-29.4 (q)3 and NJAC 7:8-5.4(b)2 the

groundwater recharge requirements do not apply to this development. The reduction in impervious coverage would likely allow groundwater infiltration.

Water Quality Management

As stated previously, since the project does not increase impervious cover by more than 0.25 acres (impervious cover is reduced in the proposed condition), the site does not drain to a water that has a total maximum daily load (TMDL) for TSS reduction, the regulatory requirements of the Code 25-29.4(r) and NJAC 7:8-5.5 are not applicable. Nevertheless, we believe implementation of the project will result in an improvement of runoff quality, when compared to existing site conditions and former use of the property. The anticipated improvement in water quality is based upon the net reduction in impervious cover, as well as a higher percentage of the post-project cover being comprised of mainly roof areas consisting of 52,940 square feet. The NJDEP considers roof runoff “clean,” not requiring TSS removal pursuant to State regulation.

Hydrology And Stormwater Management

Quantity Control (Peak Flow Attenuation)

Estimating runoff rates and volumes for quantity control purposes is done by utilizing what is referred to as the “NRCS Method”, which is also known as the “TR-55” methodology. This is described at length in Chapter 5 of the BMP Manual

According to the National Engineering Handbook, as published by the NRCS, the combination of a hydrologic soil group and a land use and treatment class is a hydrologic soil-cover complex, to which a runoff curve number (CN) can be assigned. The CN is an indication of the complex’s runoff potential. The Hydrologic Soil Group(s) for the project site were determined by referencing the NRCS’s Web Soil Survey for the appropriate county.

The Time of Concentration, “Tc”, for the existing and the proposed conditions have been calculated through modeling software and the paths are shown on the coverage maps. For the various ground covers, runoff coefficients, “CN”, used in the analysis were 98 for impervious areas such as buildings, parking lot, and walkways, and 71-74 for wooded/landscape areas.

The rainfall depths utilized for the project’s design were derived from NOAA Atlas 14, Volume 2, Version 3 point precipitation frequency estimates. An adjustment factor increasing the runoff factor by 1%-6% was applied in per 54 NJR 2187(a) for current storms and another 23% to 46% was added to arrive at a “future” storm intensity. Below is a summary of the storm rainfall depths used for both the existing and proposed conditions.

Storm	2-year	10-year	100-year
Current-Year-2020	3.47 in	5.38 in	9.18 in
Future-Year-2050	4.09 in	6.37 in	11.52 in.

The project's approach for compliance with the regulatory requirements for "quantity control" are set forth at Township Code 25-29.4(s) and Subpart 5.6(b)(2) of the Stormwater Management Regulations (NJAC 7:8), specifically "Demonstrate through hydrologic and hydraulic analysis that there is no increase, as compared to the pre-construction condition, in the peak runoff rates of stormwater leaving the site for the current and projected two-, ten-, and 100-year storm events, as defined and determined pursuant to § 25-29.5c and d, respectively, of this section, and that the increased volume or change in timing of stormwater runoff will not increase flood damage at or downstream of the site. This analysis shall include the analysis of impacts of existing land uses and projected land uses assuming full development under existing zoning and land use ordinances in the drainage area;" As the project is divided into two primary drainage areas with two design points, quantity control considerations are evaluated for each design point.

The TR-55 calculations provided in Appendix No. A and Appendix No. B indicate the total peak runoff and total runoff volumes from the subject drainage areas under pre-project and post-project conditions respectively. Tables below provide a summary of the peak runoff rates and total runoff volumes for the regulated storms under existing and proposed conditions for both design points and the overall site, respectively. The following data verifies the project's compliance with the standards pertaining to "quantity control" as the peak runoff rates for post-project conditions never exceed the pre-project conditions. There is no increase in volume for post-conditions because we were able to maintain drainage areas with the use of roof drains, therefore, we will not increase flood damage at or downstream of the site. Our site currently connects to an existing 72" culvert pipe and a storm sewer system on Sheridan Avenue which will safely convey the runoff and minimize erosion.

Table No. 1				
Design Point #1				
Storm Freq.	Runoff Rates (cfs)		Total Volume Runoff (cf)	
	PRE	POST	PRE	POST
2-Year(2020)	3.42	3.38	23,157	23,111
10-Year(2020)	5.82	5.75	39,692	39,645
100-Year(2020)	10.83	10.67	74,476	74,356
2-Year(2050)	4.21	4.17	28,405	28,362
10-Year(2050)	7.17	7.08	48,587	48,528
100-Year(2050)	14.10	13.89	96,456	96,261

Table No. 2				
Design Point #2				
Storm Freq.	Runoff Rates (cfs)		Total Volume Runoff (cf)	
	PRE	POST	PRE	POST
2-Year(2020)	0.61	0.52	3,919	3,361
10-Year(2020)	0.99	0.91	6,436	5,818
100-Year(2020)	1.77	1.71	11,573	10,992
2-Year(2050)	0.73	0.65	4,727	4,140
10-Year(2050)	1.20	1.12	7,763	7,141
100-Year(2050)	2.26	2.22	14,774	14,261

Table No. 3				
Overall Site (Total)				
Storm Freq.	Runoff Rates (cfs)		Total Volume Runoff (cf)	
	PRE	POST	PRE	POST
2-Year(2020)	4.03	3.90	27,076	26,472
10-Year(2020)	6.82	6.65	46,128	45,463
100-Year(2020)	12.60	12.38	86,050	85,348
2-Year(2050)	4.95	4.81	33,132	32,502
10-Year(2050)	8.36	8.20	56,350	55,669
100-Year(2050)	16.35	16.11	111,230	110,523

5. Soil Erosion and Sediment Control Compliance

The project has also been designed to minimize erosion and sedimentation in accordance with "The Standards for Soil Erosion and Sediment Control in New Jersey". "Soil Erosion and Sediment Control Plan" is included in the set of project plans, specifying numerous practices to achieve this goal. The project's "Soil Erosion and Sediment Control Plan" is subject to review and approval by the Hudson Essex Passaic Soil Conservation District (HEPSCD). The District's certification of the plan is required before any construction may commence, which provides further assurance that the project's implementation will minimize erosion and sedimentation.

6. Collection and Conveyance System Design

The project's storm water management system also includes a network of storm sewer pipes to convey the stormwater runoff to and from the various management facilities. Similarly, stormwater inlets are strategically located to collect runoff from the surface of the ground. The collection and conveyance systems (storm sewers) were designed for the peak rate of runoff during a **100-year storm** calculated per the Rational Method. Appendix No. C of this report contains the storm sewer design calculations.

The Proposed Inlet Area Map presents the inlet drainage areas for each proposed inlet collecting roof runoff via downspout leaders. There are multiple storm sewers systems proposed: system B-F encompasses Proposed Drainage Area to mimic existing condition drainage patterns.




Conclusion

The proposed improvements are designed in accordance with local, county and state standards as specified herein. The measures and design provided herein are intended to prevent or limit the impact of the proposed development on the site and the surrounding areas with respect to stormwater quantity, quality, groundwater recharge, and erosion from stormwater runoff. The proposed project will not increase impervious surfaces within the property in question and will provide peak flow attenuation by reducing the peak flow and volume as compared to existing conditions.

As per the requirements for a major site development, there is a reduction in the existing peak runoff rates and volumes for stormwater leaving the site for the 2, 10, and 100-year storm events at each design point respectively. It is our opinion that the calculations provided and summarized above demonstrate compliance with the Township ordinance 25-29 Stormwater Control.

APPENDIX A

EXISTING DRAINAGE CALCULATIONS

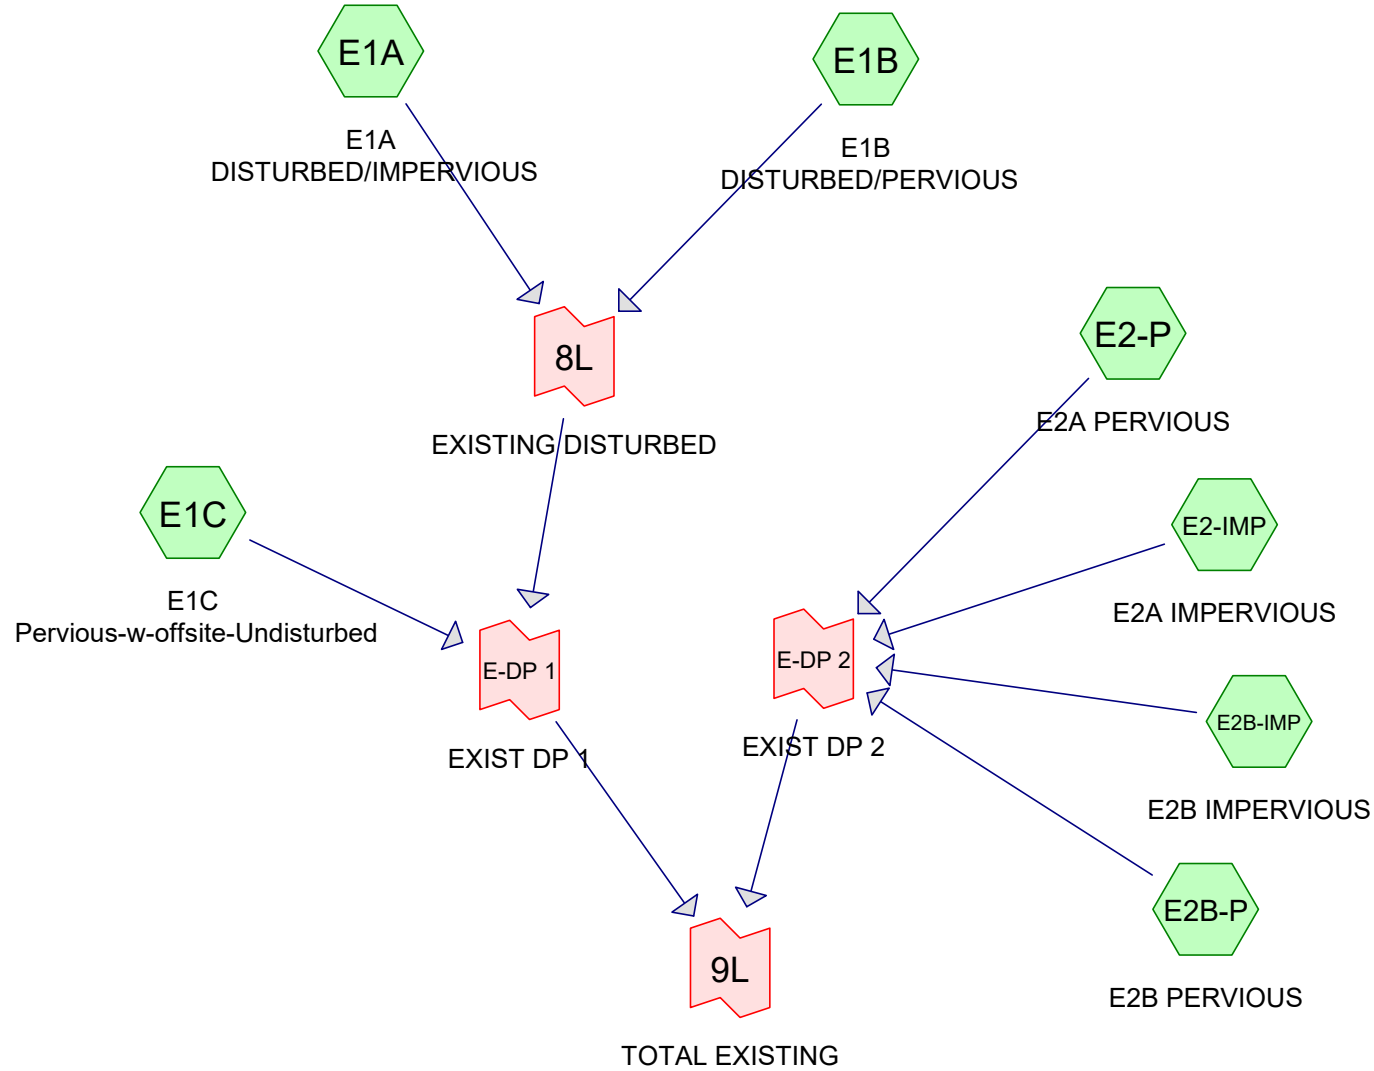

Routing Diagram for 24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs, Printed 1/28/2026
HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
4,668	74	>75% Grass cover, Good, HSG C (E1C, E2-P, E2B-P)
1,220	98	Impervious (E1C)
2,721	71	Meadow, non-grazed, HSG C (E1C)
78,560	98	Paved parking, HSG C (E1A, E2-IMP, E2B-IMP)
708	98	Roof-offsite (E1C)
4,643	98	Roofs, HSG C (E2-IMP)
7,928	72	Woods/grass comb., Good, HSG C (E1B)
32,886	70	wooded (E1C)

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 3

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
98,520	HSG C	E1A, E1B, E1C, E2-IMP, E2-P, E2B-IMP, E2B-P
0	HSG D	
34,814	Other	E1C

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 4

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
0	0	4,668	0	0	4,668	>75% Grass cover, Good	E1C, E2-P, E2B-P
0	0	0	0	1,220	1,220	Impervious	E1C
0	0	2,721	0	0	2,721	Meadow, non-grazed	E1C
0	0	78,560	0	0	78,560	Paved parking	E1A, E2-IMP, E2B-IMP
0	0	0	0	708	708	Roof-offsite	E1C
0	0	4,643	0	0	4,643	Roofs	E2-IMP
0	0	7,928	0	0	7,928	Woods/grass comb., Good	E1B
0	0	0	0	32,886	32,886	wooded	E1C

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 5

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 2.94 cfs @ 12.01 hrs, Volume= 18,871 cf, Depth= 3.24"
Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.30		Sheet Flow, Parking lot Smooth surfaces n= 0.011 P2= 3.47"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 6

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

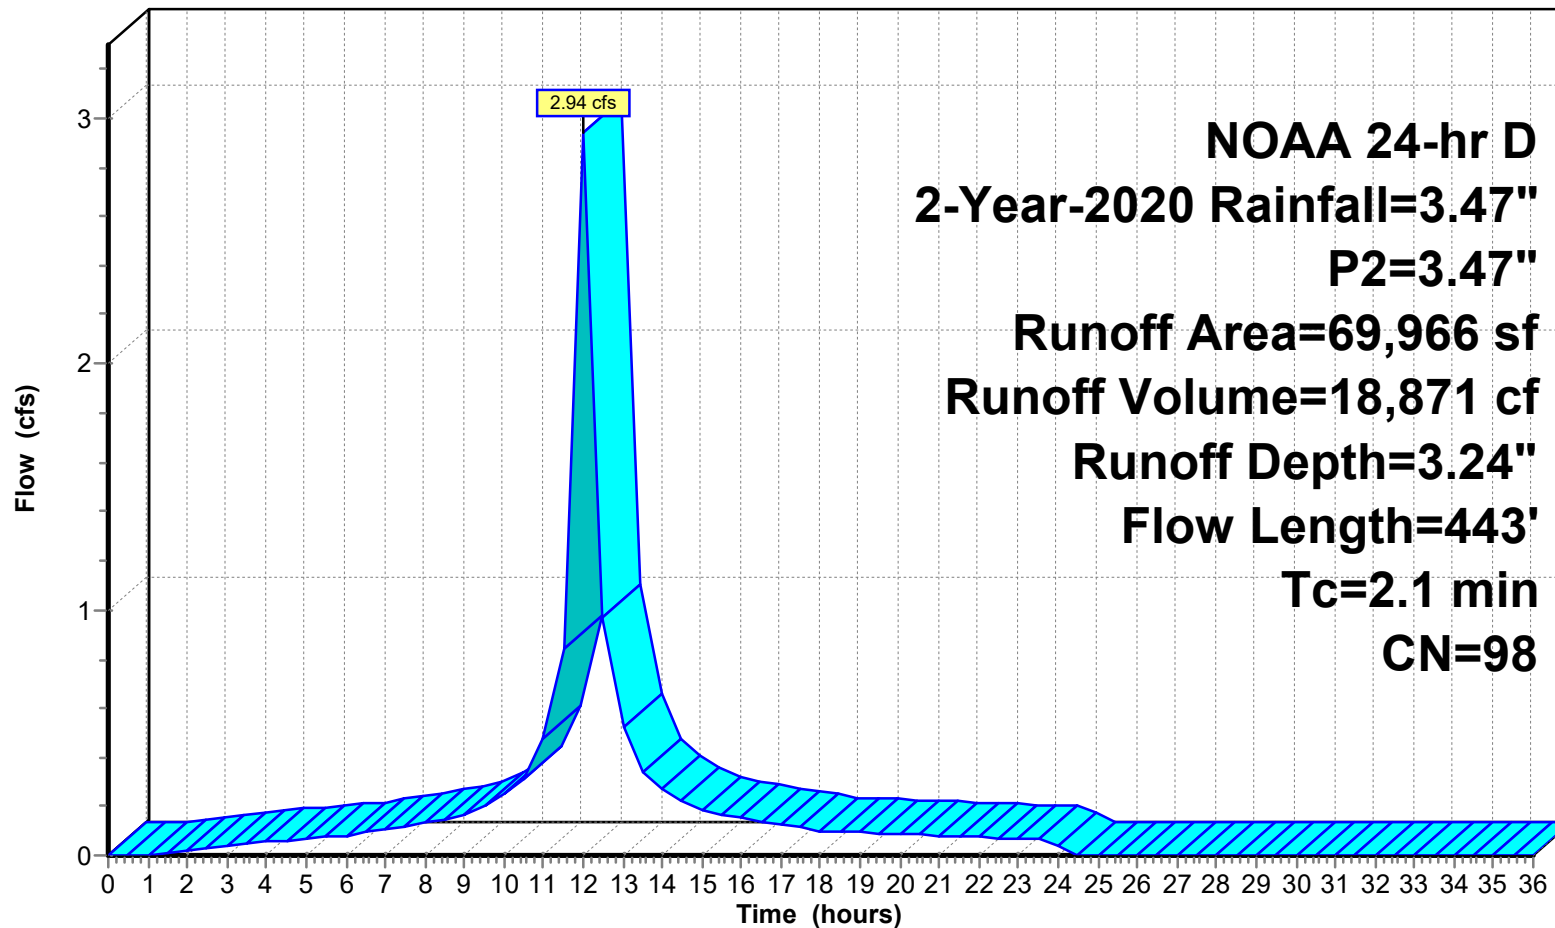

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 7

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.11 cfs @ 12.07 hrs, Volume= 728 cf, Depth= 1.10"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	25	0.5000	0.22		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 3.47"
0.5	75	0.0800	2.35		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 3.47"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.8	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 8

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

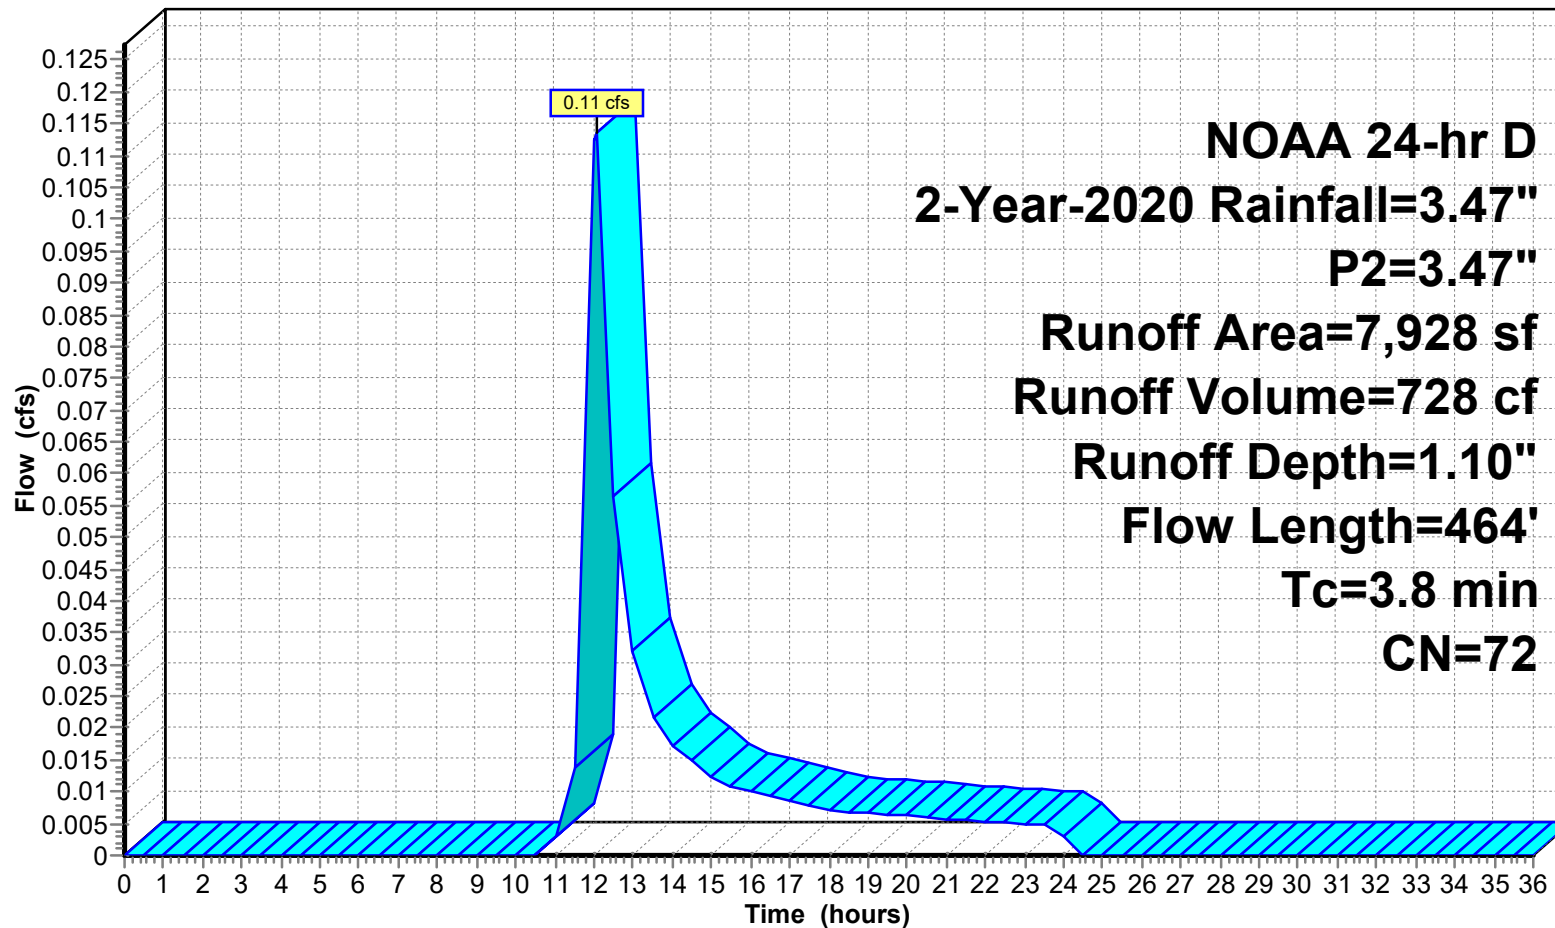

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 9

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 0.44 cfs @ 12.36 hrs, Volume= 3,559 cf, Depth= 1.10"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
* 708	98	Roof-offsite
* 1,220	98	Impervious
2,721	71	Meadow, non-grazed, HSG C
* 32,886	70	wooded
1,240	74	>75% Grass cover, Good, HSG C
38,775	72	Weighted Average
36,847		95.03% Pervious Area
1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
13.6	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 10

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

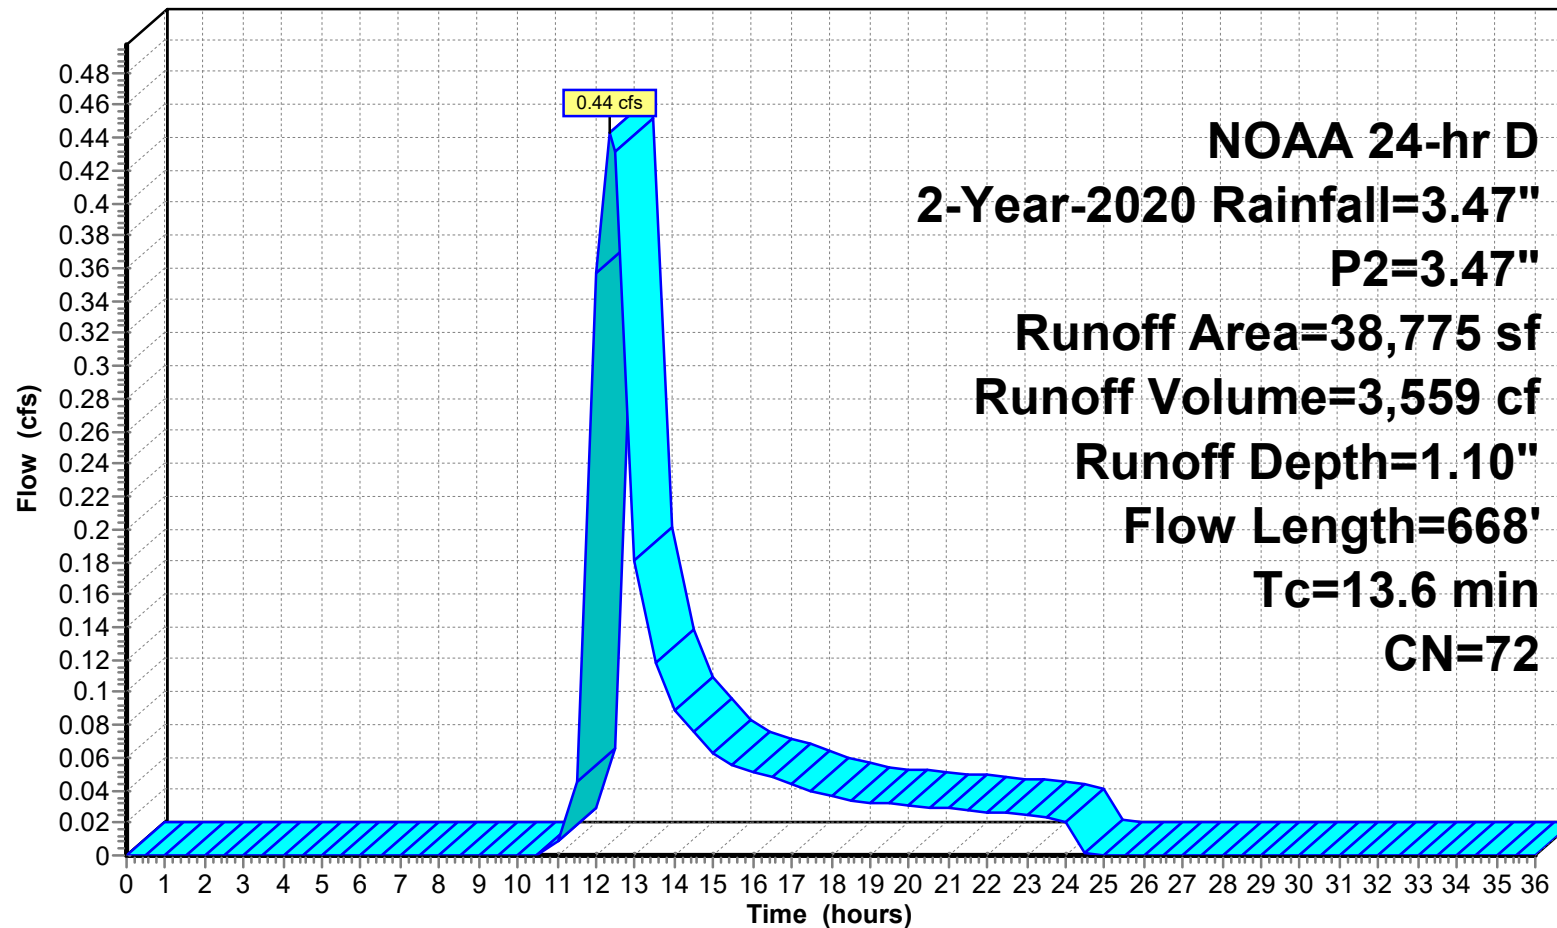

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 11

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 0.51 cfs @ 12.01 hrs, Volume= 3,246 cf, Depth= 3.24"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0550	2.15		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 12

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

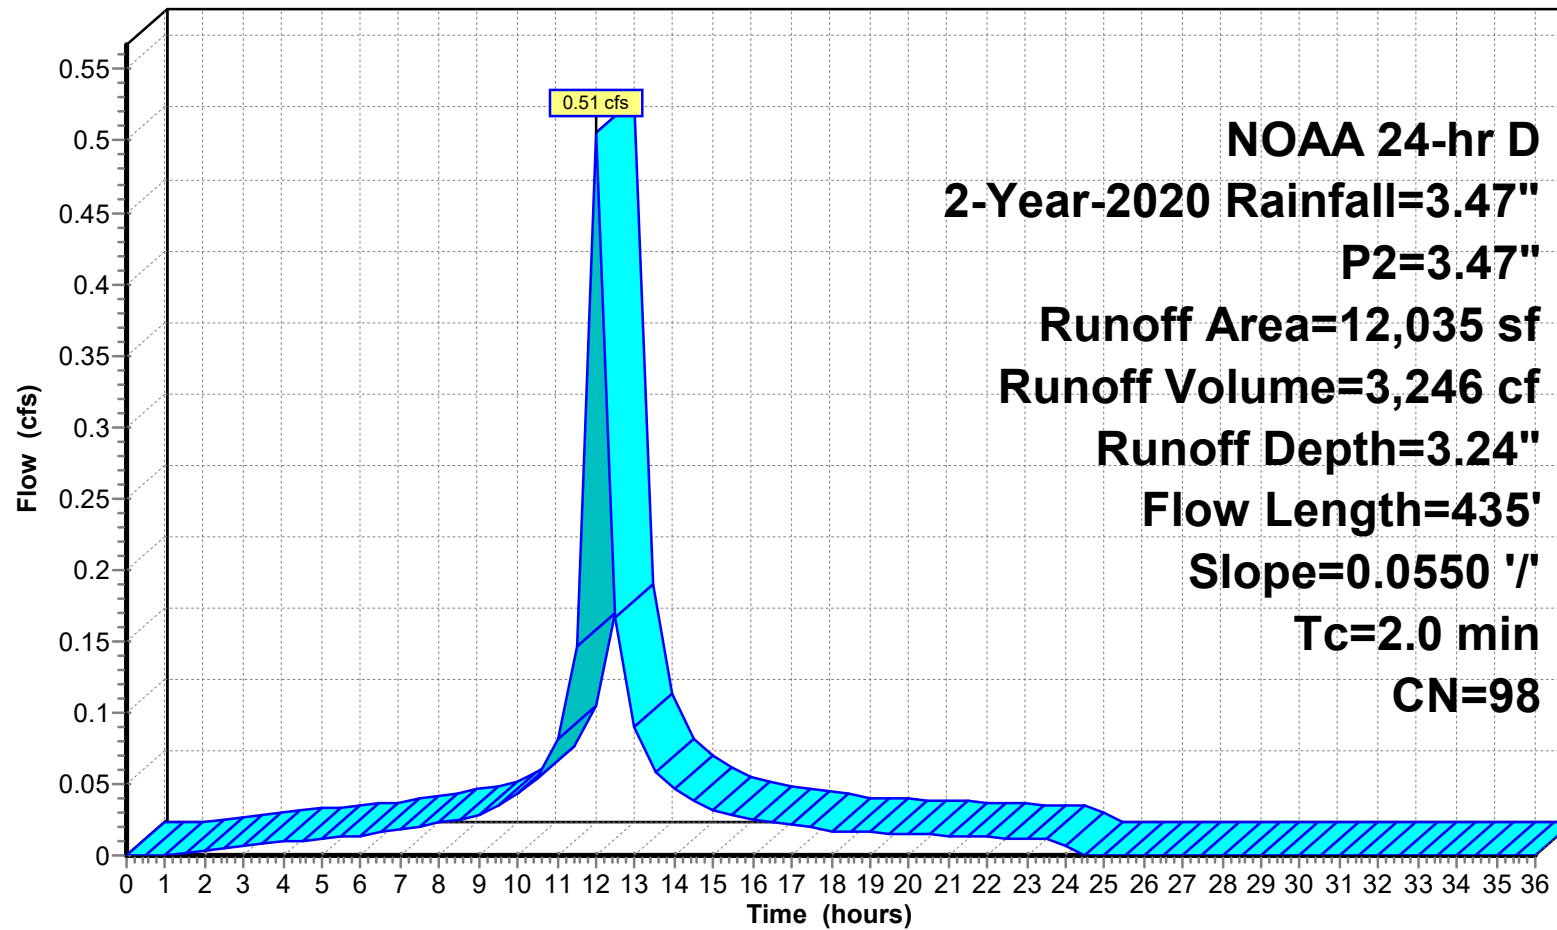

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 13

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.03 cfs @ 12.08 hrs, Volume= 213 cf, Depth= 1.22"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 14

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

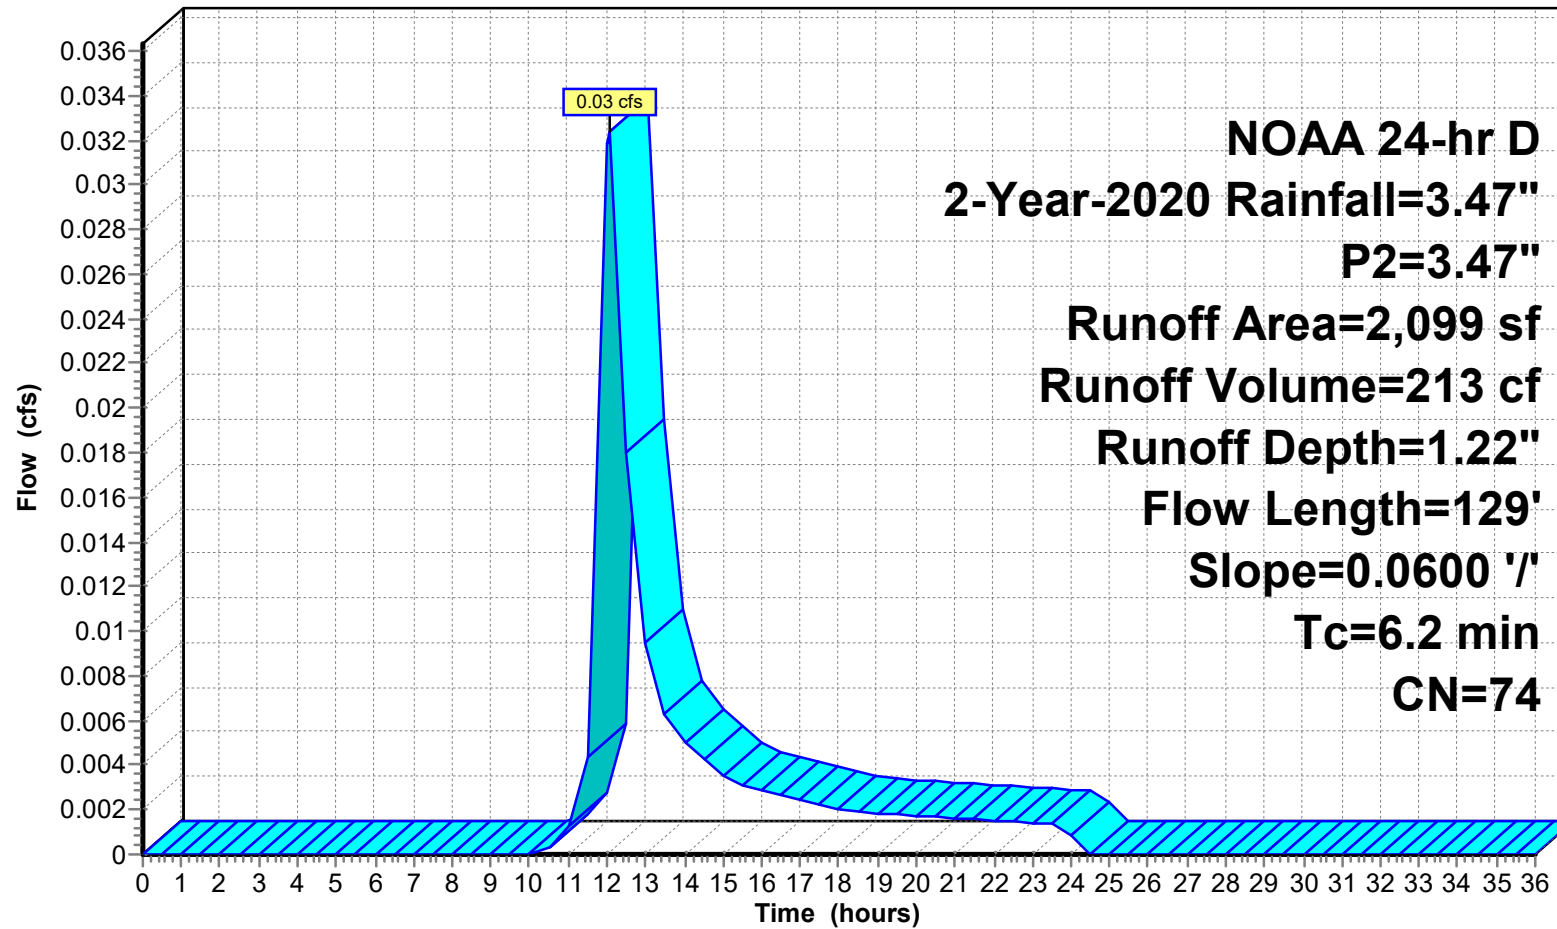

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 15

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.05 cfs @ 12.00 hrs, Volume= 324 cf, Depth= 3.24"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 16

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

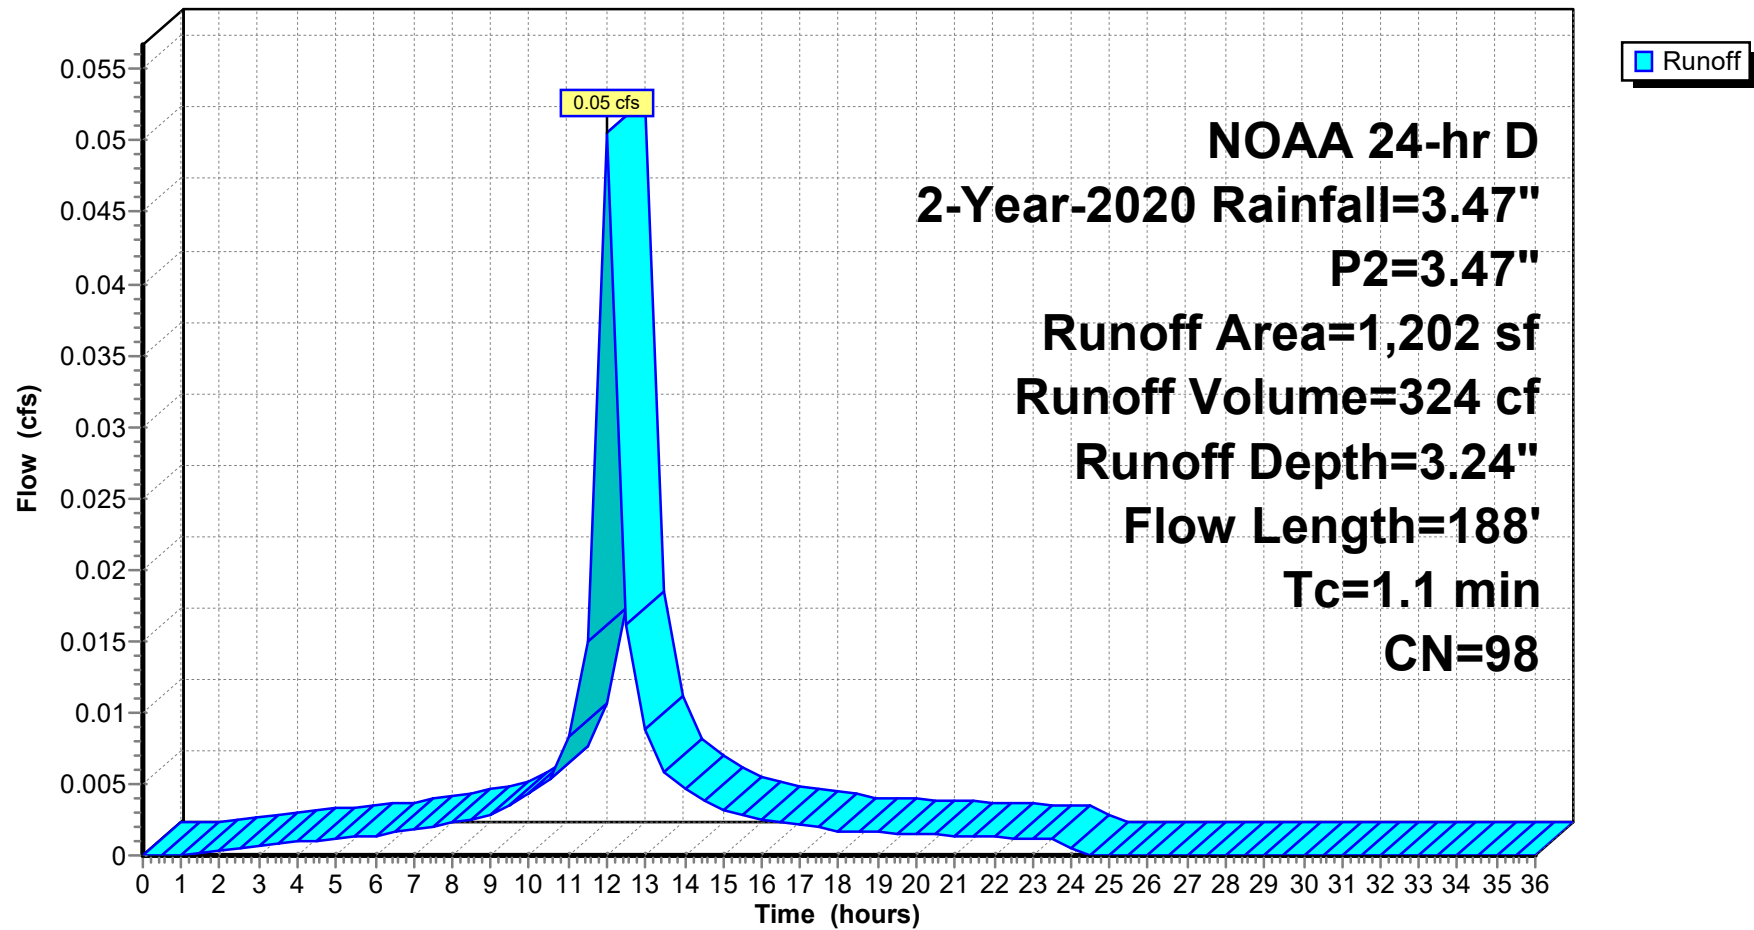

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 17

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.02 cfs @ 12.08 hrs, Volume= 135 cf, Depth= 1.22"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 18

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

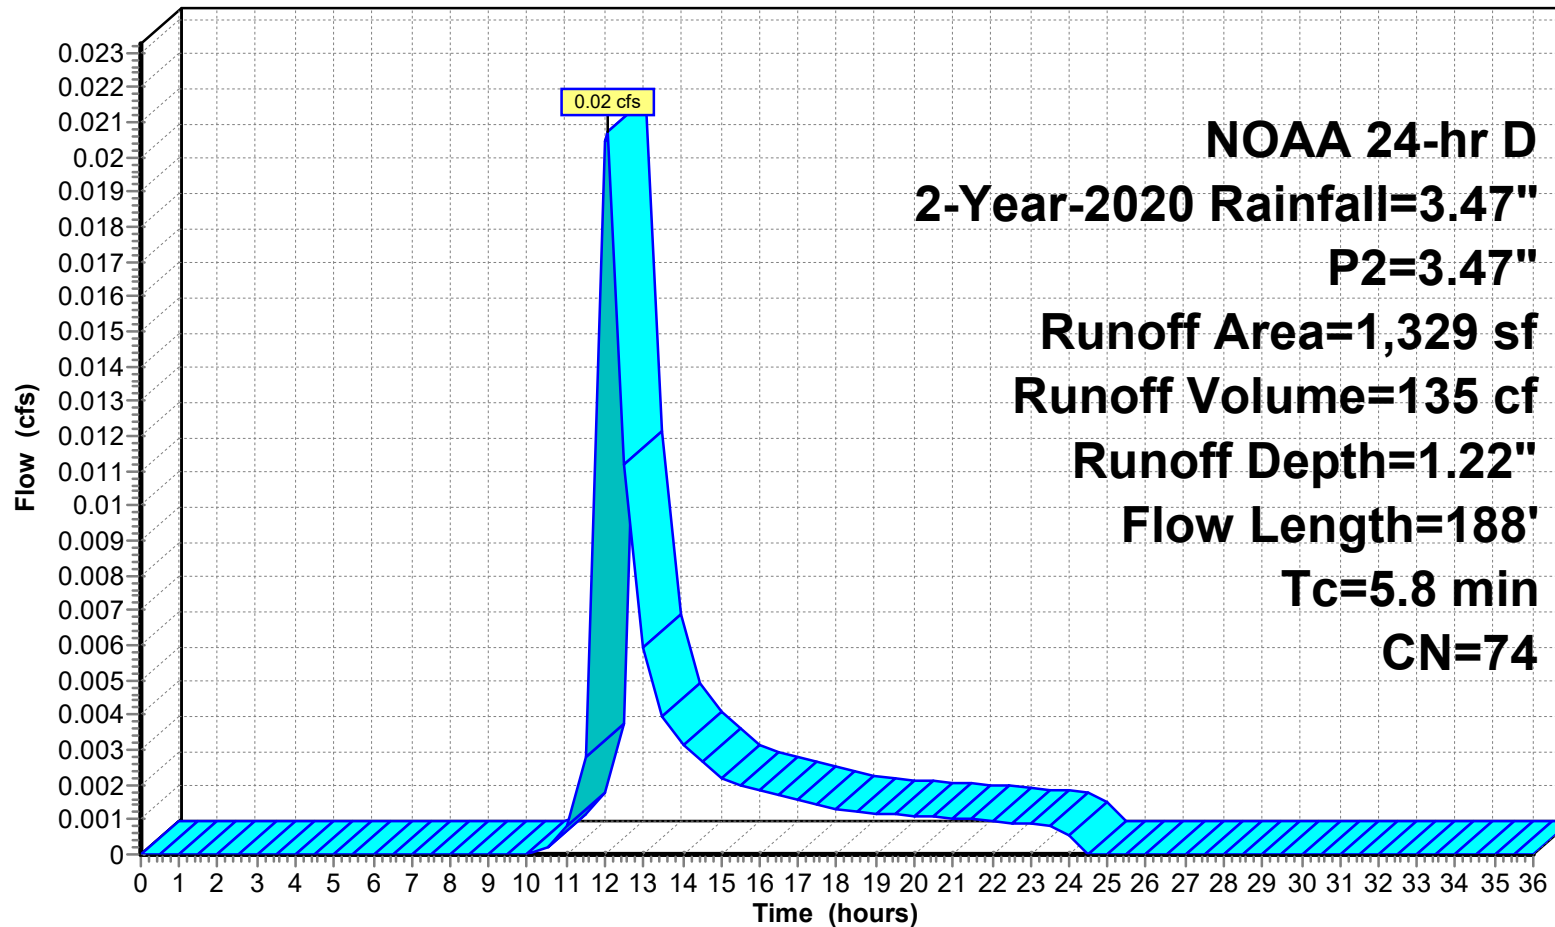

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 19


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 3.02" for 2-Year-2020 event
Inflow = 3.06 cfs @ 12.01 hrs, Volume= 19,598 cf
Primary = 3.06 cfs @ 12.01 hrs, Volume= 19,598 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

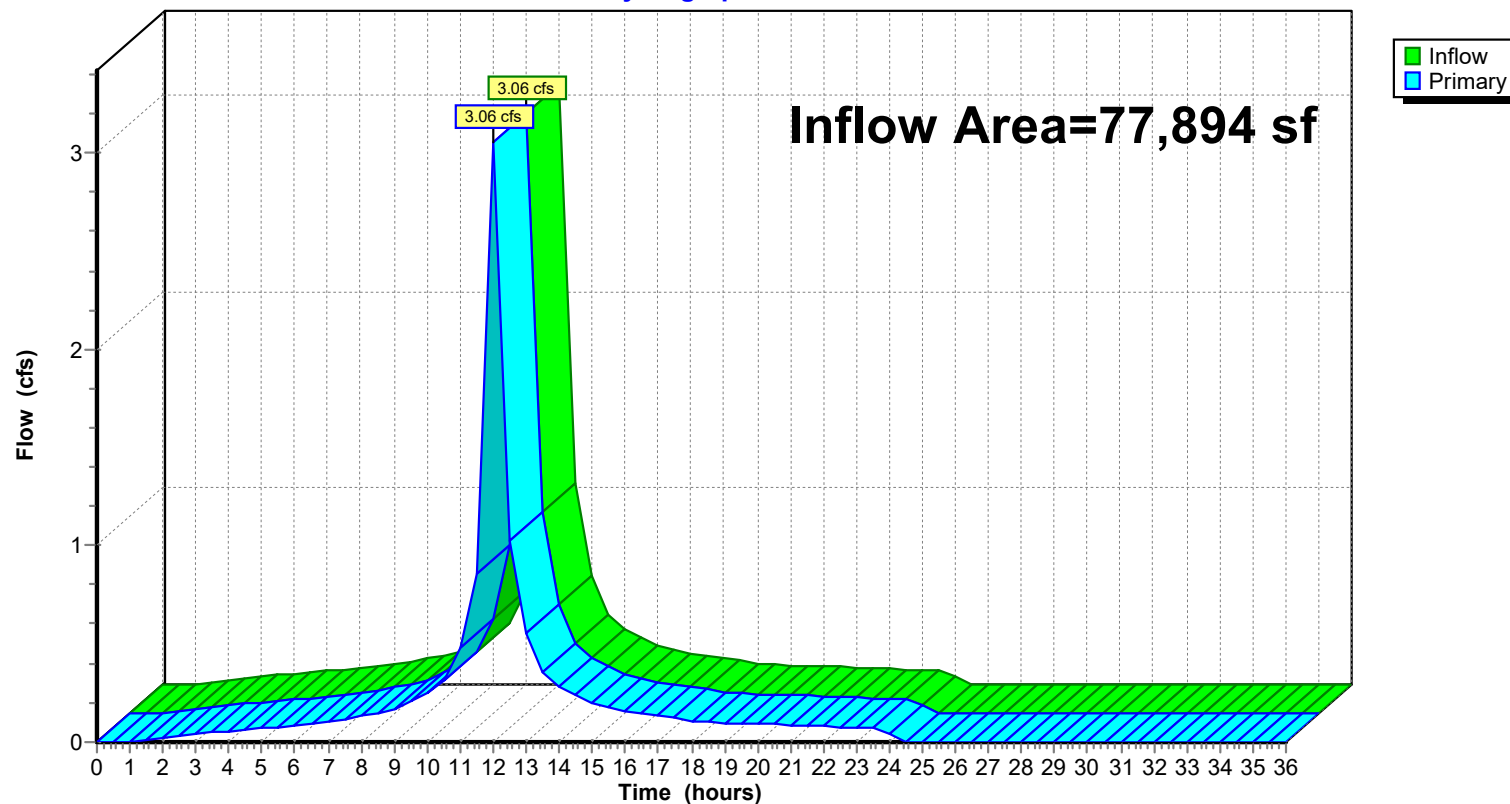

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 20


Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 2.44" for 2-Year-2020 event
Inflow = 4.03 cfs @ 12.03 hrs, Volume= 27,076 cf
Primary = 4.03 cfs @ 12.03 hrs, Volume= 27,076 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

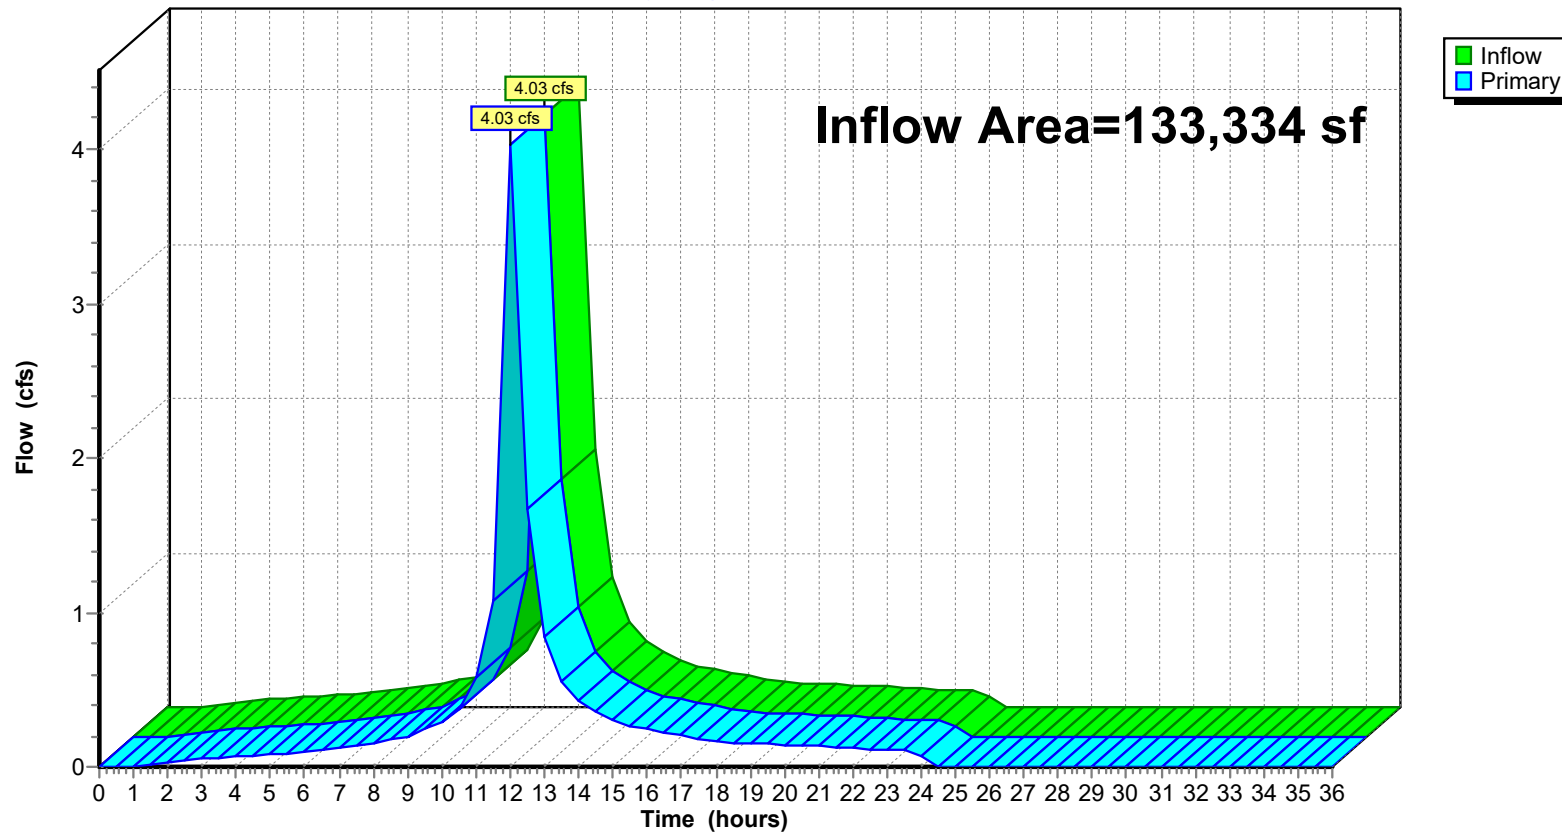

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 21


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 2.38" for 2-Year-2020 event
Inflow = 3.42 cfs @ 12.03 hrs, Volume= 23,157 cf
Primary = 3.42 cfs @ 12.03 hrs, Volume= 23,157 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

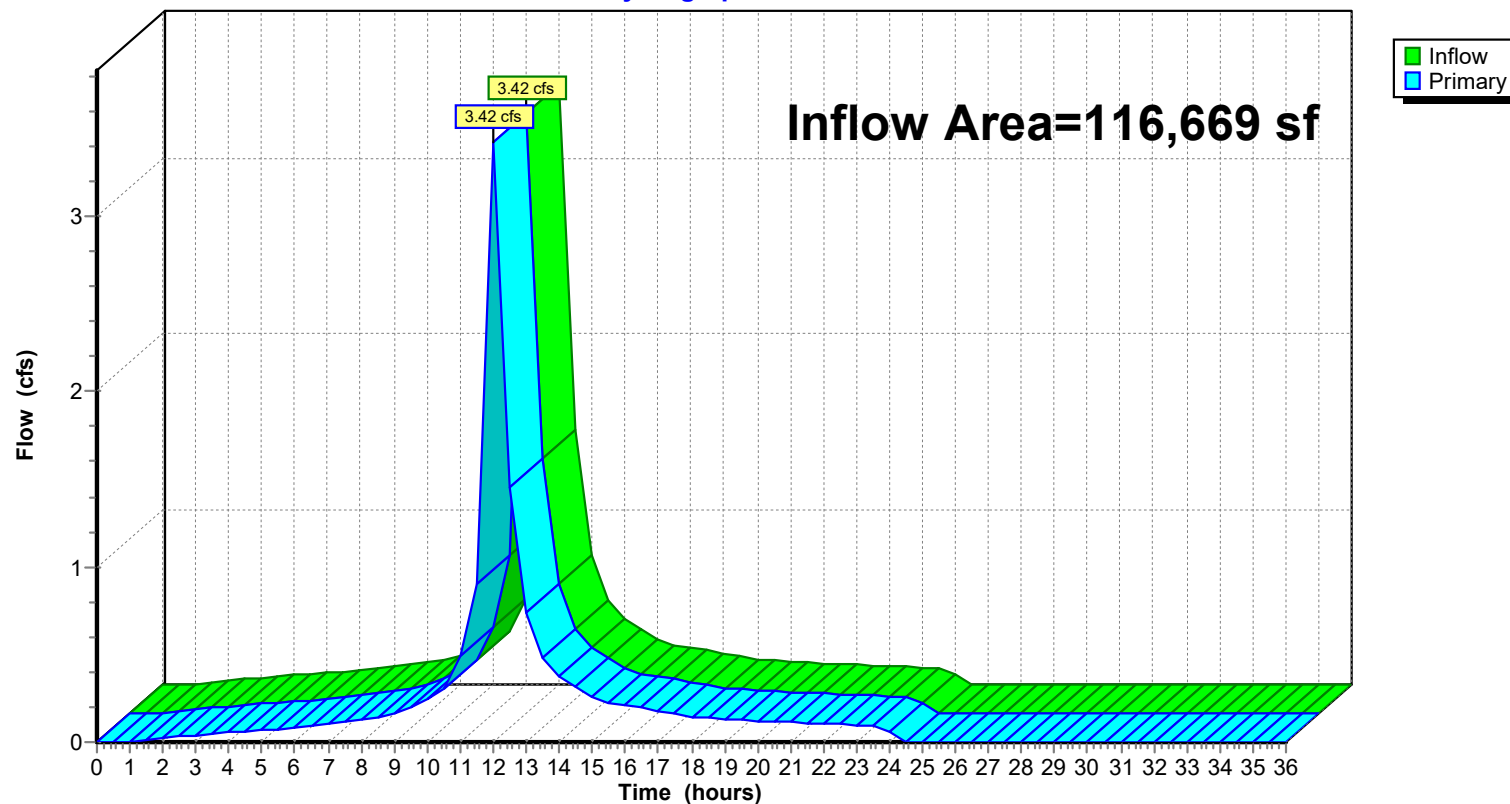

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 22


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 2.82" for 2-Year-2020 event
Inflow = 0.61 cfs @ 12.01 hrs, Volume= 3,919 cf
Primary = 0.61 cfs @ 12.01 hrs, Volume= 3,919 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 2: EXIST DP 2

Hydrograph

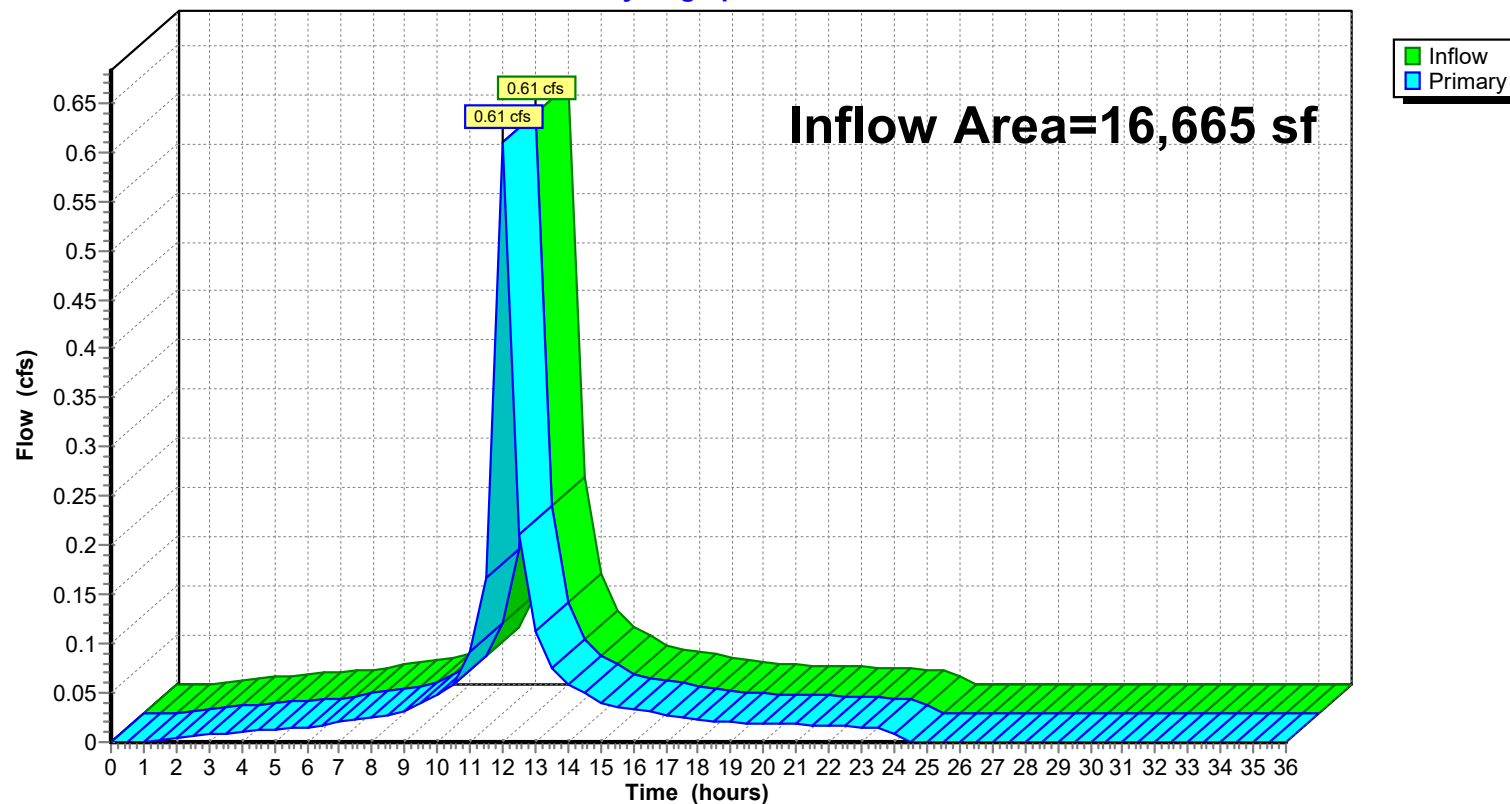

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 23

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 4.60 cfs @ 12.01 hrs, Volume= 29,984 cf, Depth= 5.14"
Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.30		Sheet Flow, Parking lot Smooth surfaces n= 0.011 P2= 3.47"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 24

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

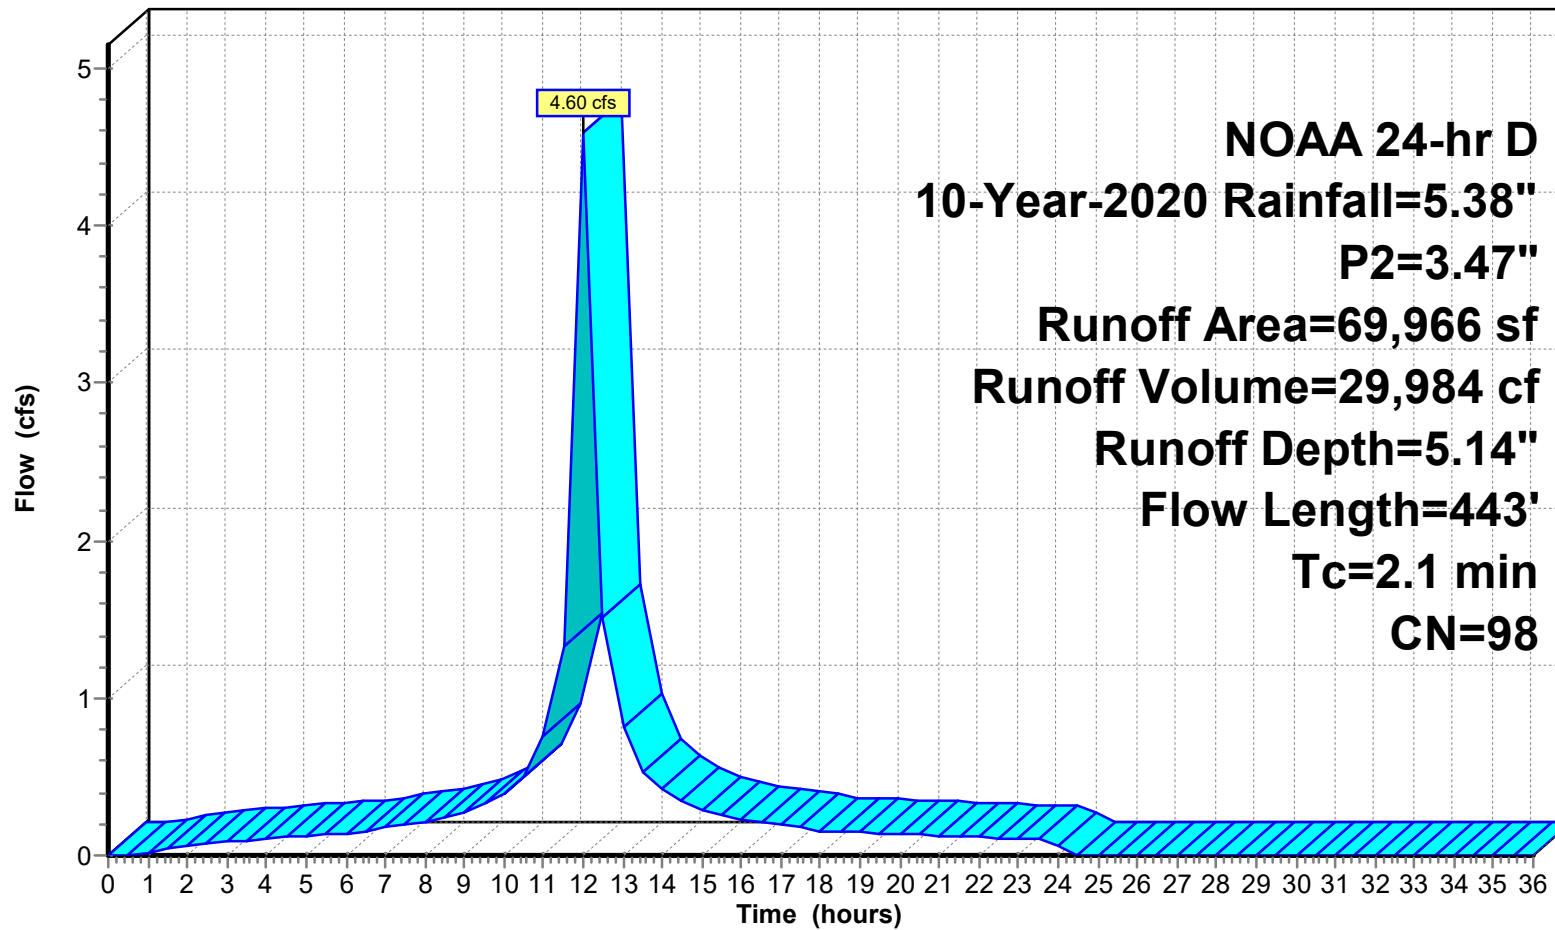

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 25

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.28 cfs @ 12.05 hrs, Volume= 1,648 cf, Depth= 2.49"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	25	0.5000	0.22		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 3.47"
0.5	75	0.0800	2.35		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 3.47"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.8	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 26

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

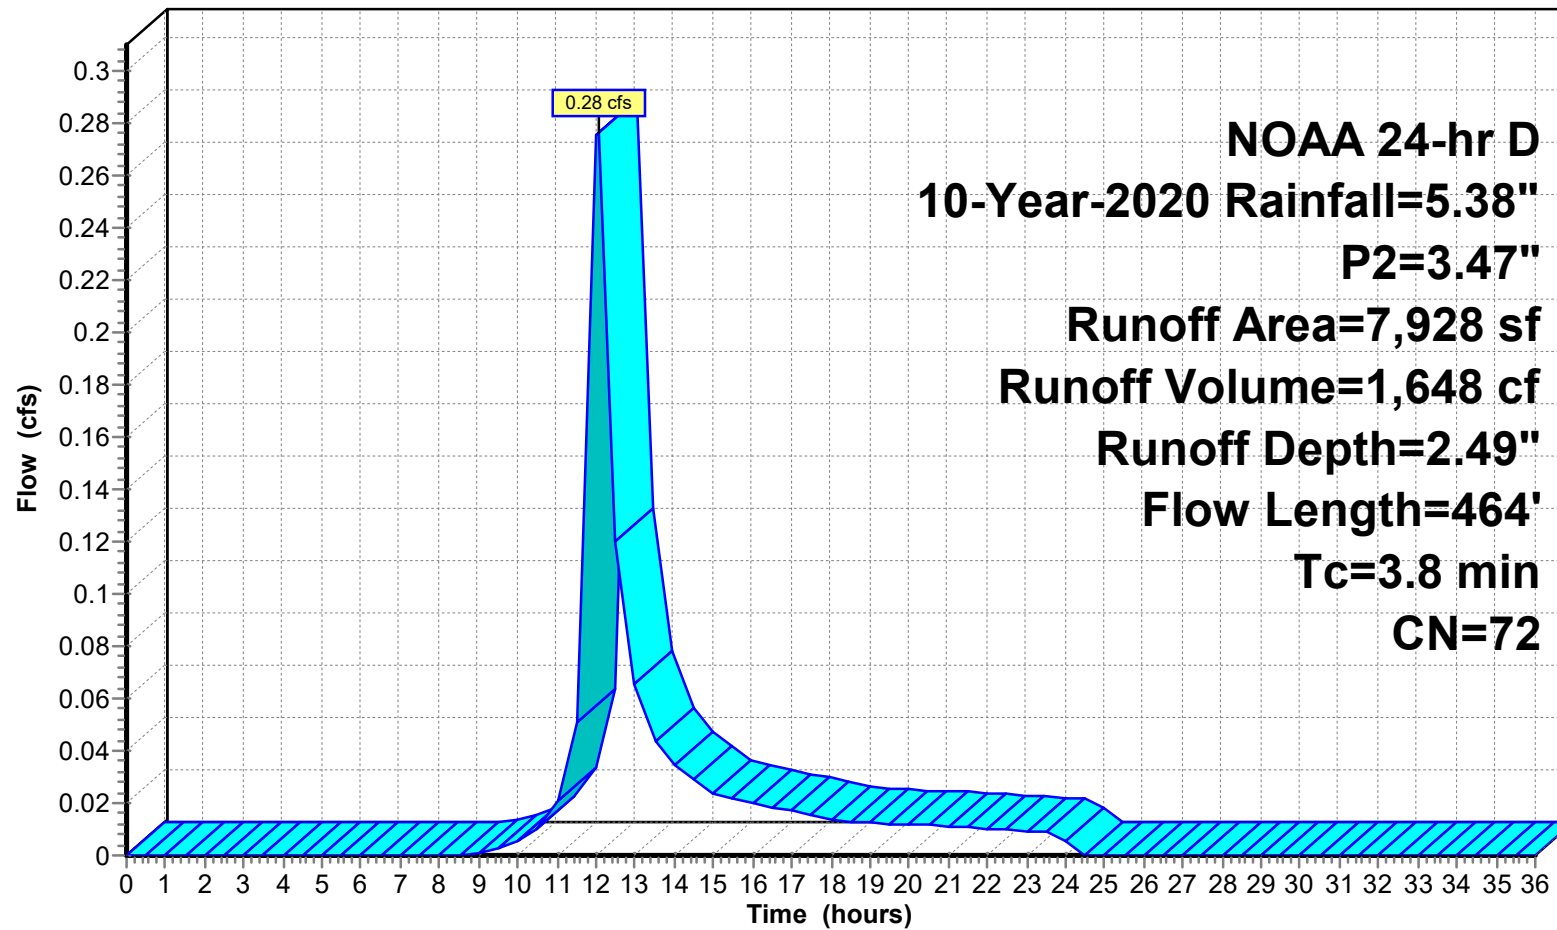

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 27

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 1.02 cfs @ 12.27 hrs, Volume= 8,060 cf, Depth= 2.49"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

	Area (sf)	CN	Description
*	708	98	Roof-offsite
*	1,220	98	Impervious
	2,721	71	Meadow, non-grazed, HSG C
*	32,886	70	wooded
	1,240	74	>75% Grass cover, Good, HSG C
	38,775	72	Weighted Average
	36,847		95.03% Pervious Area
	1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
13.6	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 28

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

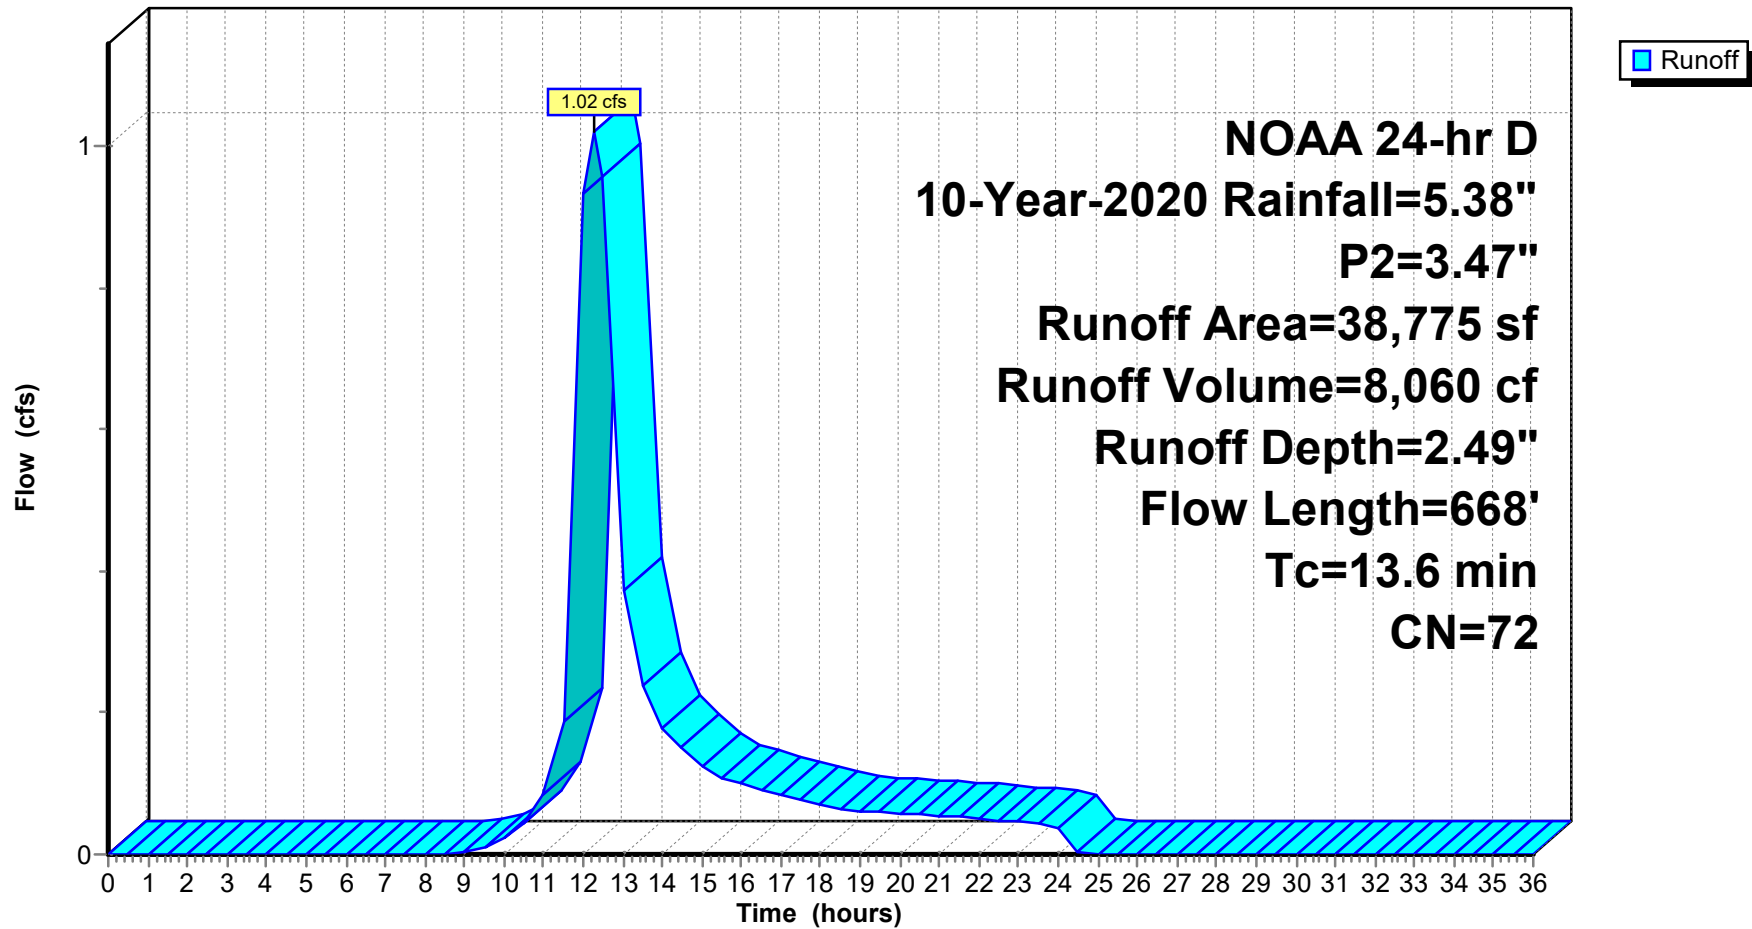

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 29

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 0.79 cfs @ 12.01 hrs, Volume= 5,158 cf, Depth= 5.14"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0550	2.15		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 30

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

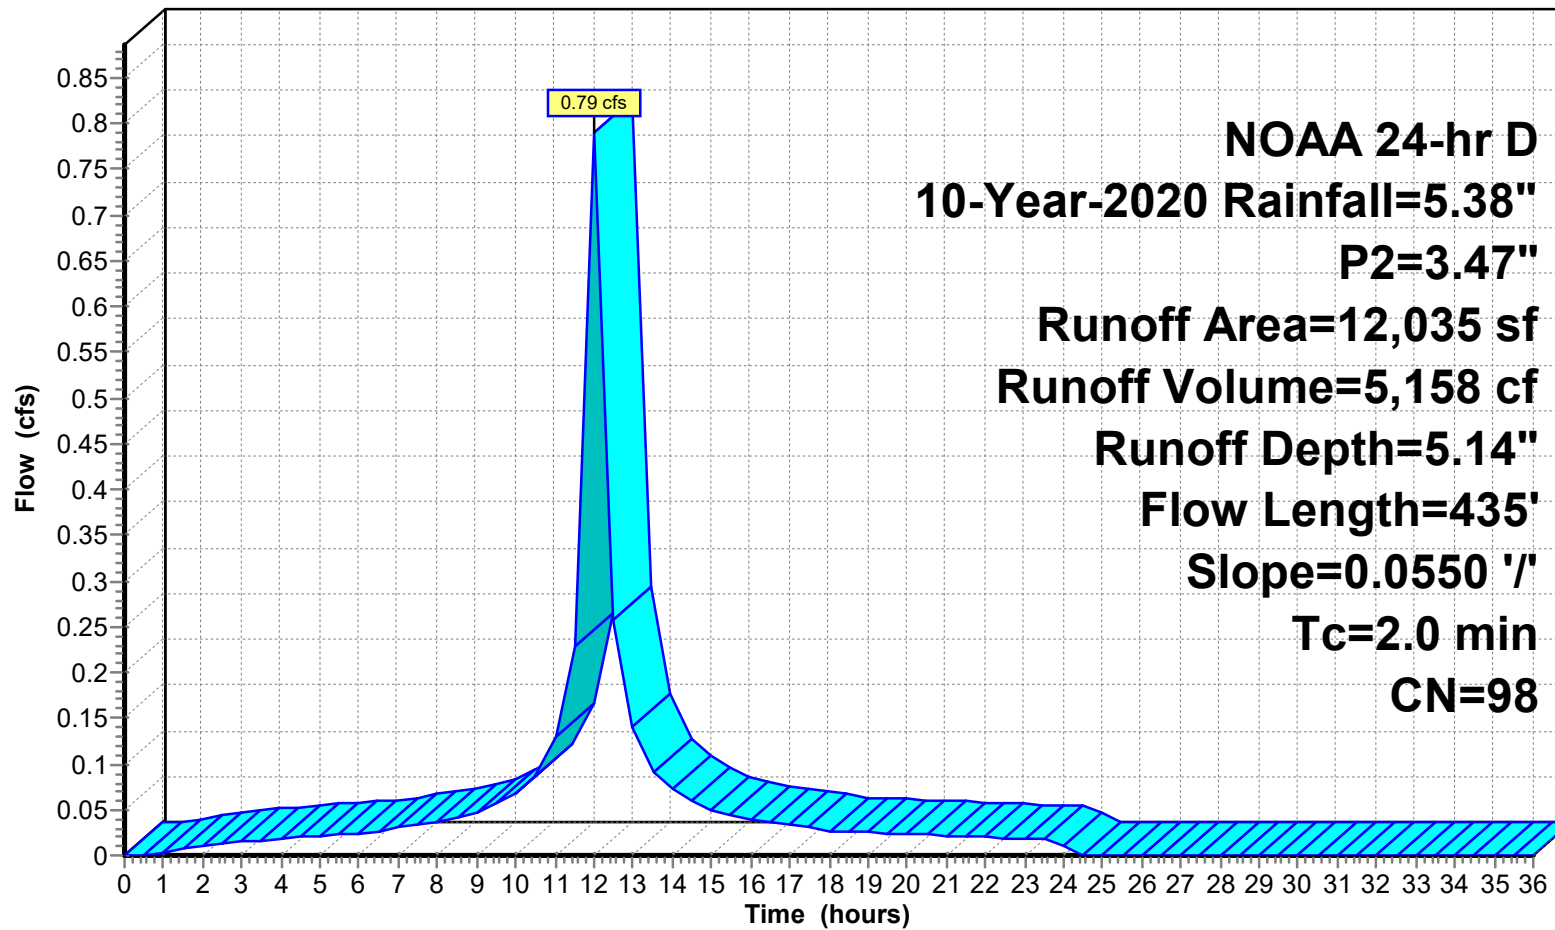

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 31

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.08 cfs @ 12.06 hrs, Volume= 467 cf, Depth= 2.67"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 32

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

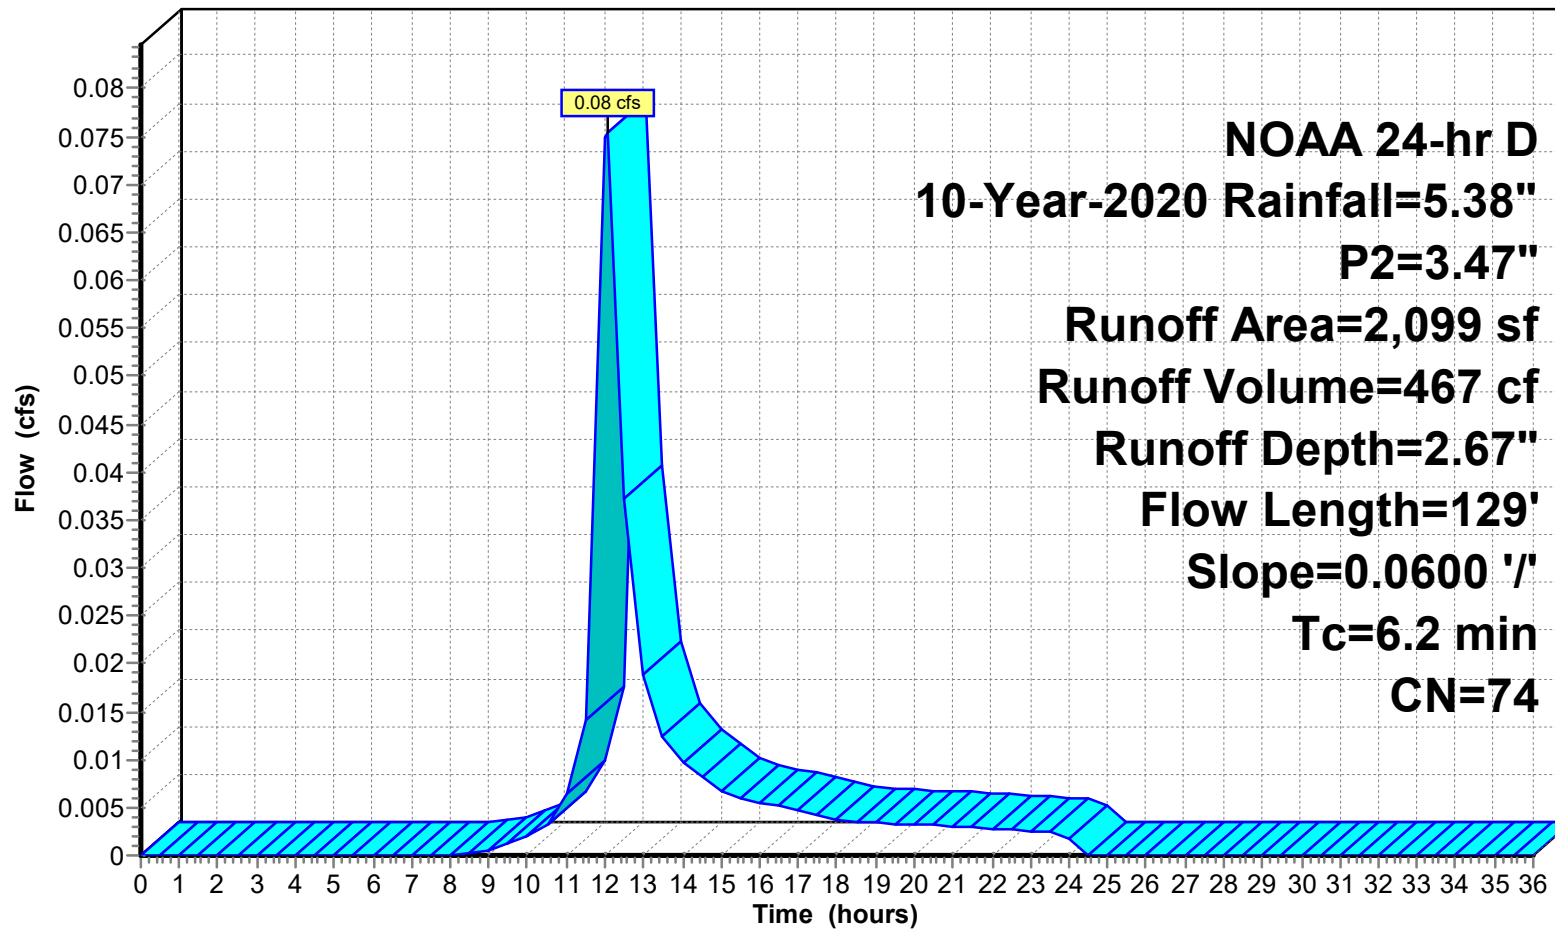

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 33

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.08 cfs @ 12.00 hrs, Volume= 515 cf, Depth= 5.14"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 34

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

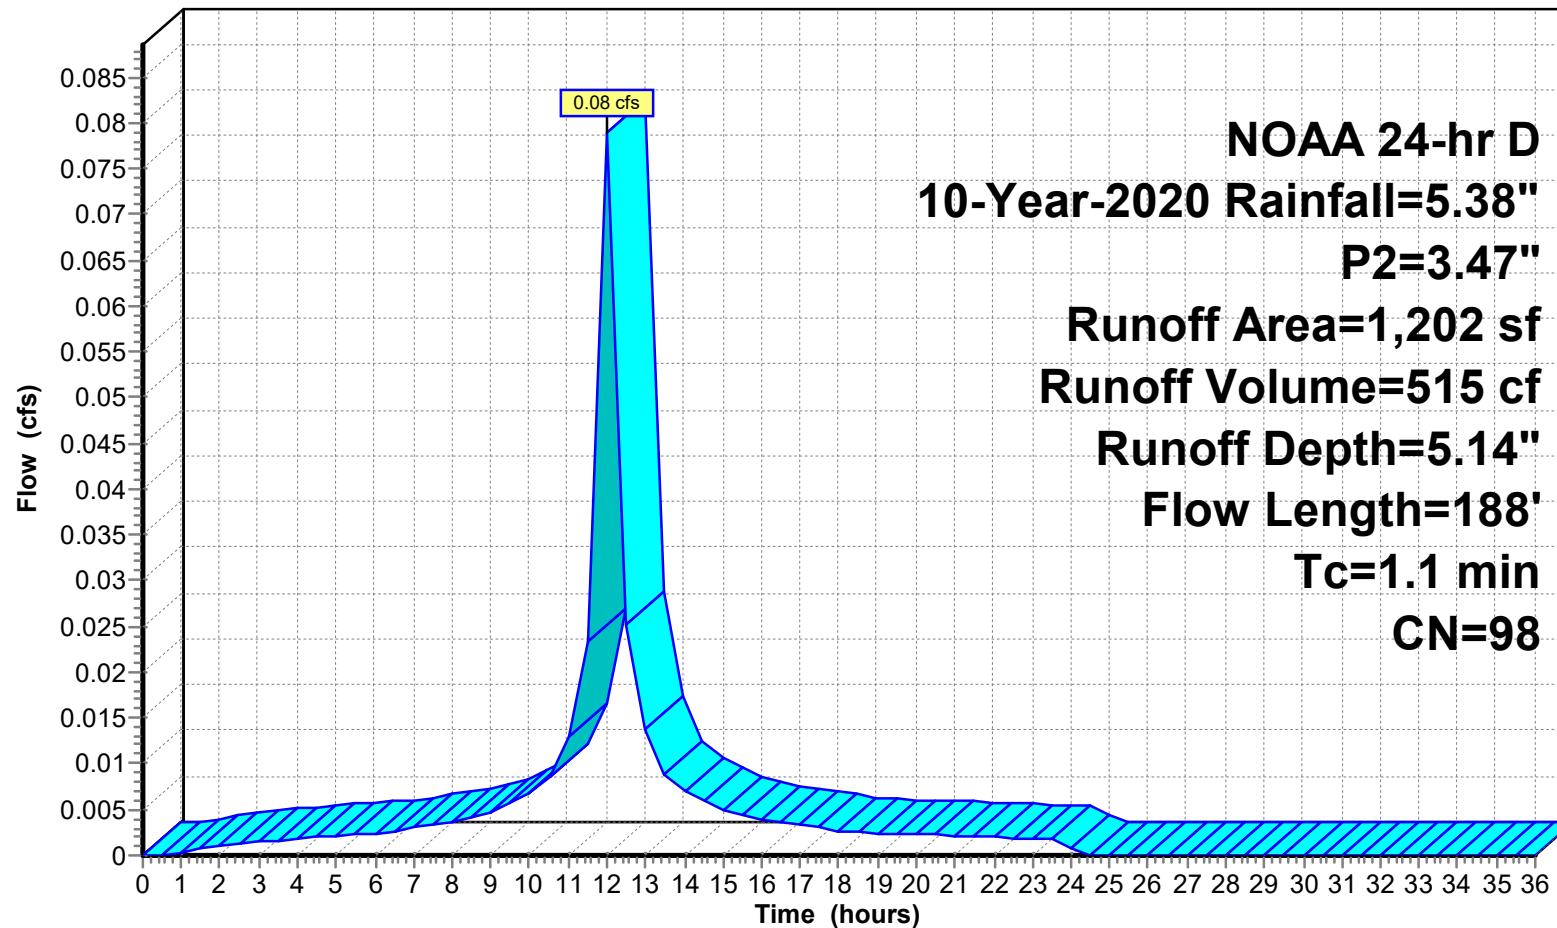

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 35

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.05 cfs @ 12.05 hrs, Volume= 296 cf, Depth= 2.67"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 36

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

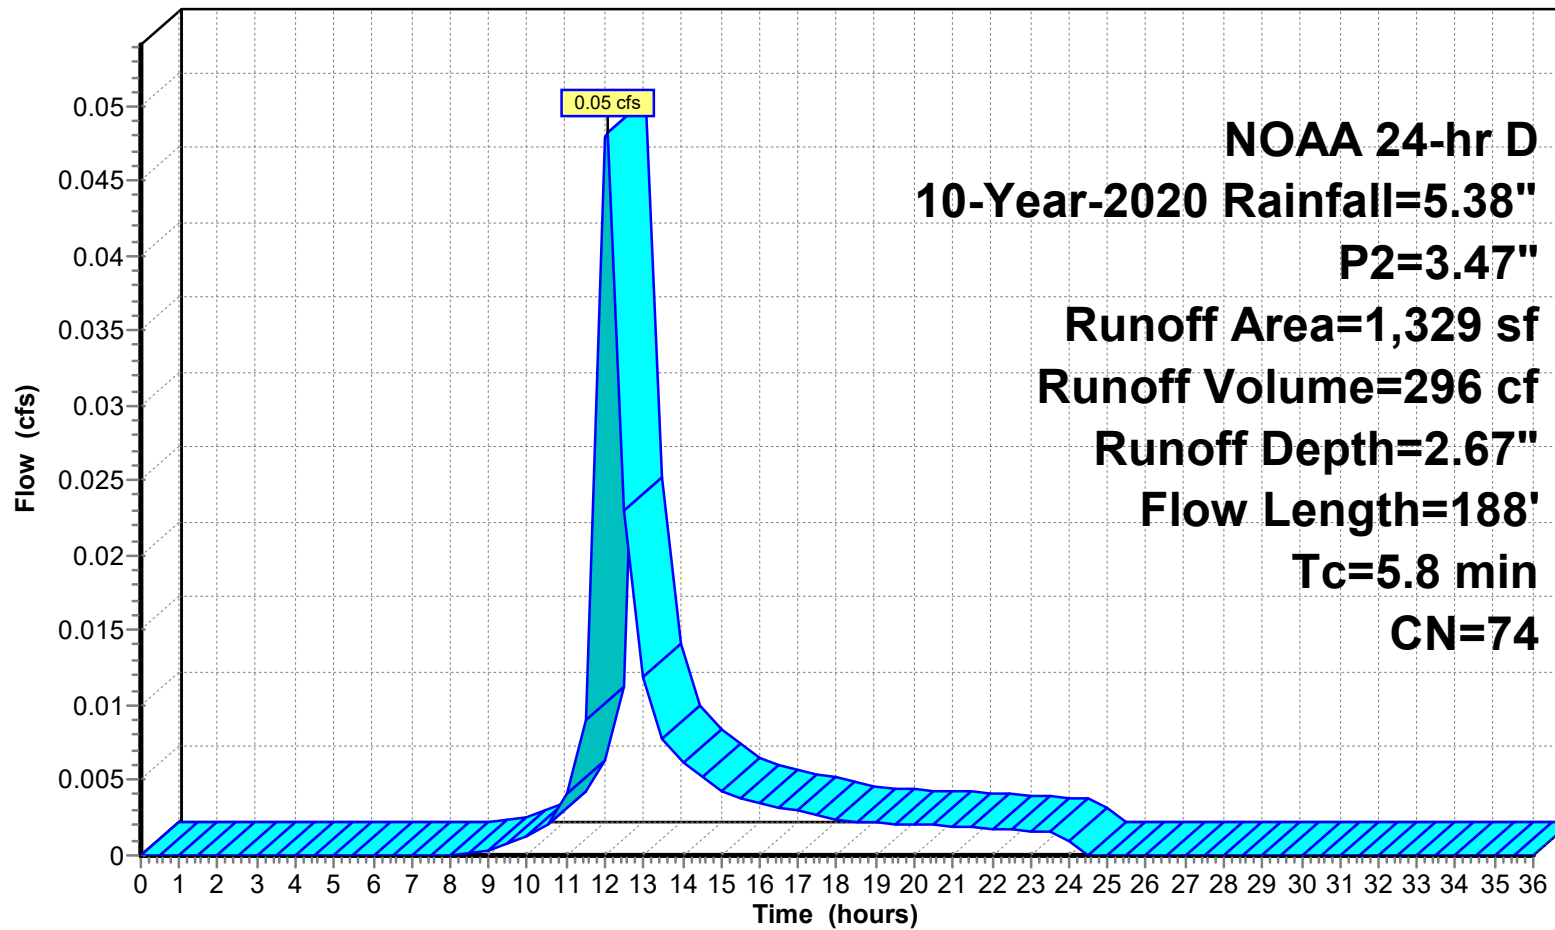

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 37


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 4.87" for 10-Year-2020 event
Inflow = 4.87 cfs @ 12.01 hrs, Volume= 31,632 cf
Primary = 4.87 cfs @ 12.01 hrs, Volume= 31,632 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

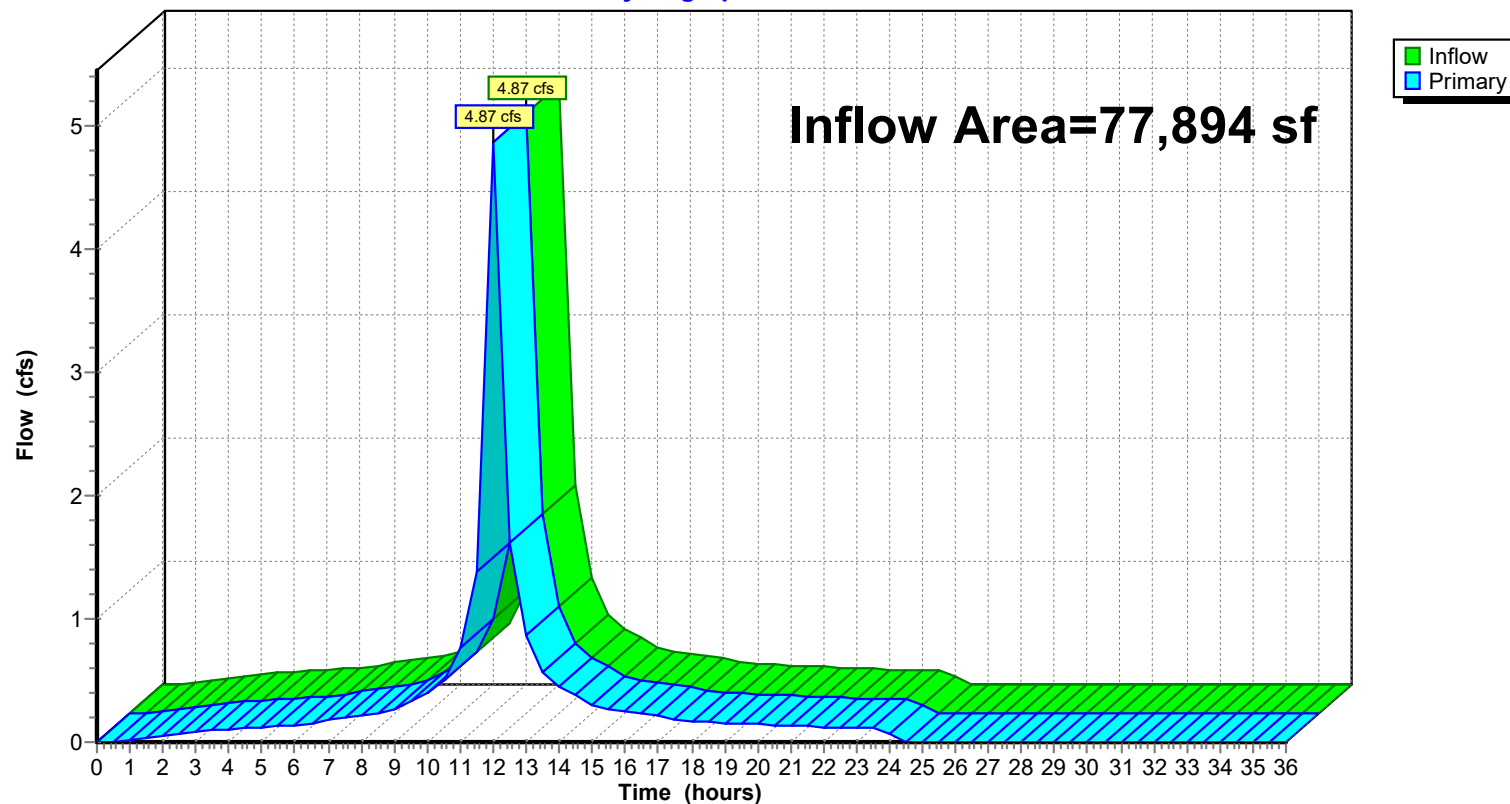

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 38


Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 4.15" for 10-Year-2020 event
Inflow = 6.82 cfs @ 12.03 hrs, Volume= 46,128 cf
Primary = 6.82 cfs @ 12.03 hrs, Volume= 46,128 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

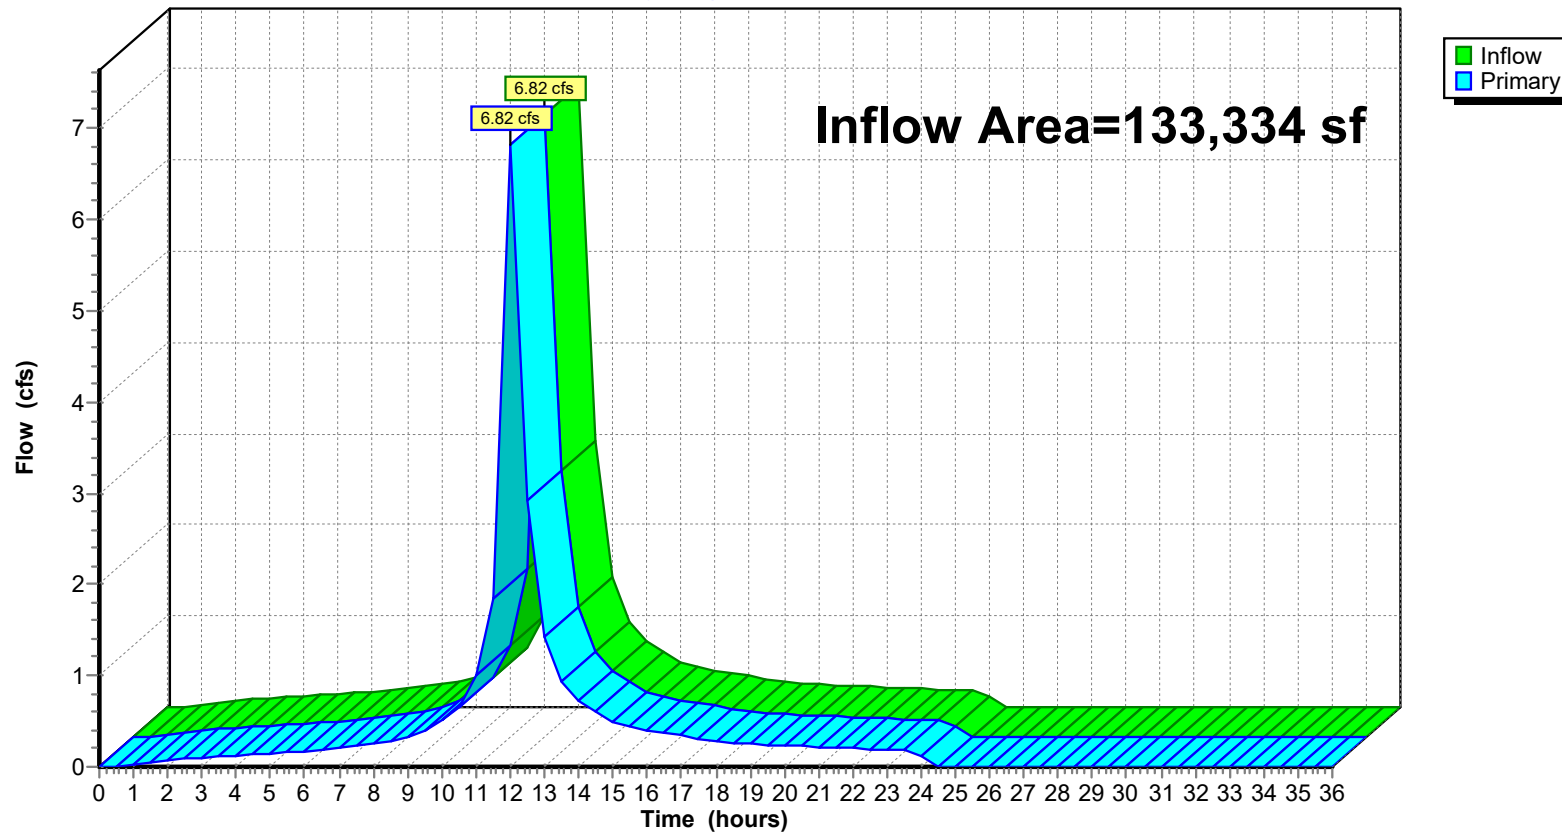

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 39


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 4.08" for 10-Year-2020 event
Inflow = 5.82 cfs @ 12.03 hrs, Volume= 39,692 cf
Primary = 5.82 cfs @ 12.03 hrs, Volume= 39,692 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

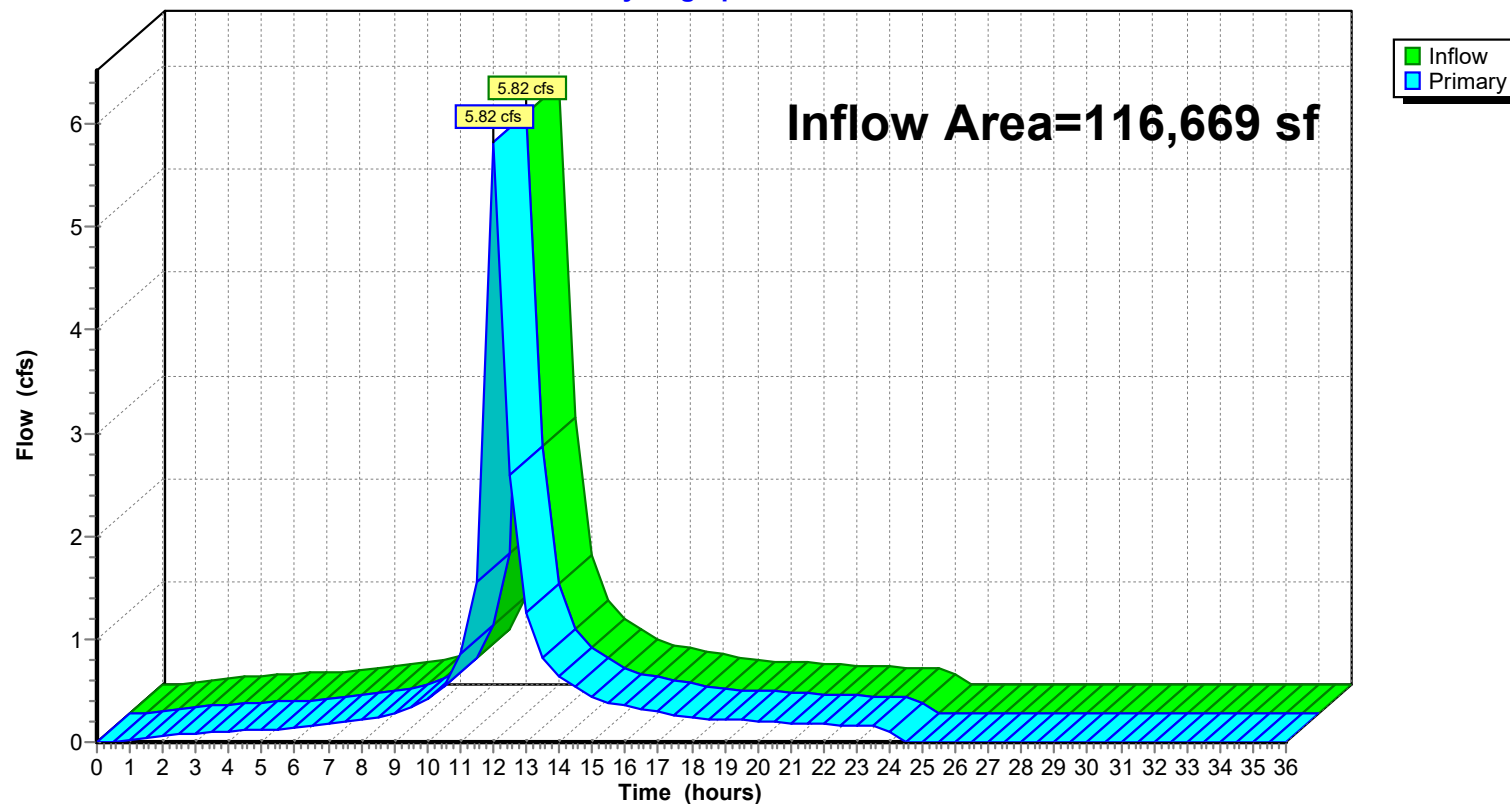

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 40


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 4.63" for 10-Year-2020 event
Inflow = 0.99 cfs @ 12.01 hrs, Volume= 6,436 cf
Primary = 0.99 cfs @ 12.01 hrs, Volume= 6,436 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 2: EXIST DP 2

Hydrograph

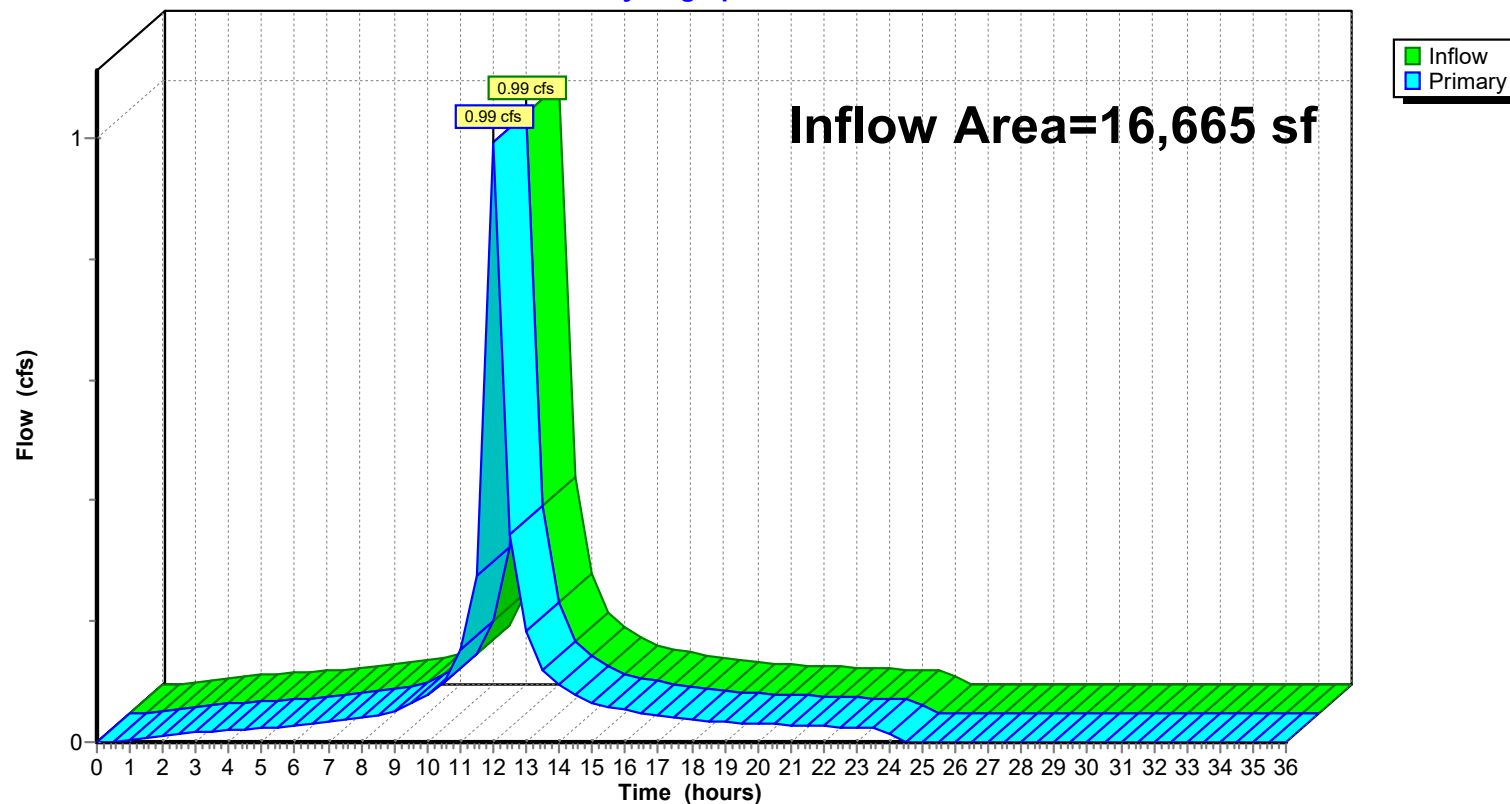

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 41

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 7.87 cfs @ 12.01 hrs, Volume= 52,122 cf, Depth= 8.94"
Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.30		Sheet Flow, Parking lot Smooth surfaces n= 0.011 P2= 3.47"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 42

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

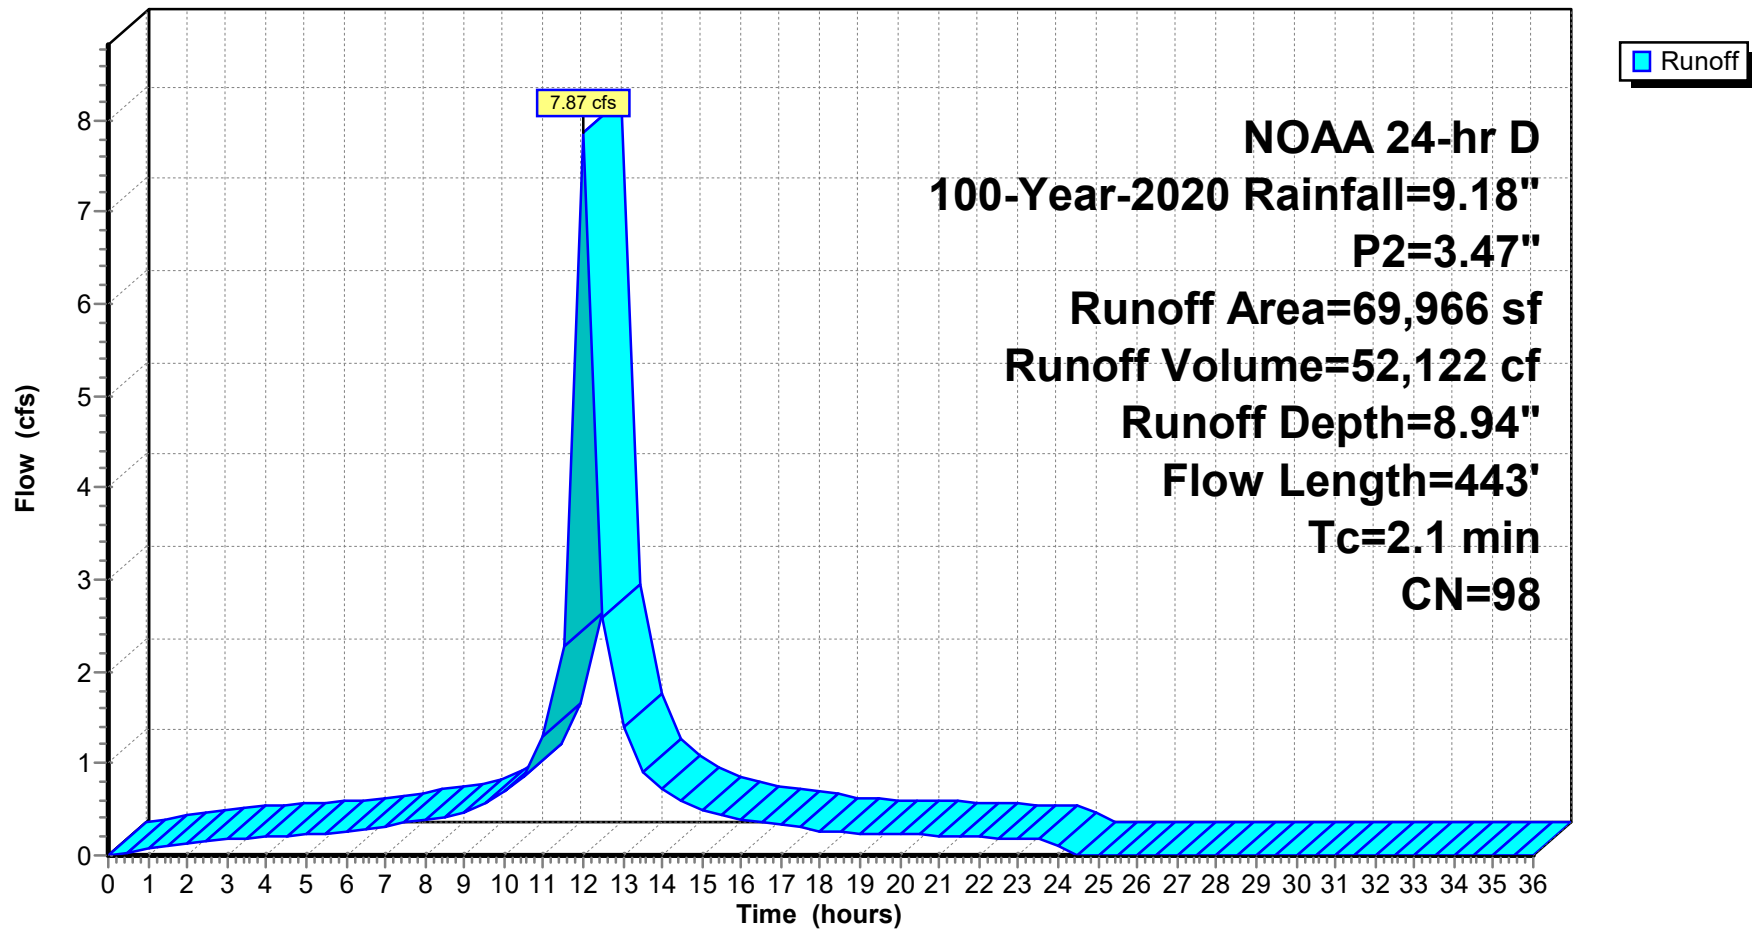

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 43

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.65 cfs @ 12.03 hrs, Volume= 3,795 cf, Depth= 5.74"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.9	25	0.5000	0.22		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 3.47"
0.5	75	0.0800	2.35		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 3.47"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.8	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 44

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

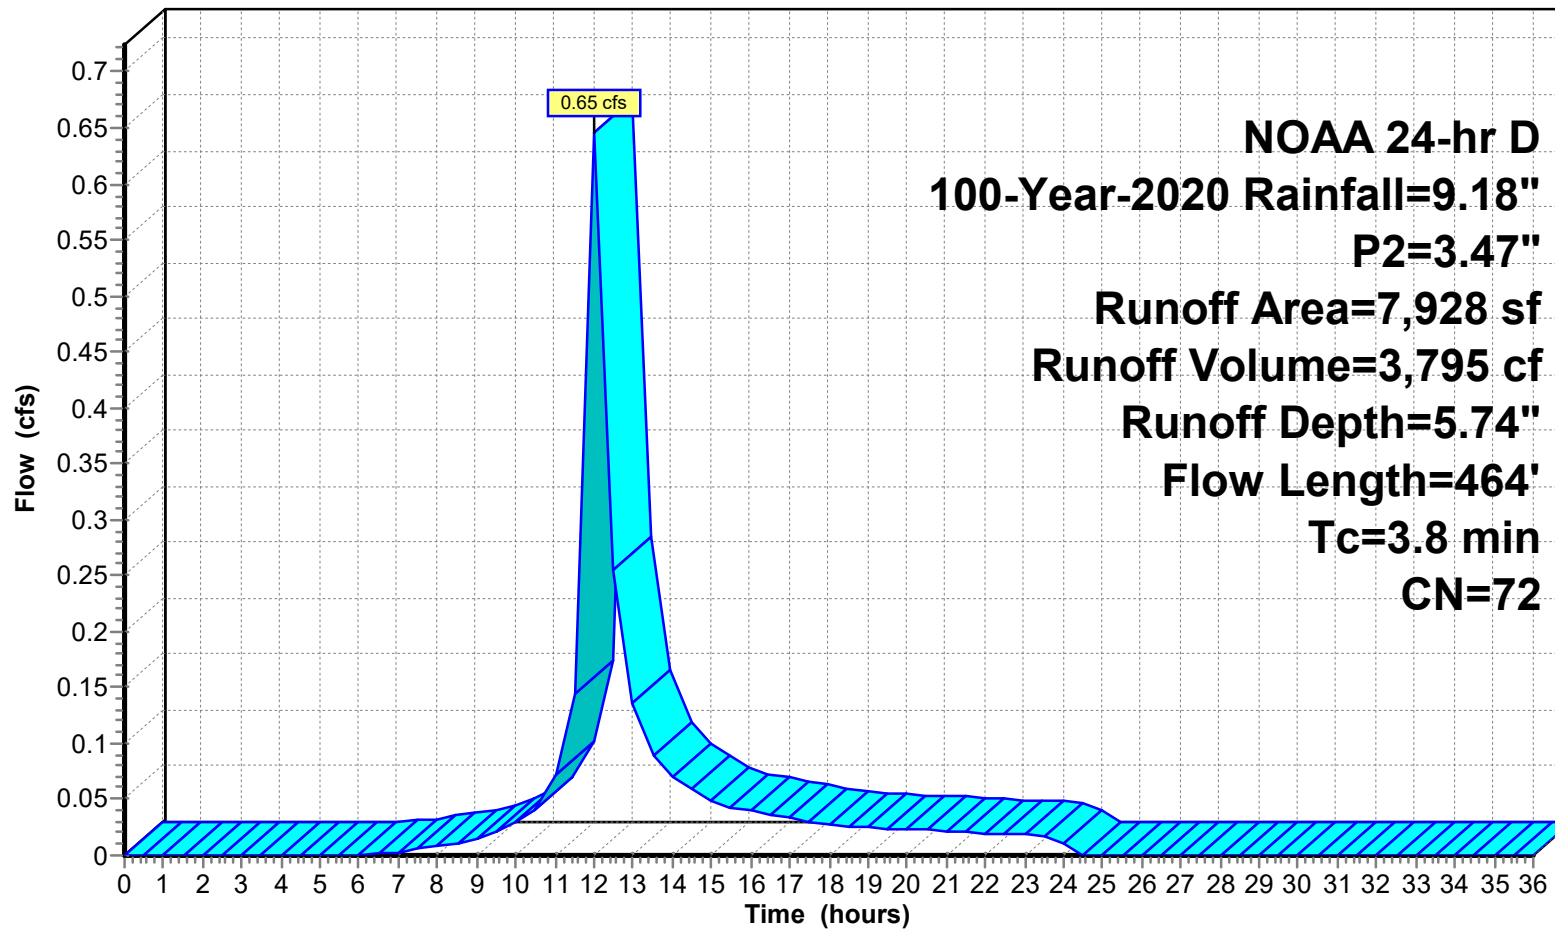

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 45

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 2.44 cfs @ 12.20 hrs, Volume= 18,560 cf, Depth= 5.74"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

	Area (sf)	CN	Description
*	708	98	Roof-offsite
*	1,220	98	Impervious
	2,721	71	Meadow, non-grazed, HSG C
*	32,886	70	wooded
	1,240	74	>75% Grass cover, Good, HSG C
	38,775	72	Weighted Average
	36,847		95.03% Pervious Area
	1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
13.6	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 46

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

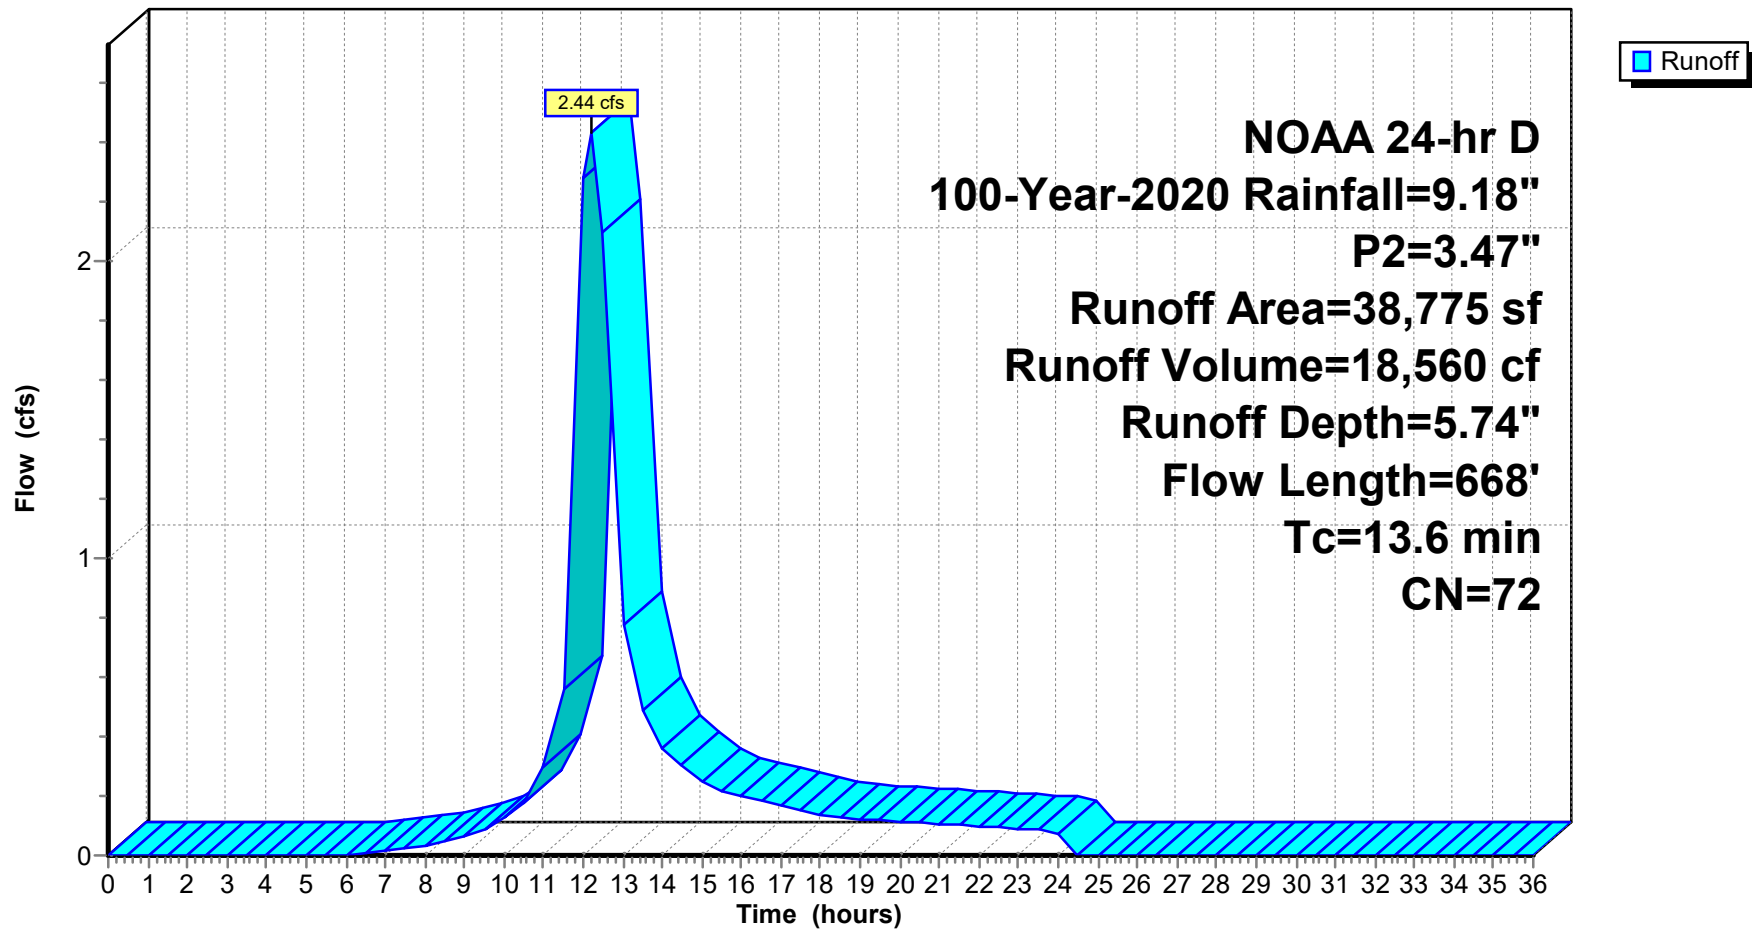

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 47

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 1.35 cfs @ 12.01 hrs, Volume= 8,966 cf, Depth= 8.94"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0550	2.15		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 48

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

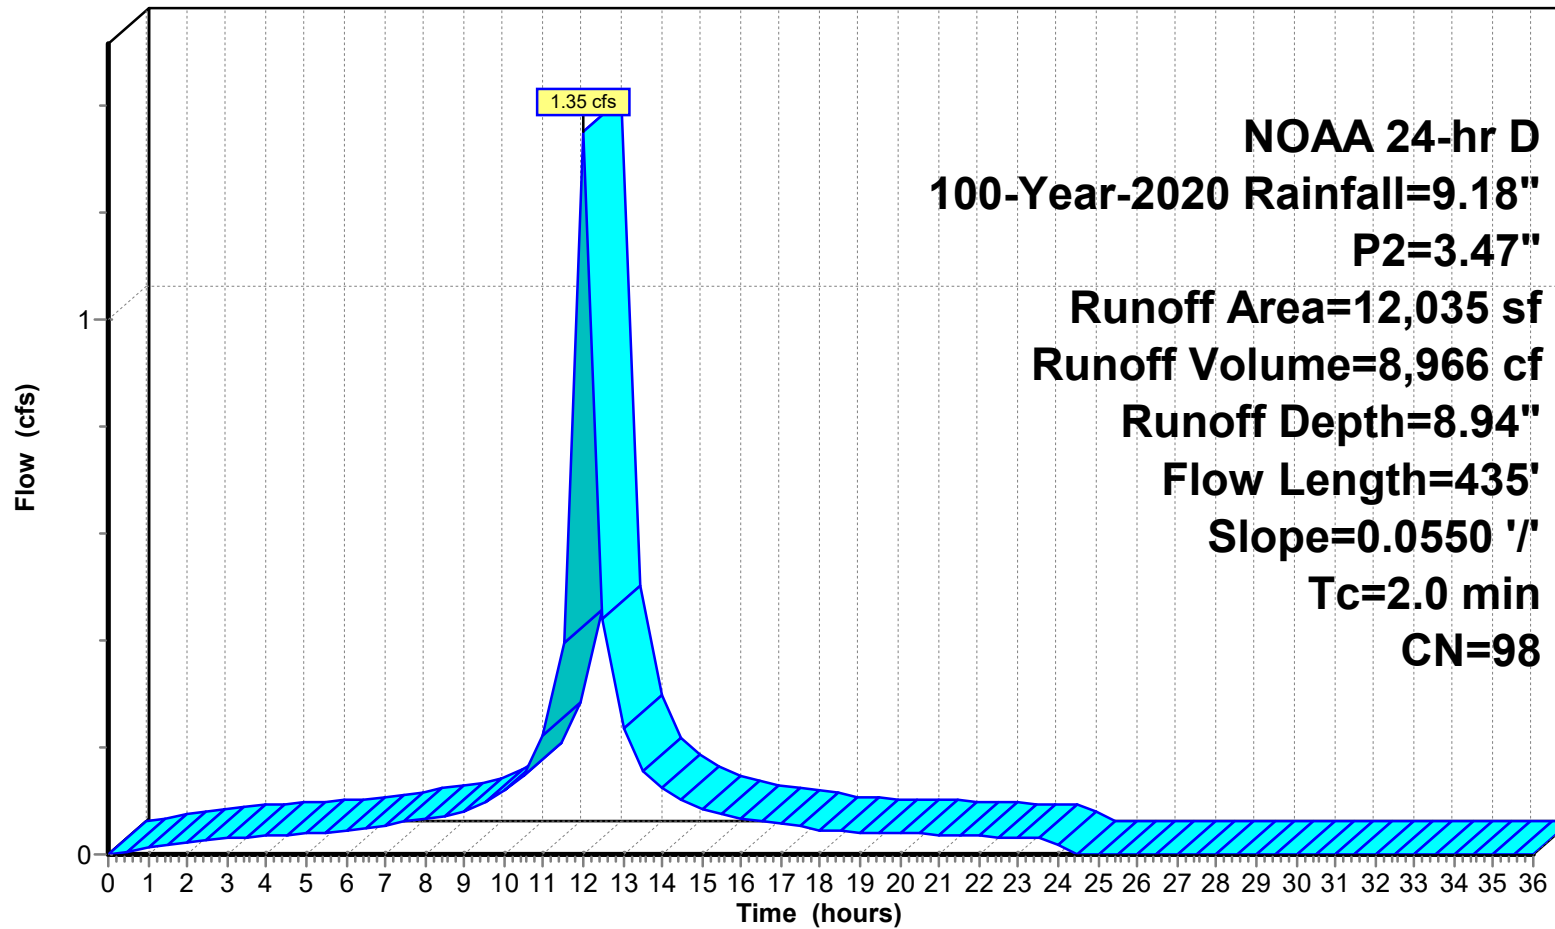

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 49

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.17 cfs @ 12.04 hrs, Volume= 1,048 cf, Depth= 5.99"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 50

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

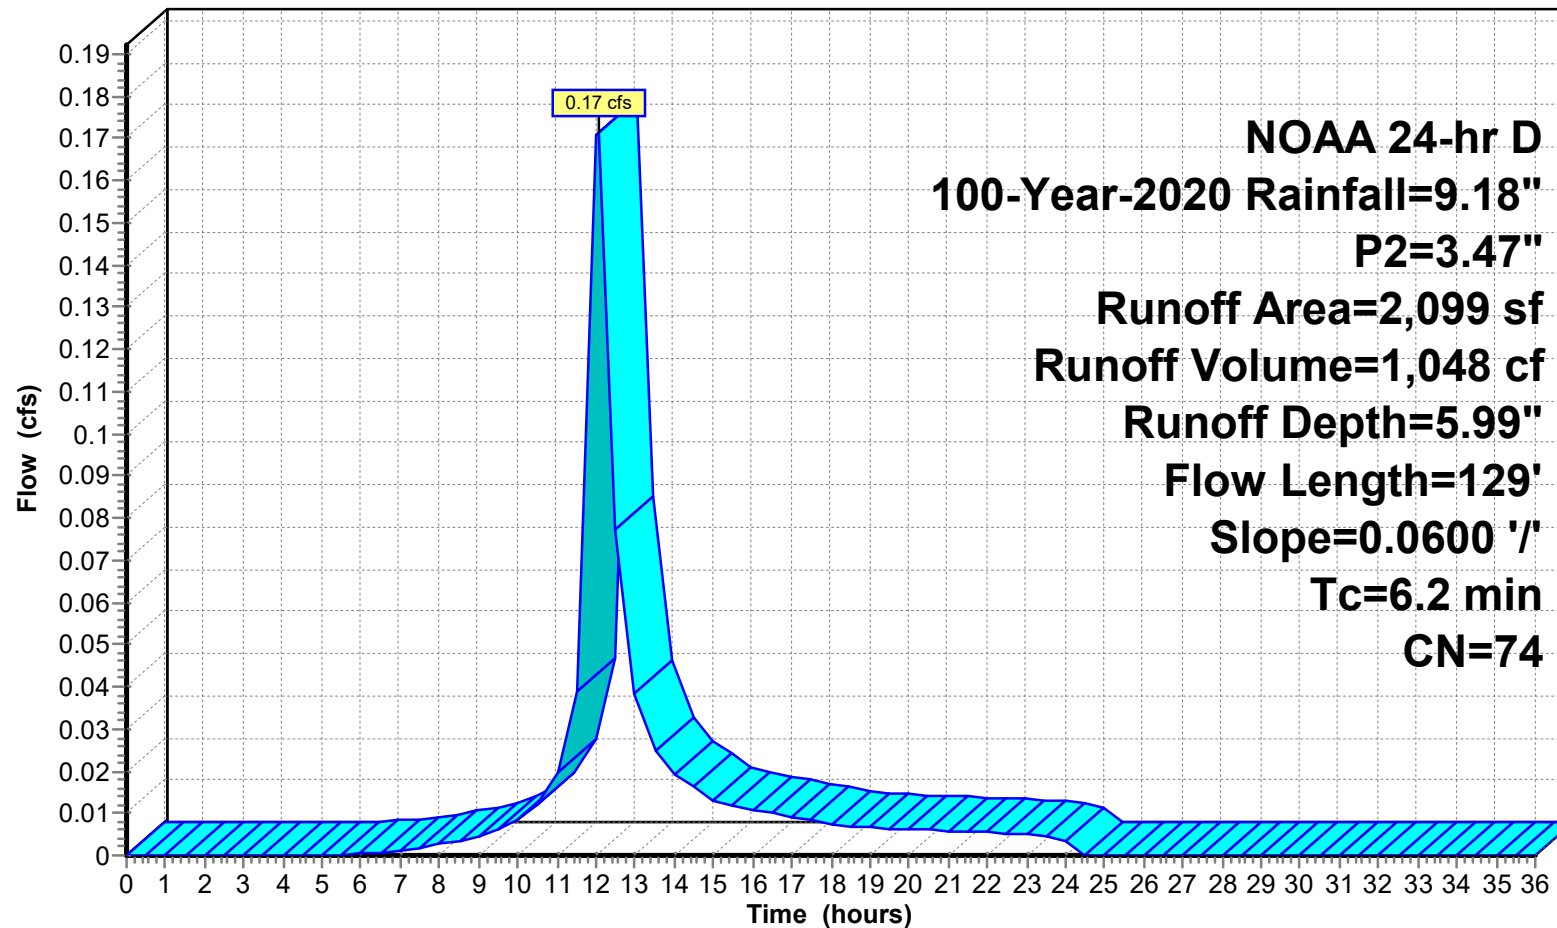

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 51

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.14 cfs @ 12.00 hrs, Volume= 895 cf, Depth= 8.94"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 52

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

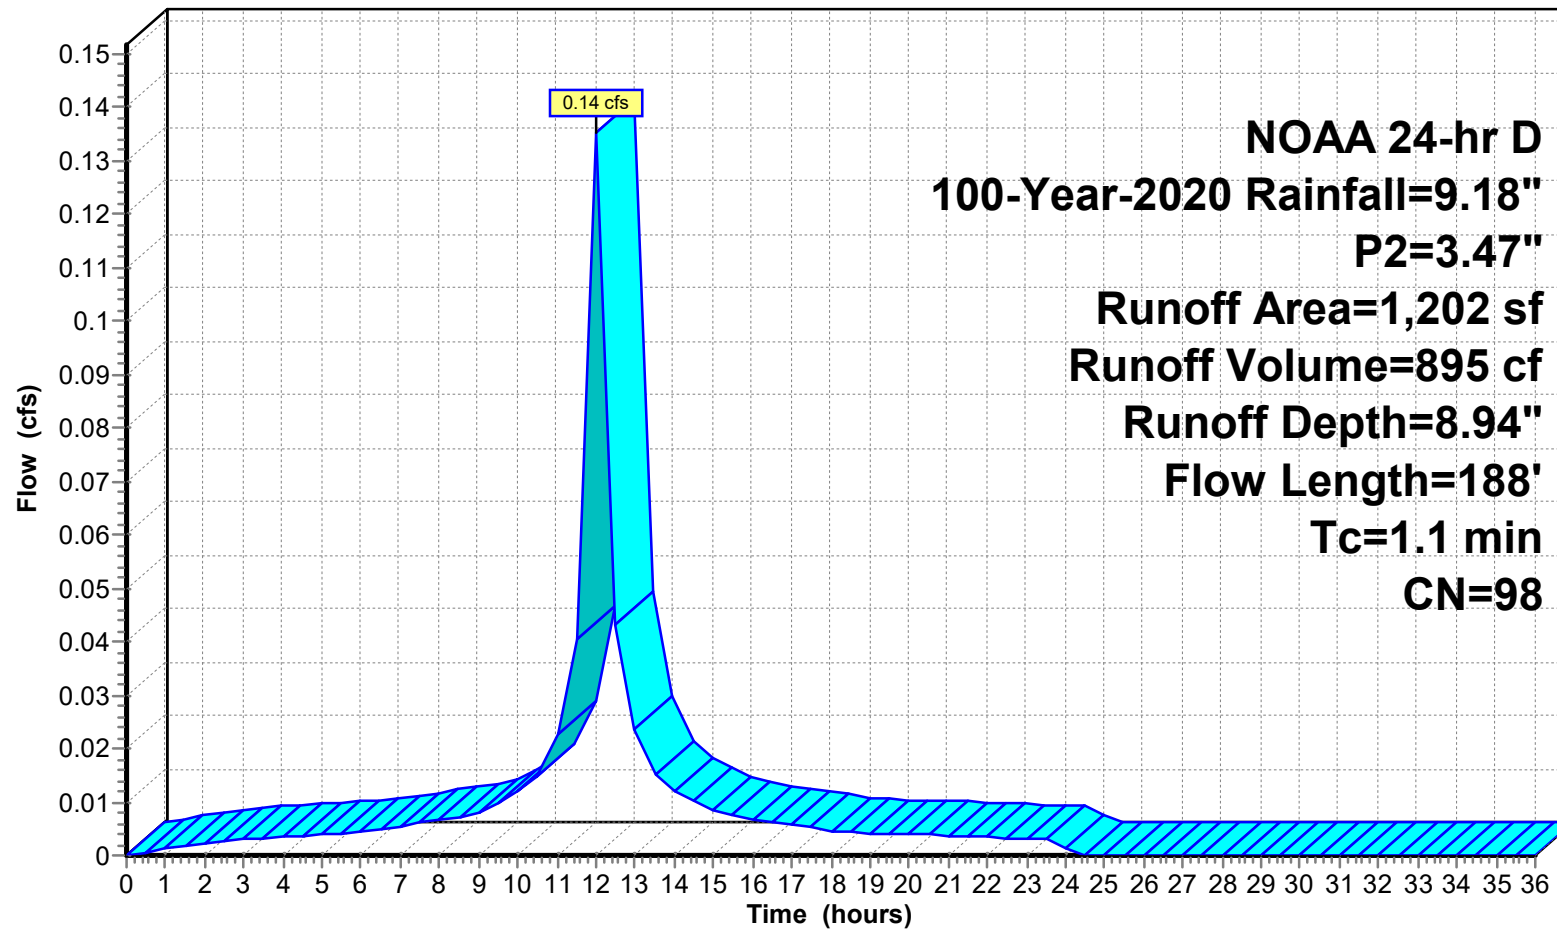

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 53

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.11 cfs @ 12.04 hrs, Volume= 664 cf, Depth= 5.99"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 54

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

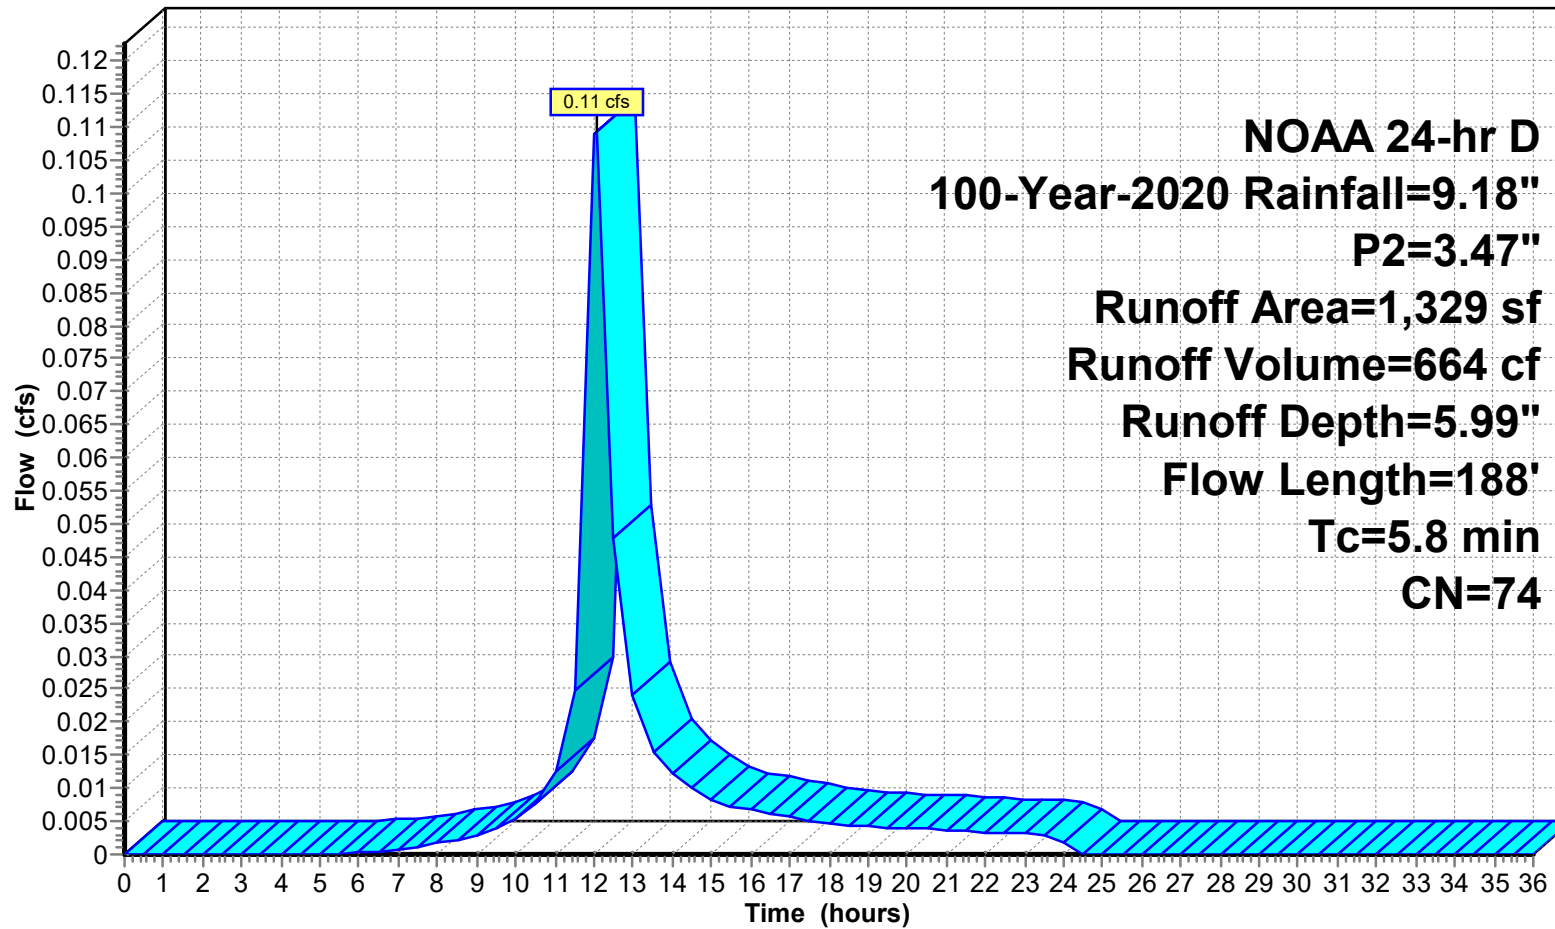

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 55


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 8.61" for 100-Year-2020 event
Inflow = 8.52 cfs @ 12.01 hrs, Volume= 55,917 cf
Primary = 8.52 cfs @ 12.01 hrs, Volume= 55,917 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

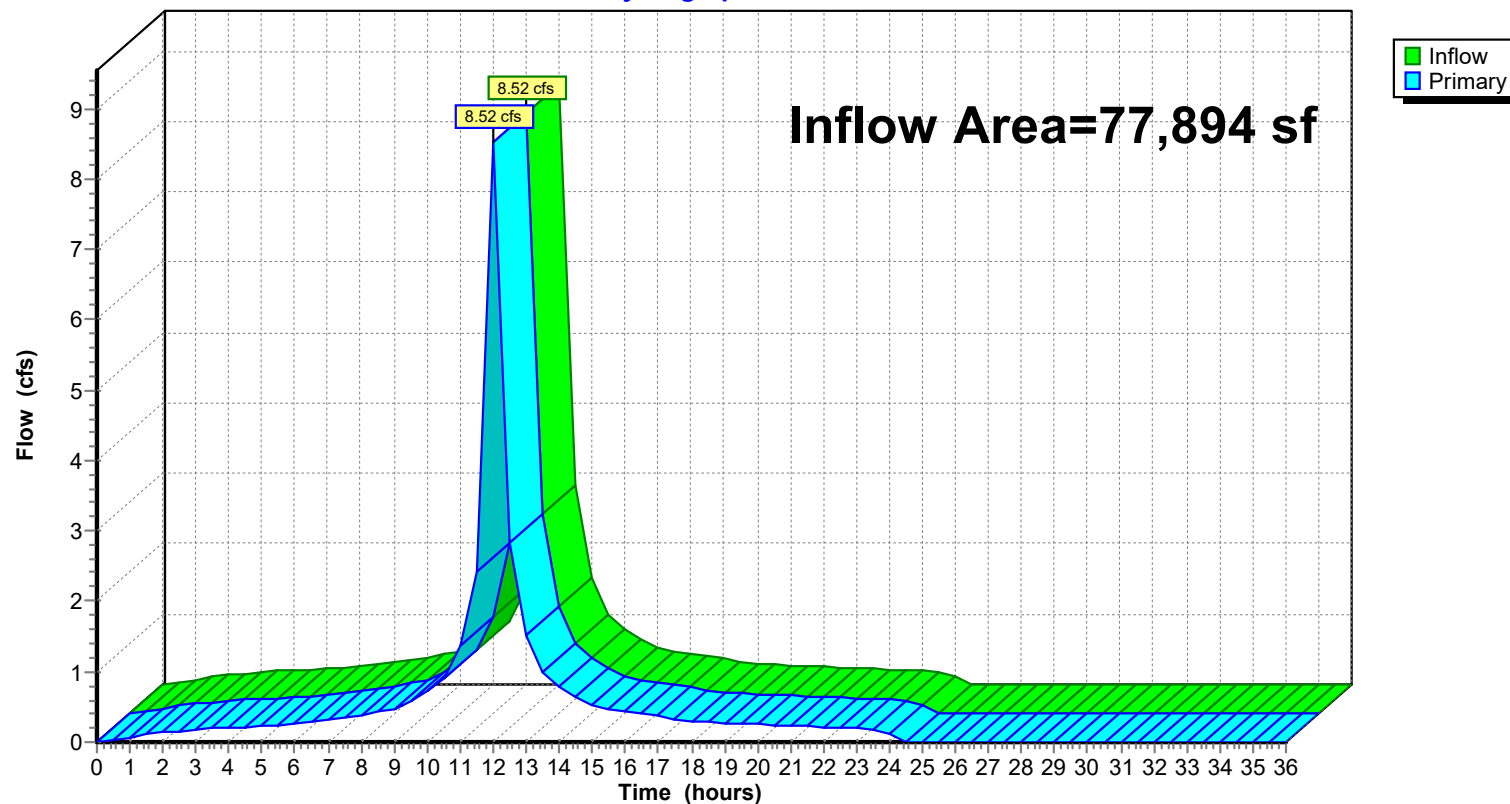

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 56


Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 7.74" for 100-Year-2020 event
Inflow = 12.60 cfs @ 12.03 hrs, Volume= 86,050 cf
Primary = 12.60 cfs @ 12.03 hrs, Volume= 86,050 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

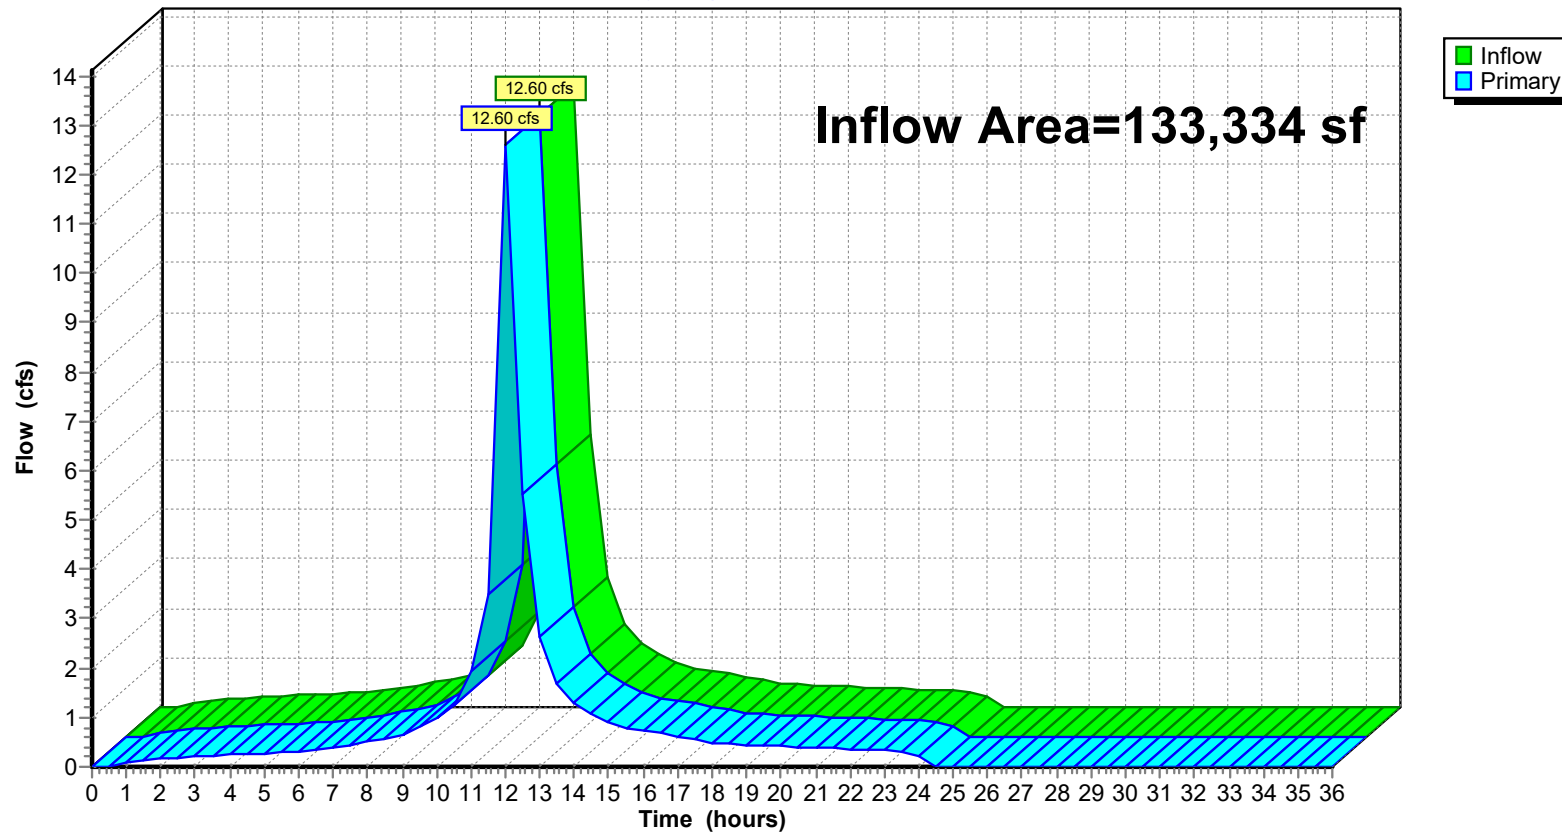

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 57


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 7.66" for 100-Year-2020 event
Inflow = 10.83 cfs @ 12.04 hrs, Volume= 74,476 cf
Primary = 10.83 cfs @ 12.04 hrs, Volume= 74,476 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

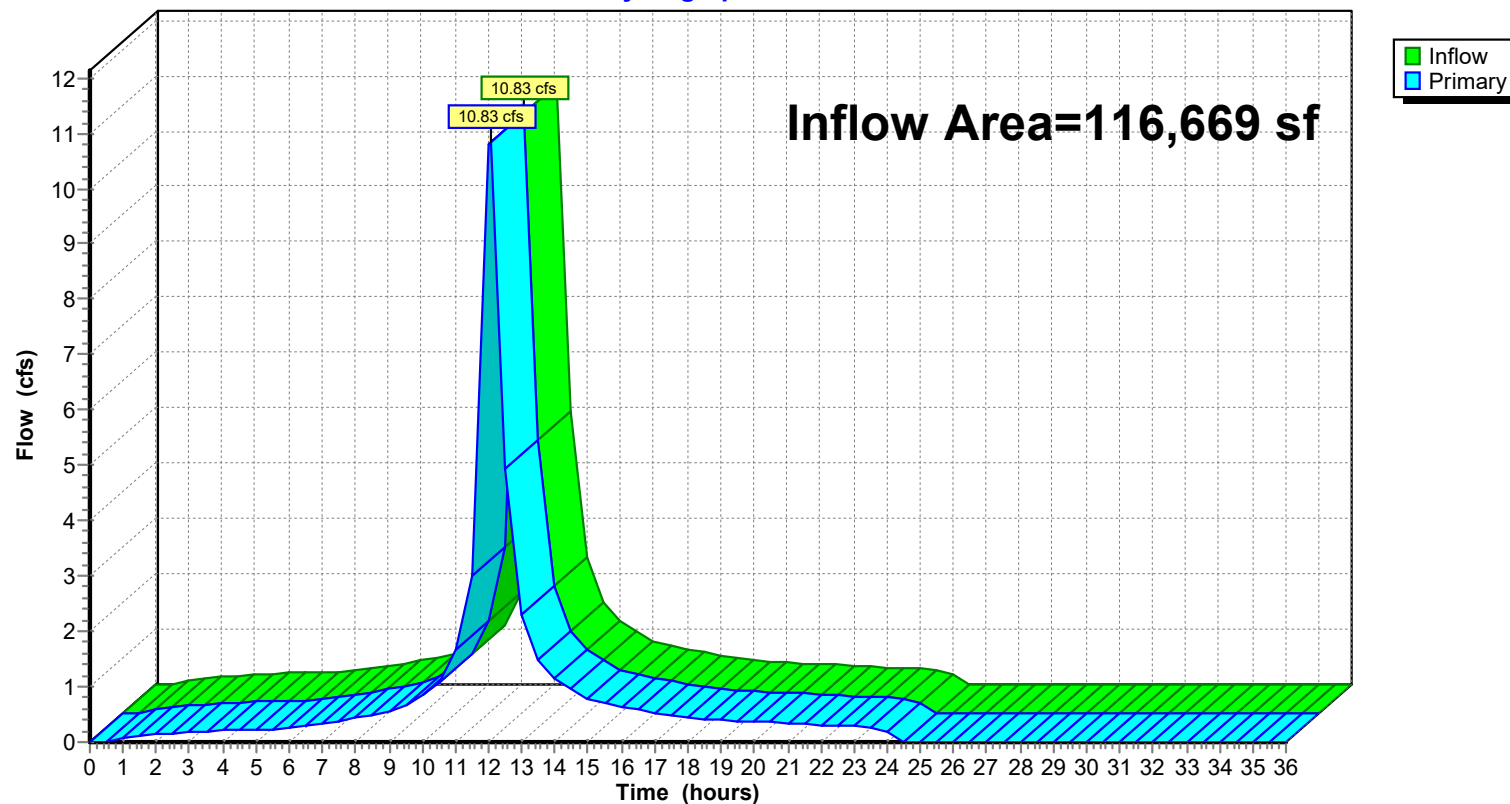

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 58


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 8.33" for 100-Year-2020 event
Inflow = 1.77 cfs @ 12.01 hrs, Volume= 11,573 cf
Primary = 1.77 cfs @ 12.01 hrs, Volume= 11,573 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 2: EXIST DP 2

Hydrograph

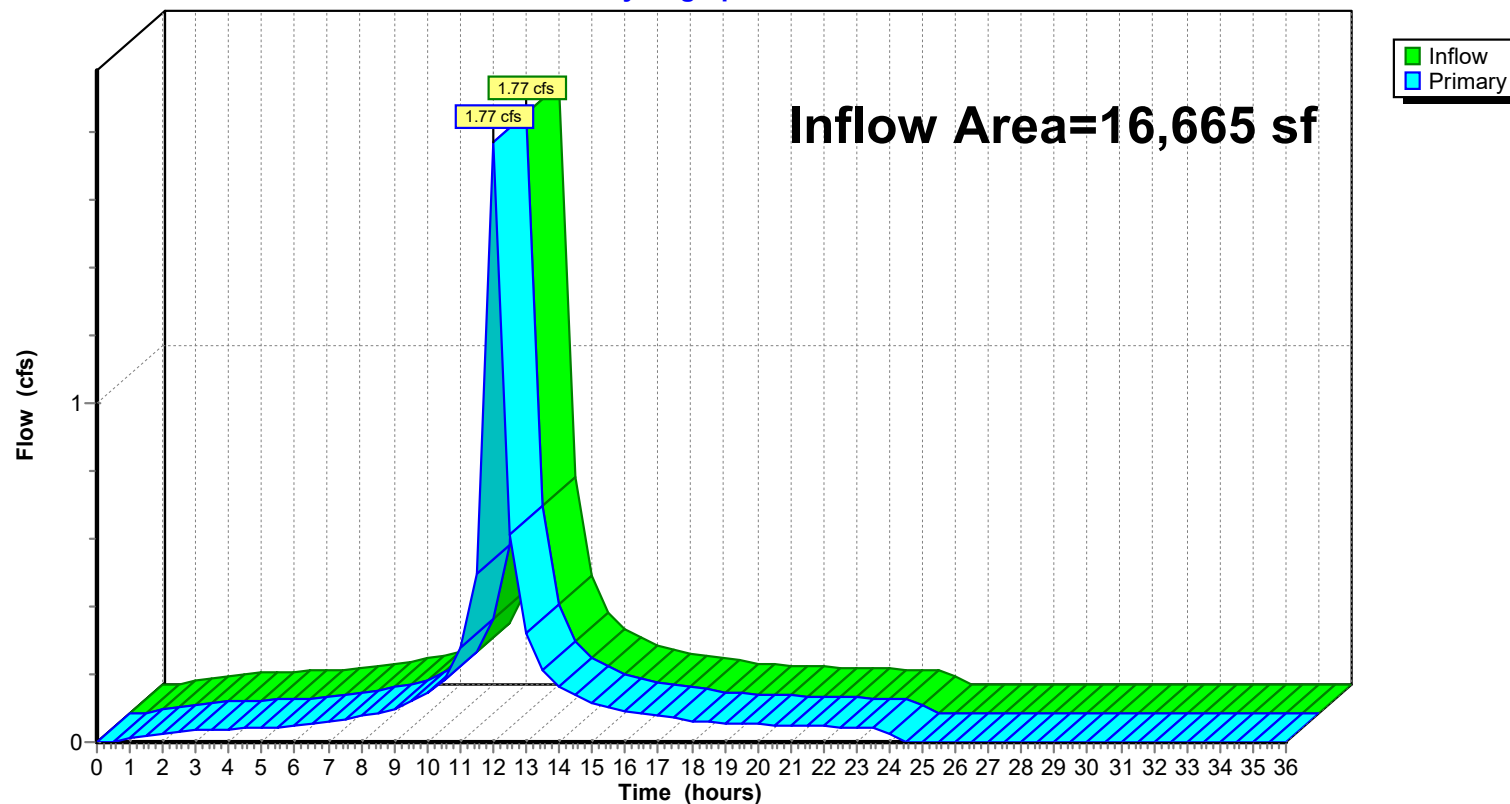

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 59

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 3.48 cfs @ 12.01 hrs, Volume= 22,476 cf, Depth= 3.85"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.49		Sheet Flow, Parking lot
					Smooth surfaces n= 0.011 P2= 4.09"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 60

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

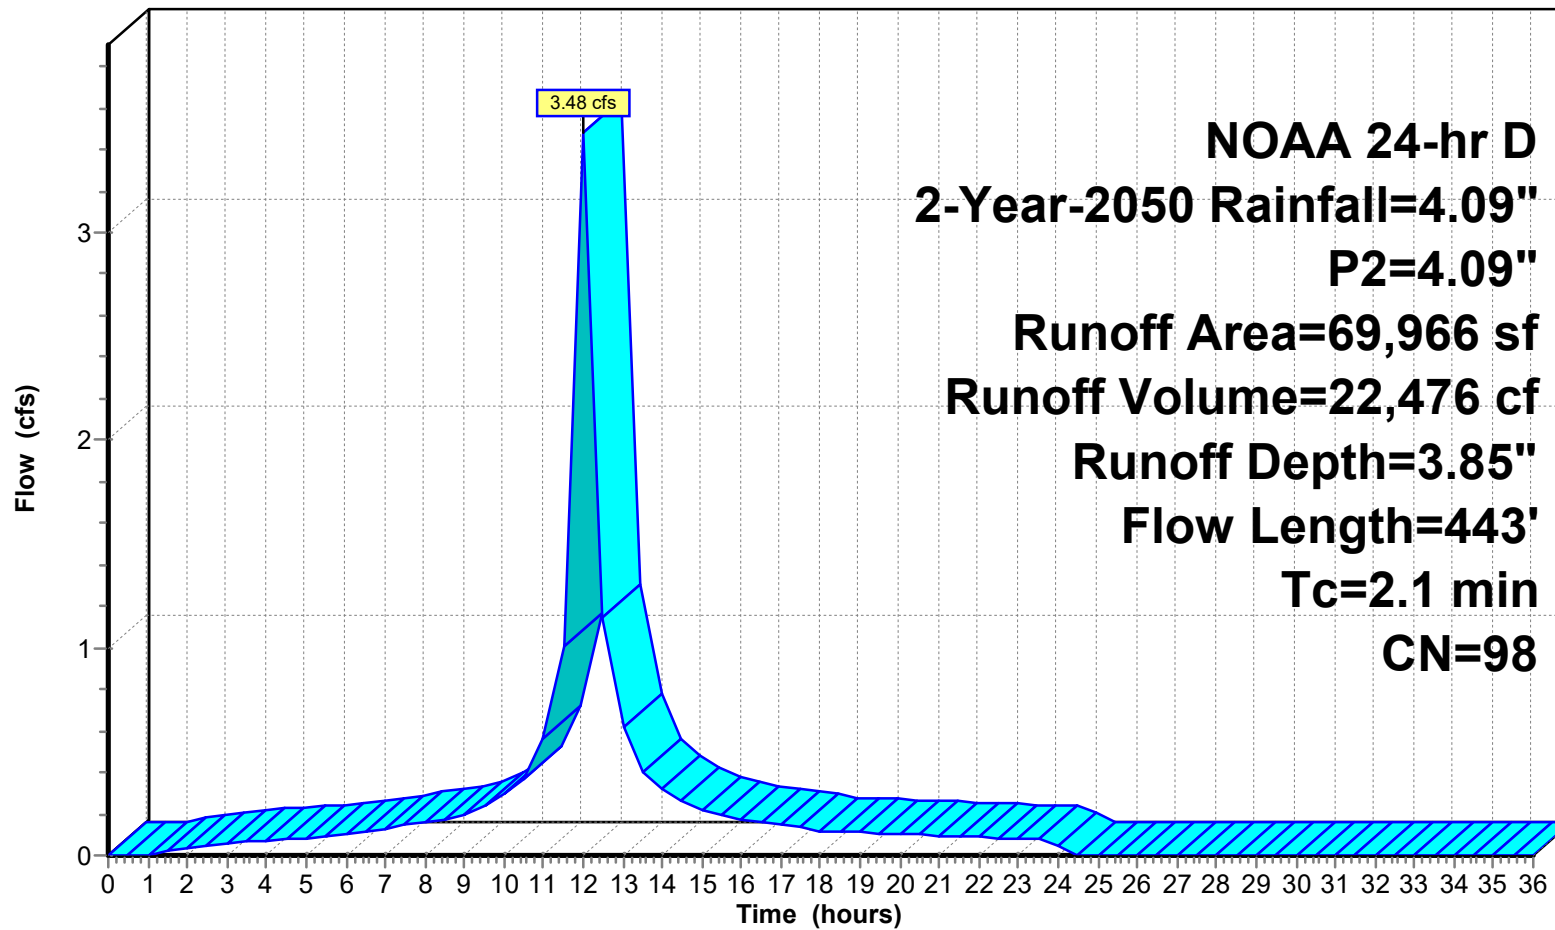

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 61

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.16 cfs @ 12.06 hrs, Volume= 1,007 cf, Depth= 1.52"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	25	0.5000	0.24		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 4.09"
0.5	75	0.0800	2.56		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 4.09"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.6	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 62

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

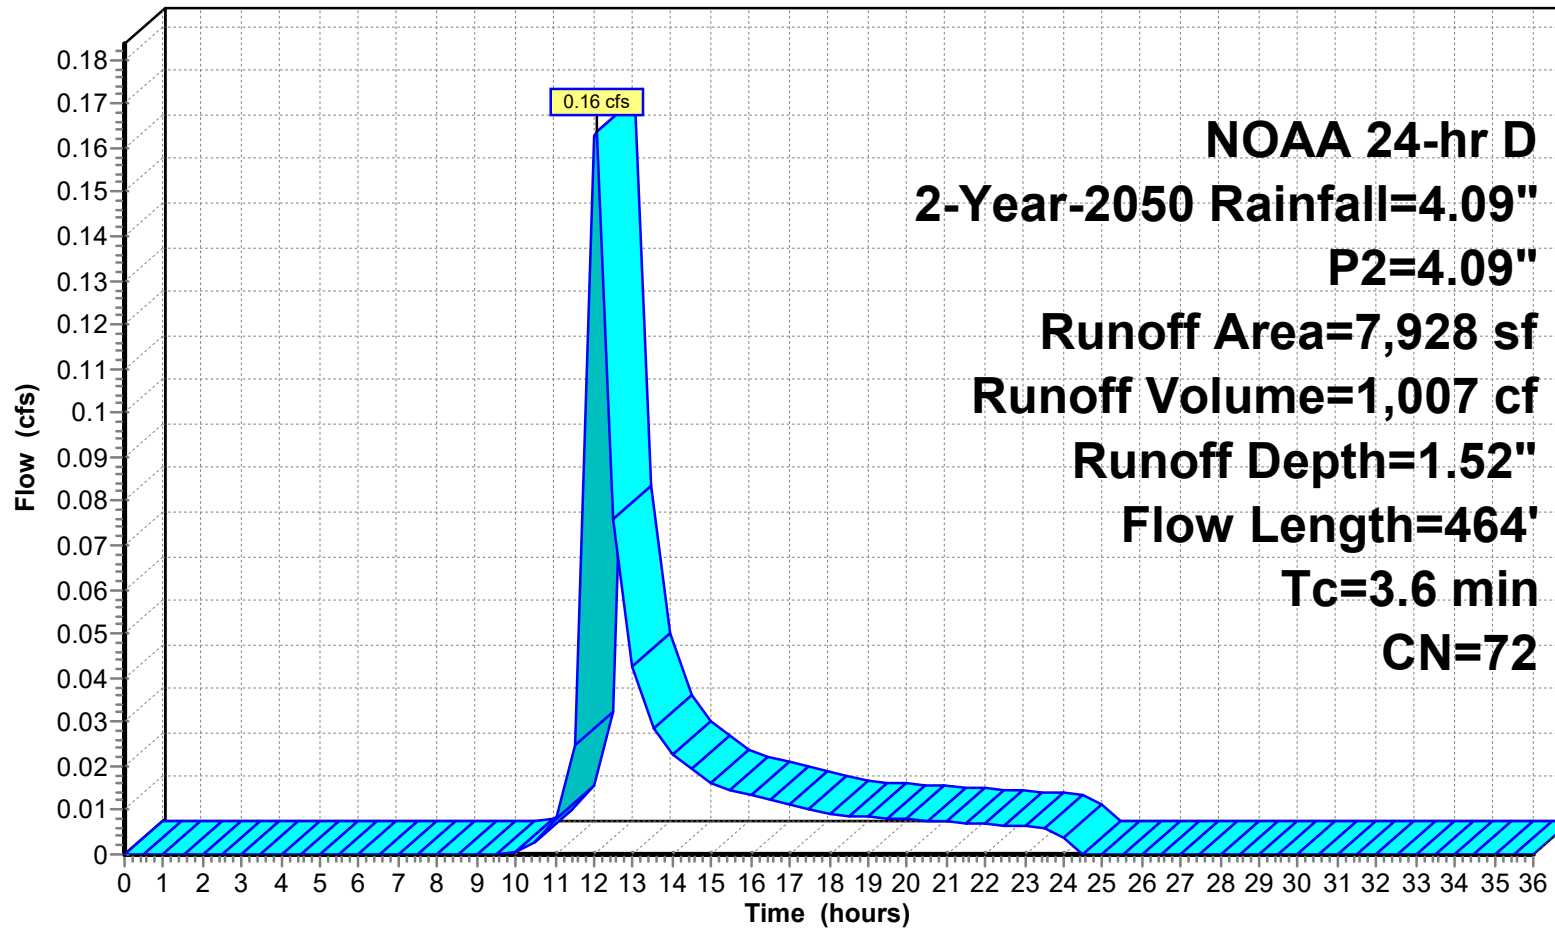

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 63

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 0.61 cfs @ 12.27 hrs, Volume= 4,923 cf, Depth= 1.52"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
* 708	98	Roof-offsite
* 1,220	98	Impervious
2,721	71	Meadow, non-grazed, HSG C
* 32,886	70	wooded
1,240	74	>75% Grass cover, Good, HSG C
38,775	72	Weighted Average
36,847		95.03% Pervious Area
1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
12.7	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 64

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

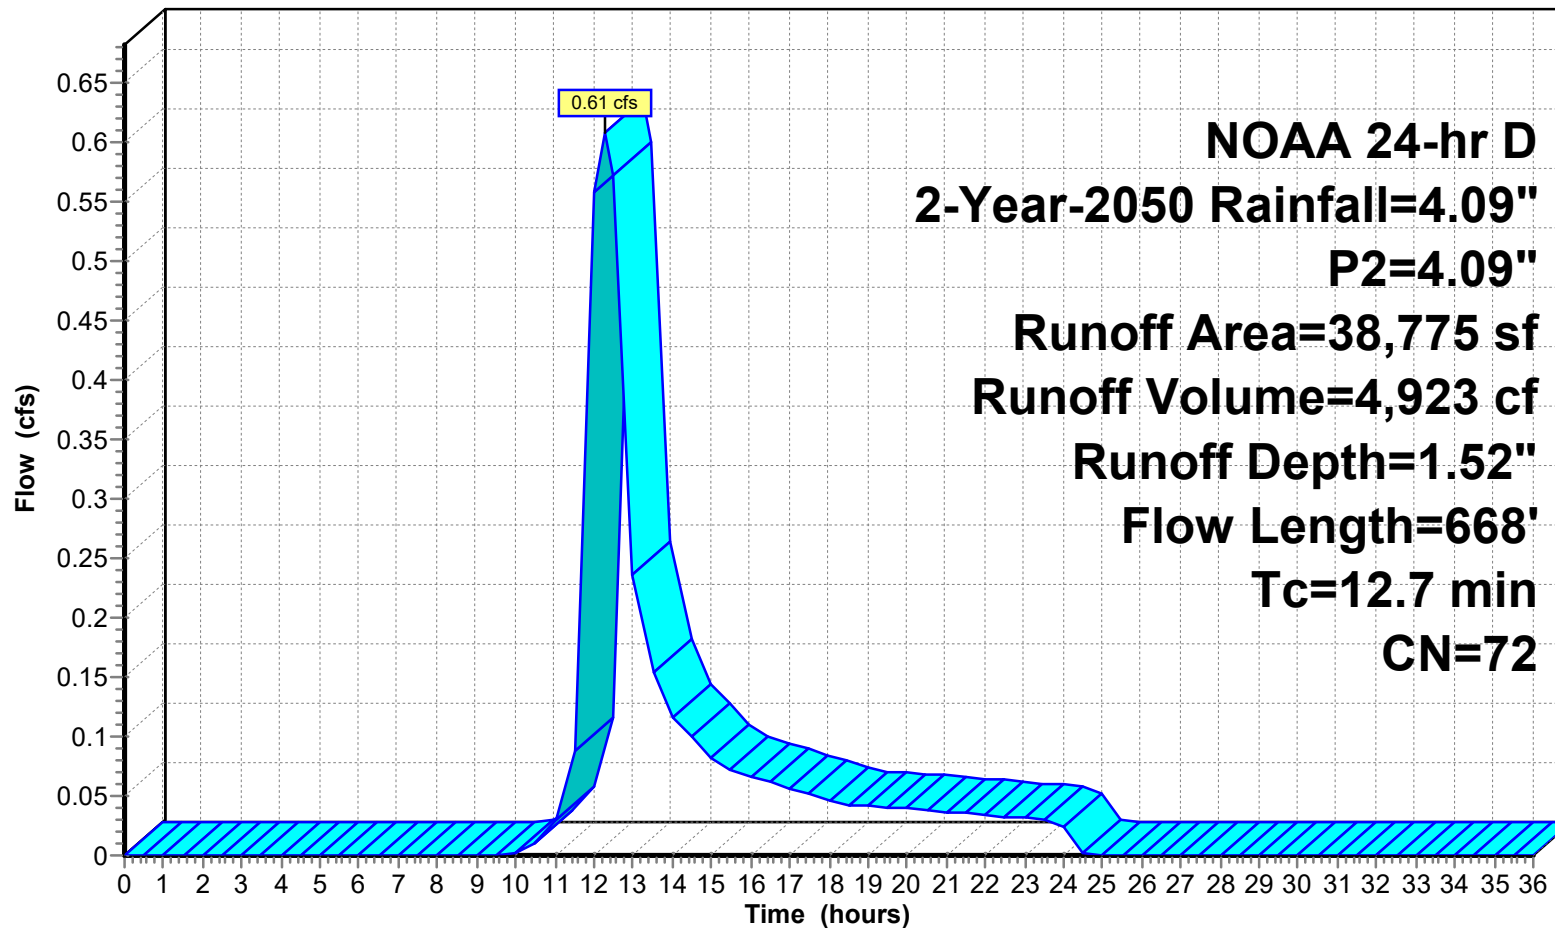

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 65

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 0.60 cfs @ 12.01 hrs, Volume= 3,866 cf, Depth= 3.85"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0550	2.33		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 66

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

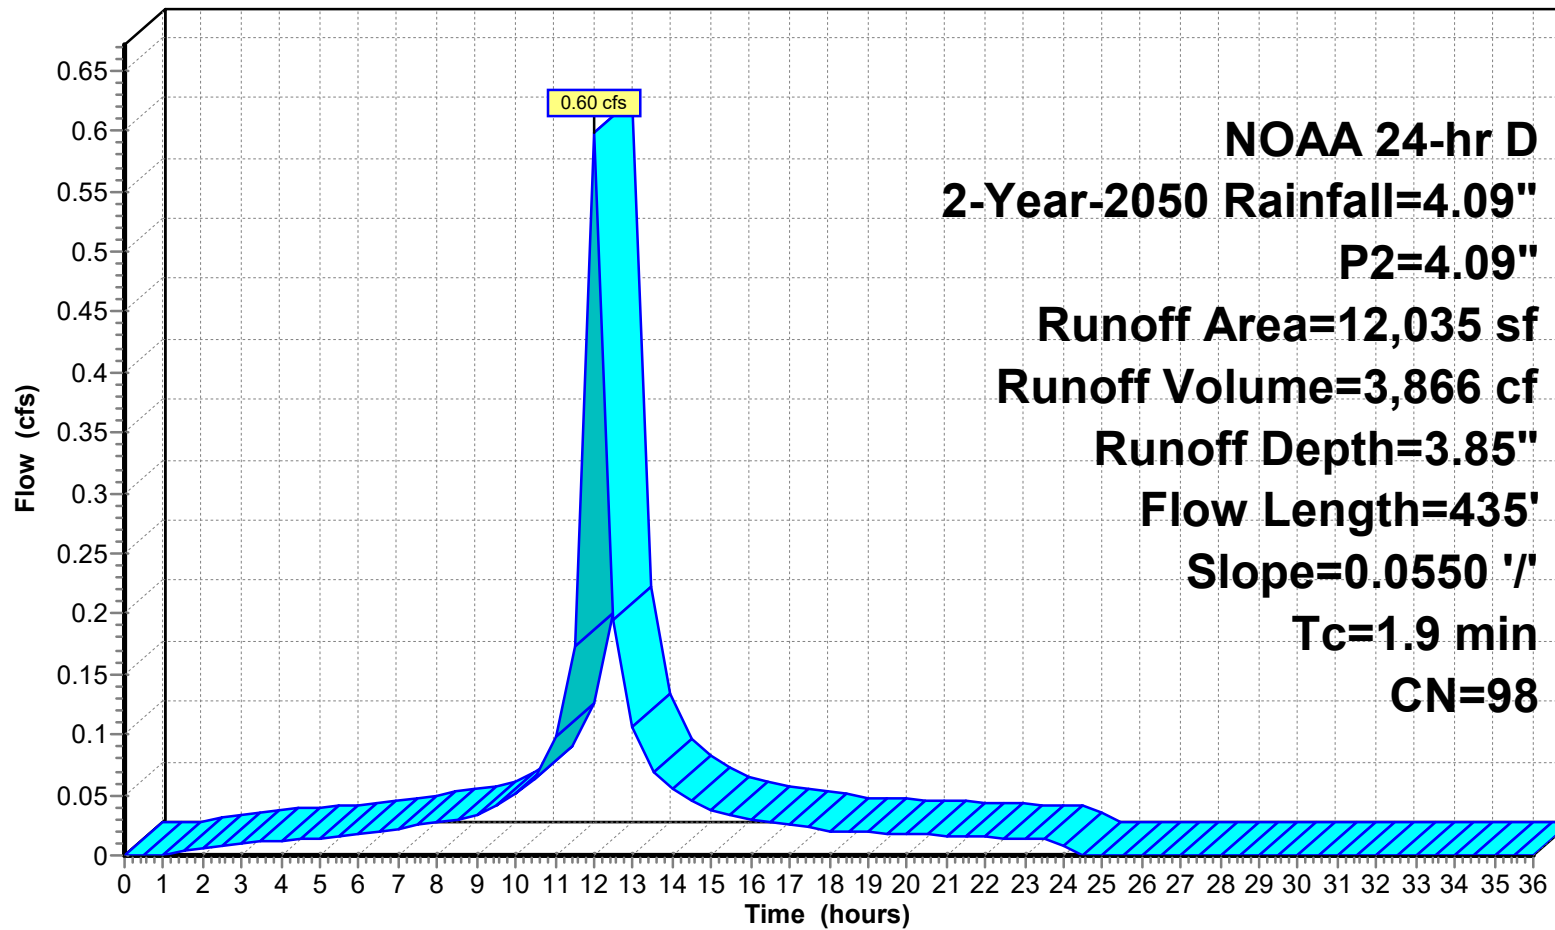

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 67

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.05 cfs @ 12.07 hrs, Volume= 291 cf, Depth= 1.66"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 68

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

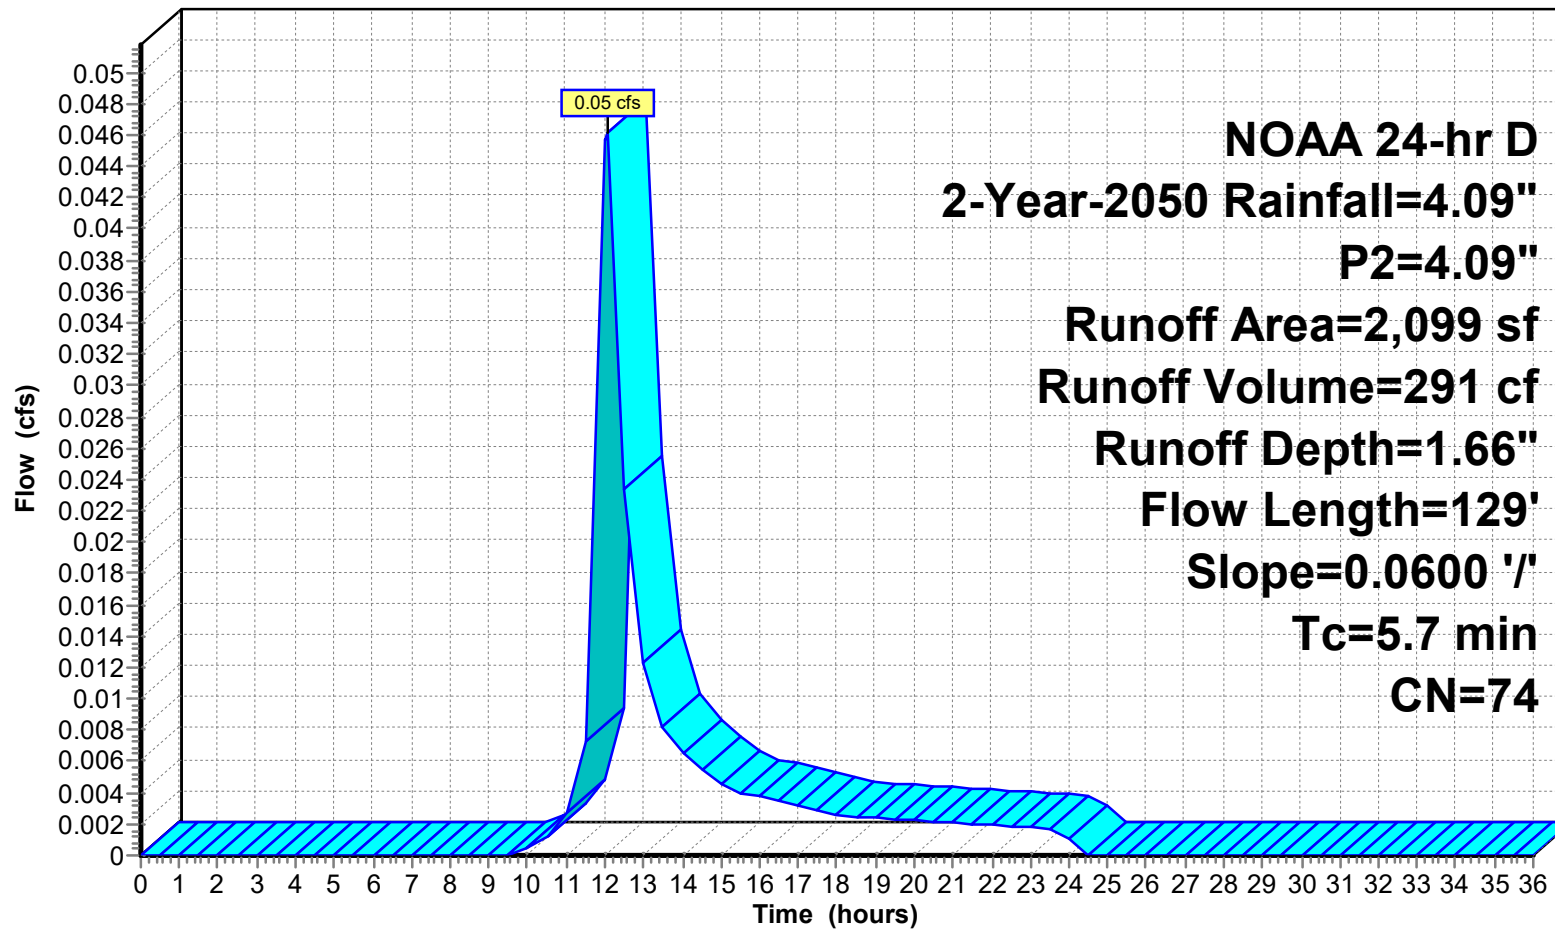

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 69

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.06 cfs @ 12.00 hrs, Volume= 386 cf, Depth= 3.85"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 70

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

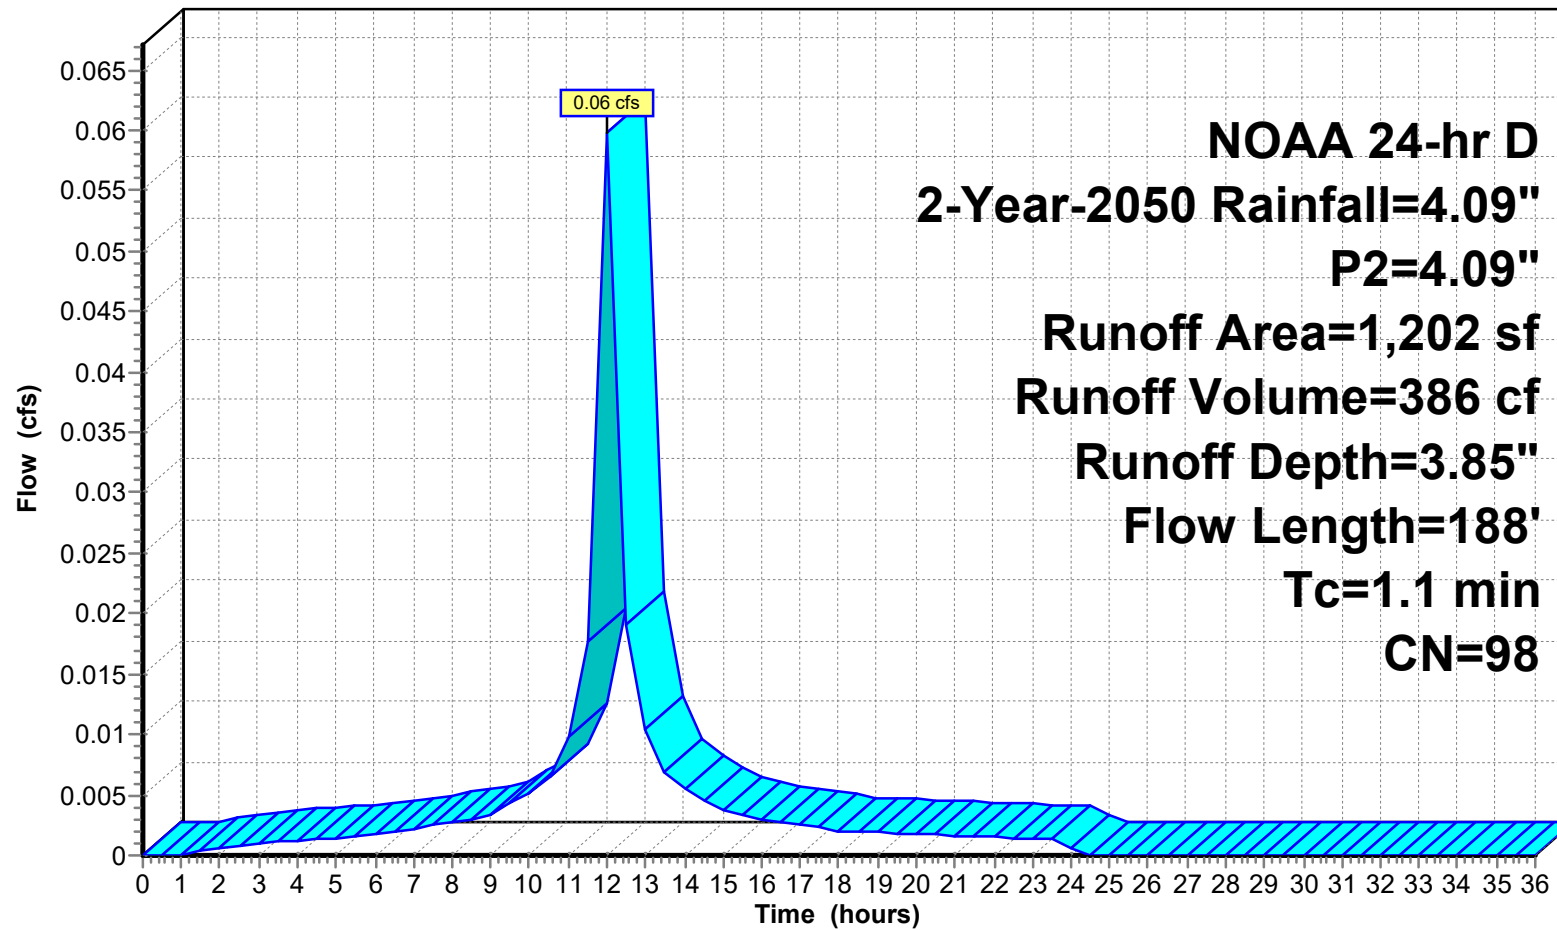

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 71

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.03 cfs @ 12.06 hrs, Volume= 184 cf, Depth= 1.66"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 72

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

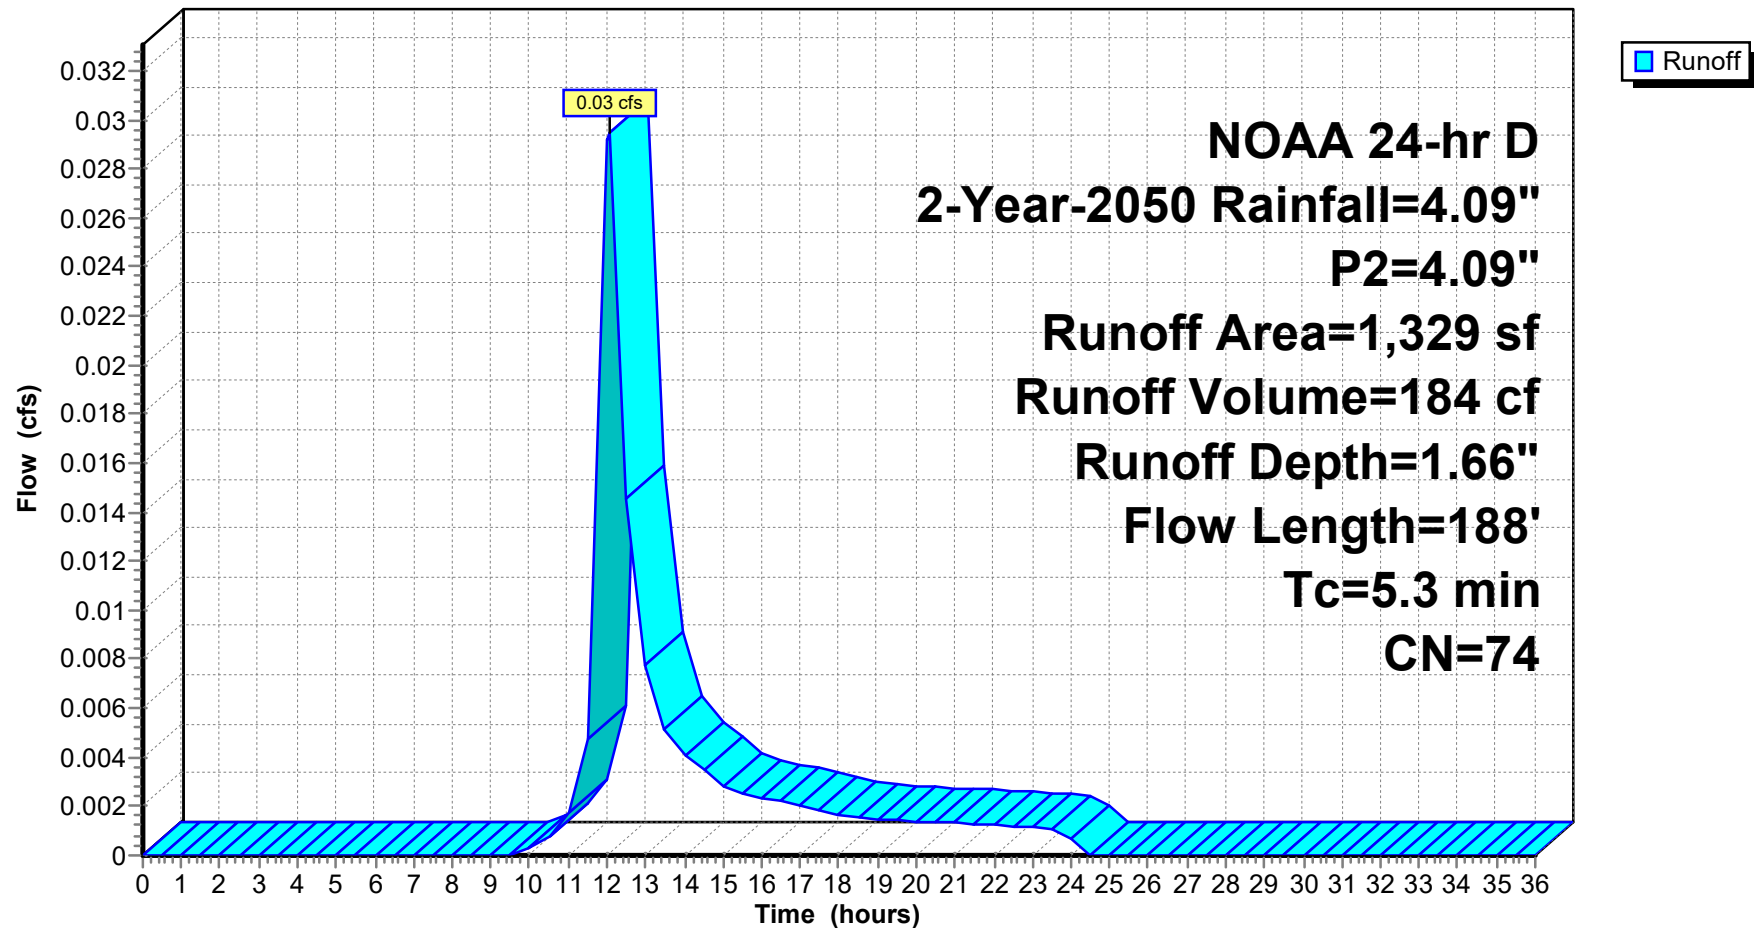

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 73


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 3.62" for 2-Year-2050 event
Inflow = 3.64 cfs @ 12.01 hrs, Volume= 23,482 cf
Primary = 3.64 cfs @ 12.01 hrs, Volume= 23,482 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

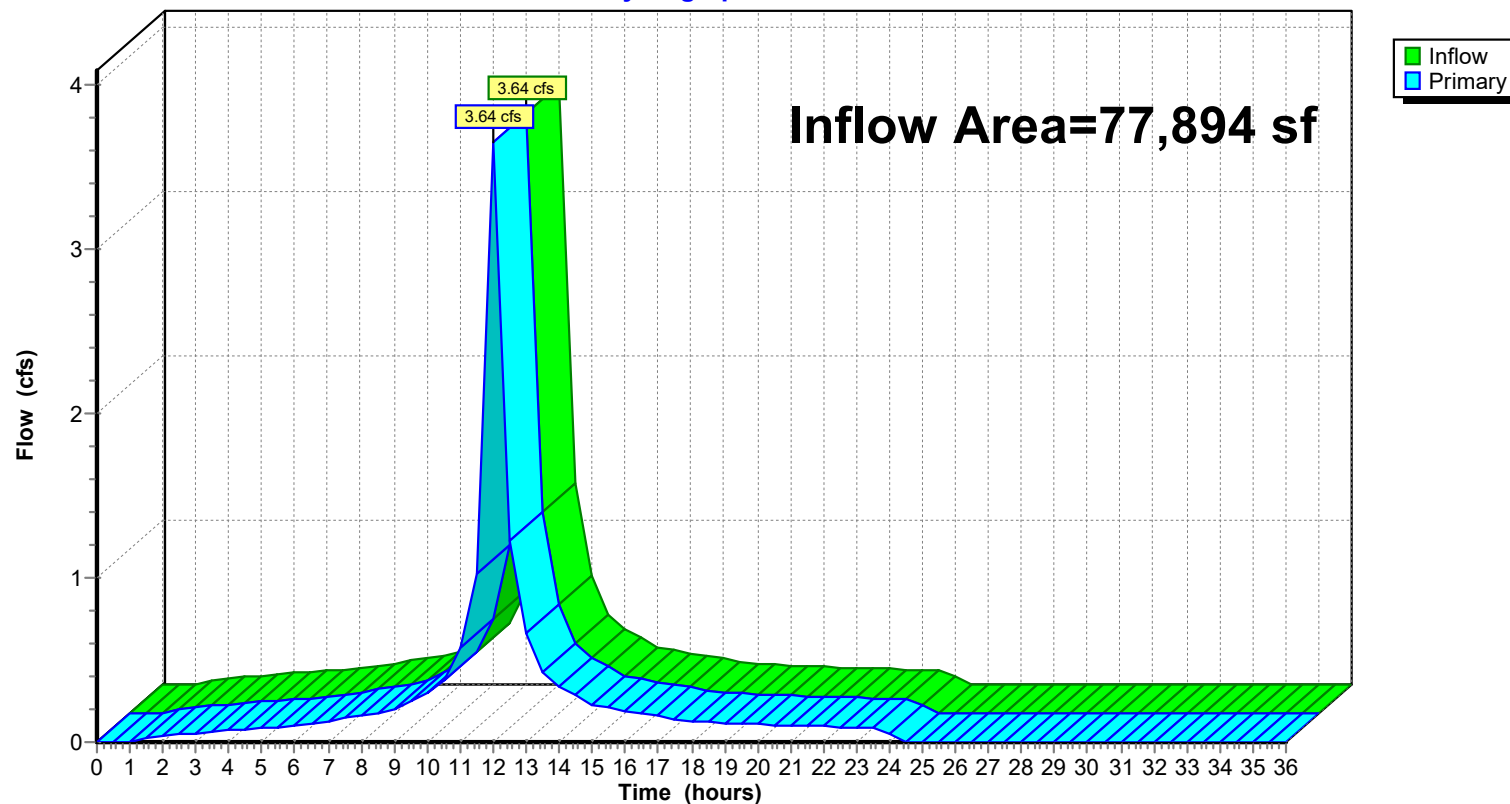

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 74


Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 2.98" for 2-Year-2050 event
Inflow = 4.95 cfs @ 12.03 hrs, Volume= 33,132 cf
Primary = 4.95 cfs @ 12.03 hrs, Volume= 33,132 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

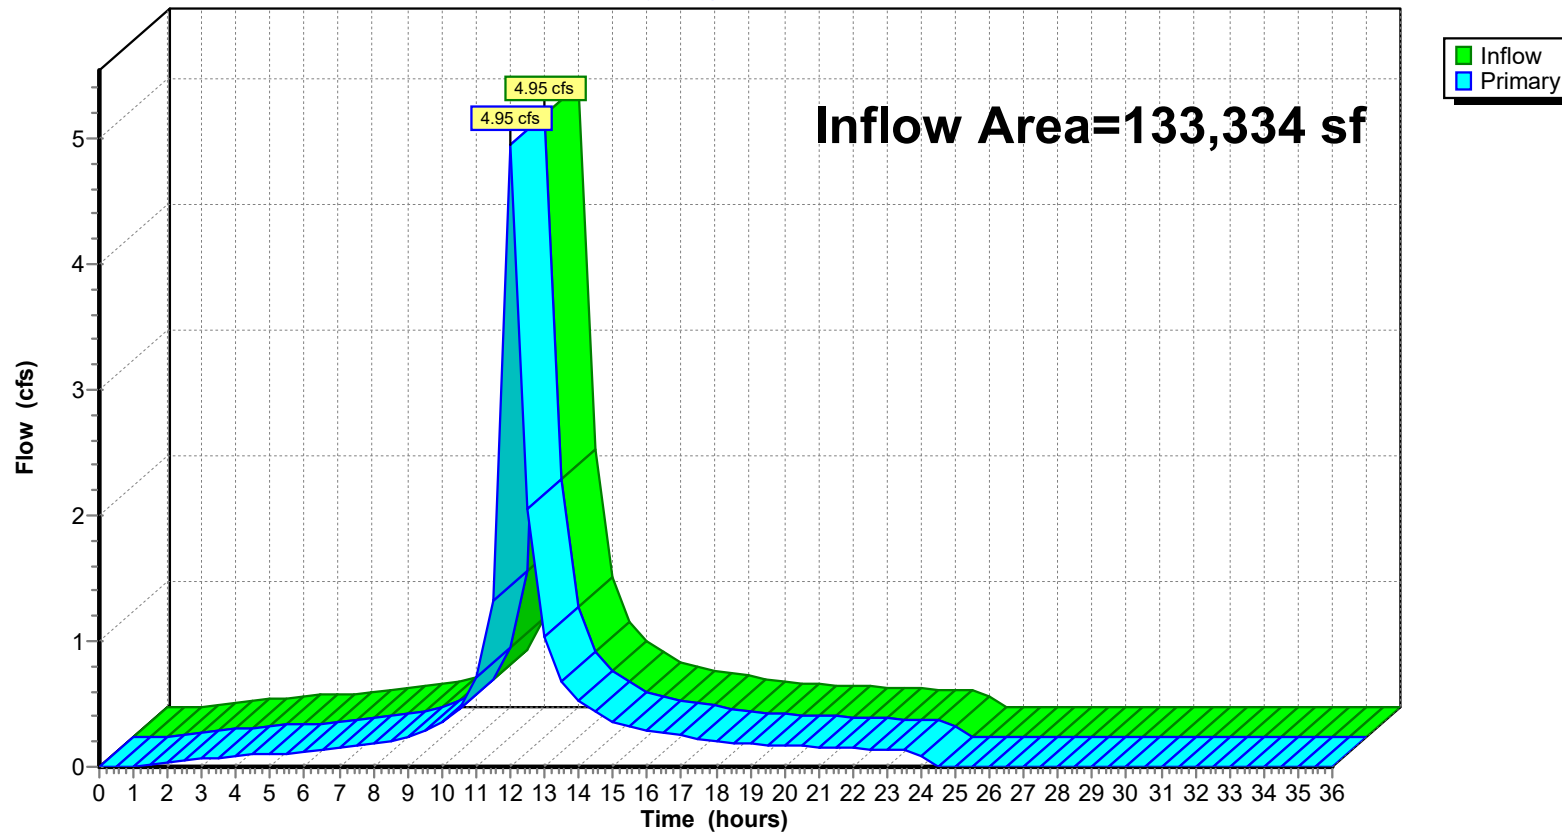

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 75


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 2.92" for 2-Year-2050 event
Inflow = 4.21 cfs @ 12.03 hrs, Volume= 28,405 cf
Primary = 4.21 cfs @ 12.03 hrs, Volume= 28,405 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

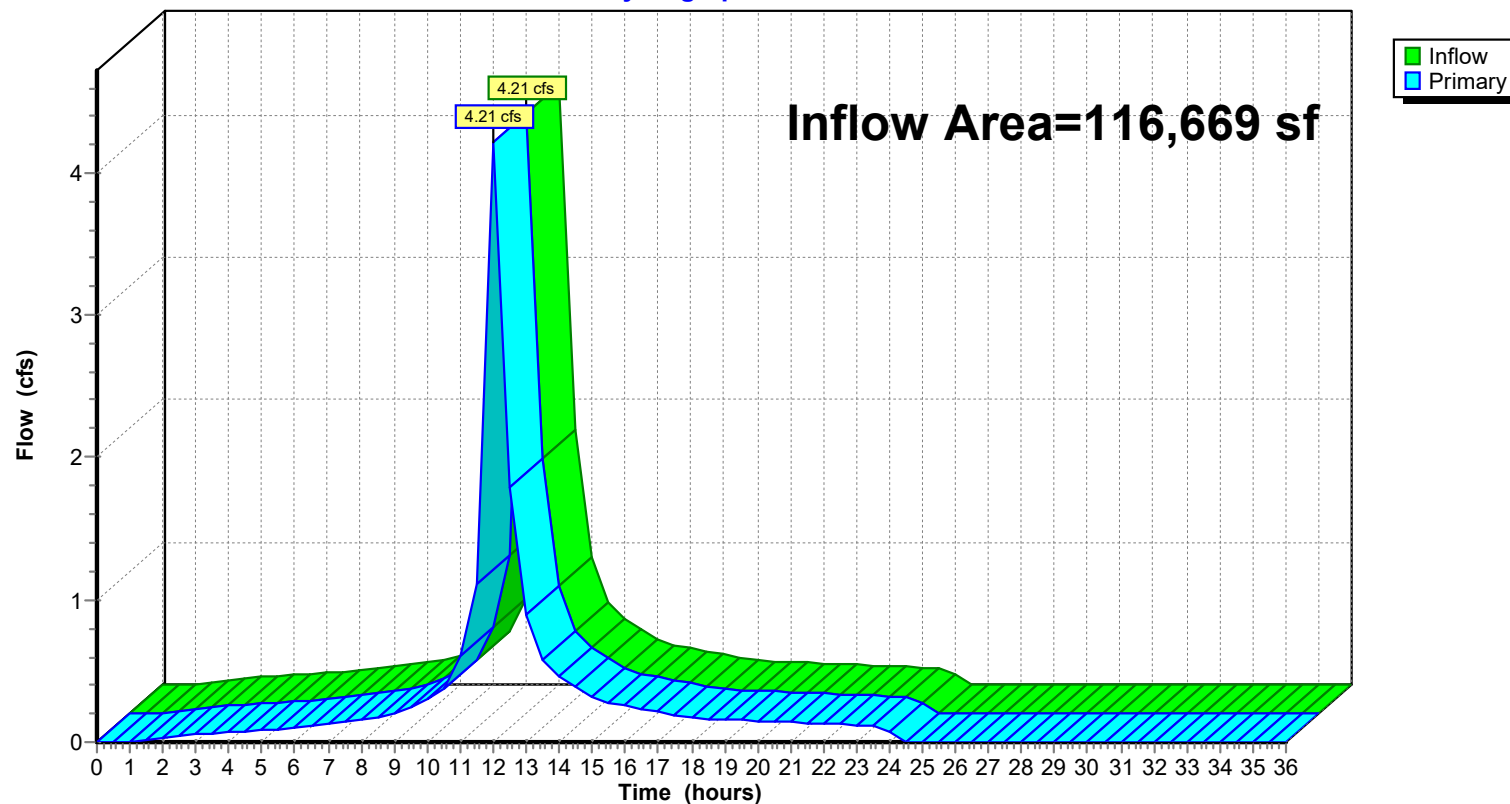

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 76


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 3.40" for 2-Year-2050 event
Inflow = 0.73 cfs @ 12.01 hrs, Volume= 4,727 cf
Primary = 0.73 cfs @ 12.01 hrs, Volume= 4,727 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 2: EXIST DP 2

Hydrograph

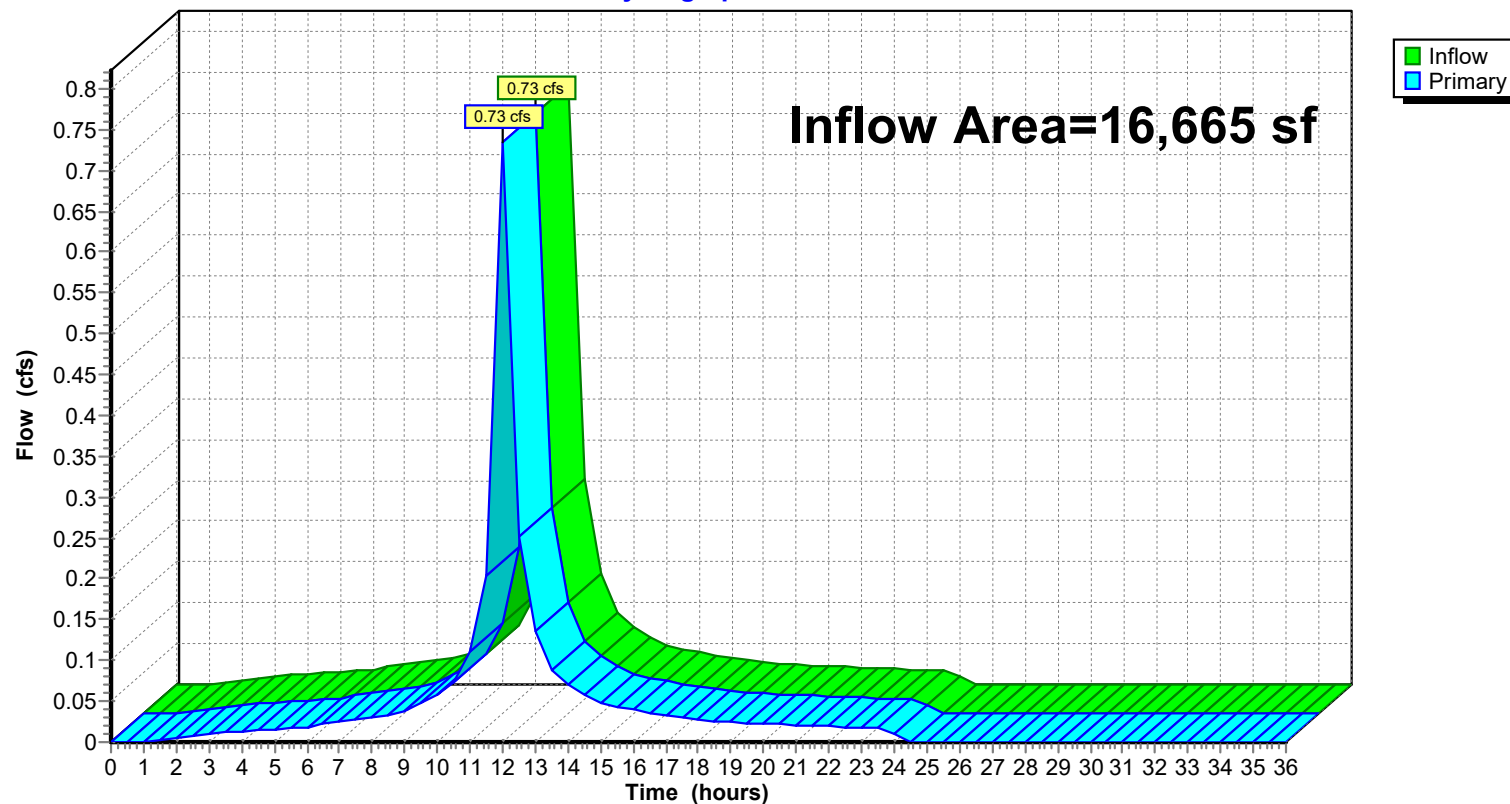

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 77

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 5.45 cfs @ 12.01 hrs, Volume= 35,750 cf, Depth= 6.13"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.49		Sheet Flow, Parking lot
					Smooth surfaces n= 0.011 P2= 4.09"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 78

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

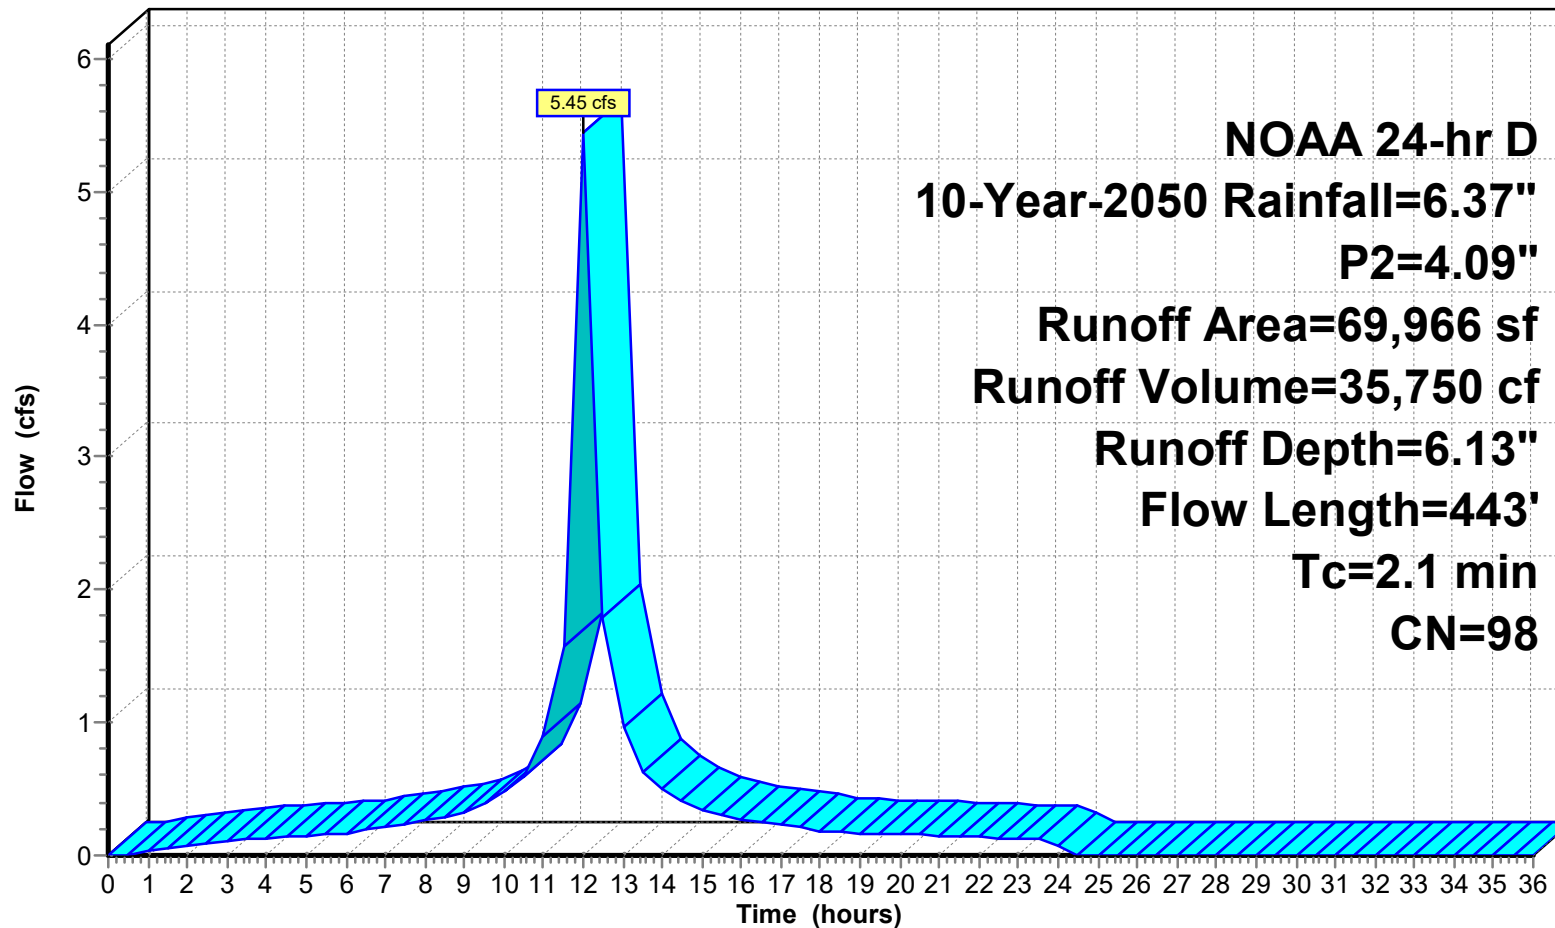

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 79

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.37 cfs @ 12.04 hrs, Volume= 2,179 cf, Depth= 3.30"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	25	0.5000	0.24		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 4.09"
0.5	75	0.0800	2.56		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 4.09"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.6	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 80

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

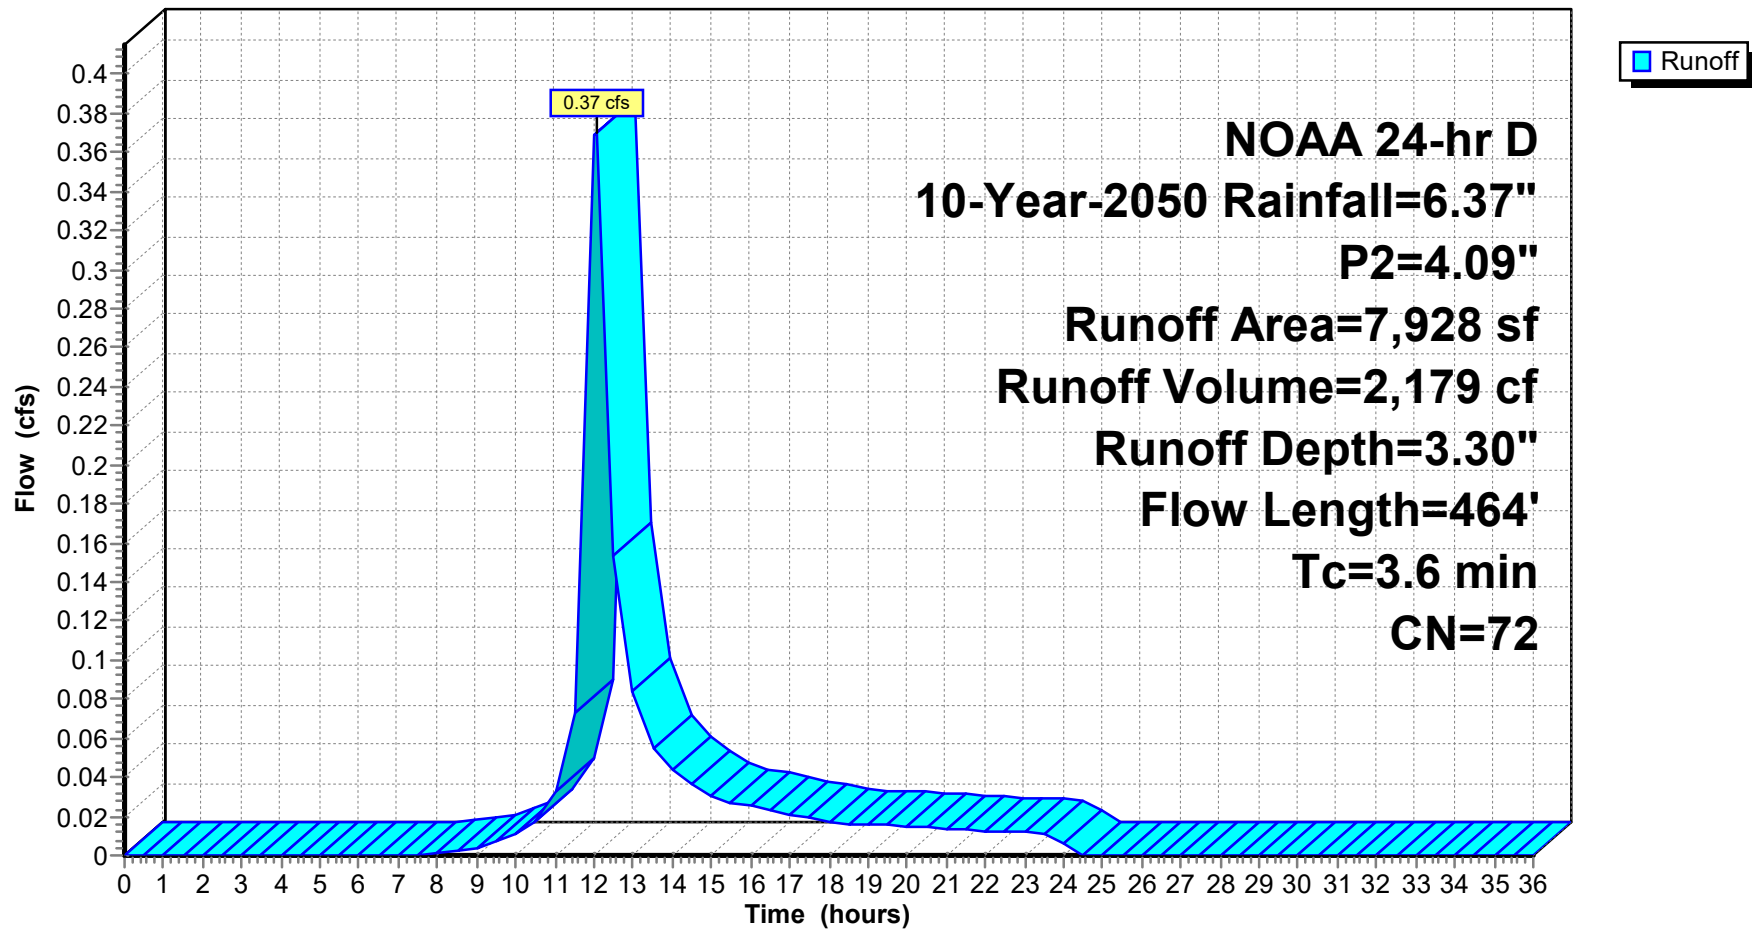

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 81

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 1.42 cfs @ 12.19 hrs, Volume= 10,658 cf, Depth= 3.30"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

	Area (sf)	CN	Description
*	708	98	Roof-offsite
*	1,220	98	Impervious
	2,721	71	Meadow, non-grazed, HSG C
*	32,886	70	wooded
	1,240	74	>75% Grass cover, Good, HSG C
	38,775	72	Weighted Average
	36,847		95.03% Pervious Area
	1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
12.7	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 82

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

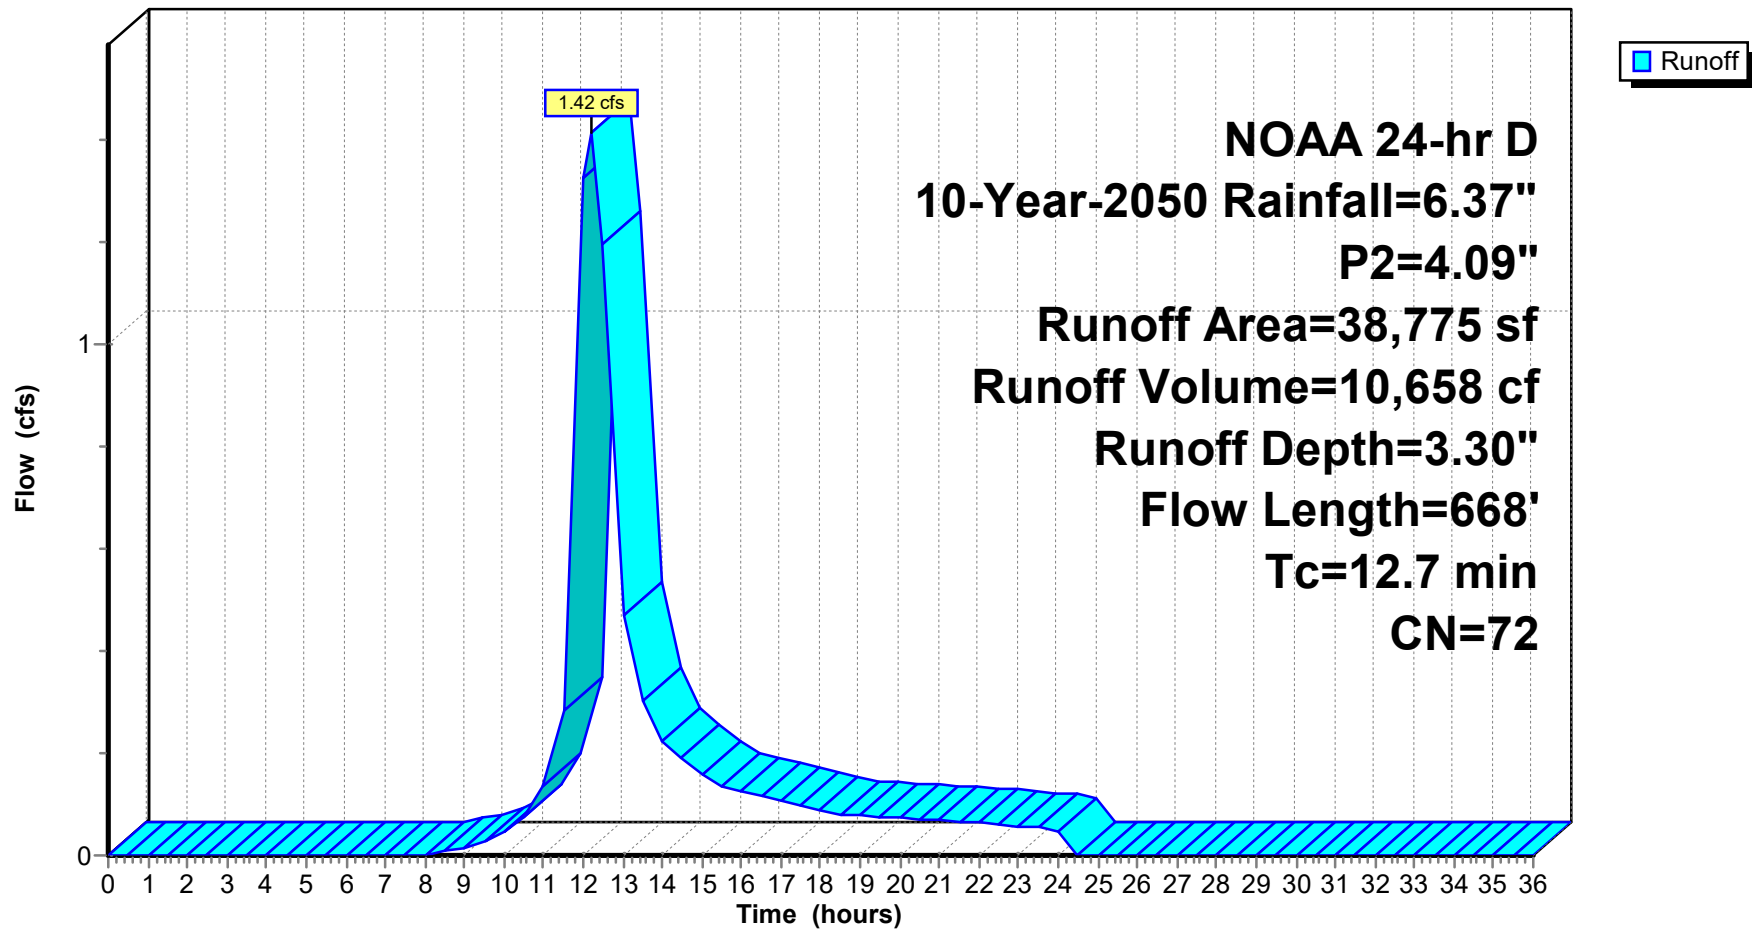

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 83

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 0.94 cfs @ 12.01 hrs, Volume= 6,149 cf, Depth= 6.13"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0550	2.33		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 84

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

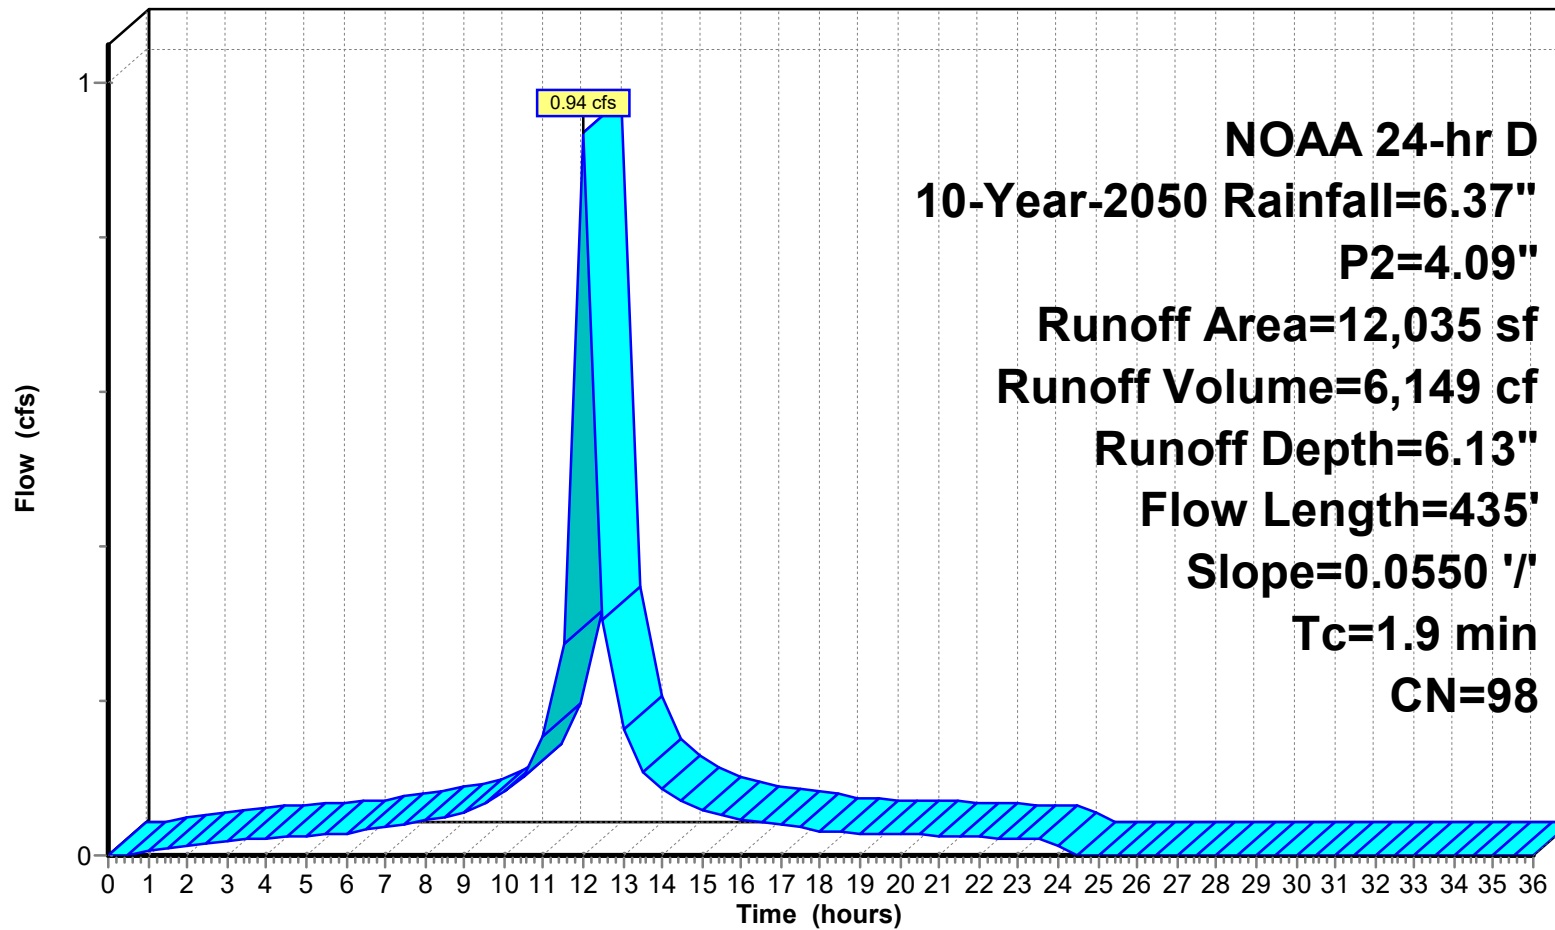

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 85

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.10 cfs @ 12.05 hrs, Volume= 612 cf, Depth= 3.50"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 86

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

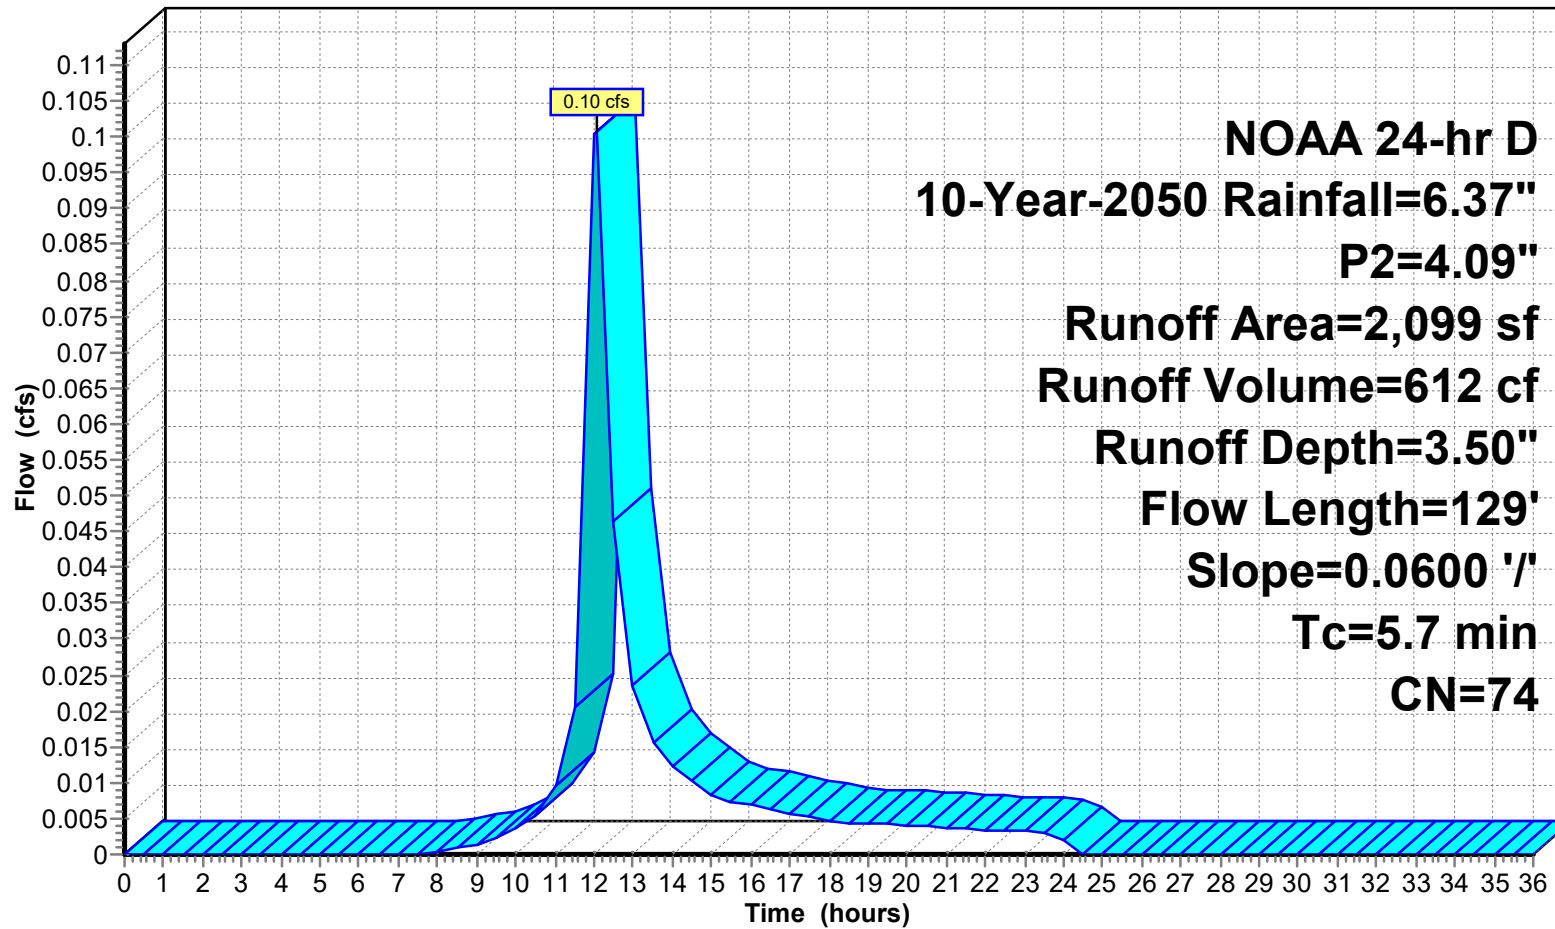

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 87

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.09 cfs @ 12.00 hrs, Volume= 614 cf, Depth= 6.13"
Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 88

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

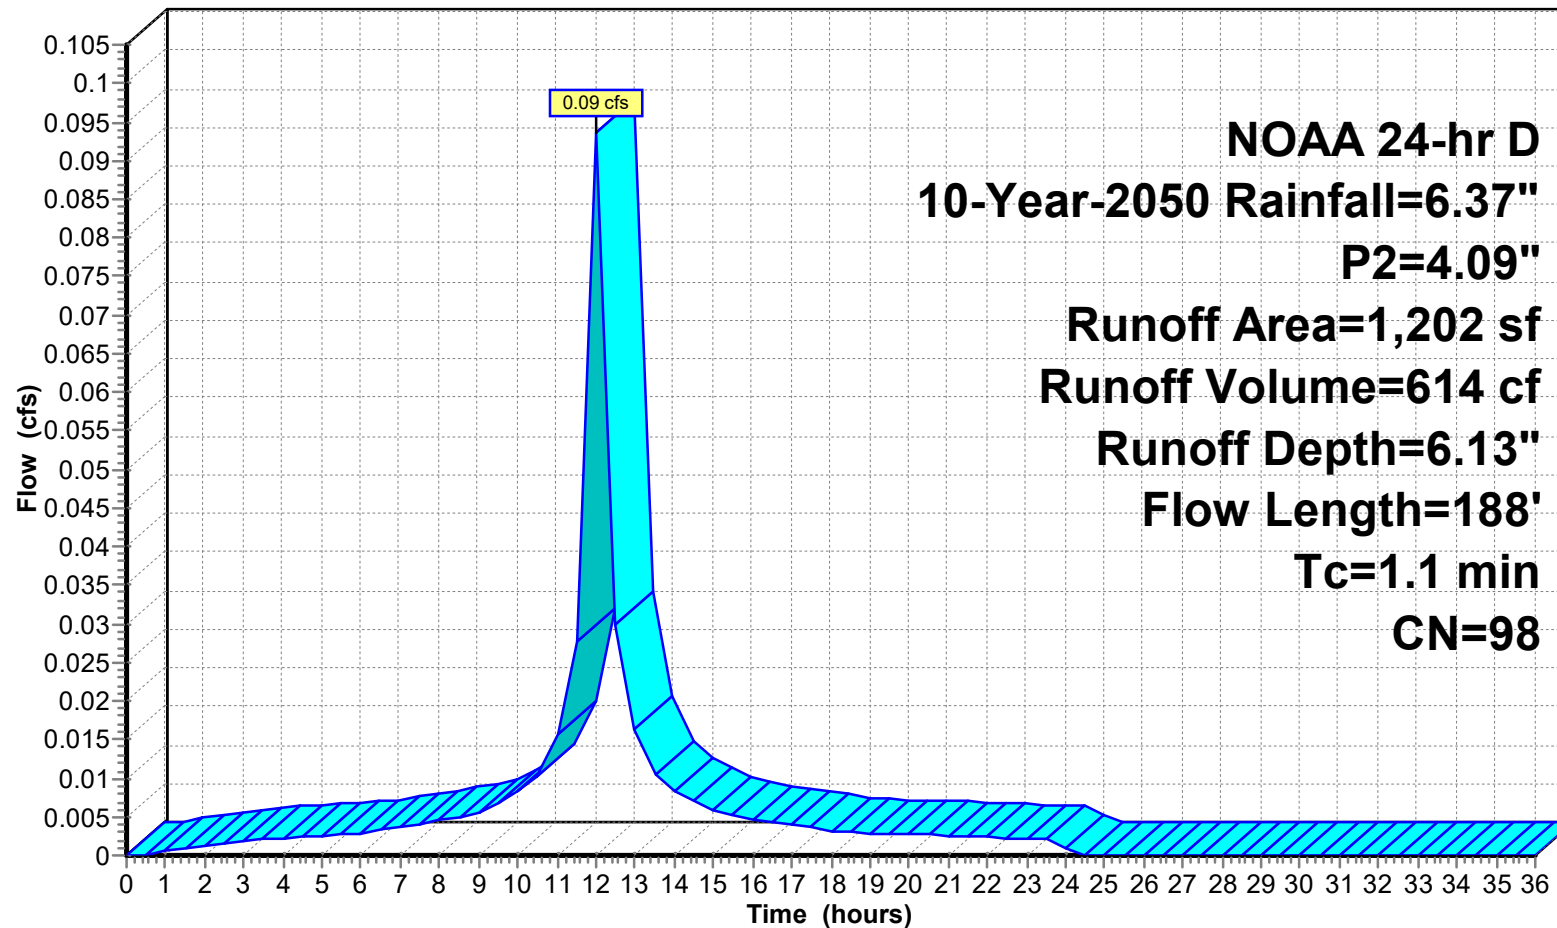

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 89

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.06 cfs @ 12.05 hrs, Volume= 387 cf, Depth= 3.50"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 90

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

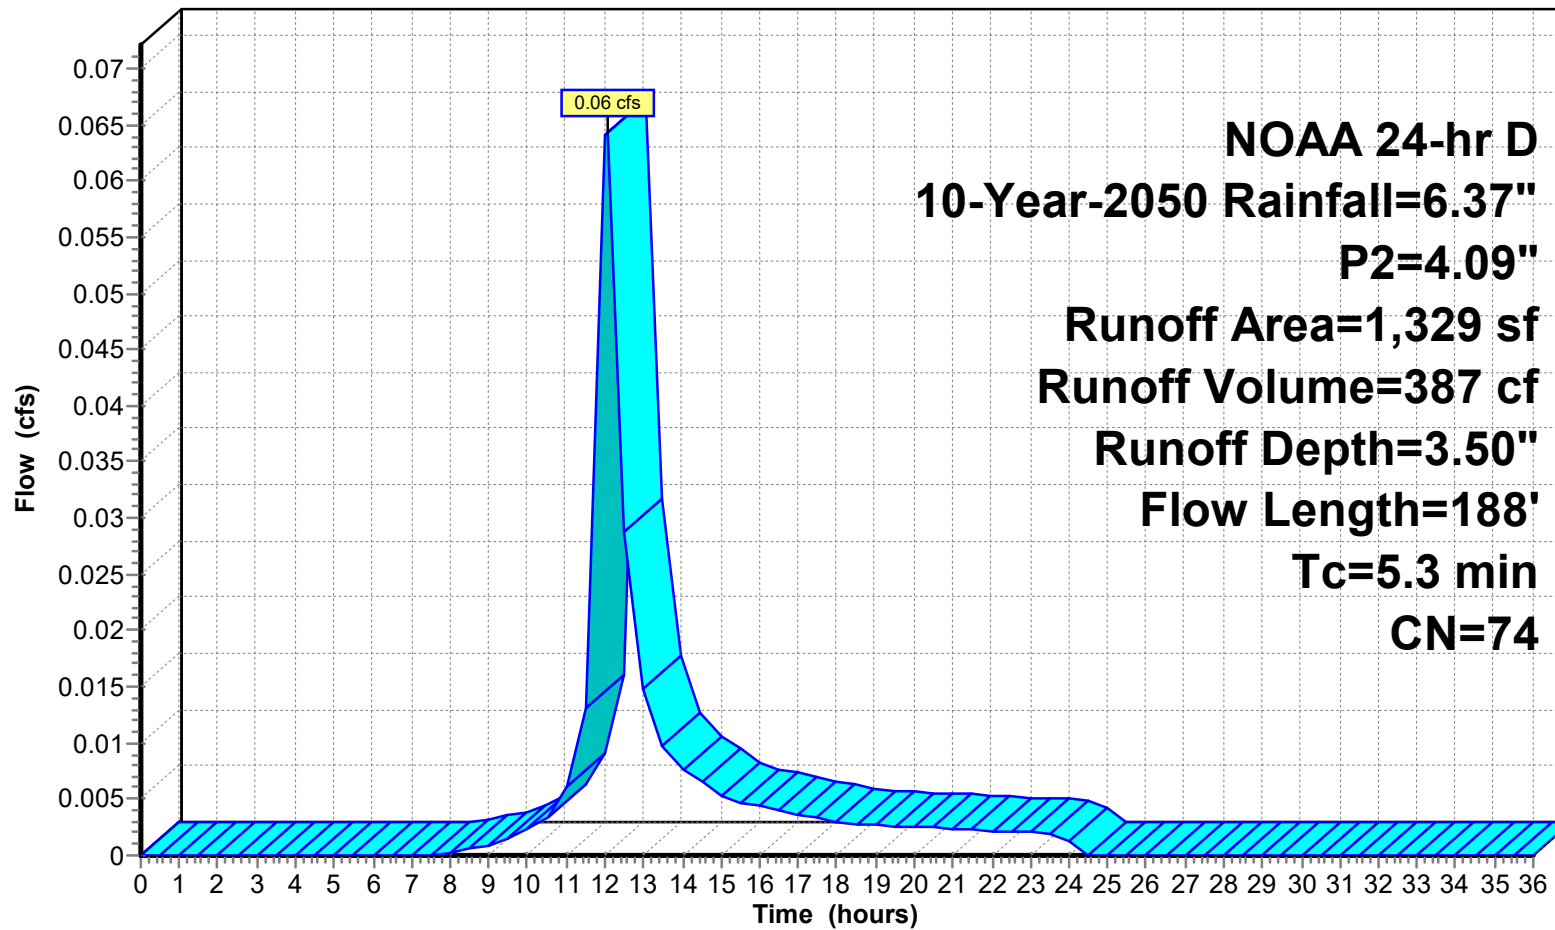

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 91


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 5.84" for 10-Year-2050 event
Inflow = 5.82 cfs @ 12.01 hrs, Volume= 37,929 cf
Primary = 5.82 cfs @ 12.01 hrs, Volume= 37,929 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

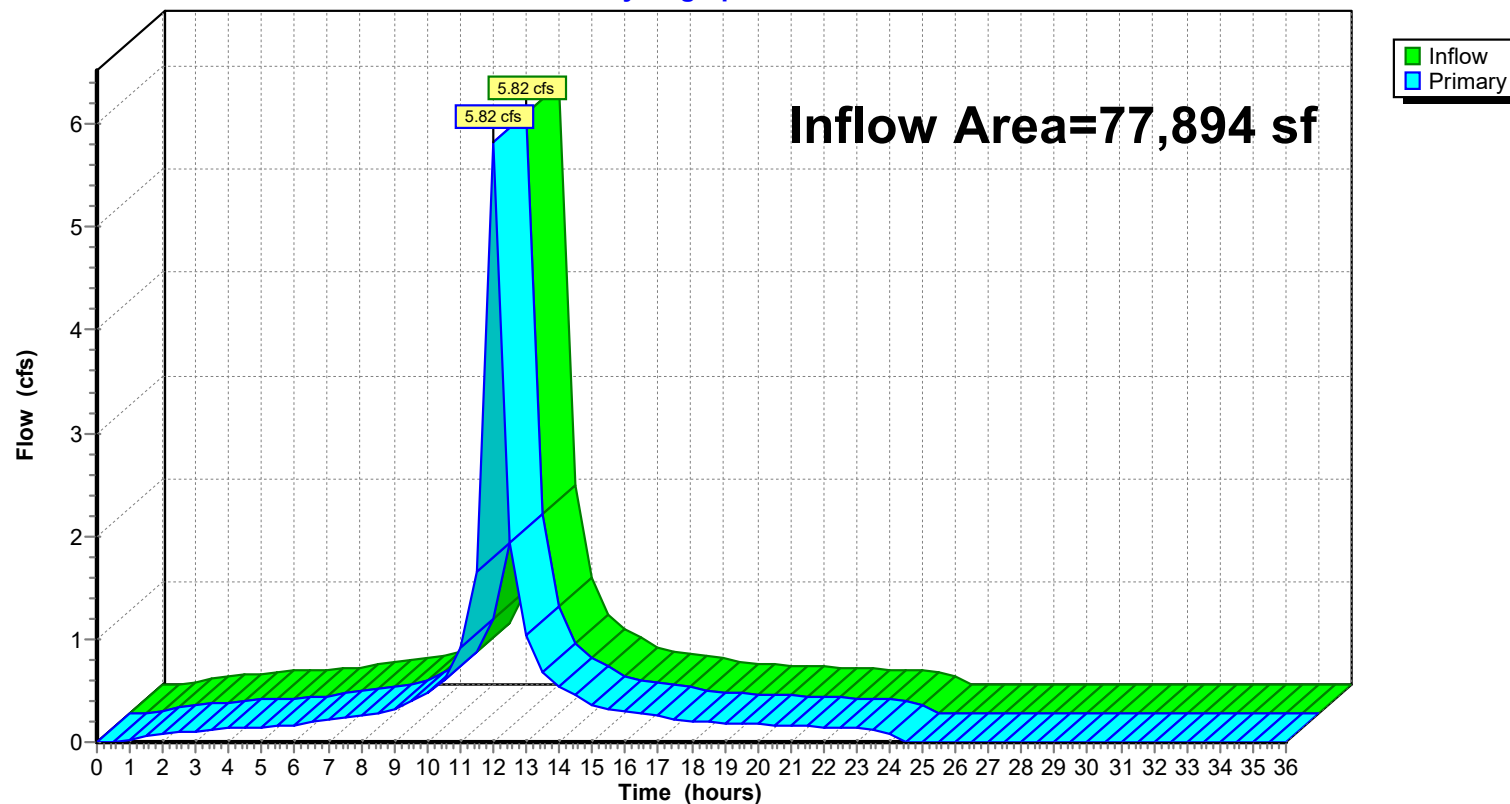

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 92


Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 5.07" for 10-Year-2050 event
Inflow = 8.36 cfs @ 12.03 hrs, Volume= 56,350 cf
Primary = 8.36 cfs @ 12.03 hrs, Volume= 56,350 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

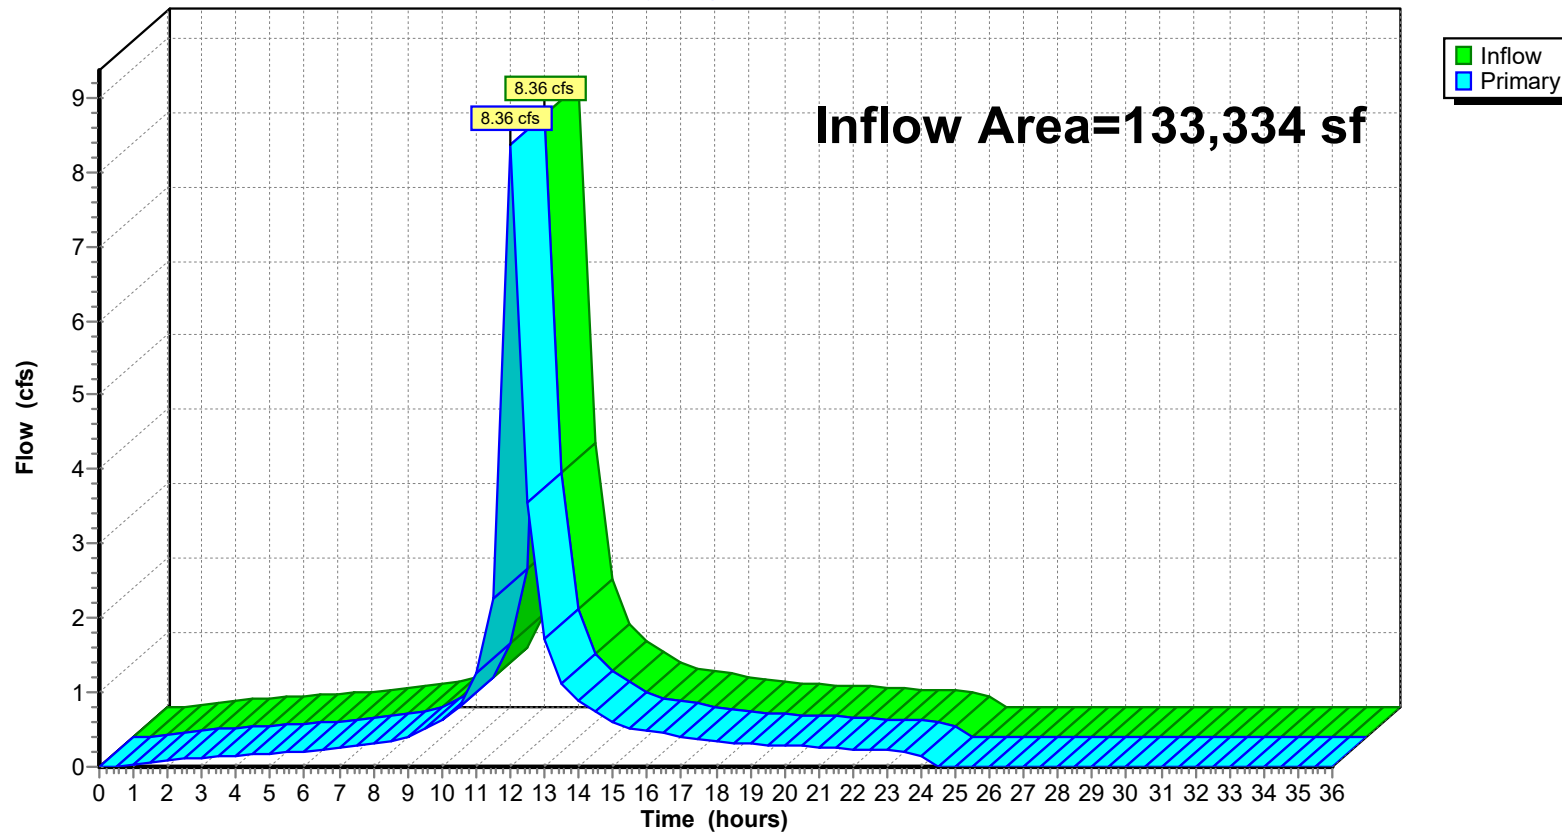

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 93


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 5.00" for 10-Year-2050 event
Inflow = 7.17 cfs @ 12.03 hrs, Volume= 48,587 cf
Primary = 7.17 cfs @ 12.03 hrs, Volume= 48,587 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

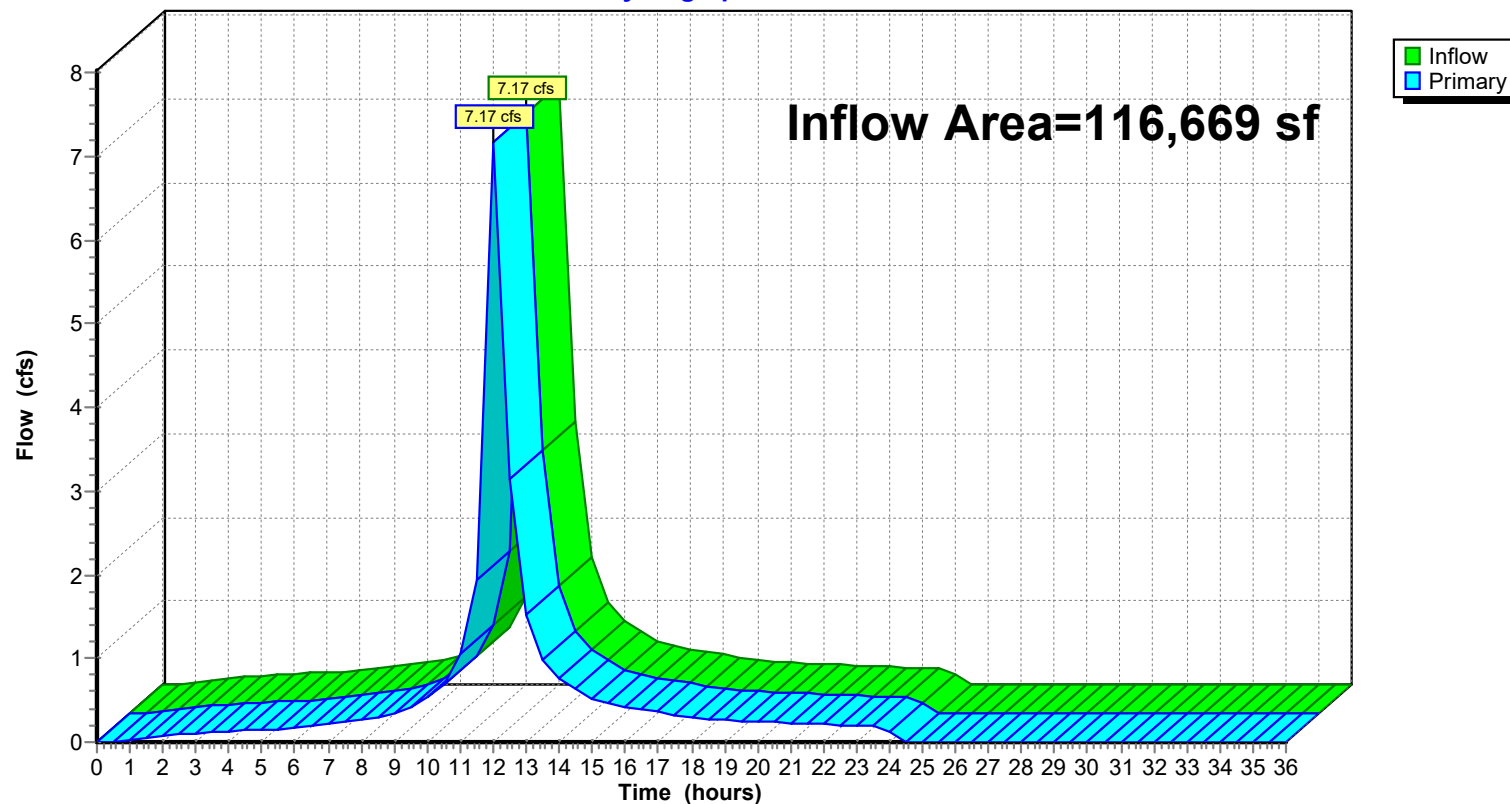

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 94


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 5.59" for 10-Year-2050 event
Inflow = 1.20 cfs @ 12.01 hrs, Volume= 7,763 cf
Primary = 1.20 cfs @ 12.01 hrs, Volume= 7,763 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 2: EXIST DP 2

Hydrograph

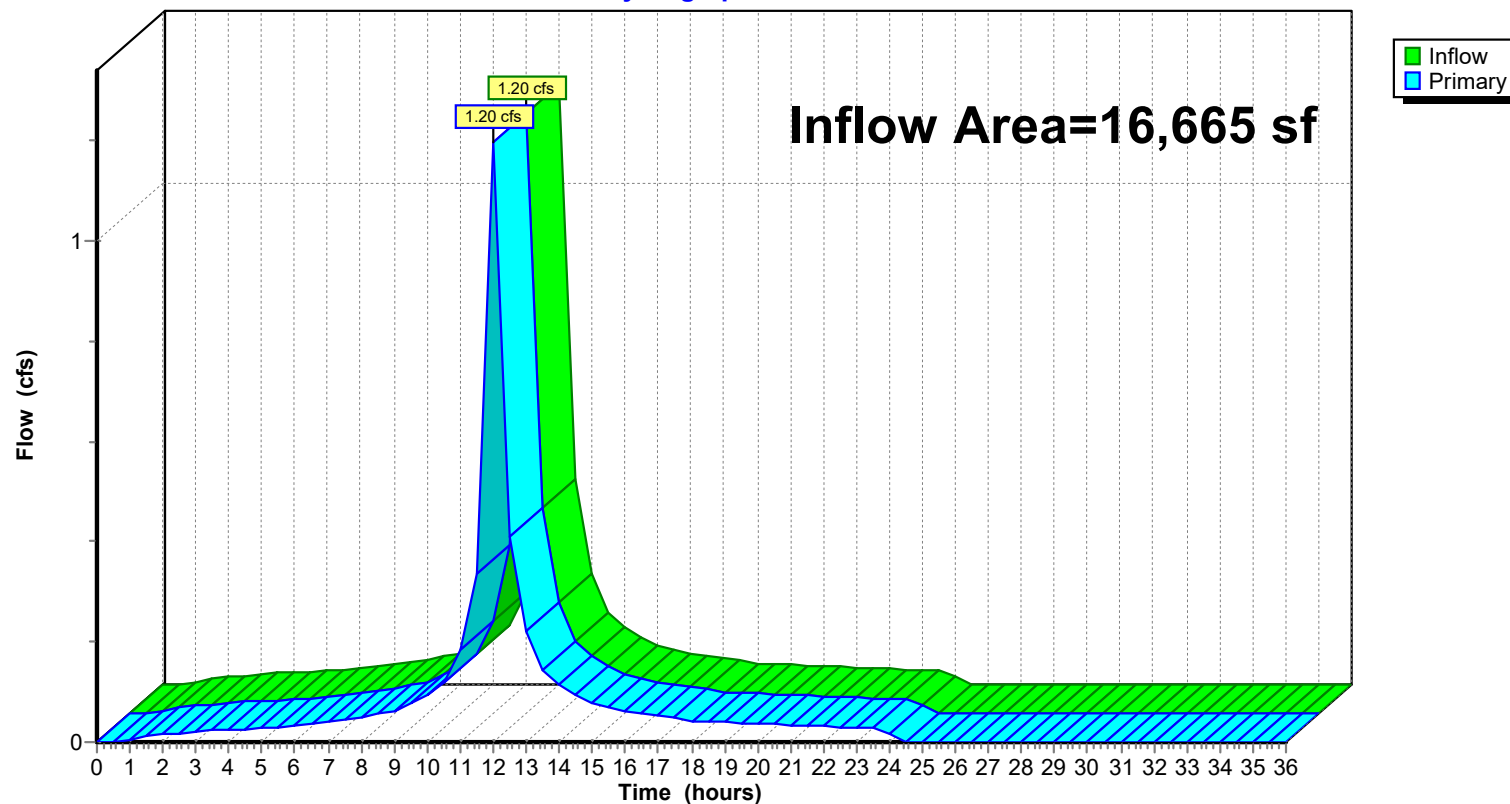

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 95

Summary for Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Runoff = 9.89 cfs @ 12.01 hrs, Volume= 65,760 cf, Depth=11.28"
Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
69,966	98	Paved parking, HSG C
69,966		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0650	2.49		Sheet Flow, Parking lot Smooth surfaces n= 0.011 P2= 4.09"
1.4	343	0.0420	4.16		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
2.1	443	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 96

Subcatchment E1A: E1A DISTURBED/IMPERVIOUS

Hydrograph

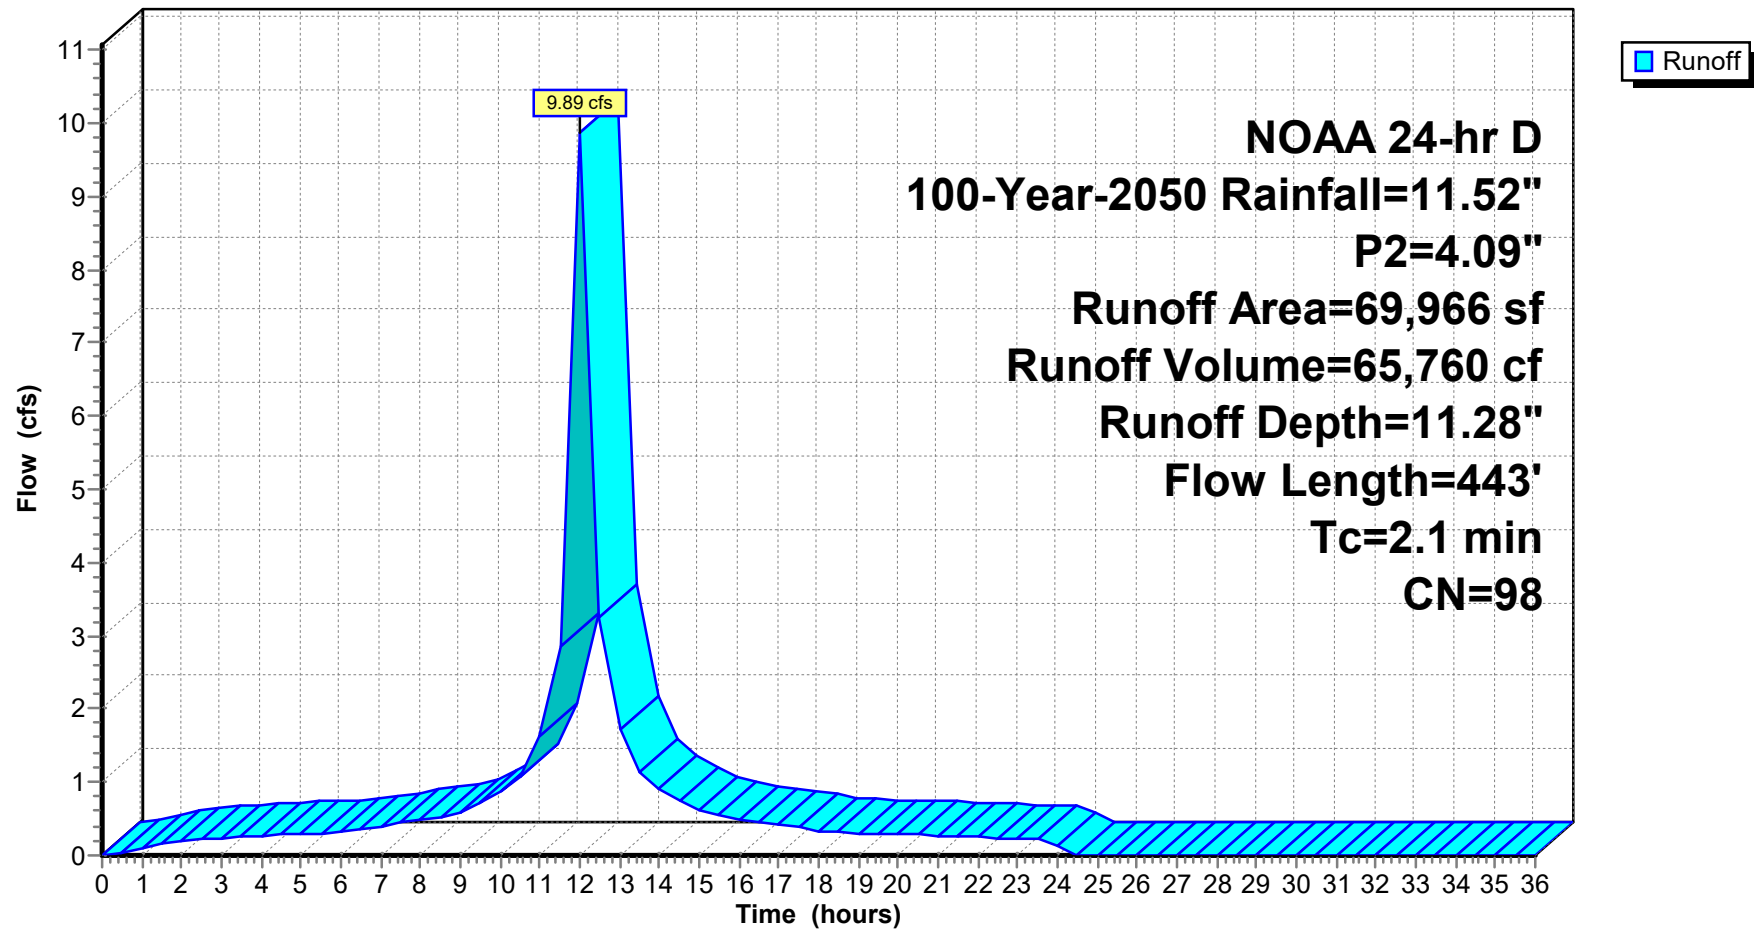

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 97

Summary for Subcatchment E1B: E1B DISTURBED/PERVIOUS

Runoff = 0.89 cfs @ 12.03 hrs, Volume= 5,211 cf, Depth= 7.89"
 Routed to Link 8L : EXISTING DISTURBED

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
7,928	72	Woods/grass comb., Good, HSG C
7,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.7	25	0.5000	0.24		Sheet Flow, Wooded
					Woods: Light underbrush n= 0.400 P2= 4.09"
0.5	75	0.0800	2.56		Sheet Flow, Paved area
					Smooth surfaces n= 0.011 P2= 4.09"
1.4	364	0.0480	4.45		Shallow Concentrated Flow, Parking lot
					Paved Kv= 20.3 fps
3.6	464	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 98

Subcatchment E1B: E1B DISTURBED/PERVIOUS

Hydrograph

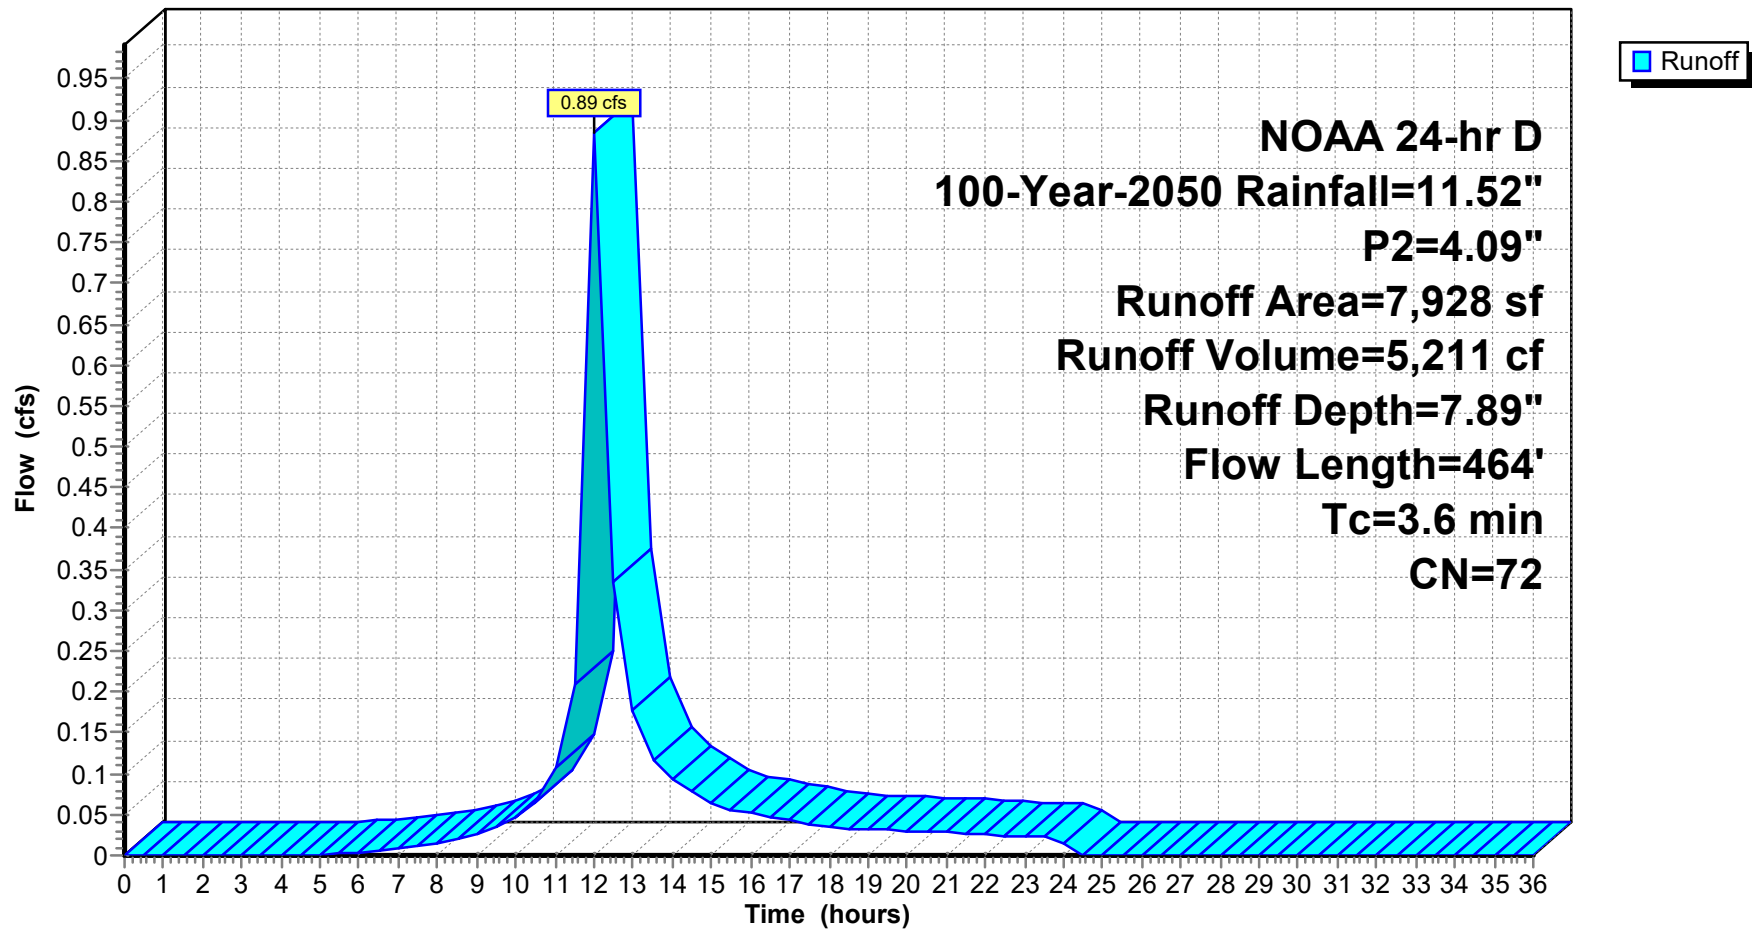

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 99

Summary for Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Runoff = 3.43 cfs @ 12.15 hrs, Volume= 25,485 cf, Depth= 7.89"
 Routed to Link E-DP 1 : EXIST DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 708	98	Roof-offsite
* 1,220	98	Impervious
2,721	71	Meadow, non-grazed, HSG C
* 32,886	70	wooded
1,240	74	>75% Grass cover, Good, HSG C
38,775	72	Weighted Average
36,847		95.03% Pervious Area
1,928		4.97% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
0.6	123	0.5000	3.54		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
1.7	445	0.0470	4.40		Shallow Concentrated Flow, Parking lot Paved Kv= 20.3 fps
12.7	668	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 100

Subcatchment E1C: E1C Pervious-w-offsite-Undisturbed

Hydrograph

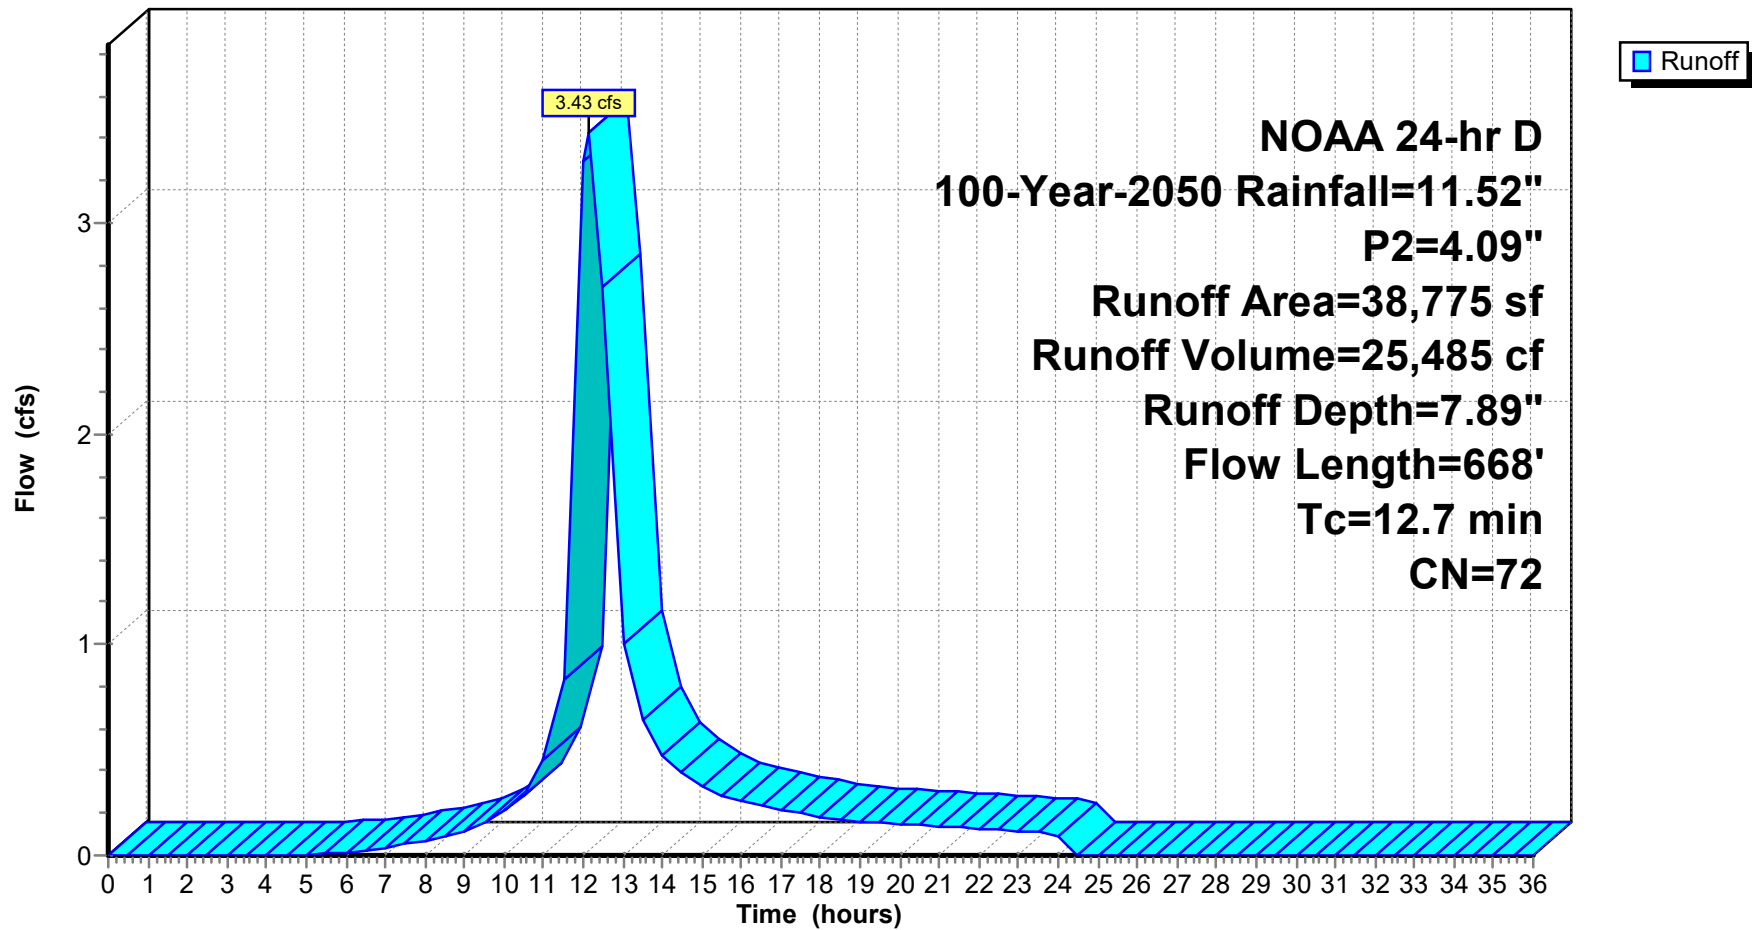

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 101

Summary for Subcatchment E2-IMP: E2A IMPERVIOUS

Runoff = 1.70 cfs @ 12.01 hrs, Volume= 11,312 cf, Depth=11.28"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
4,643	98	Roofs, HSG C
7,392	98	Paved parking, HSG C
12,035	98	Weighted Average
12,035		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0550	2.33		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0550	4.76		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 102

Subcatchment E2-IMP: E2A IMPERVIOUS

Hydrograph

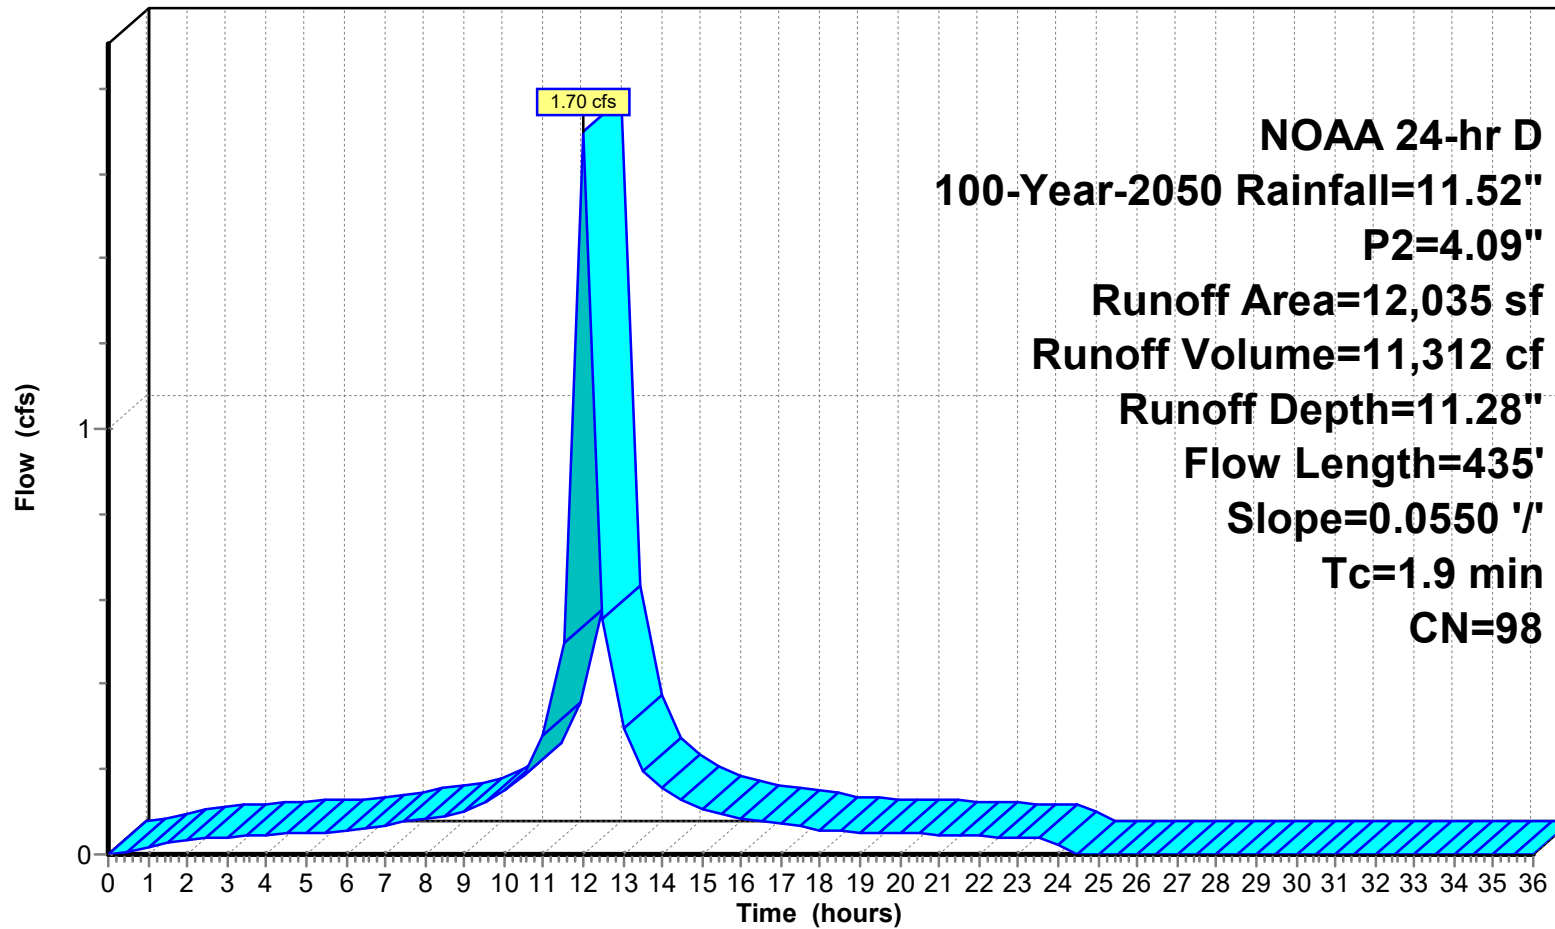

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Prepared by Jarmel Kizel Architects & Engrs

Printed 1/28/2026

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Page 103

Summary for Subcatchment E2-P: E2A PERVIOUS

Runoff = 0.23 cfs @ 12.03 hrs, Volume= 1,428 cf, Depth= 8.17"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
2,099	74	>75% Grass cover, Good, HSG C
2,099		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0600	3.94		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 104

Subcatchment E2-P: E2A PERVIOUS

Hydrograph

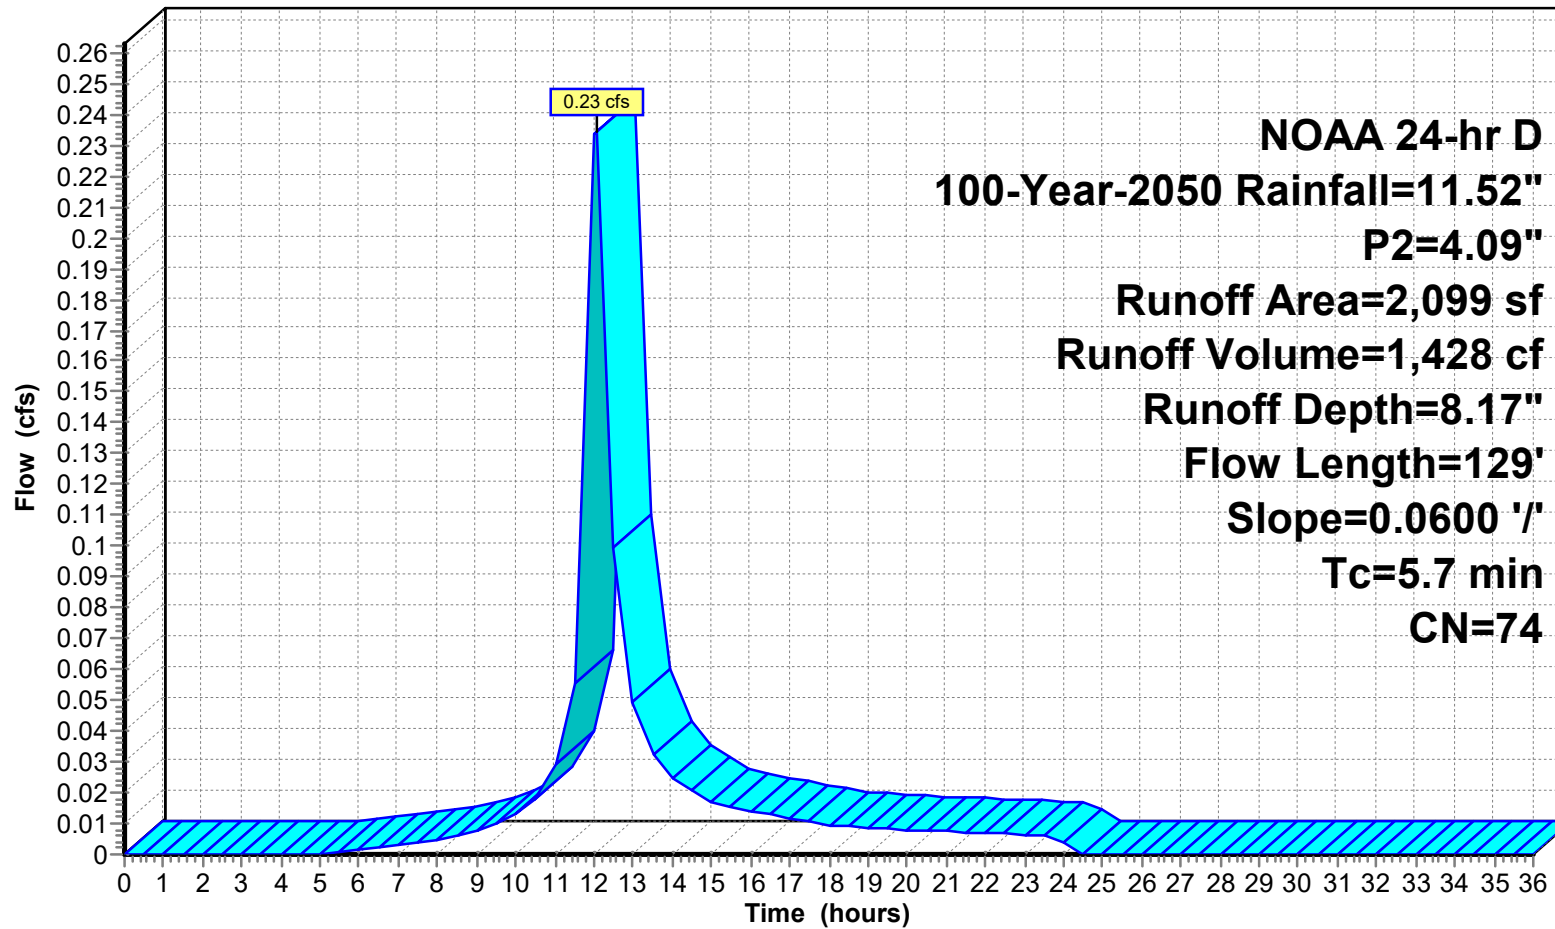

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 105

Summary for Subcatchment E2B-IMP: E2B IMPERVIOUS

Runoff = 0.17 cfs @ 12.00 hrs, Volume= 1,130 cf, Depth=11.28"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
1,202	98	Paved parking, HSG C
1,202		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0250	3.21		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 106

Subcatchment E2B-IMP: E2B IMPERVIOUS

Hydrograph

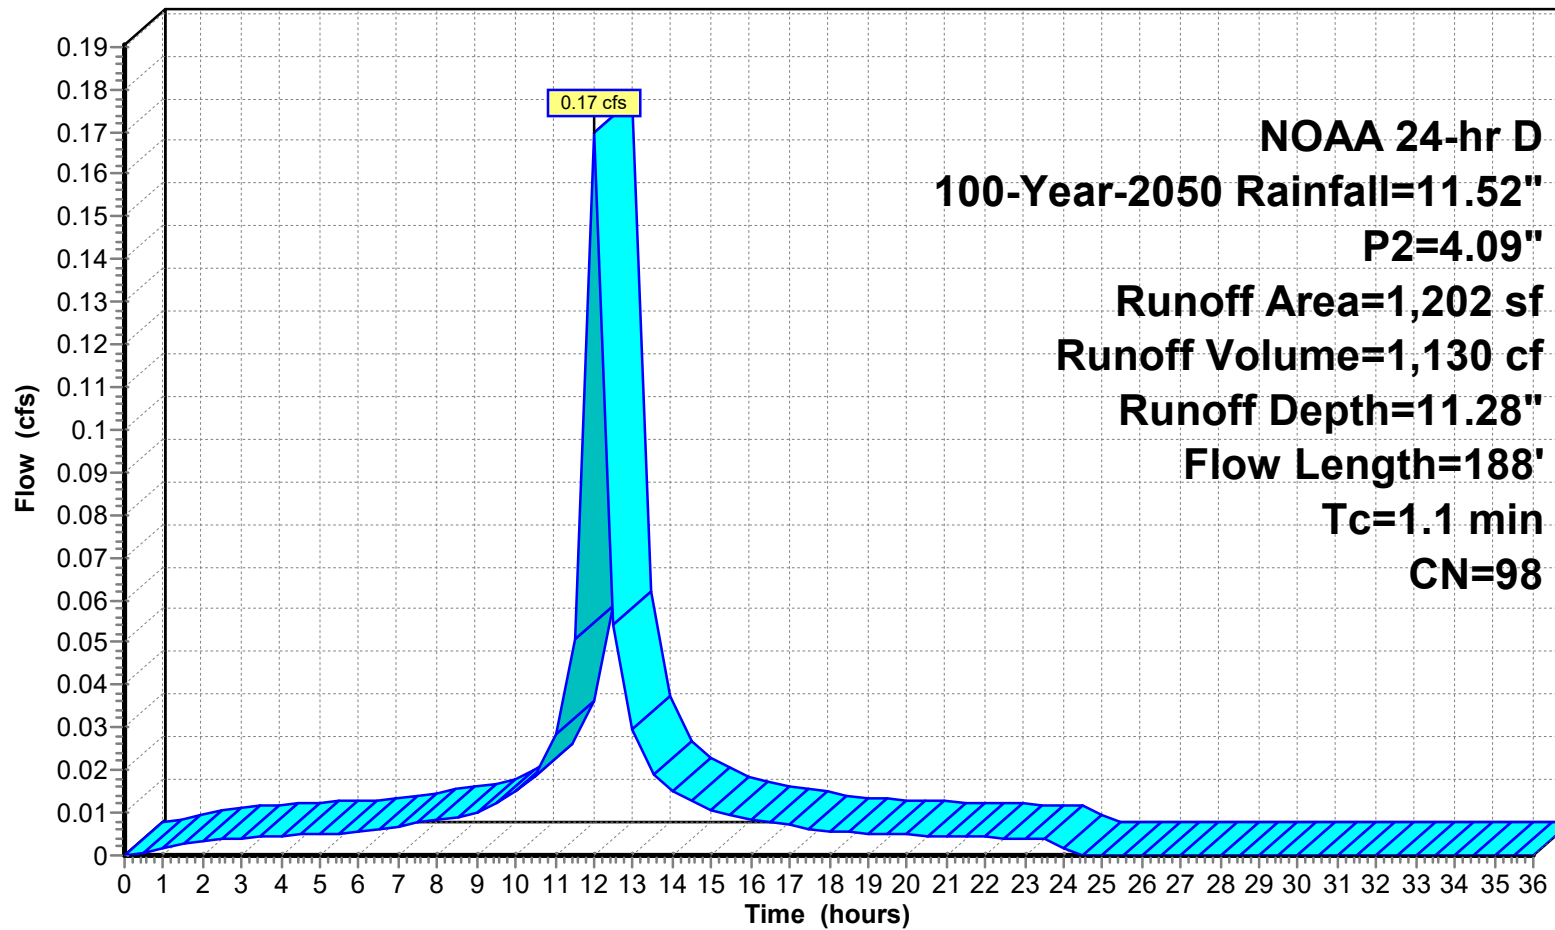

Runoff

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Prepared by Jarmel Kizel Architects & Engrs

Printed 1/28/2026

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Page 107

Summary for Subcatchment E2B-P: E2B PERVIOUS

Runoff = 0.15 cfs @ 12.03 hrs, Volume= 904 cf, Depth= 8.17"
 Routed to Link E-DP 2 : EXIST DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
1,329	74	>75% Grass cover, Good, HSG C
1,329		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0250	2.55		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 108

Subcatchment E2B-P: E2B PERVIOUS

Hydrograph

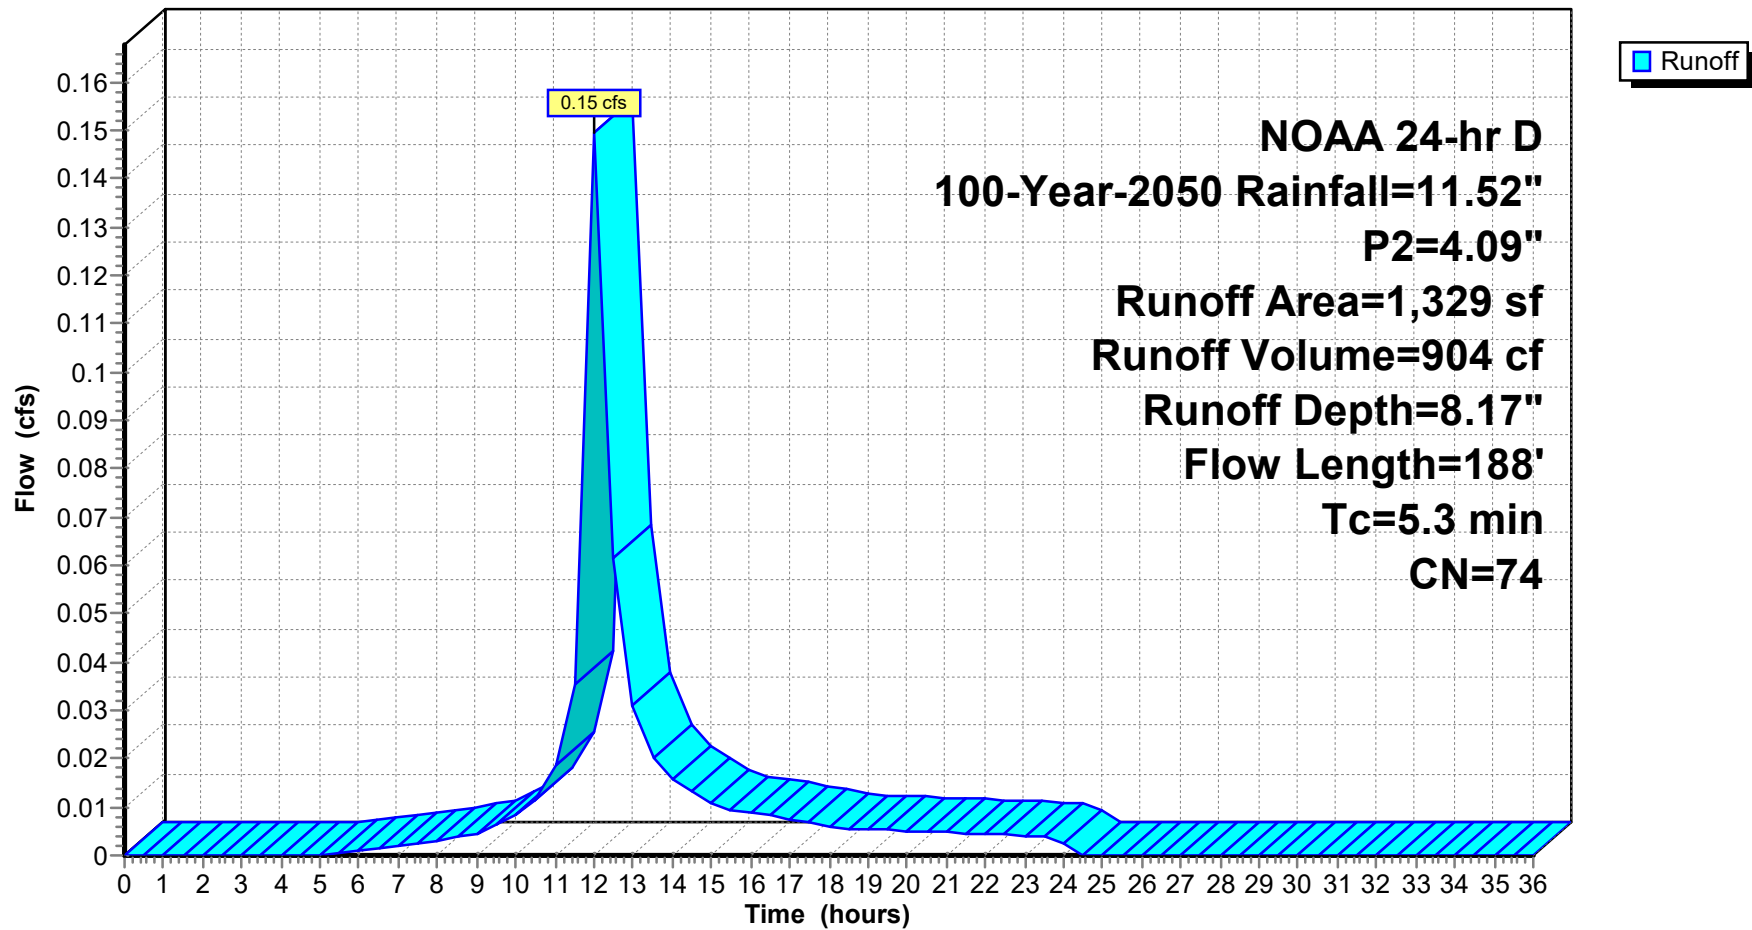

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 109


Summary for Link 8L: EXISTING DISTURBED

Inflow Area = 77,894 sf, 89.82% Impervious, Inflow Depth = 10.93" for 100-Year-2050 event
Inflow = 10.77 cfs @ 12.01 hrs, Volume= 70,971 cf
Primary = 10.77 cfs @ 12.01 hrs, Volume= 70,971 cf, Atten= 0%, Lag= 0.0 min
Routed to Link E-DP 1 : EXIST DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 8L: EXISTING DISTURBED

Hydrograph

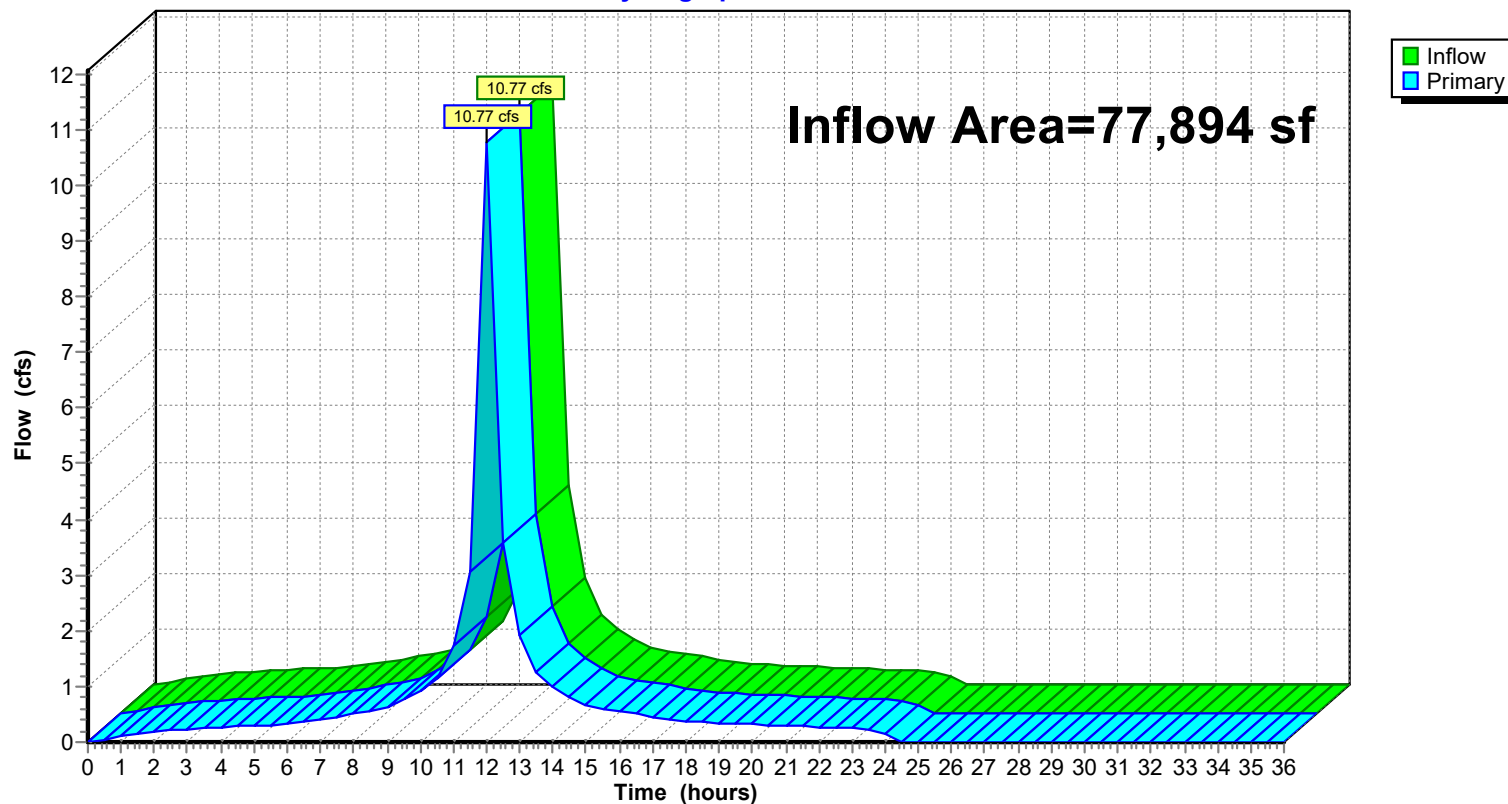

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 110

Summary for Link 9L: TOTAL EXISTING

Inflow Area = 133,334 sf, 63.85% Impervious, Inflow Depth = 10.01" for 100-Year-2050 event


Inflow = 16.35 cfs @ 12.03 hrs, Volume= 111,230 cf

Primary = 16.35 cfs @ 12.03 hrs, Volume= 111,230 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 9L: TOTAL EXISTING

Hydrograph

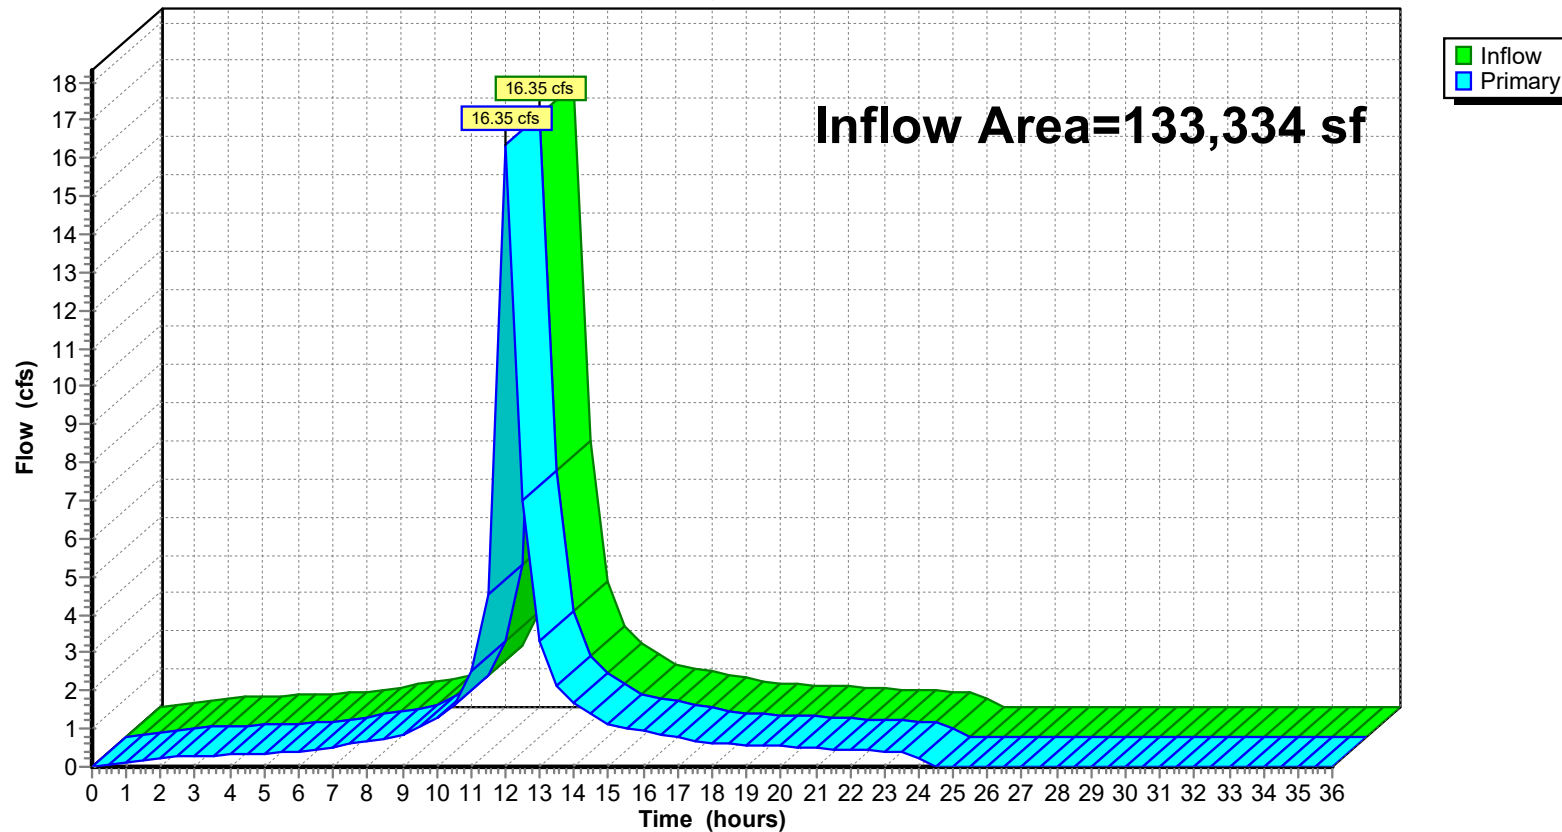

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 111


Summary for Link E-DP 1: EXIST DP 1

Inflow Area = 116,669 sf, 61.62% Impervious, Inflow Depth = 9.92" for 100-Year-2050 event
Inflow = 14.10 cfs @ 12.03 hrs, Volume= 96,456 cf
Primary = 14.10 cfs @ 12.03 hrs, Volume= 96,456 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link E-DP 1: EXIST DP 1

Hydrograph

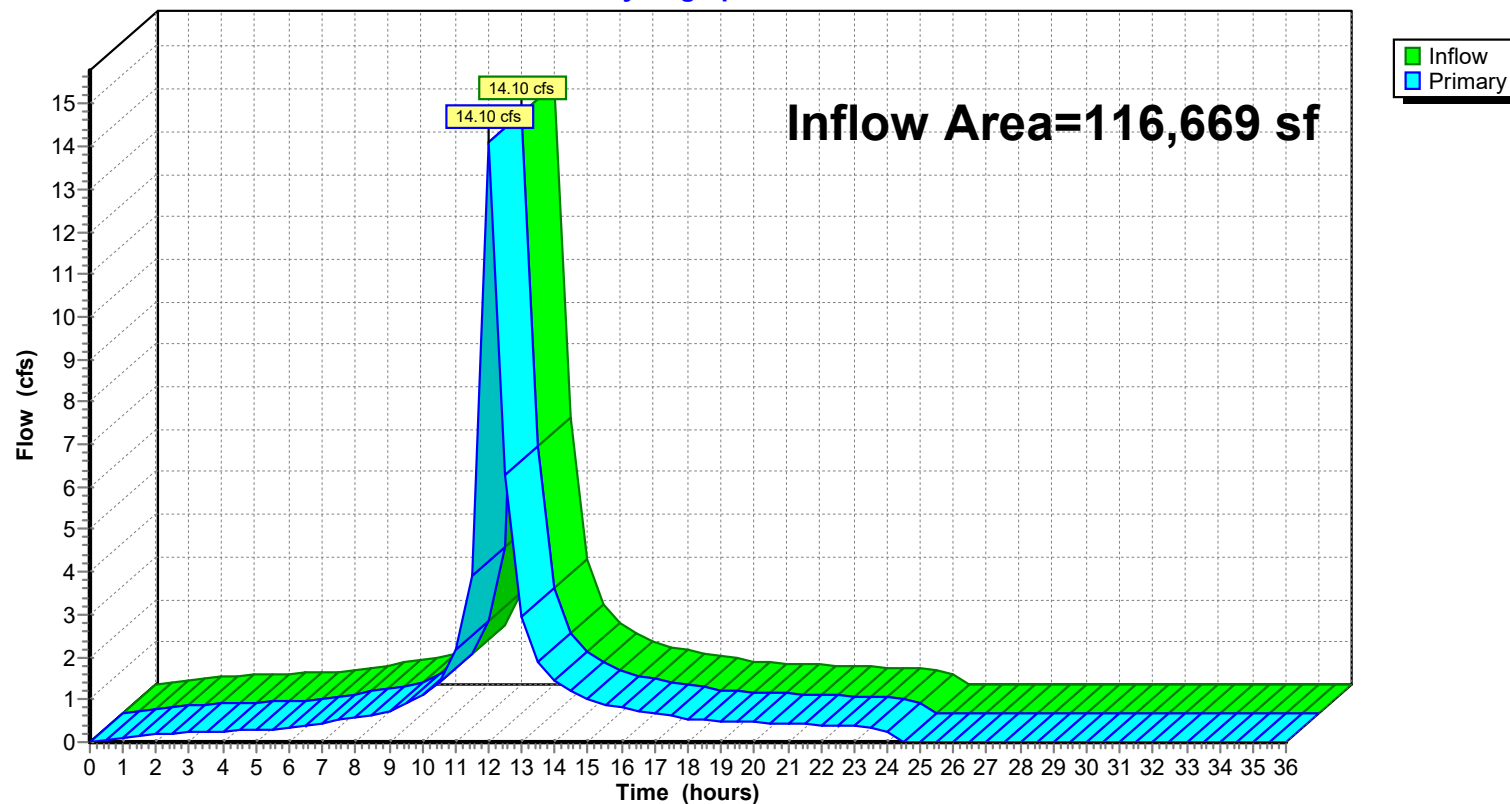

24-223 DRAINAGE DESIGN-EXISTING-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 112


Summary for Link E-DP 2: EXIST DP 2

Inflow Area = 16,665 sf, 79.43% Impervious, Inflow Depth = 10.64" for 100-Year-2050 event
Inflow = 2.26 cfs @ 12.01 hrs, Volume= 14,774 cf
Primary = 2.26 cfs @ 12.01 hrs, Volume= 14,774 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 9L : TOTAL EXISTING

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs




Link E-DP 2: EXIST DP 2

Hydrograph

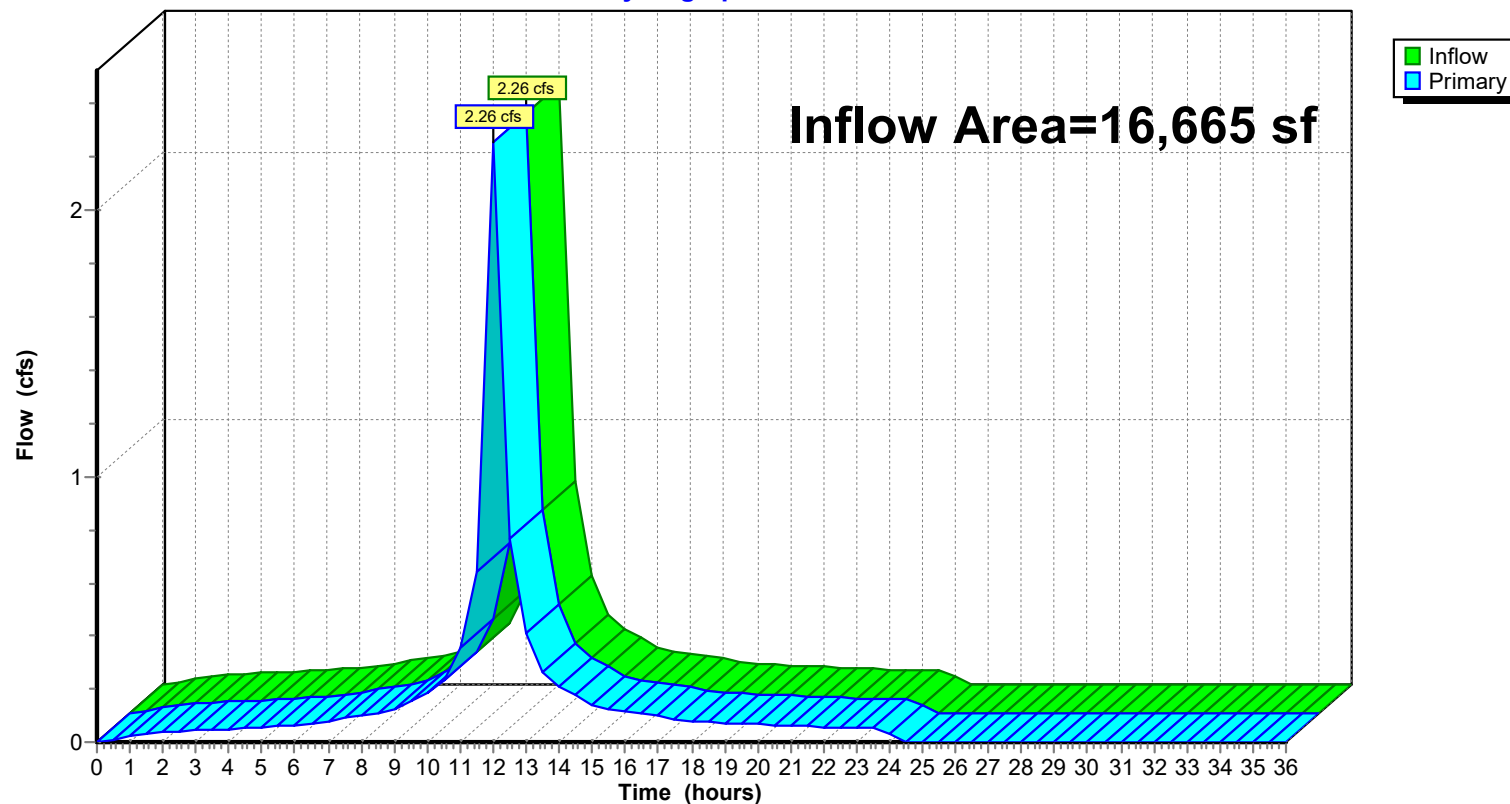

APPENDIX B

PROPOSED DRAINAGE CALCULATIONS

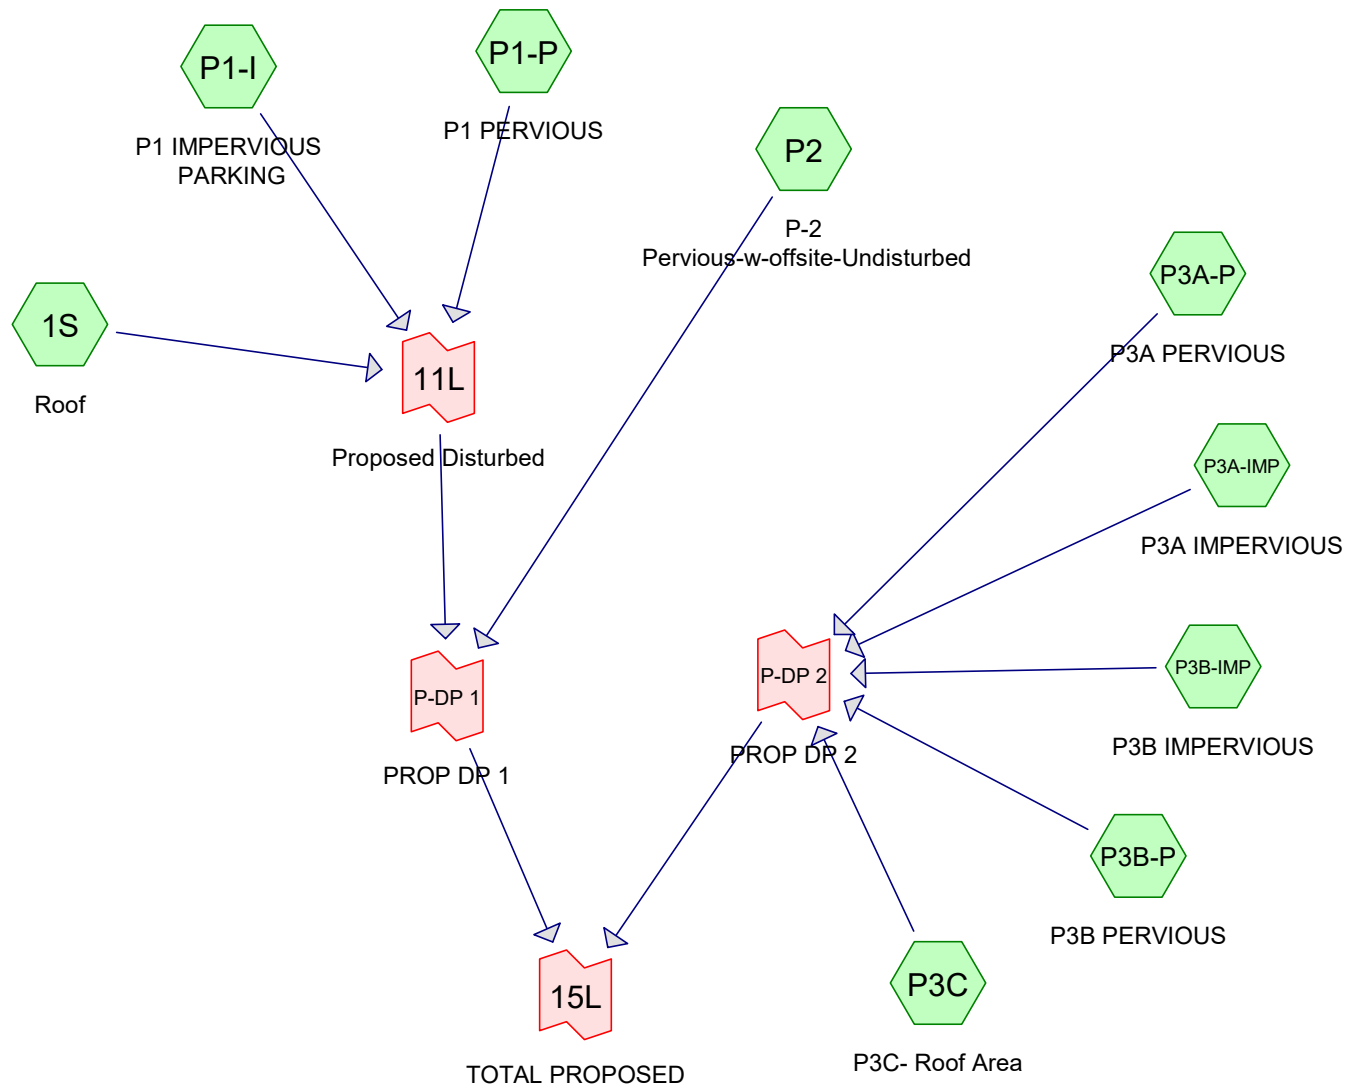

Routing Diagram for 24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnrs, Printed 1/28/2026
HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
16,526	74	>75% Grass cover, Good, HSG C (P1-P, P3A-P, P3B-P)
1,240	74	>75% Grass offsite (P2)
4,040	98	DRIVE/SIDEWALK (P3A-IMP)
1,220	98	Impervious (P2)
1,506	71	Meadow, non-grazed, HSG C (P2)
53,037	98	Roof and Amenity Area (1S, P3C)
2,744	98	Roof-offsite (P2)
980	98	SIDEWALK AREA (P3B-IMP)
19,976	98	Uncovered Paved parking, HSG C (P1-I)
32,065	70	wooded (P2)

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 3

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
0	HSG B	
38,008	HSG C	P1-I, P1-P, P2, P3A-P, P3B-P
0	HSG D	
95,326	Other	1S, P2, P3A-IMP, P3B-IMP, P3C

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Printed 1/28/2026

Page 4

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Subcatchment Numbers
0	0	16,526	0	0	16,526	>75% Grass cover, Good	P1-P, P3A-P, P3B-P
0	0	0	0	1,240	1,240	>75% Grass offsite	P2
0	0	0	0	4,040	4,040	DRIVE/SIDEWALK	P3A-IMP
0	0	0	0	1,220	1,220	Impervious	P2
0	0	1,506	0	0	1,506	Meadow, non-grazed	P2
0	0	0	0	53,037	53,037	Roof and Amenity Area	1S, P3C
0	0	0	0	2,744	2,744	Roof-offsite	P2
0	0	0	0	980	980	SIDEWALK AREA	P3B-IMP
0	0	19,976	0	0	19,976	Uncovered Paved parking	P1-I
0	0	0	0	32,065	32,065	wooded	P2

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 5

Summary for Subcatchment 1S: Roof

Runoff = 2.04 cfs @ 12.01 hrs, Volume= 13,091 cf, Depth= 3.24"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	53	0.0200	1.26		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.5	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 6

Subcatchment 1S: Roof

Hydrograph

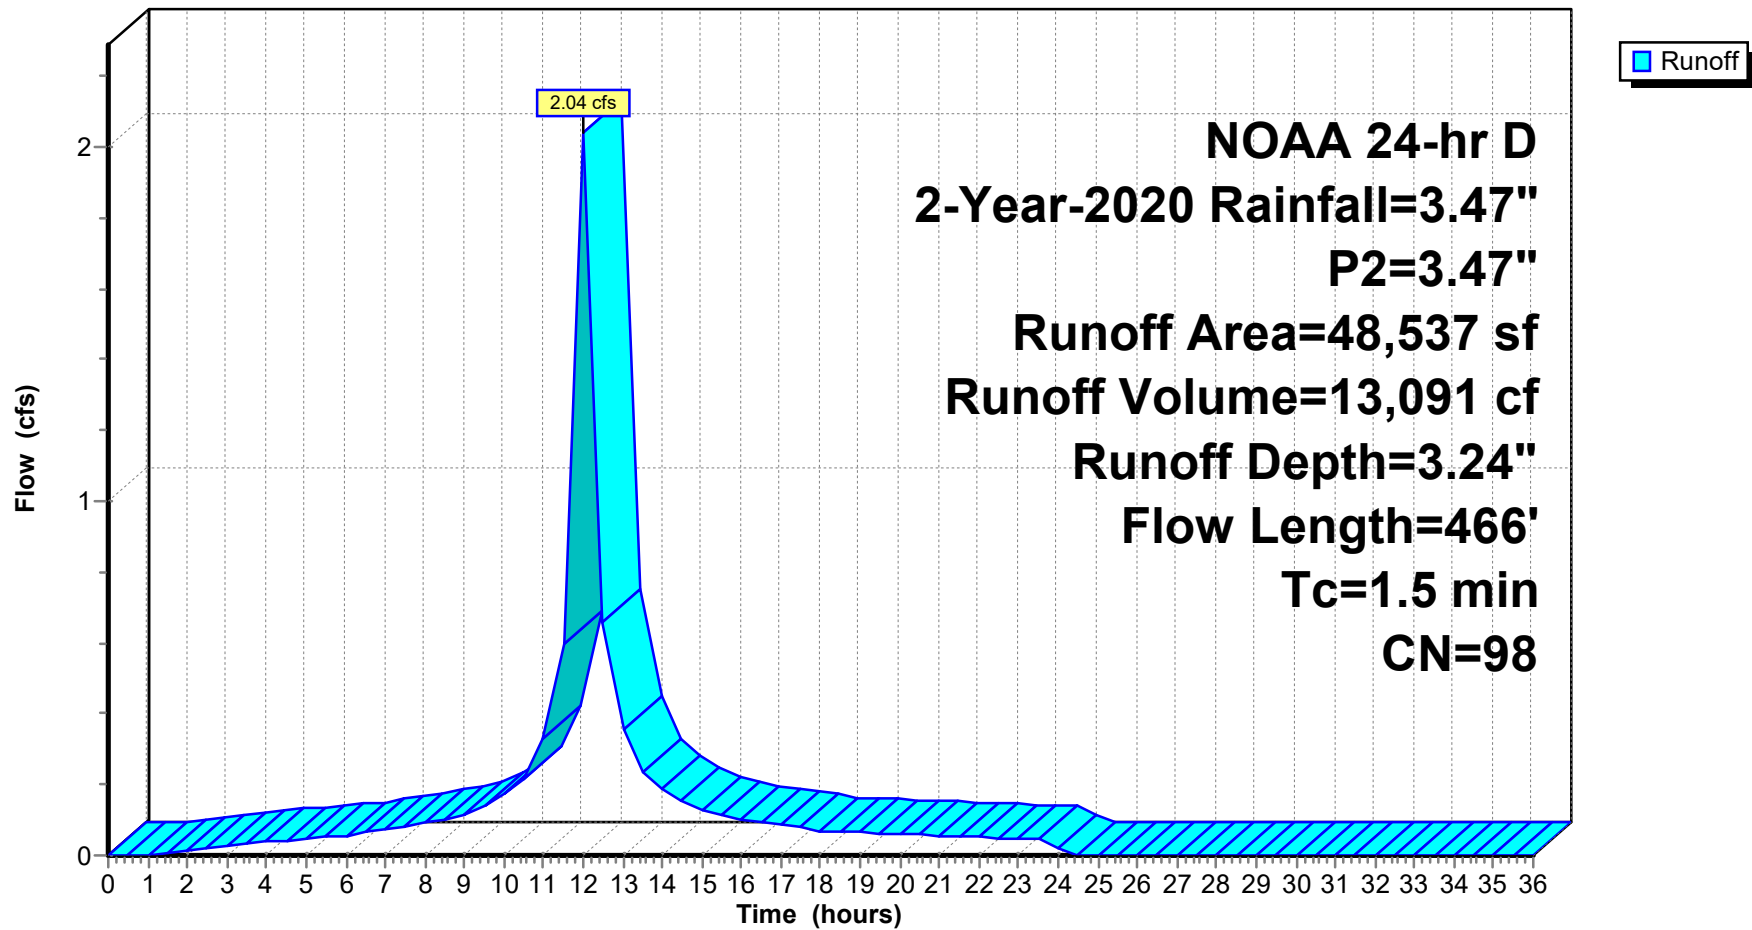

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 7

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 0.84 cfs @ 12.01 hrs, Volume= 5,388 cf, Depth= 3.24"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0150	1.12		Sheet Flow, sheet flow Parking area n= 0.013 P2= 3.47"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.7	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 8

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

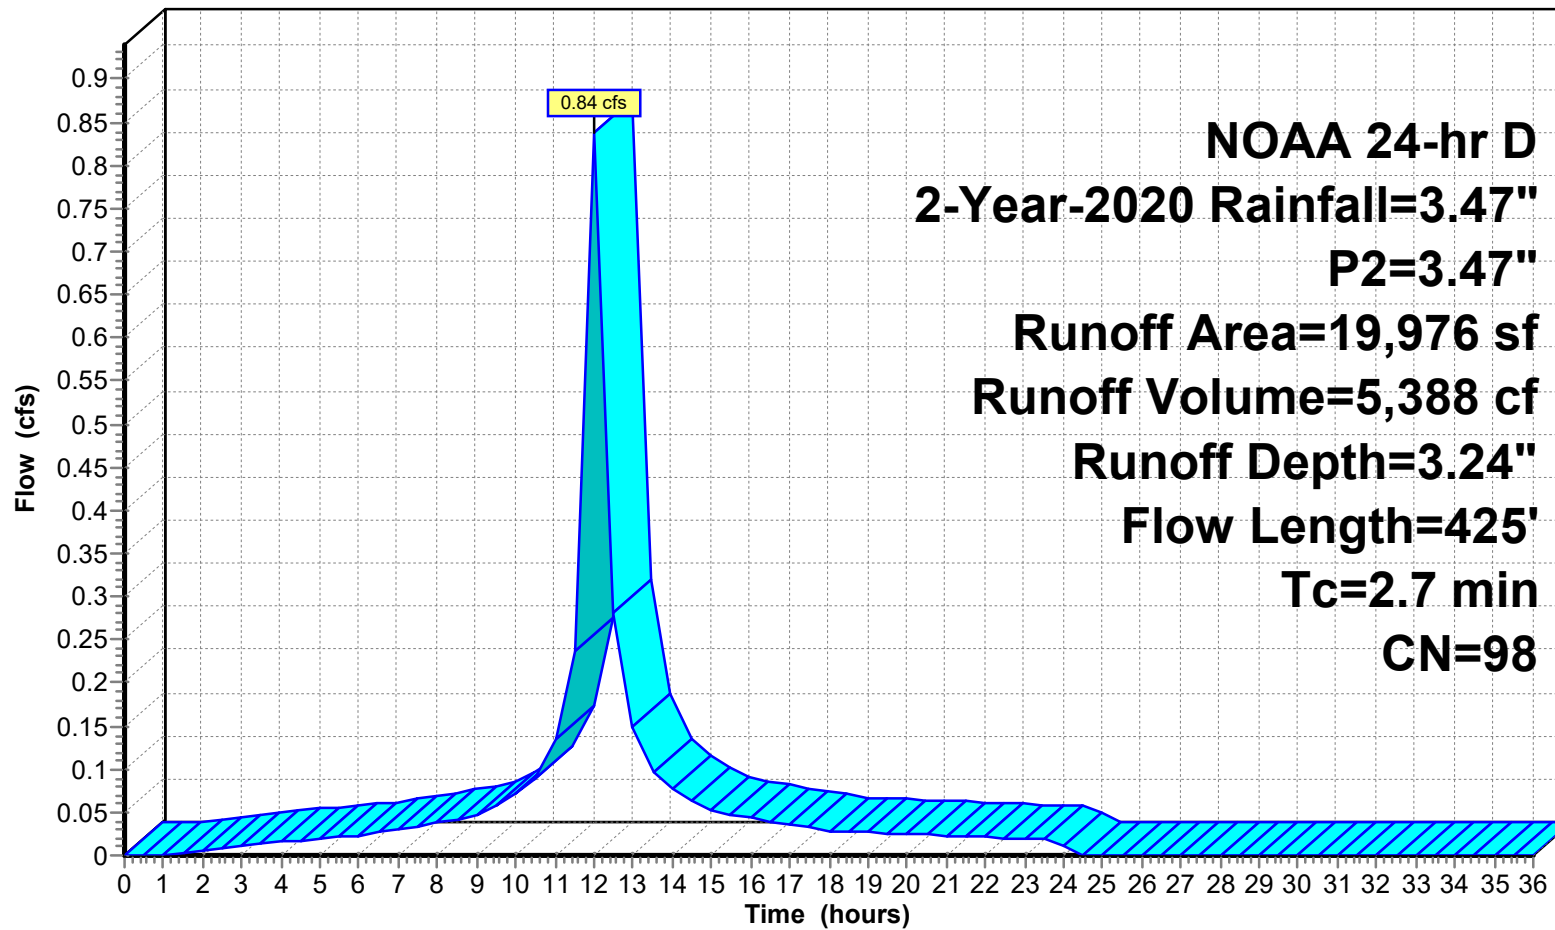

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 9

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.12 cfs @ 12.17 hrs, Volume= 886 cf, Depth= 1.22"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.0430	0.17		Sheet Flow, Grass: Dense n= 0.240 P2= 3.47"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
10.4	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 10

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

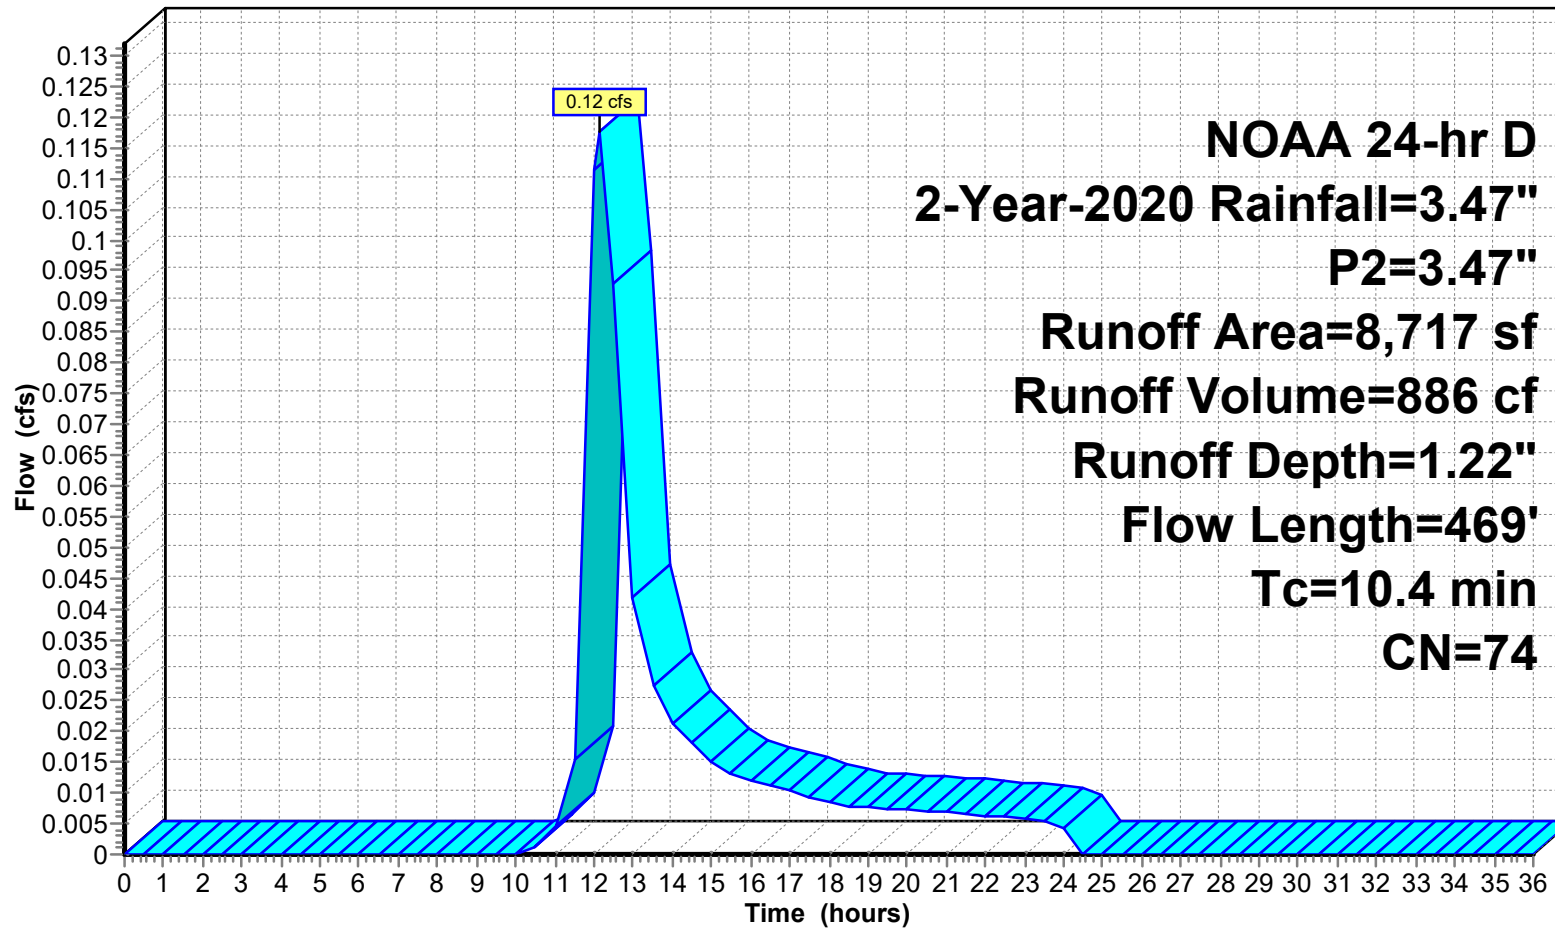

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 11

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 0.47 cfs @ 12.37 hrs, Volume= 3,747 cf, Depth= 1.16"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
14.0	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 12

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

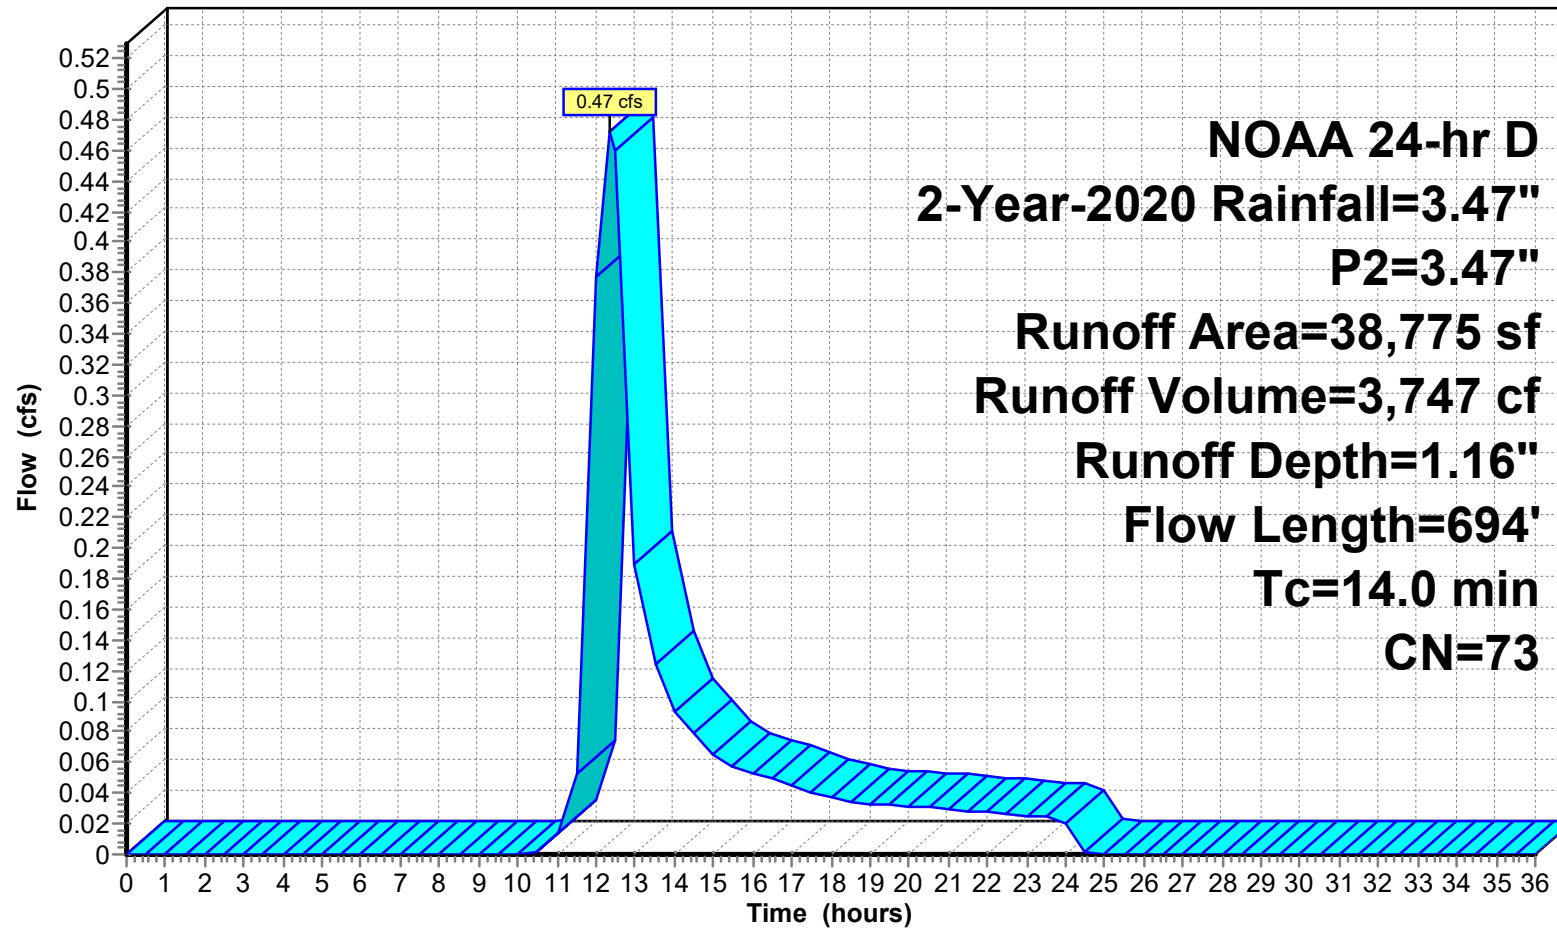

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 13

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.17 cfs @ 12.01 hrs, Volume= 1,090 cf, Depth= 3.24"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
* 4,040	98	DRIVE/SIDEWALK
4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0500	2.07		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 14

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

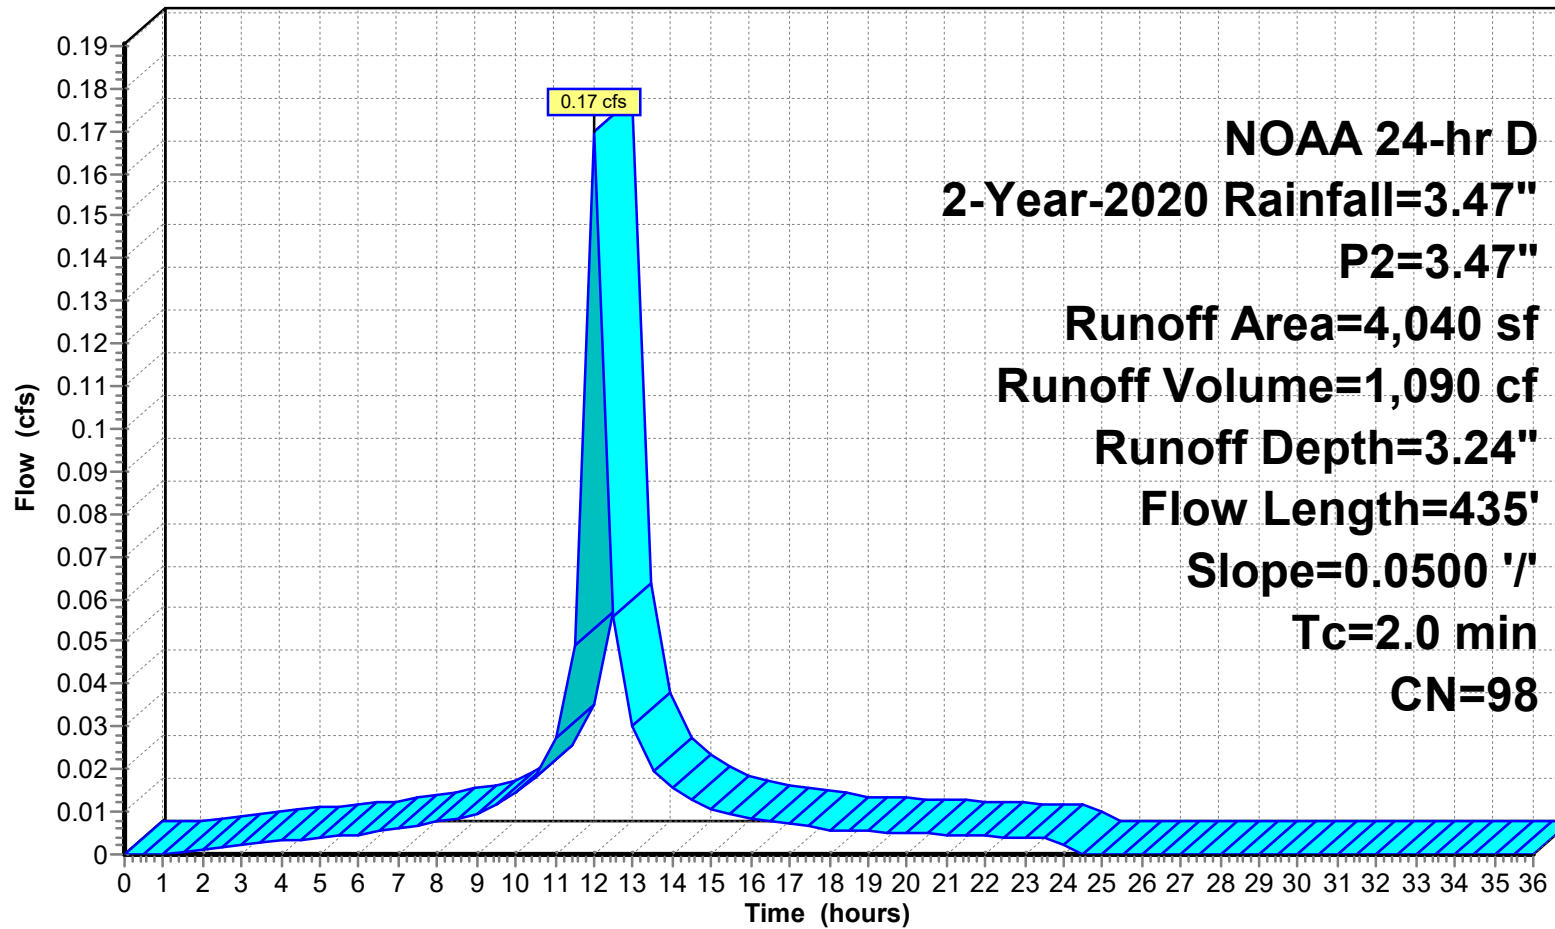

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 15

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.09 cfs @ 12.08 hrs, Volume= 602 cf, Depth= 1.22"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 16

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

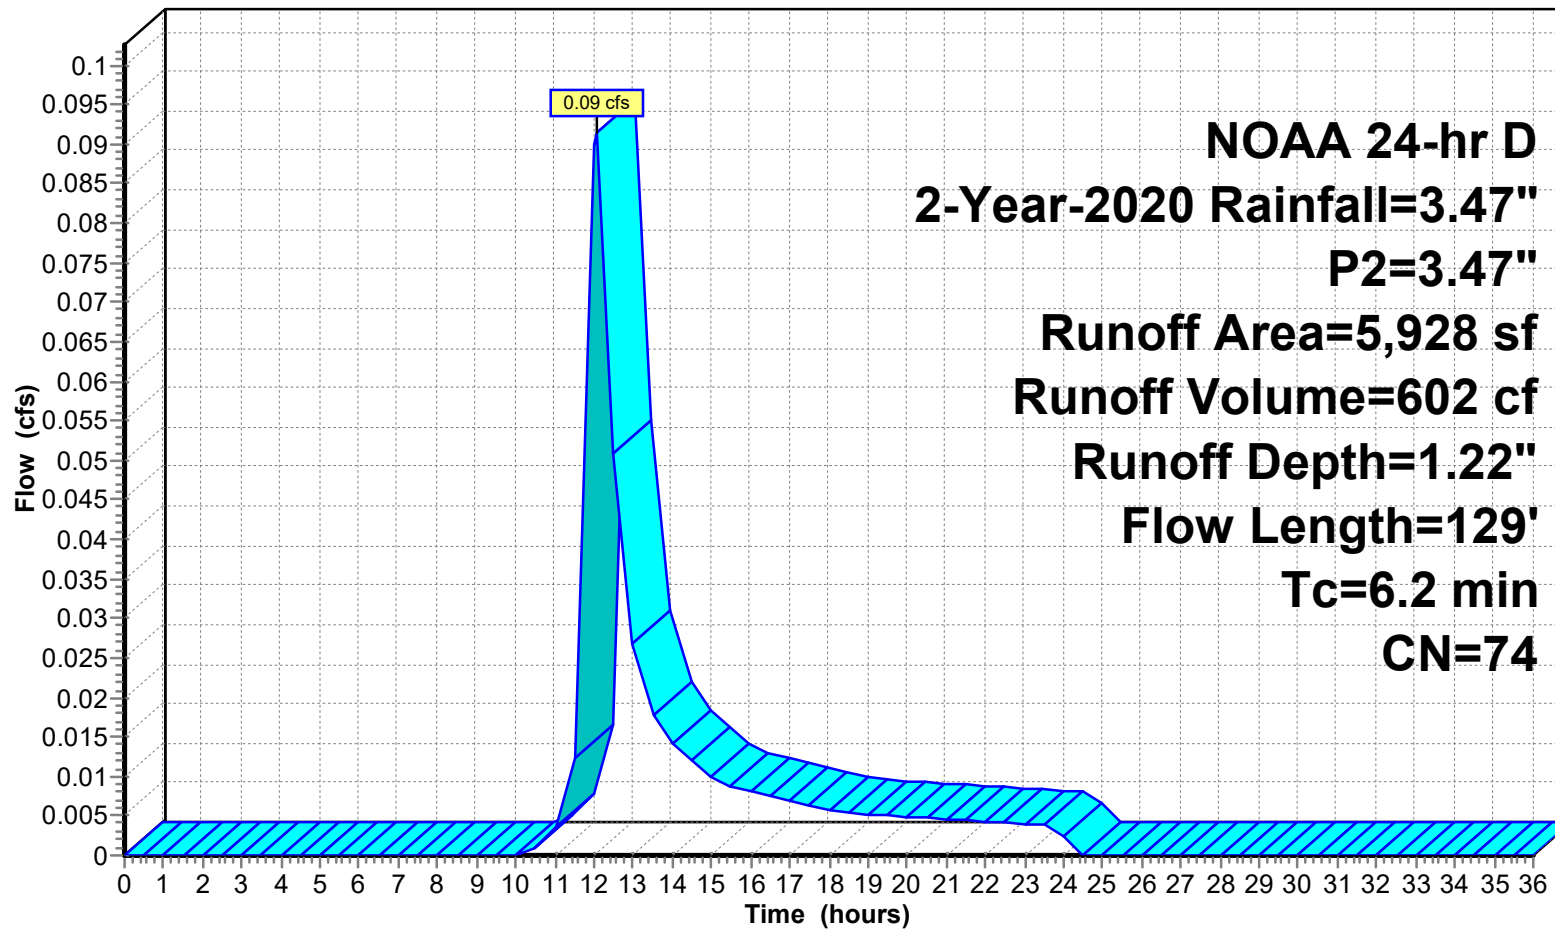

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 17

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.04 cfs @ 12.00 hrs, Volume= 264 cf, Depth= 3.24"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 18

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

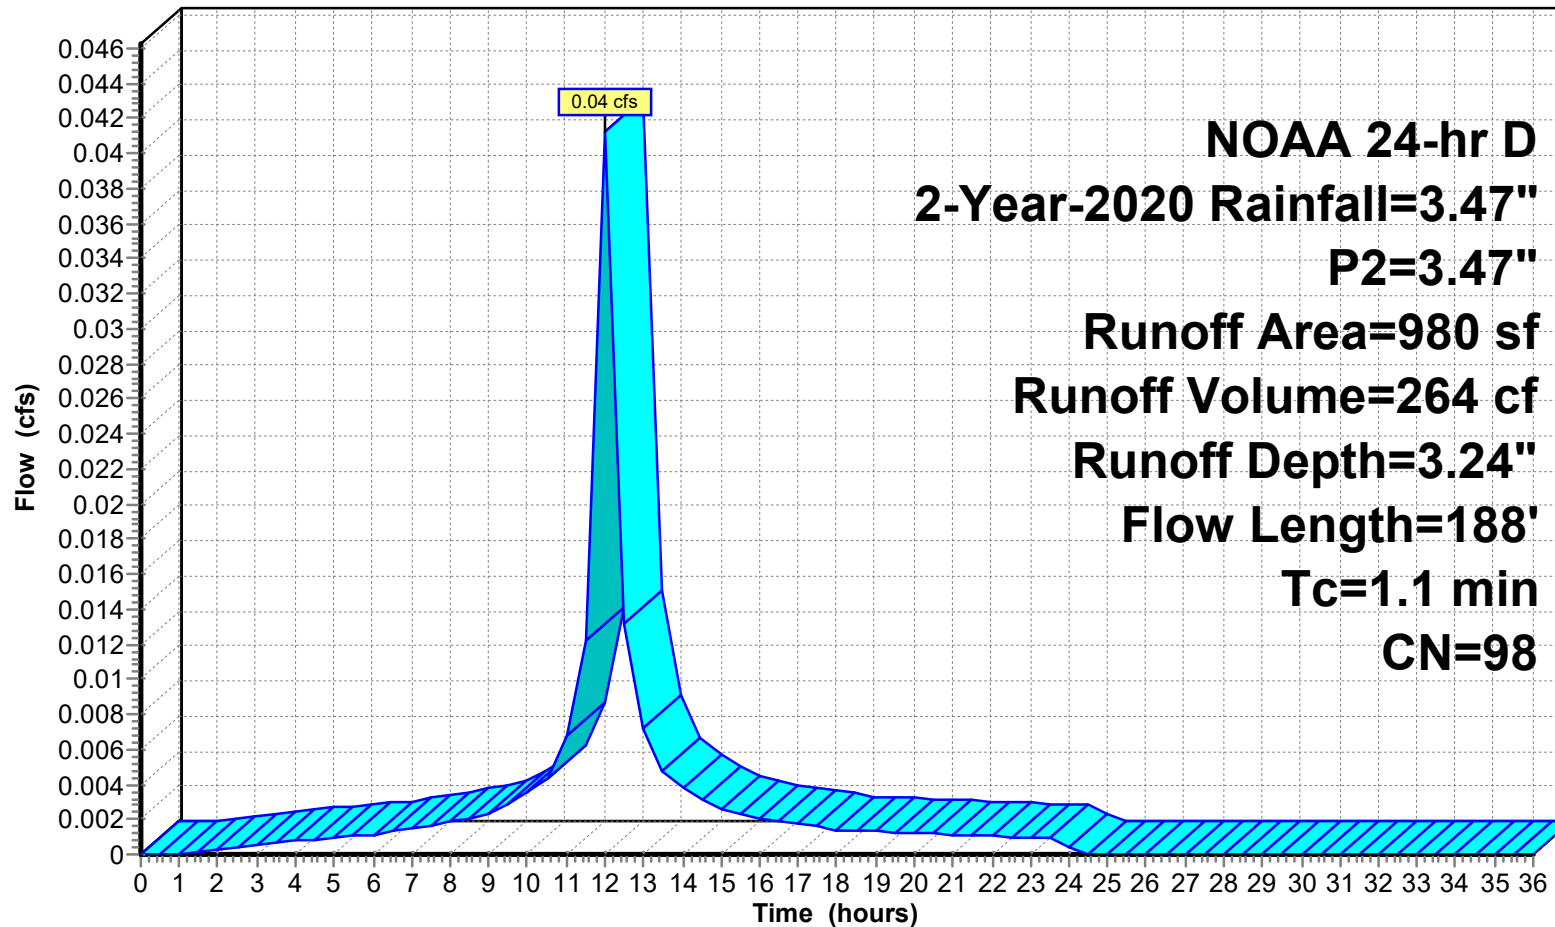

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 19

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.03 cfs @ 12.08 hrs, Volume= 191 cf, Depth= 1.22"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 20

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

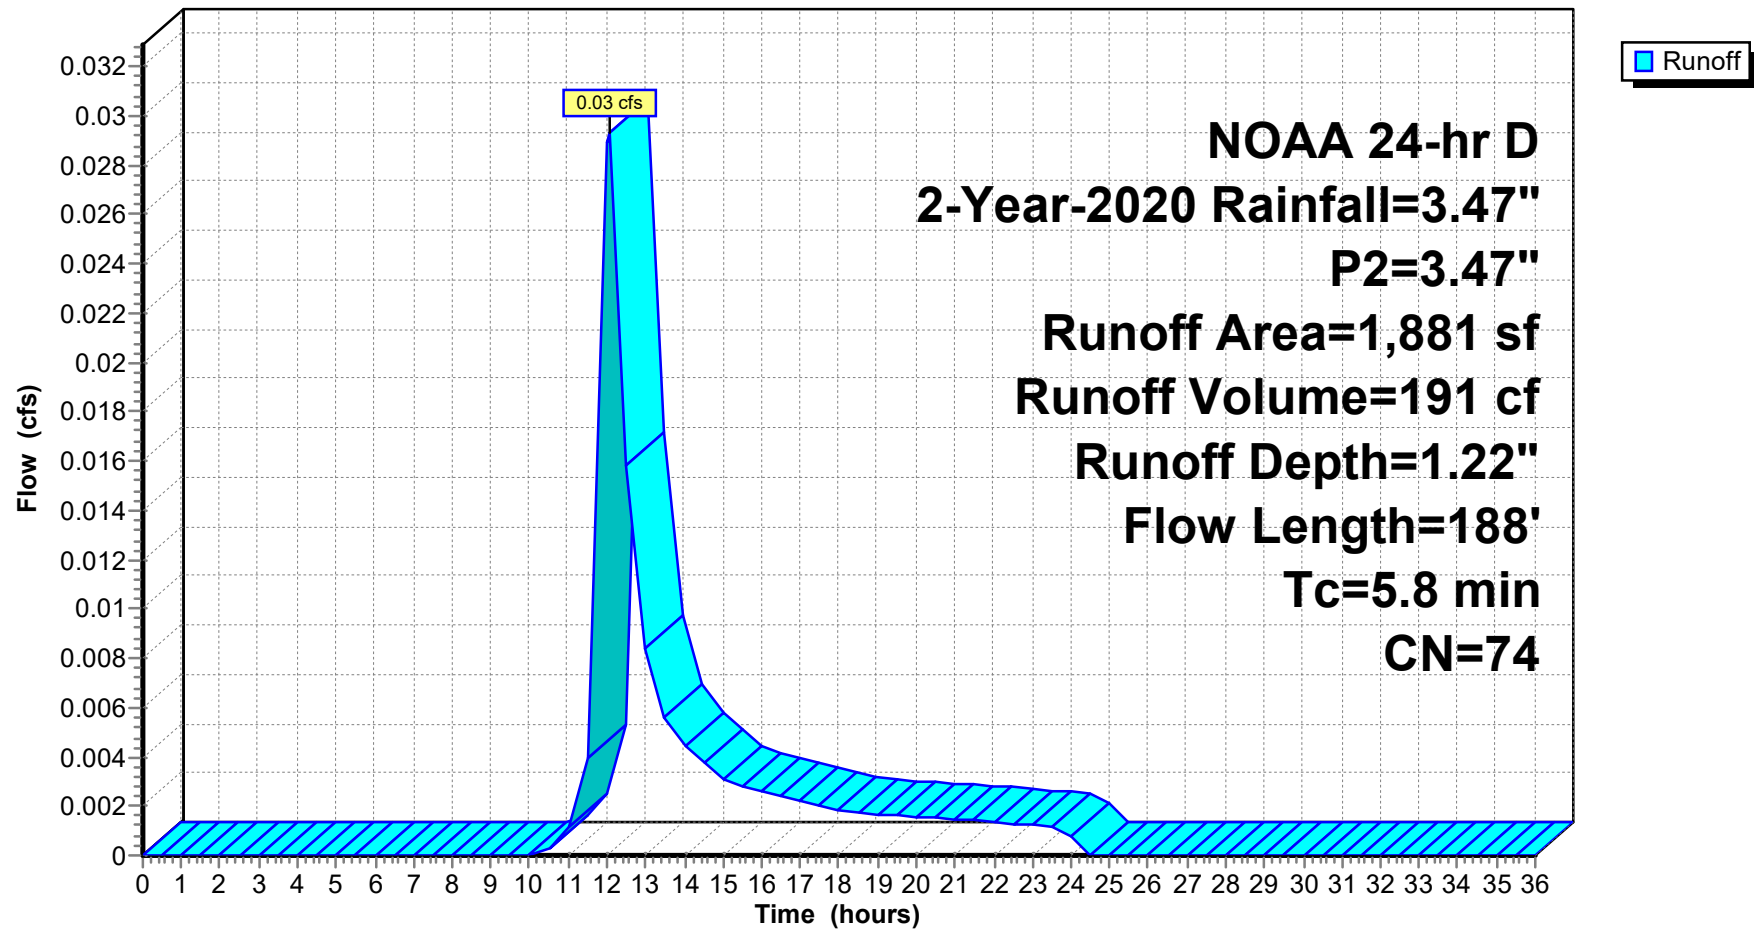

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 21

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.19 cfs @ 12.00 hrs, Volume= 1,214 cf, Depth= 3.24"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

	Area (sf)	CN	Description		
*	4,500	98	Roof and Amenity Area		
	4,500		100.00% Impervious Area		
Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	52	0.0100	0.95		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.1	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 22

Subcatchment P3C: P3C- Roof Area

Hydrograph

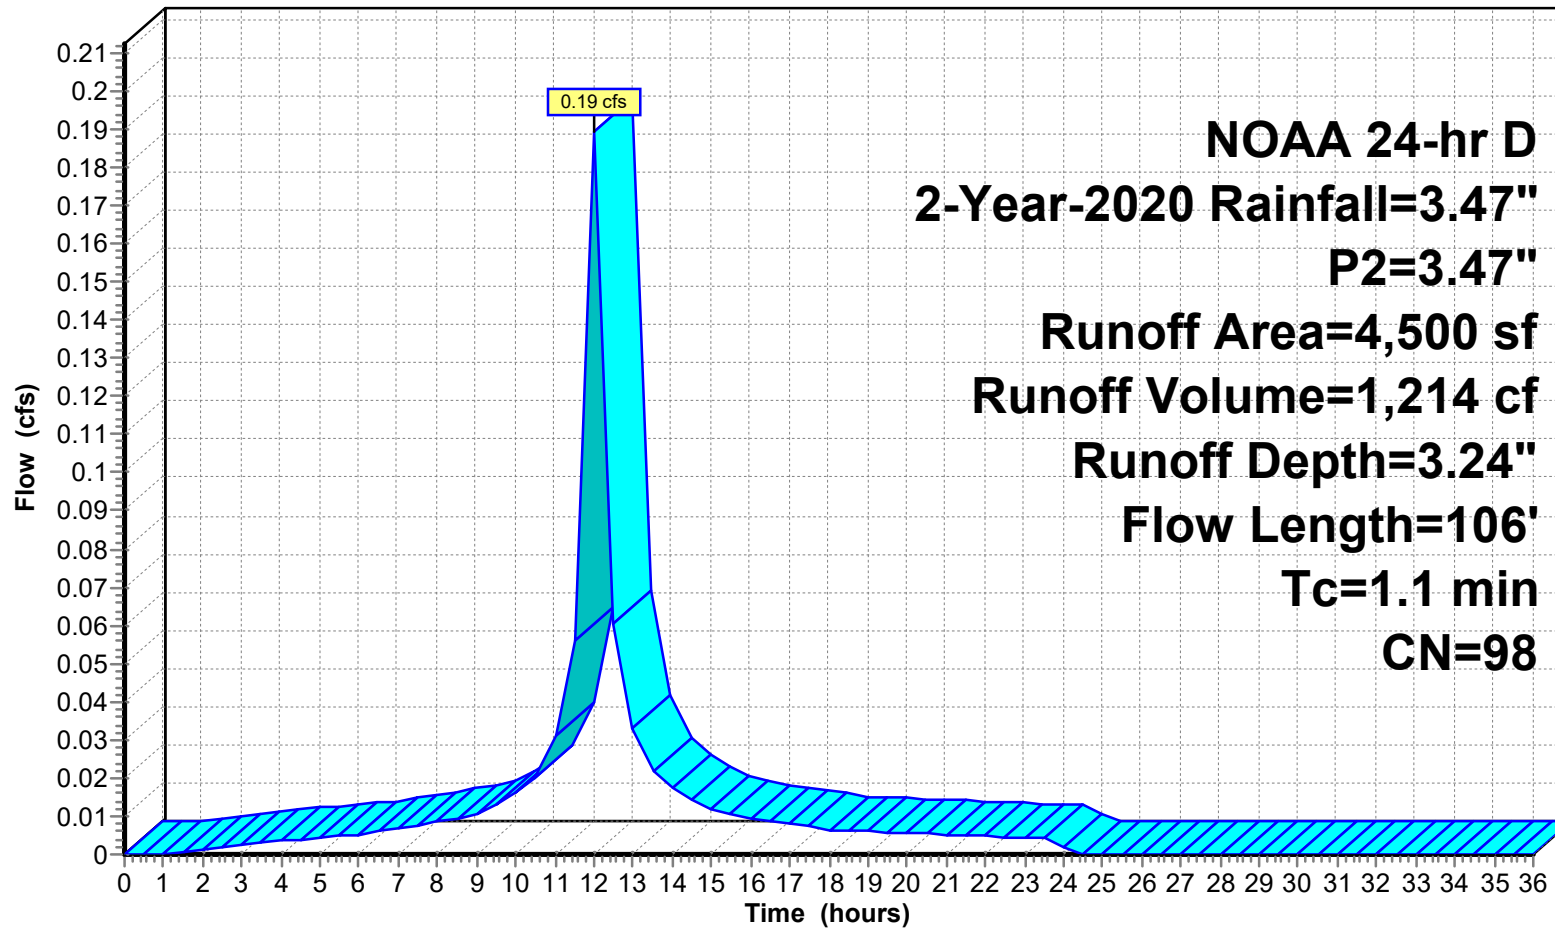

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 23


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 3.01" for 2-Year-2020 event
Inflow = 3.00 cfs @ 12.01 hrs, Volume= 19,365 cf
Primary = 3.00 cfs @ 12.01 hrs, Volume= 19,365 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

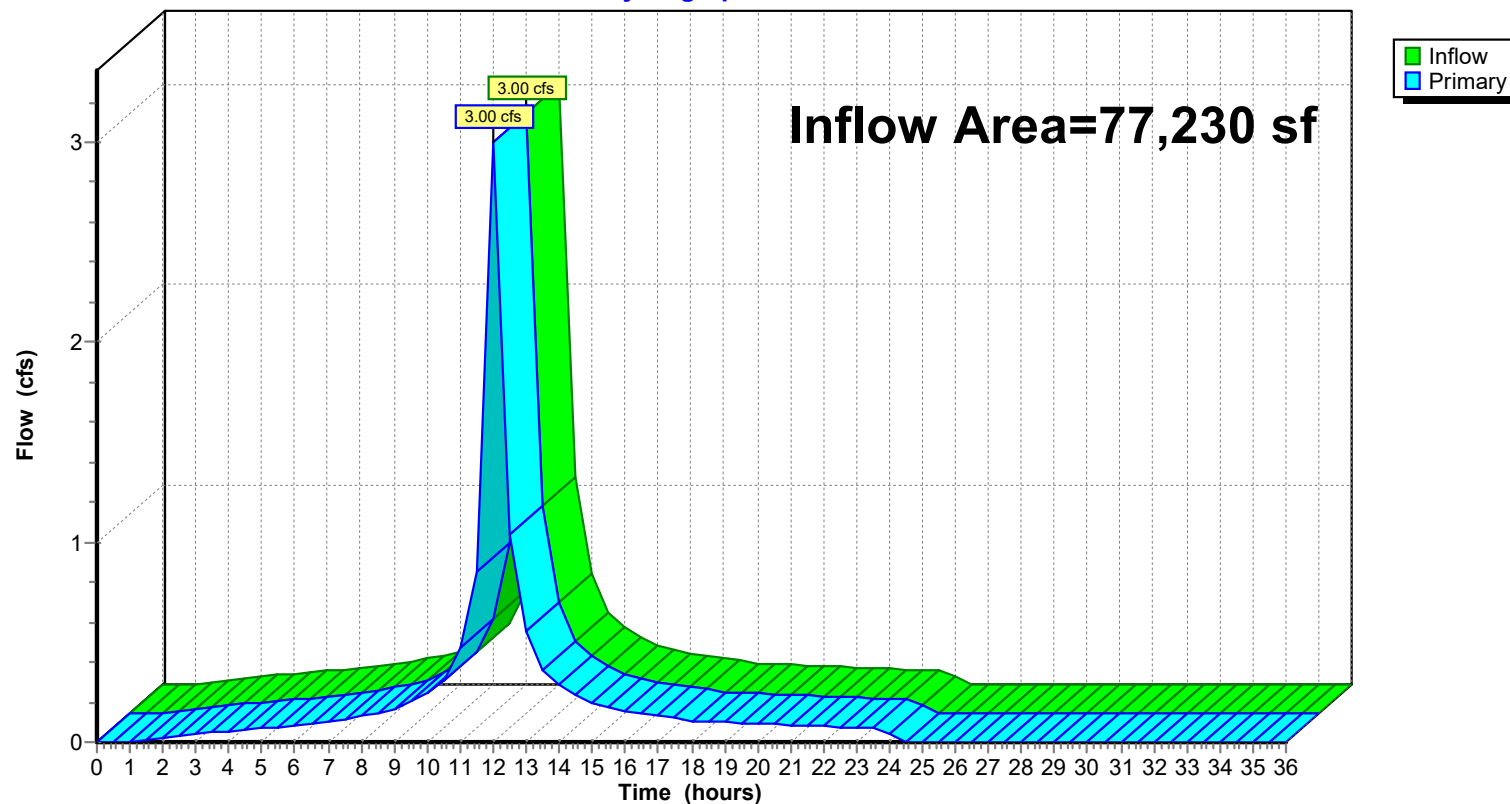

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 24


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 2.38" for 2-Year-2020 event
Inflow = 3.90 cfs @ 12.03 hrs, Volume= 26,472 cf
Primary = 3.90 cfs @ 12.03 hrs, Volume= 26,472 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

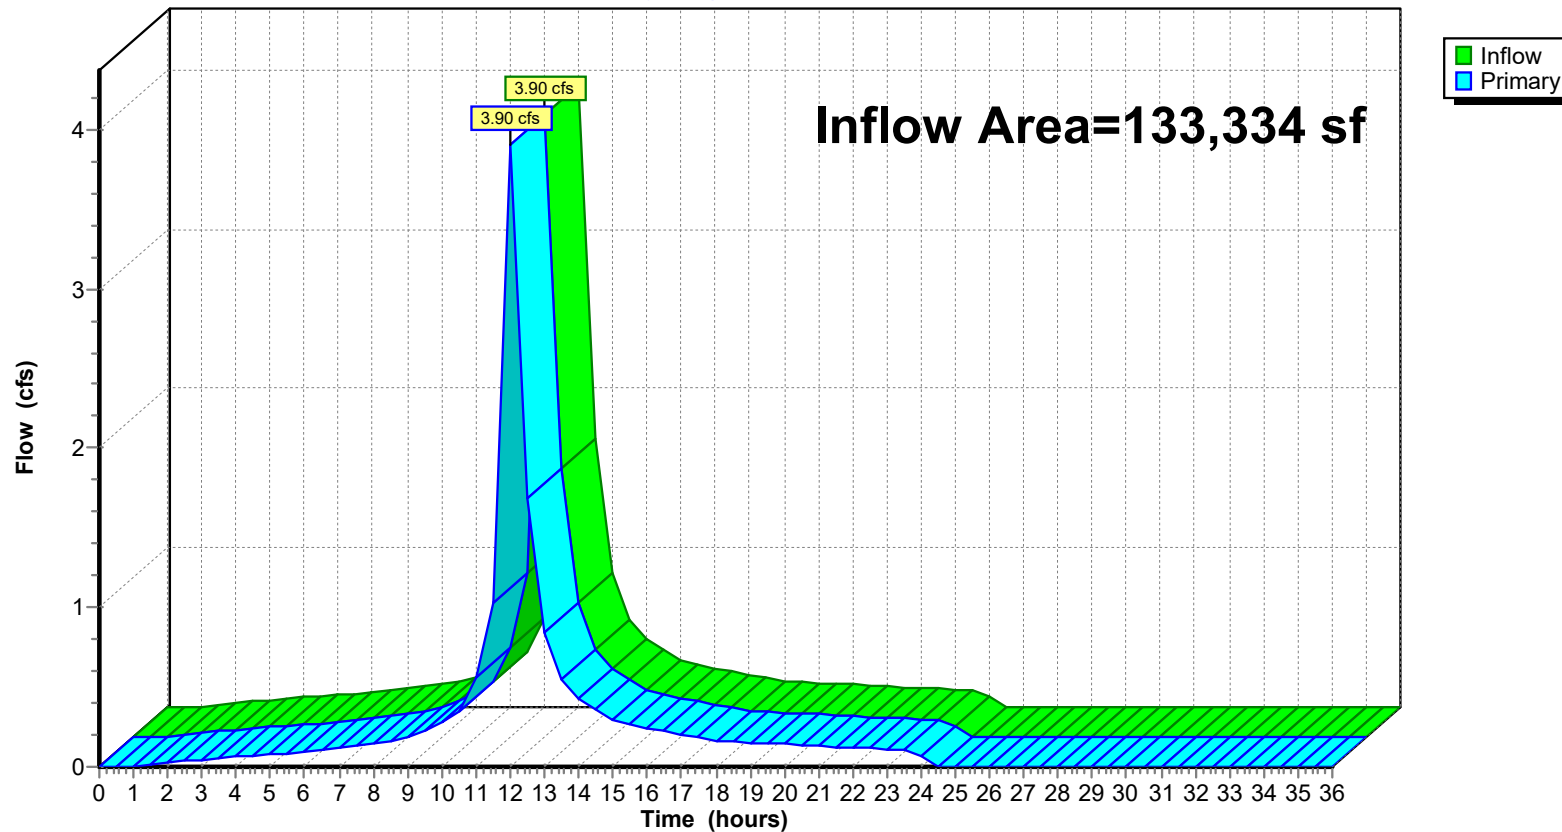

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 25


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 2.39" for 2-Year-2020 event
Inflow = 3.38 cfs @ 12.03 hrs, Volume= 23,111 cf
Primary = 3.38 cfs @ 12.03 hrs, Volume= 23,111 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

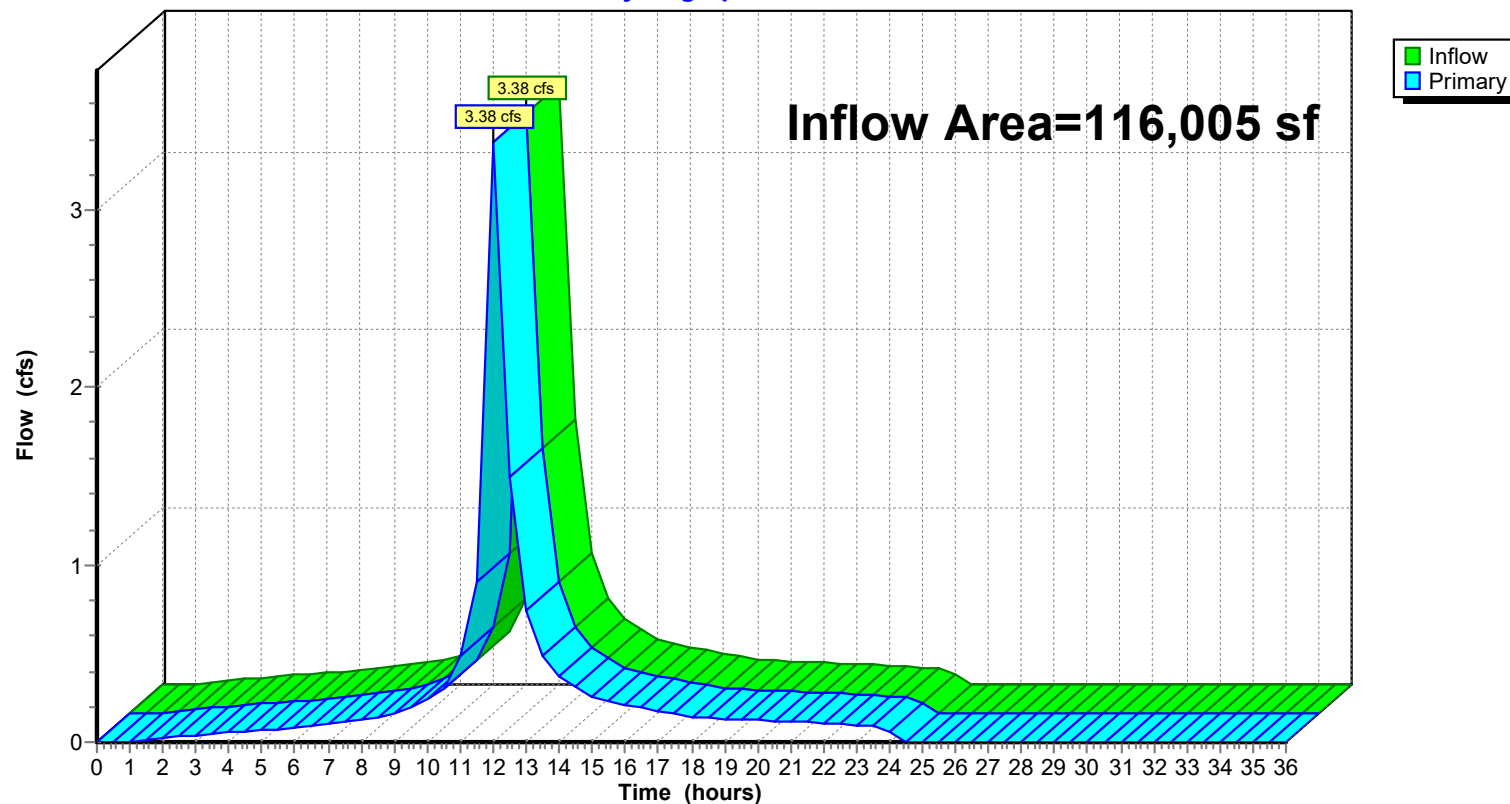

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2020 Rainfall=3.47", P2=3.47"

Printed 1/28/2026

Page 26


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 2.33" for 2-Year-2020 event
Inflow = 0.52 cfs @ 12.02 hrs, Volume= 3,361 cf
Primary = 0.52 cfs @ 12.02 hrs, Volume= 3,361 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2

Hydrograph

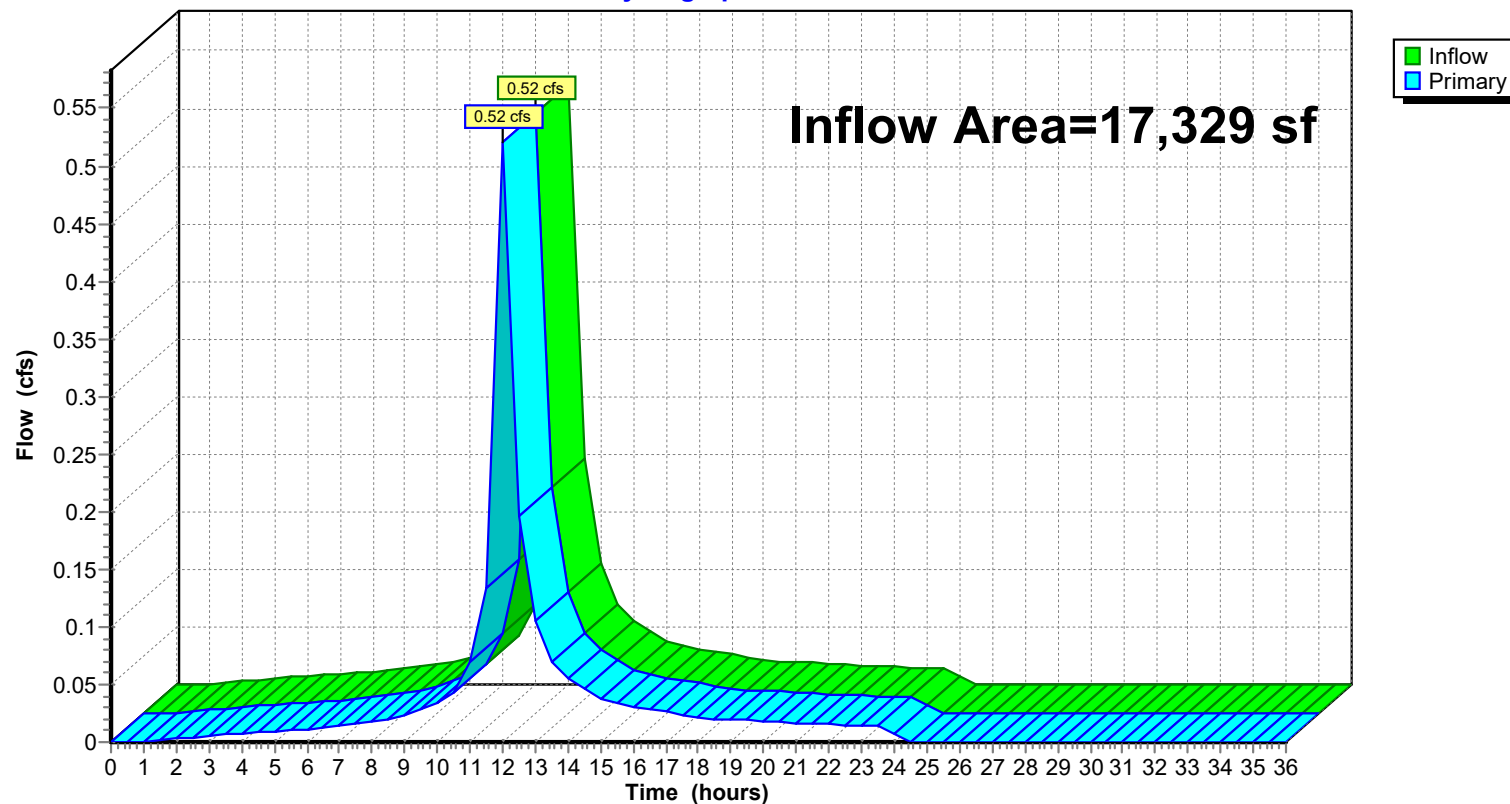

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 27

Summary for Subcatchment 1S: Roof

Runoff = 3.19 cfs @ 12.01 hrs, Volume= 20,801 cf, Depth= 5.14"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	53	0.0200	1.26		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.5	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 28

Subcatchment 1S: Roof

Hydrograph

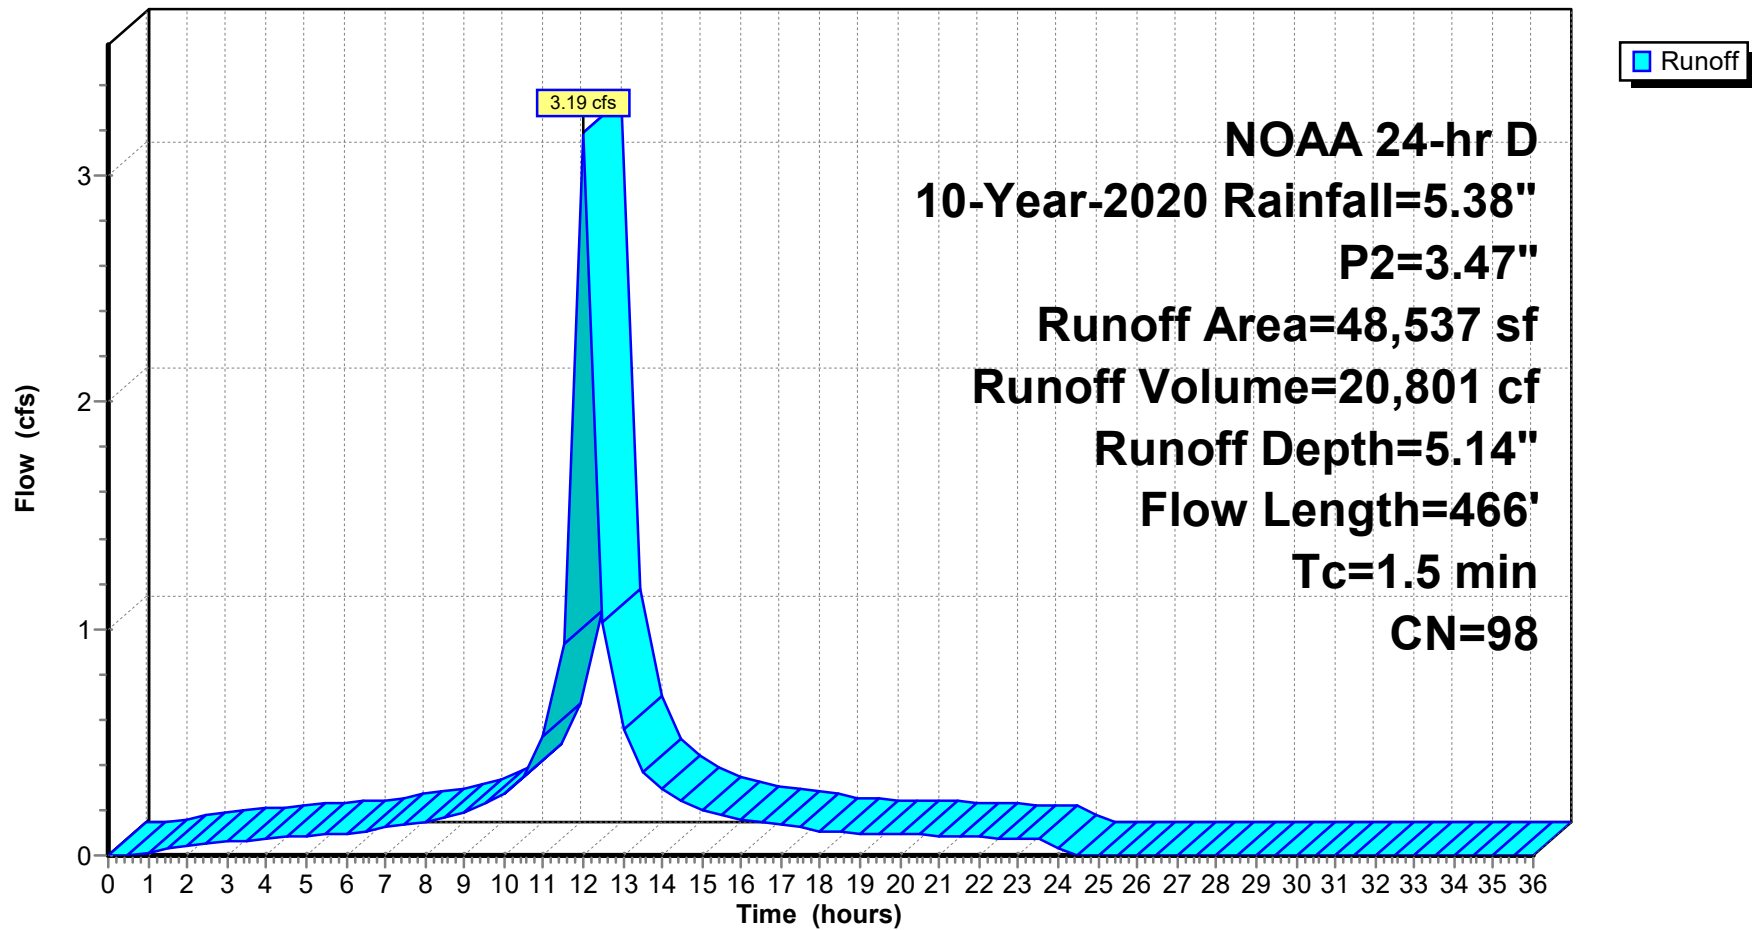

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 29

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 1.31 cfs @ 12.01 hrs, Volume= 8,561 cf, Depth= 5.14"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0150	1.12		Sheet Flow, sheet flow Parking area n= 0.013 P2= 3.47"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.7	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 30

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

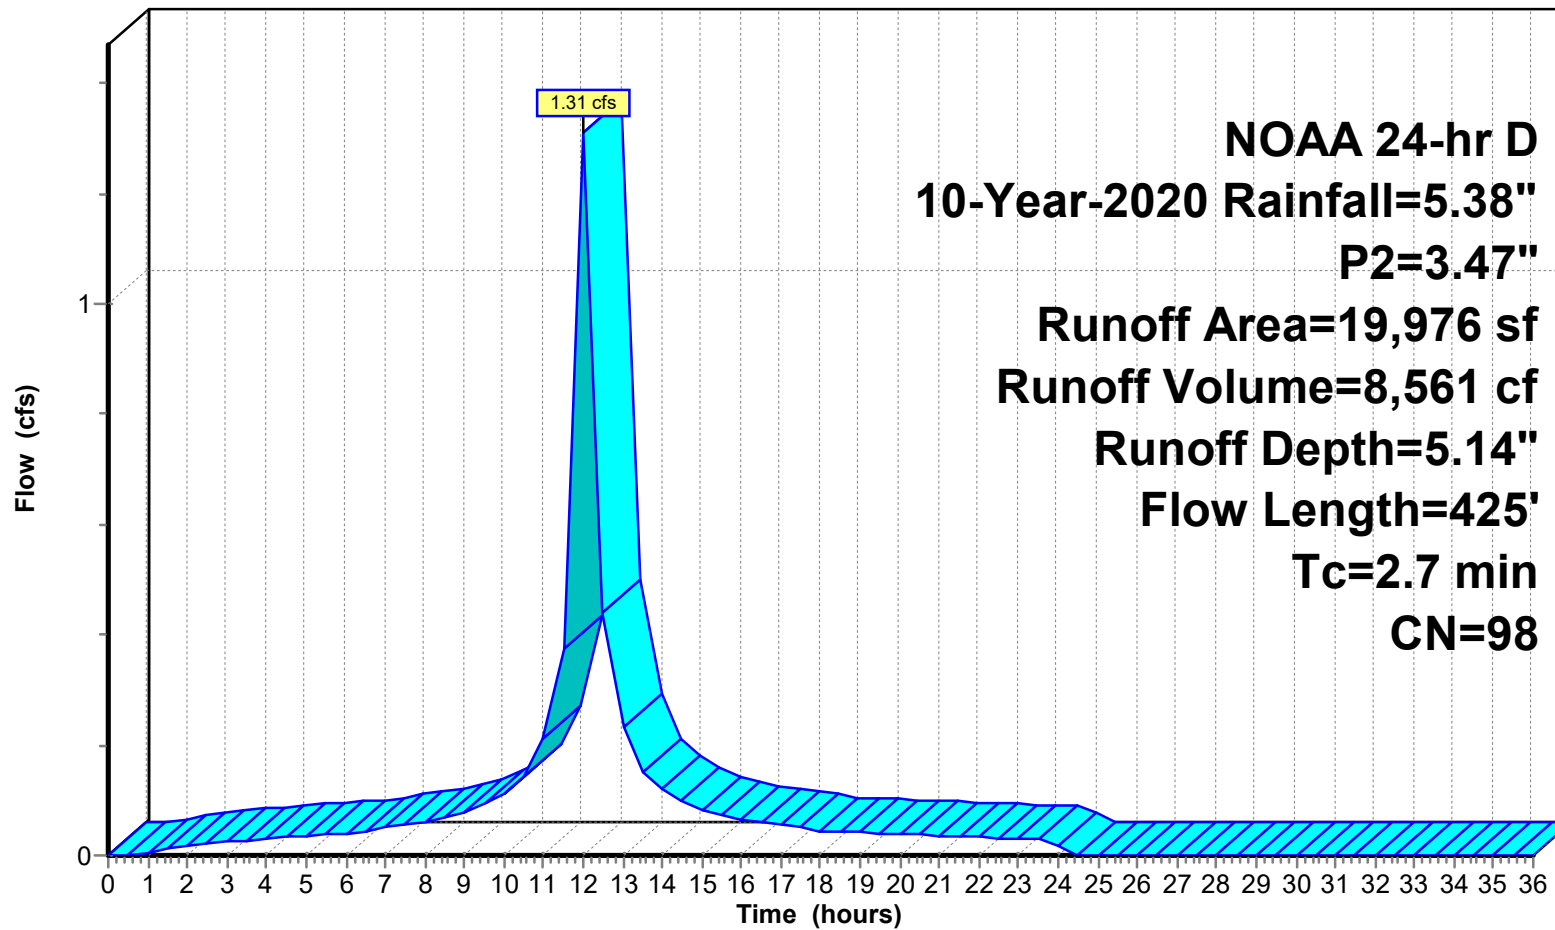

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 31

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.28 cfs @ 12.12 hrs, Volume= 1,940 cf, Depth= 2.67"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.0430	0.17		Sheet Flow, Grass: Dense n= 0.240 P2= 3.47"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
10.4	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 32

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

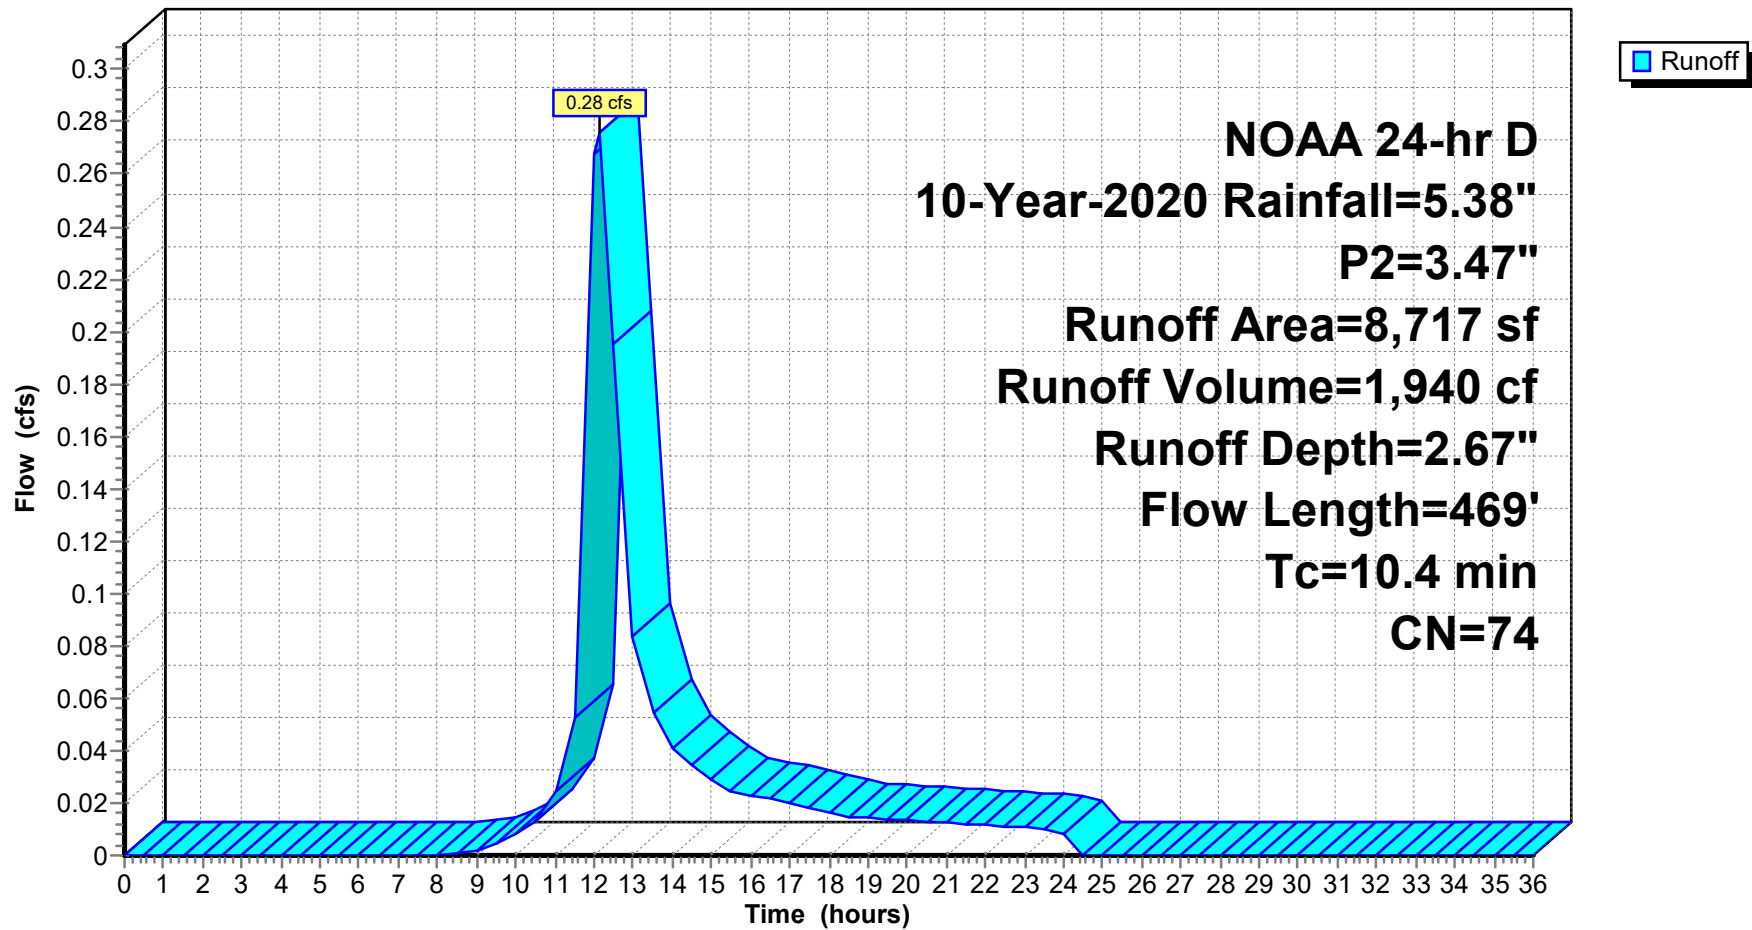

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 33

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 1.06 cfs @ 12.28 hrs, Volume= 8,344 cf, Depth= 2.58"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
14.0	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 34

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

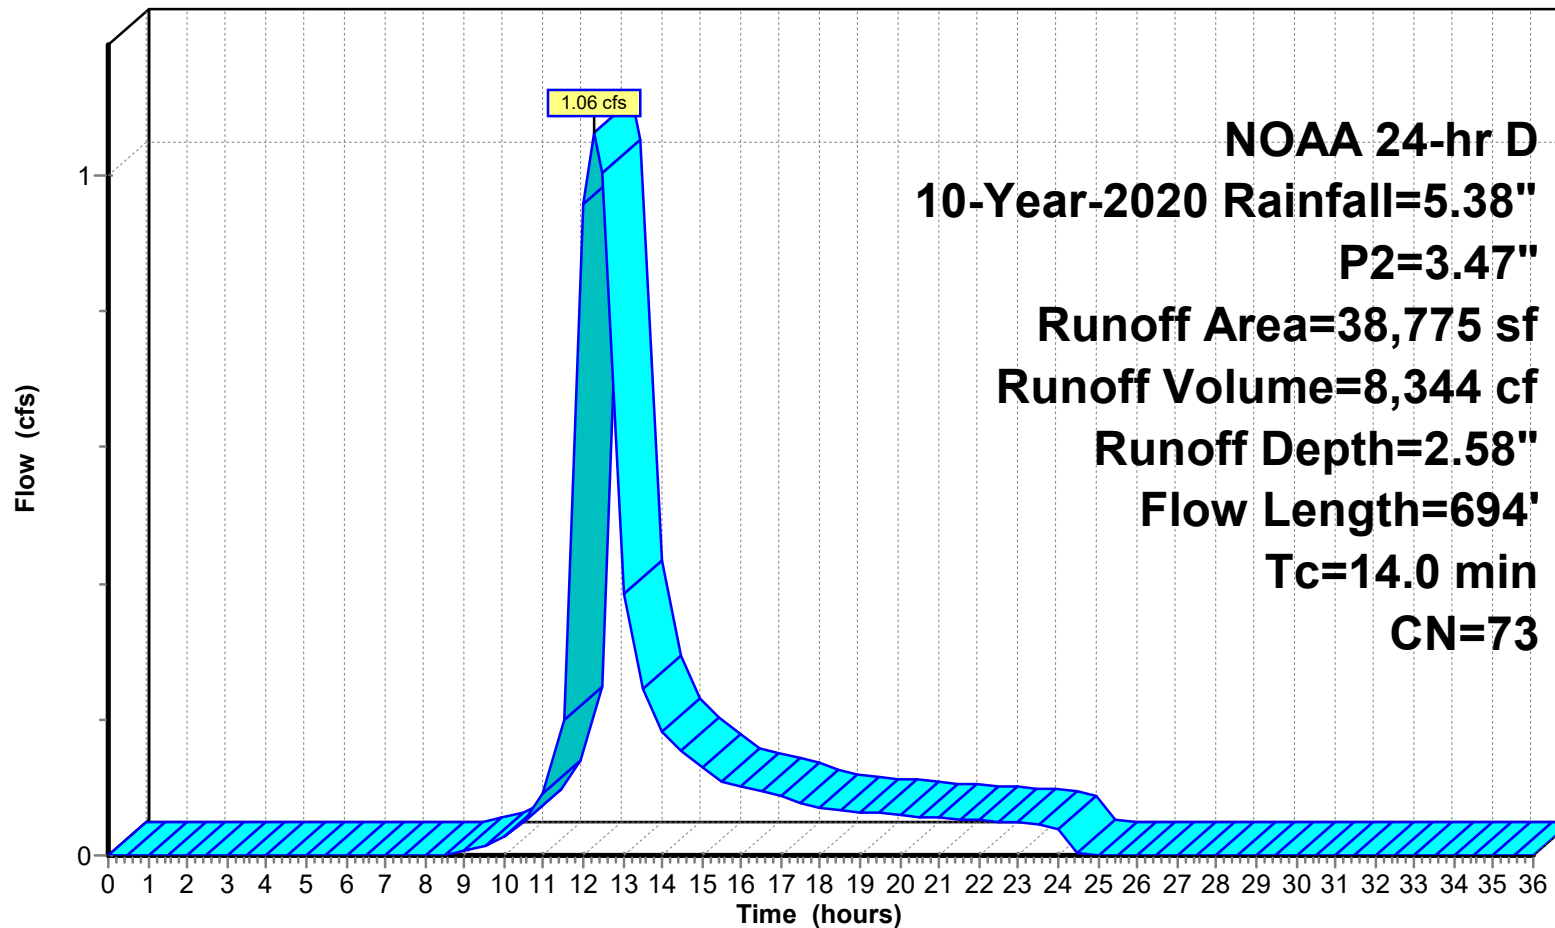

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 35

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.27 cfs @ 12.01 hrs, Volume= 1,731 cf, Depth= 5.14"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
* 4,040	98	DRIVE/SIDEWALK
4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0500	2.07		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 36

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

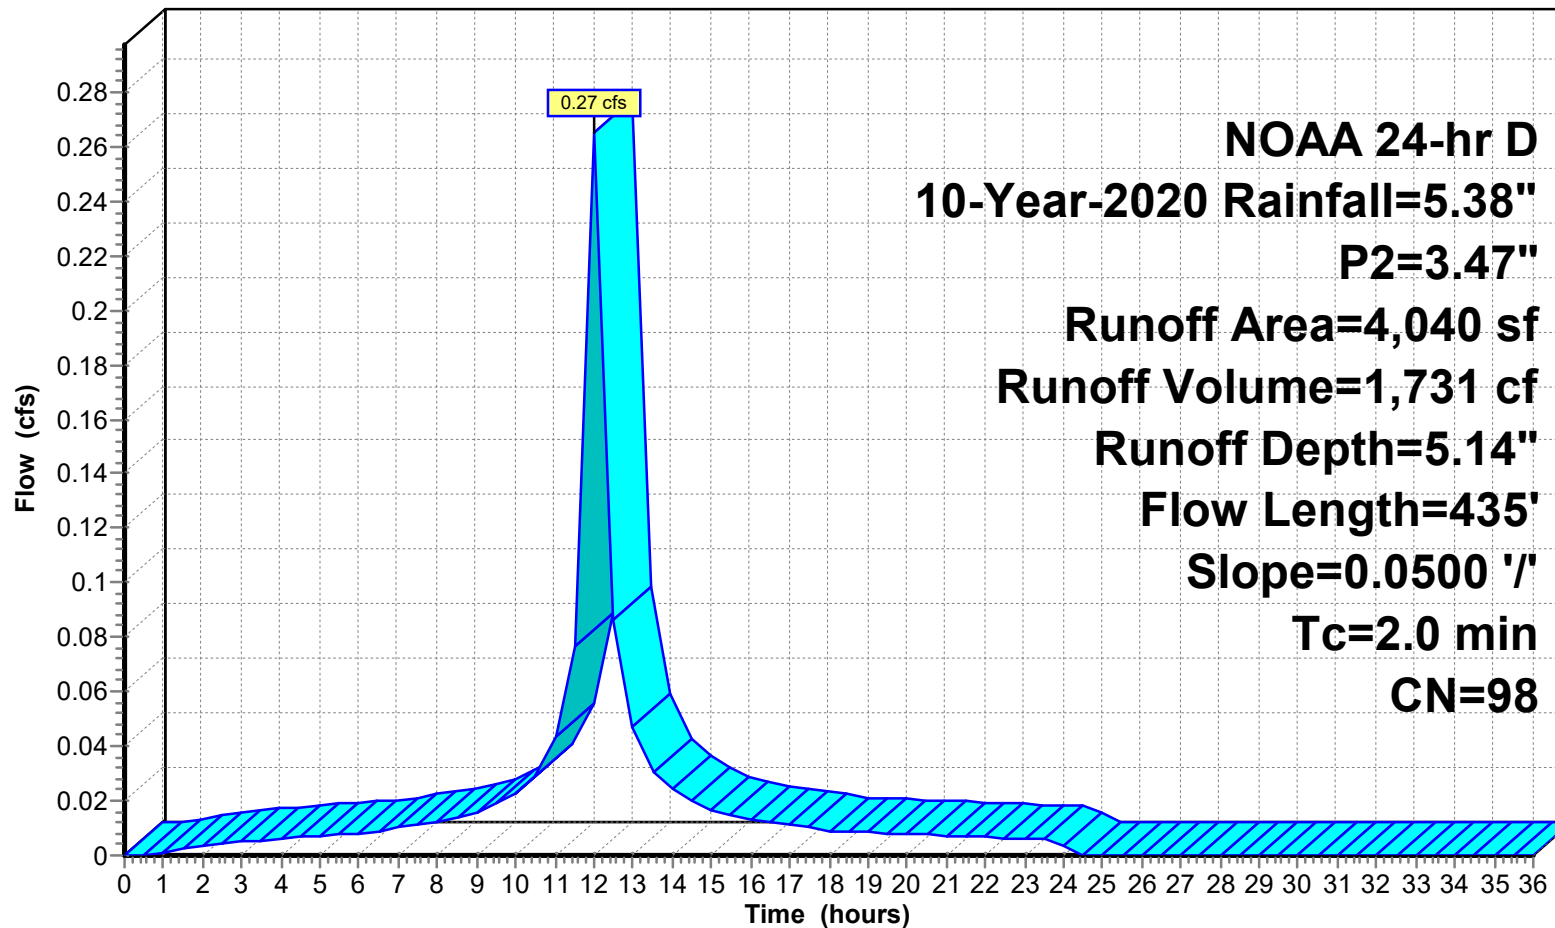

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 37

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.21 cfs @ 12.06 hrs, Volume= 1,319 cf, Depth= 2.67"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 38

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

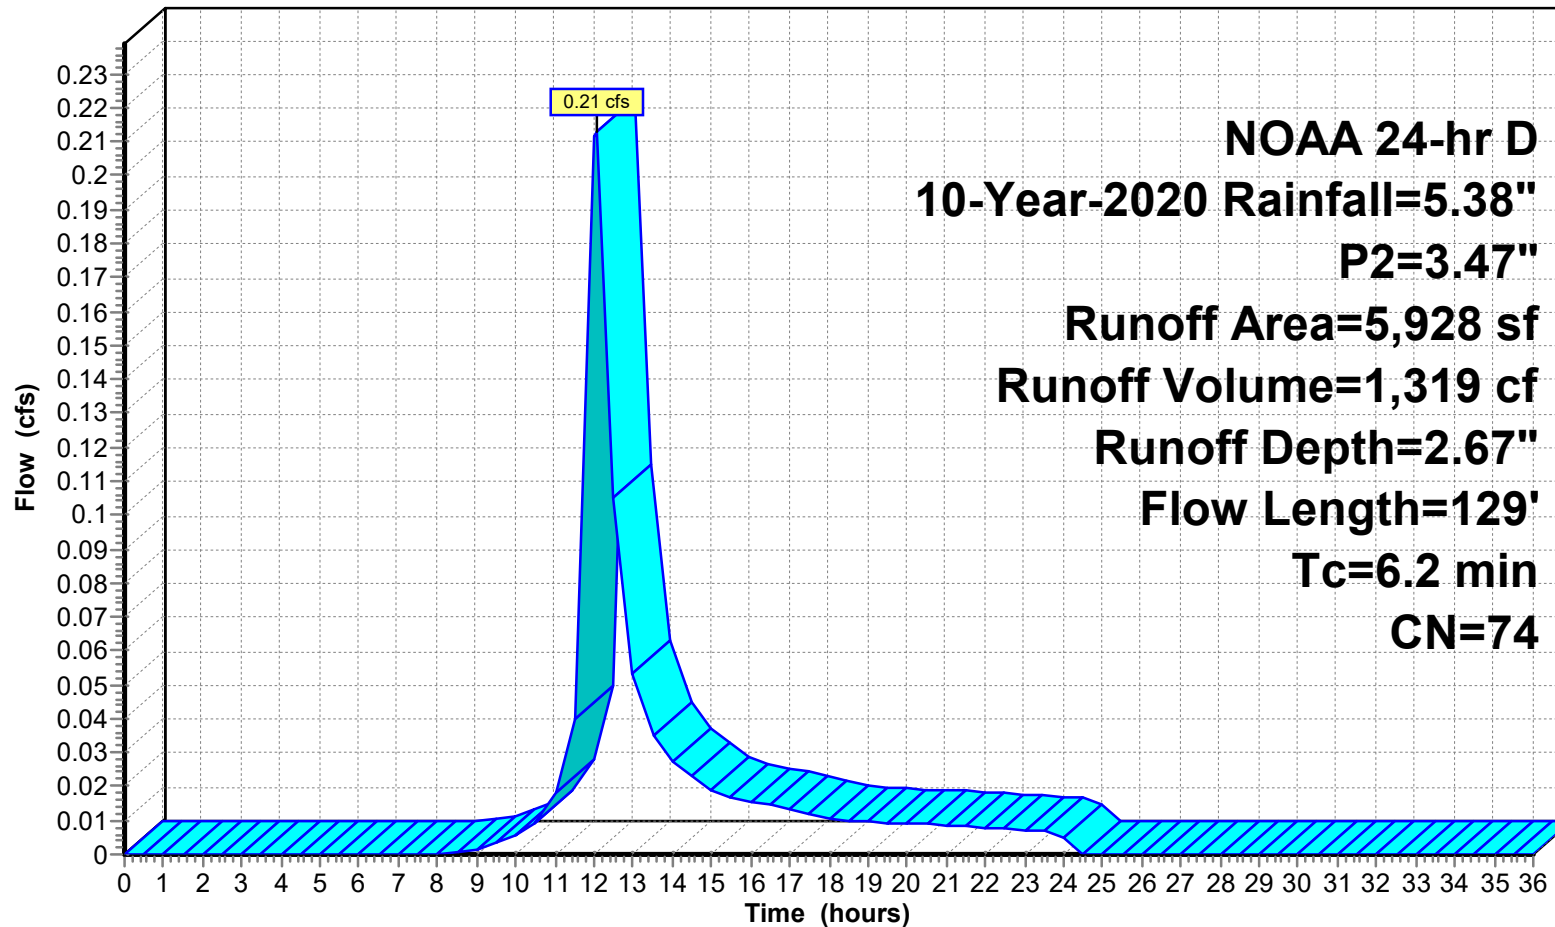

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 39

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.06 cfs @ 12.00 hrs, Volume= 420 cf, Depth= 5.14"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 40

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

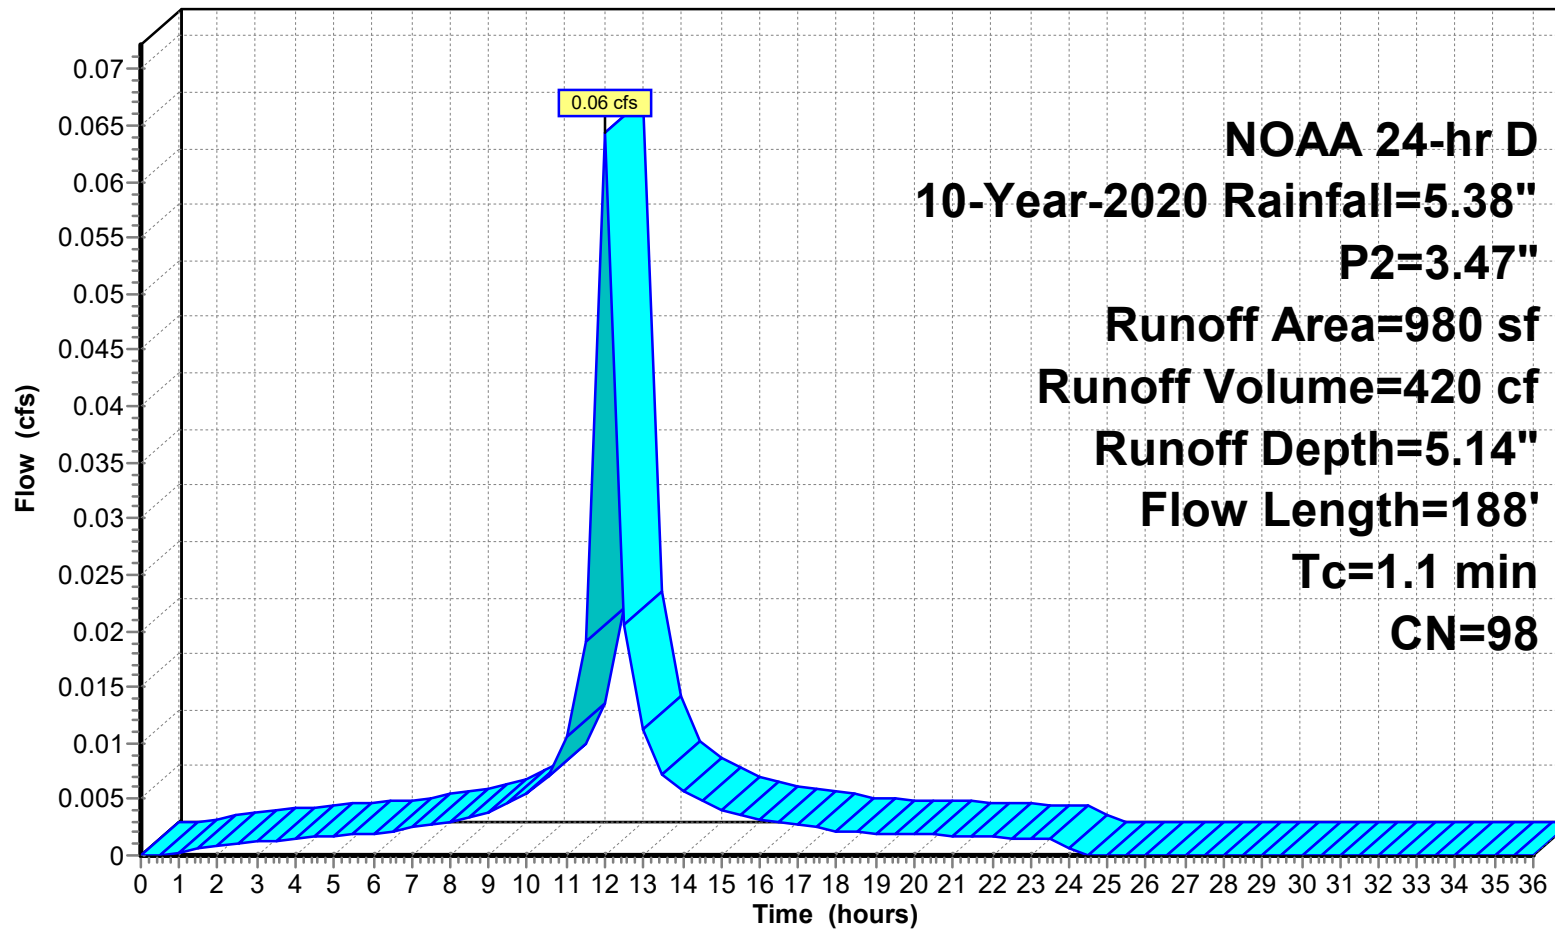

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 41

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.07 cfs @ 12.05 hrs, Volume= 419 cf, Depth= 2.67"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 42

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

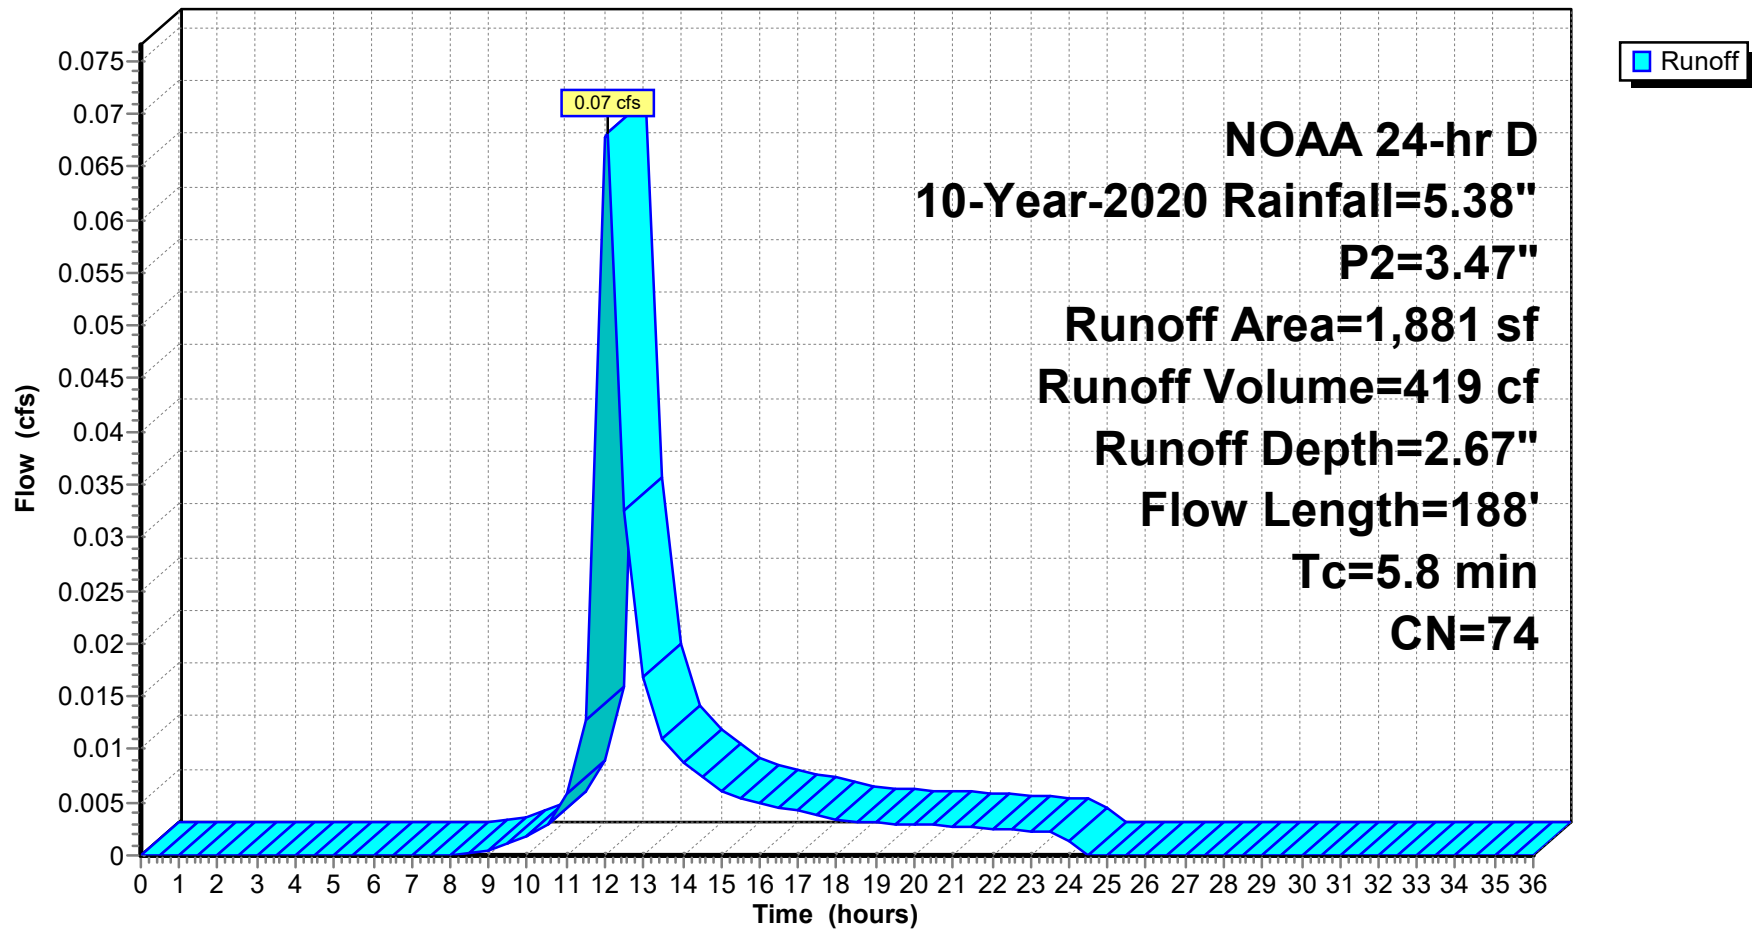

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 43

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.30 cfs @ 12.00 hrs, Volume= 1,928 cf, Depth= 5.14"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Area (sf)	CN	Description
* 4,500	98	Roof and Amenity Area
4,500		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	52	0.0100	0.95		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.1	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 44

Subcatchment P3C: P3C- Roof Area

Hydrograph

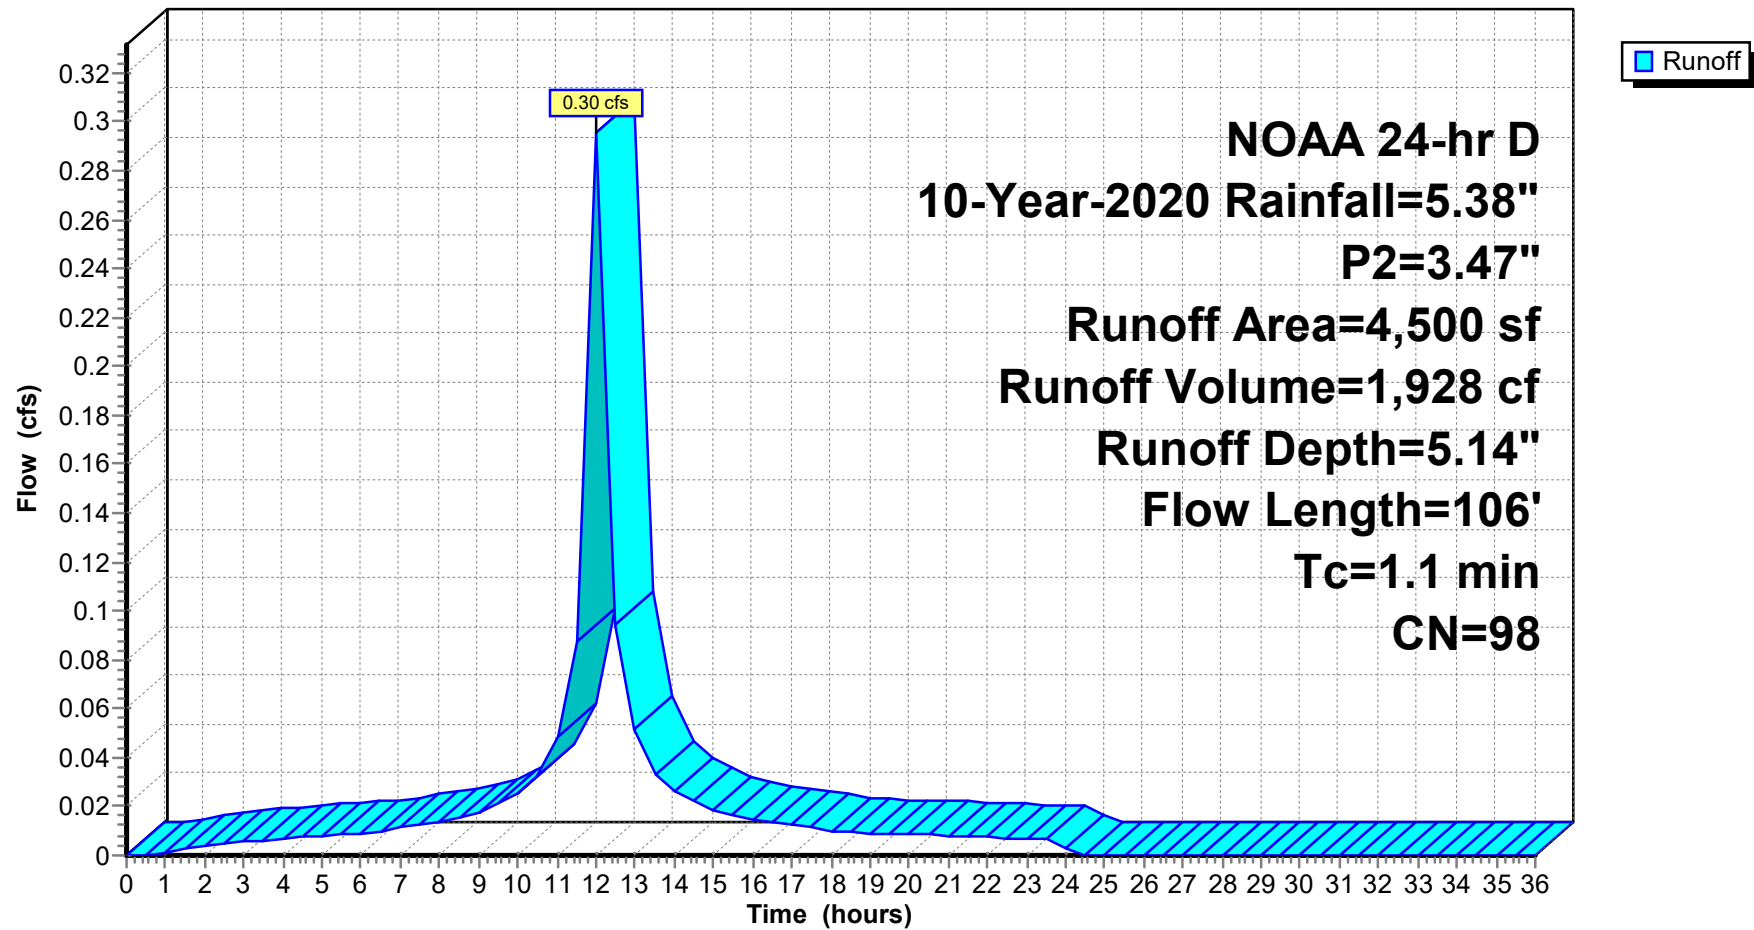

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 45


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 4.86" for 10-Year-2020 event
Inflow = 4.77 cfs @ 12.01 hrs, Volume= 31,302 cf
Primary = 4.77 cfs @ 12.01 hrs, Volume= 31,302 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

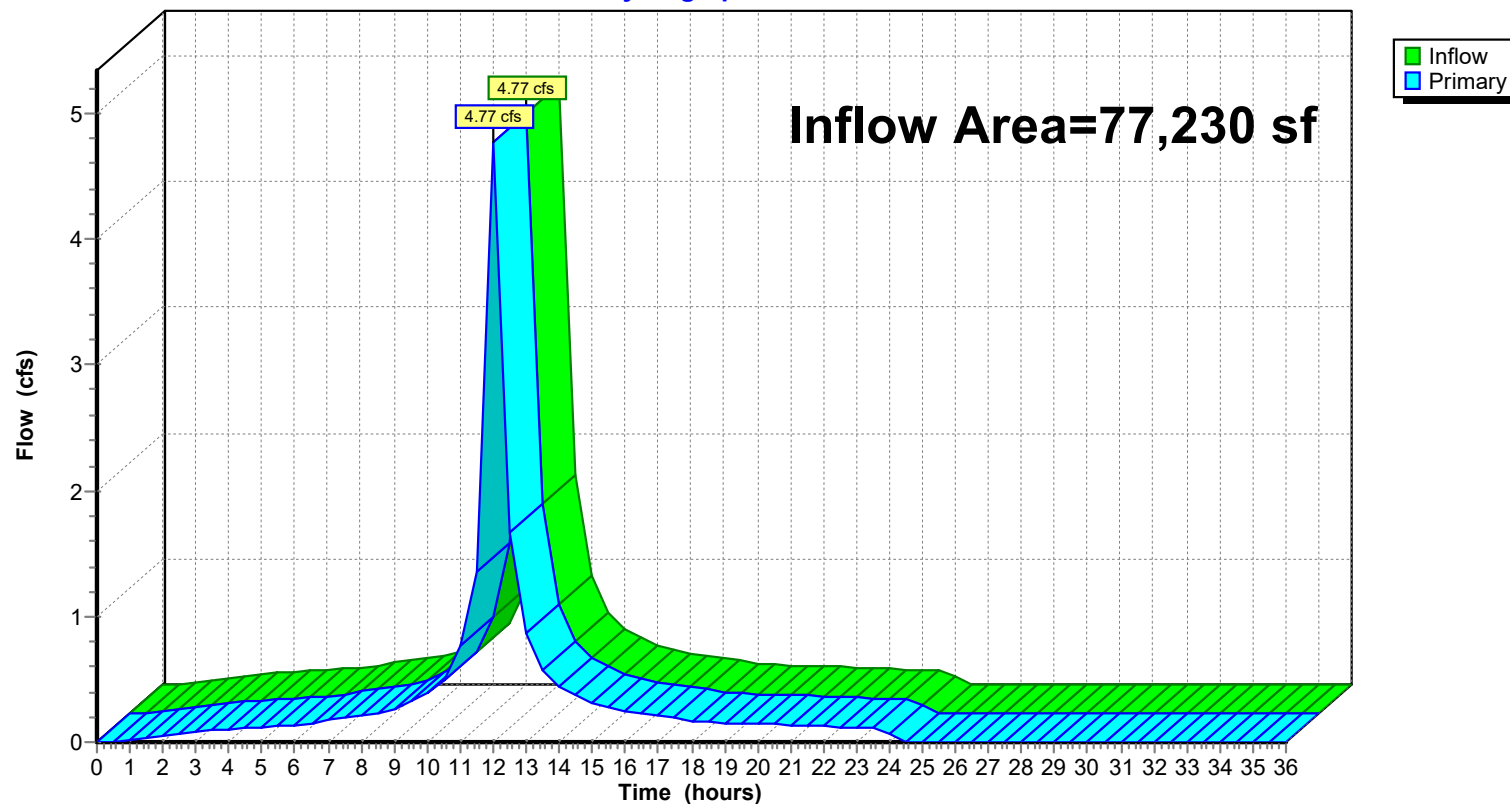

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 46


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 4.09" for 10-Year-2020 event
Inflow = 6.65 cfs @ 12.04 hrs, Volume= 45,463 cf
Primary = 6.65 cfs @ 12.04 hrs, Volume= 45,463 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

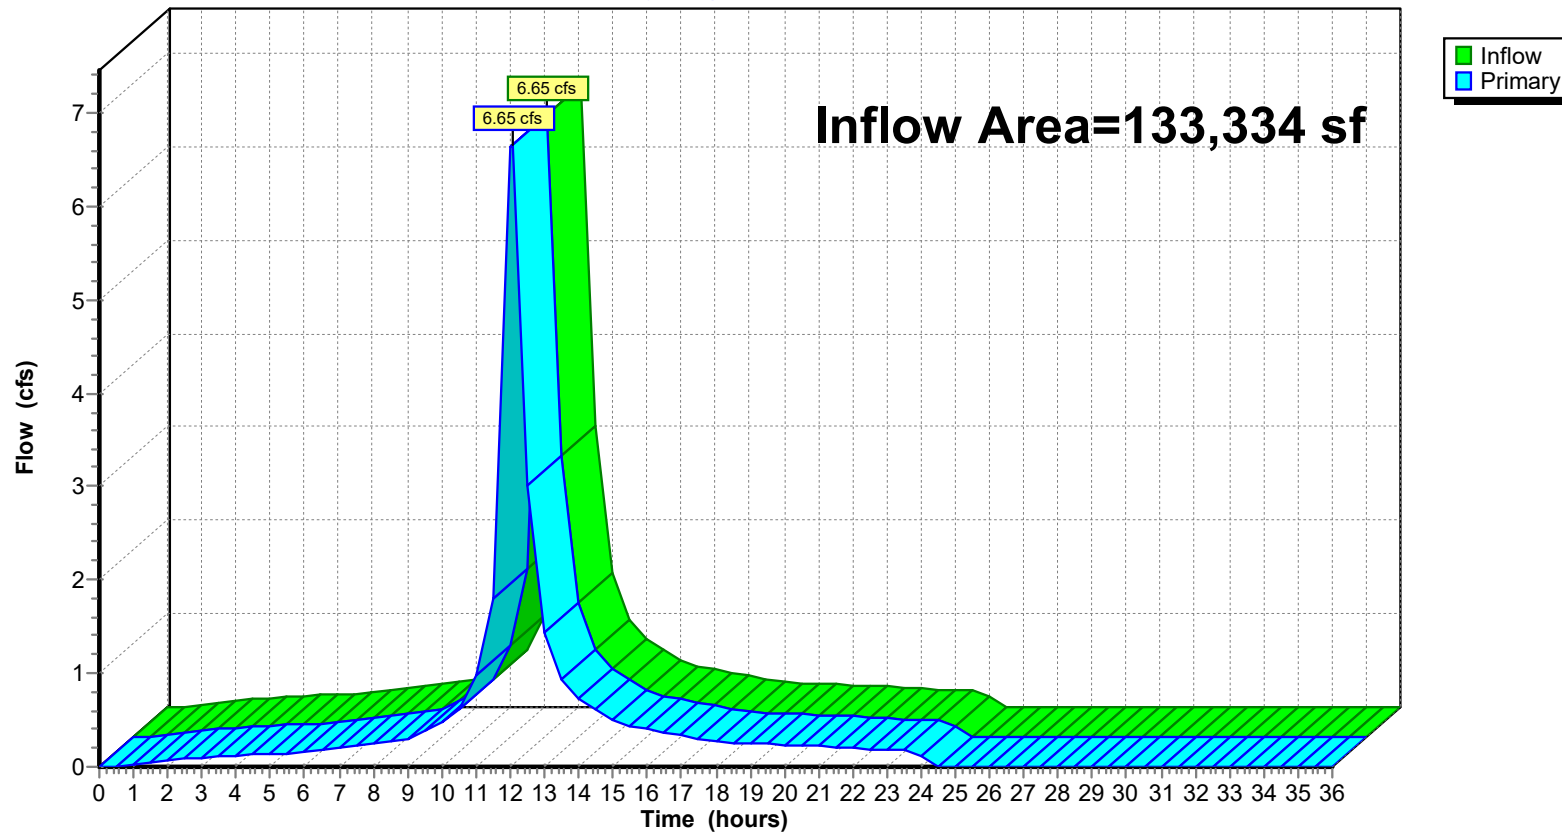

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 47


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 4.10" for 10-Year-2020 event
Inflow = 5.75 cfs @ 12.04 hrs, Volume= 39,645 cf
Primary = 5.75 cfs @ 12.04 hrs, Volume= 39,645 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

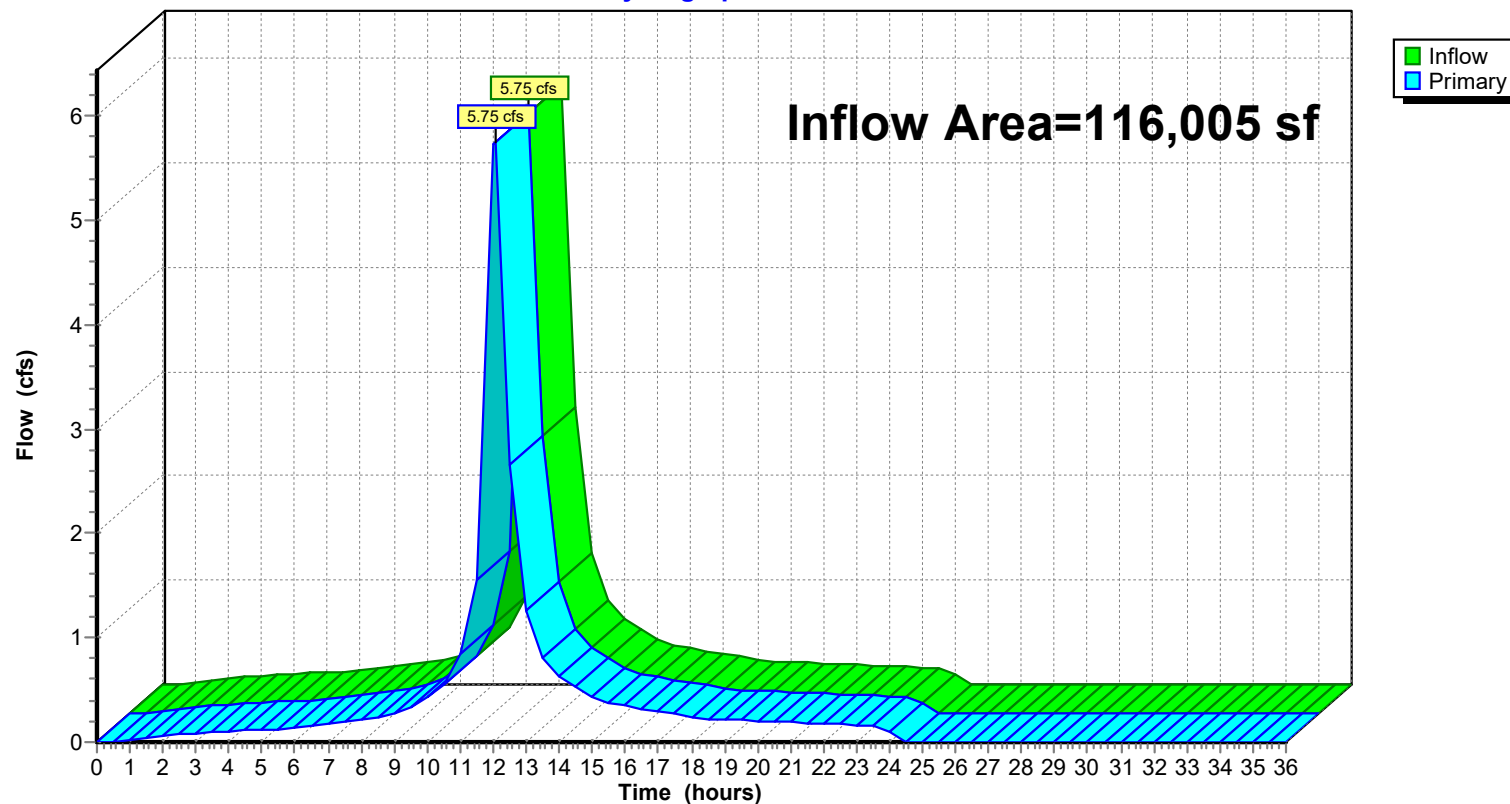

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2020 Rainfall=5.38", P2=3.47"

Printed 1/28/2026

Page 48


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 4.03" for 10-Year-2020 event
Inflow = 0.91 cfs @ 12.02 hrs, Volume= 5,818 cf
Primary = 0.91 cfs @ 12.02 hrs, Volume= 5,818 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2

Hydrograph

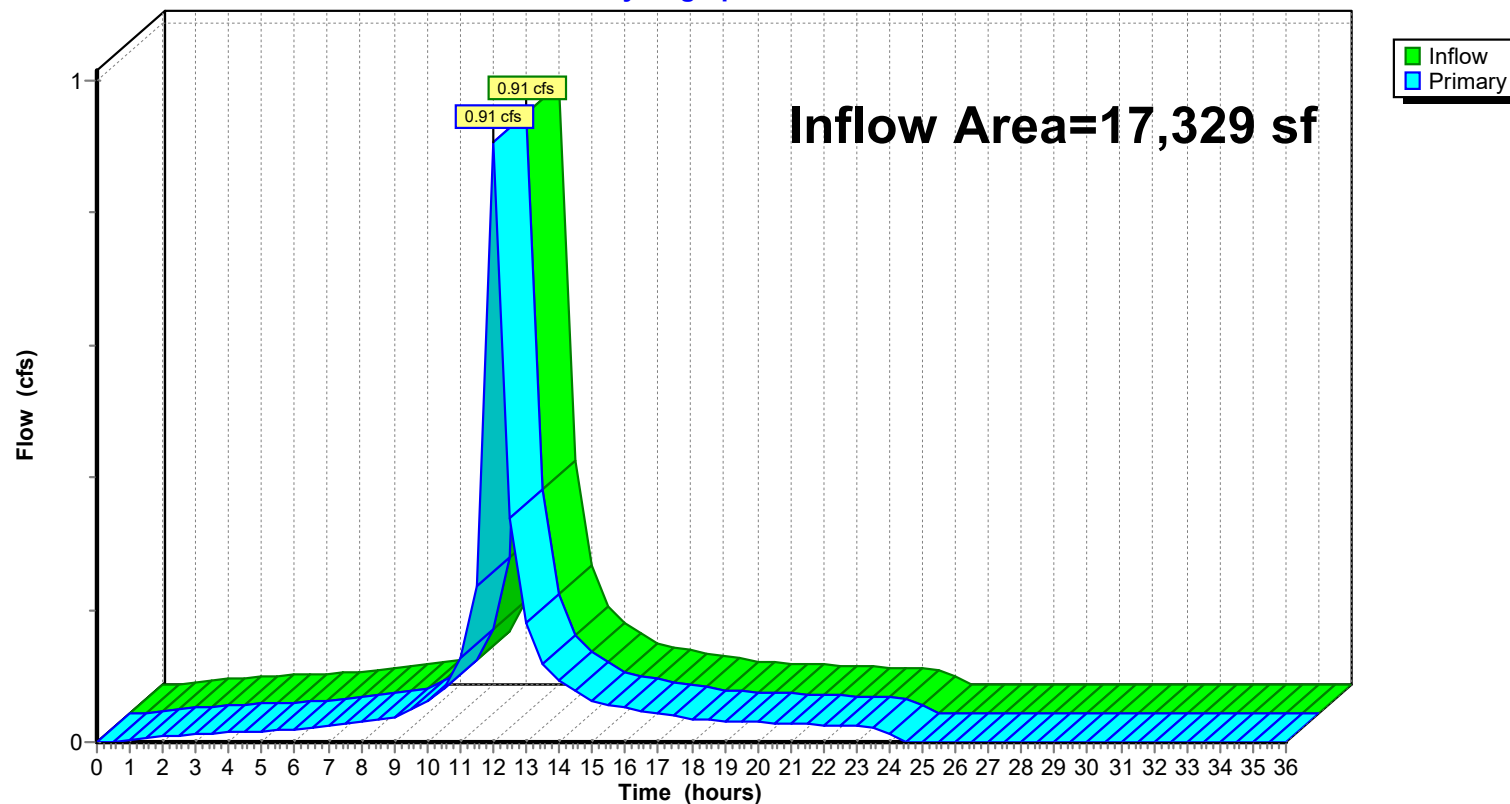

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 49

Summary for Subcatchment 1S: Roof

Runoff = 5.47 cfs @ 12.00 hrs, Volume= 36,158 cf, Depth= 8.94"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	53	0.0200	1.26		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.5	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 50

Subcatchment 1S: Roof

Hydrograph

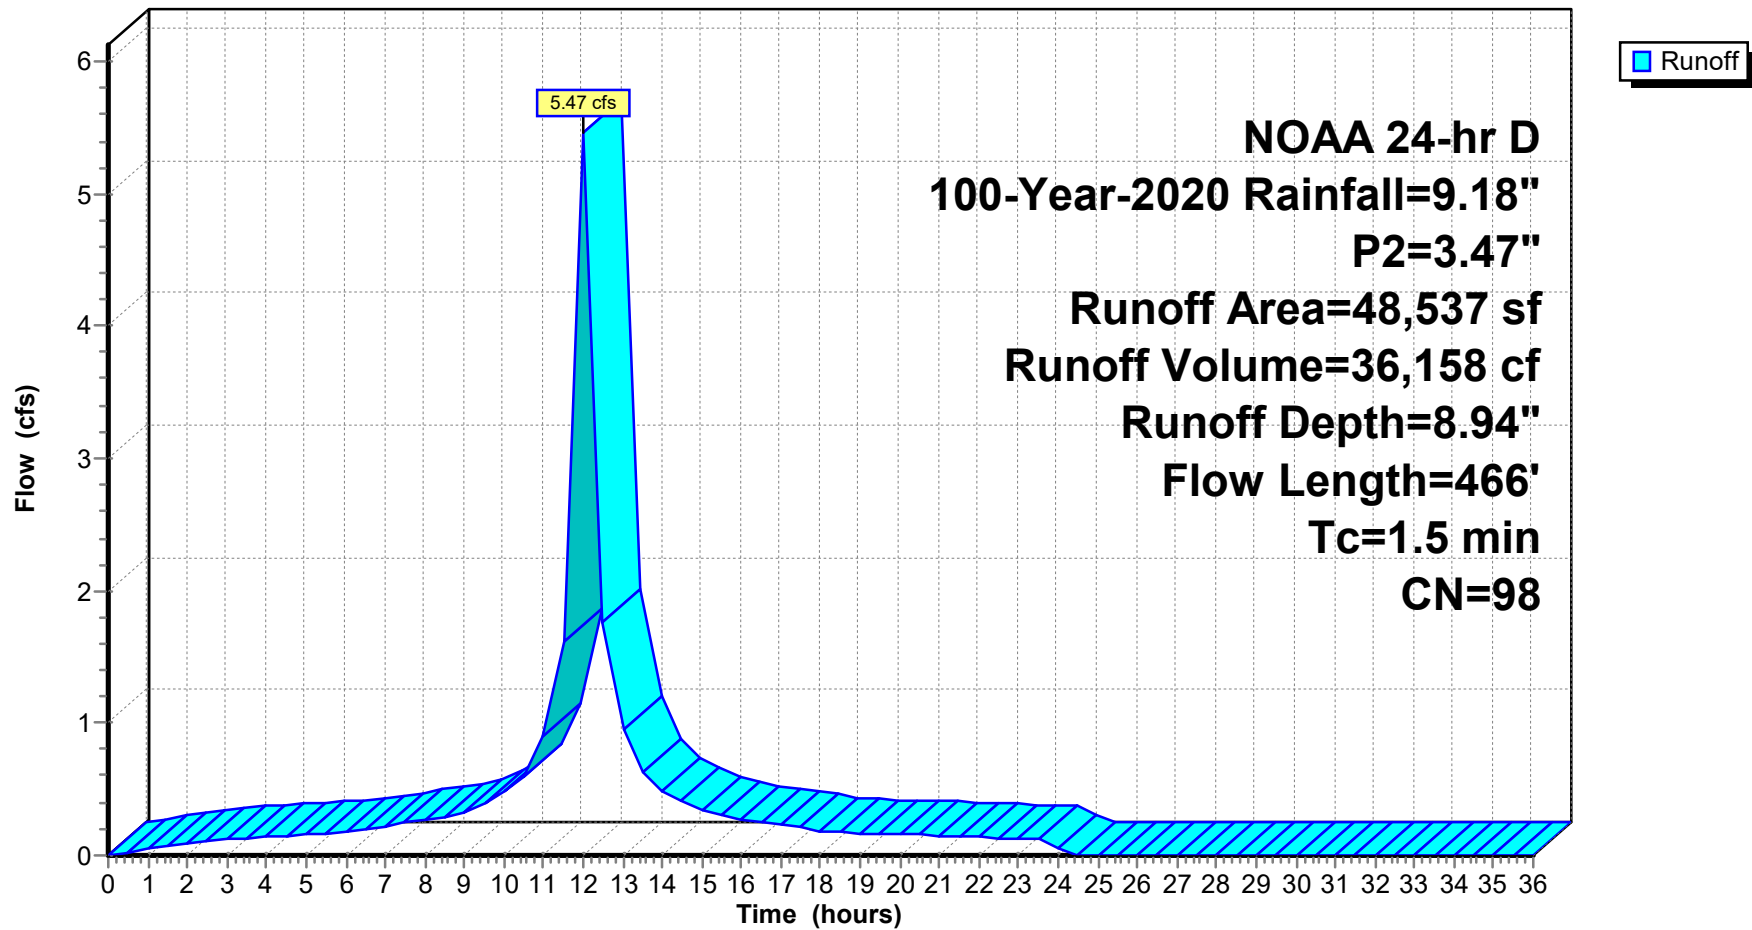

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 51

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 2.24 cfs @ 12.01 hrs, Volume= 14,881 cf, Depth= 8.94"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0150	1.12		Sheet Flow, sheet flow Parking area n= 0.013 P2= 3.47"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.7	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 52

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

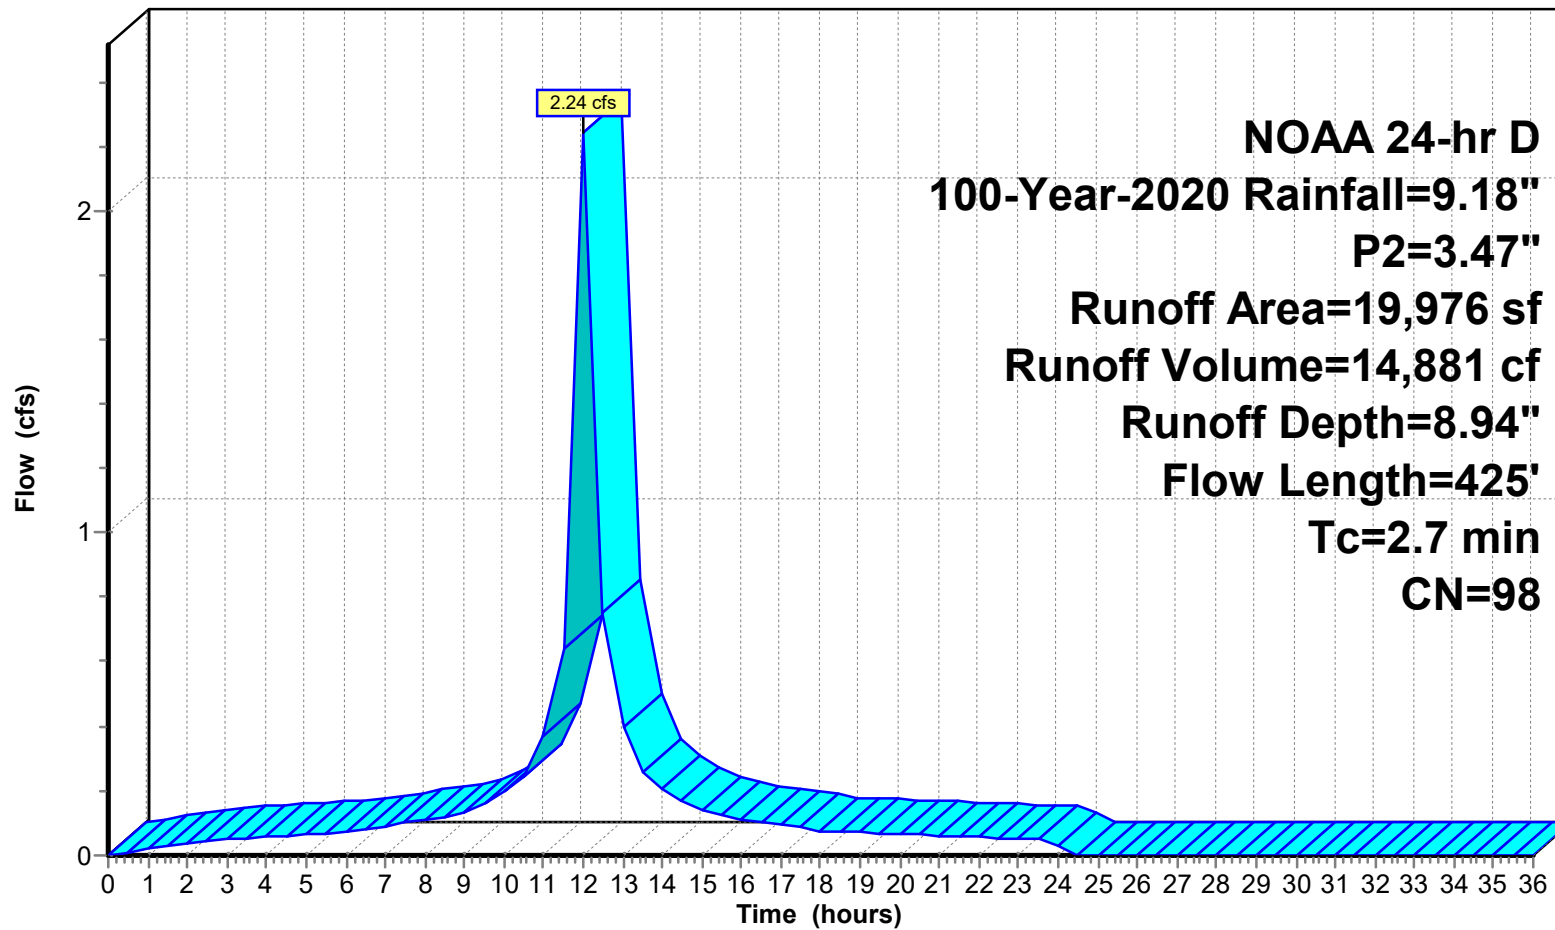

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 53

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.63 cfs @ 12.10 hrs, Volume= 4,354 cf, Depth= 5.99"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.1	100	0.0430	0.17		Sheet Flow, Grass: Dense n= 0.240 P2= 3.47"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
10.4	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 54

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

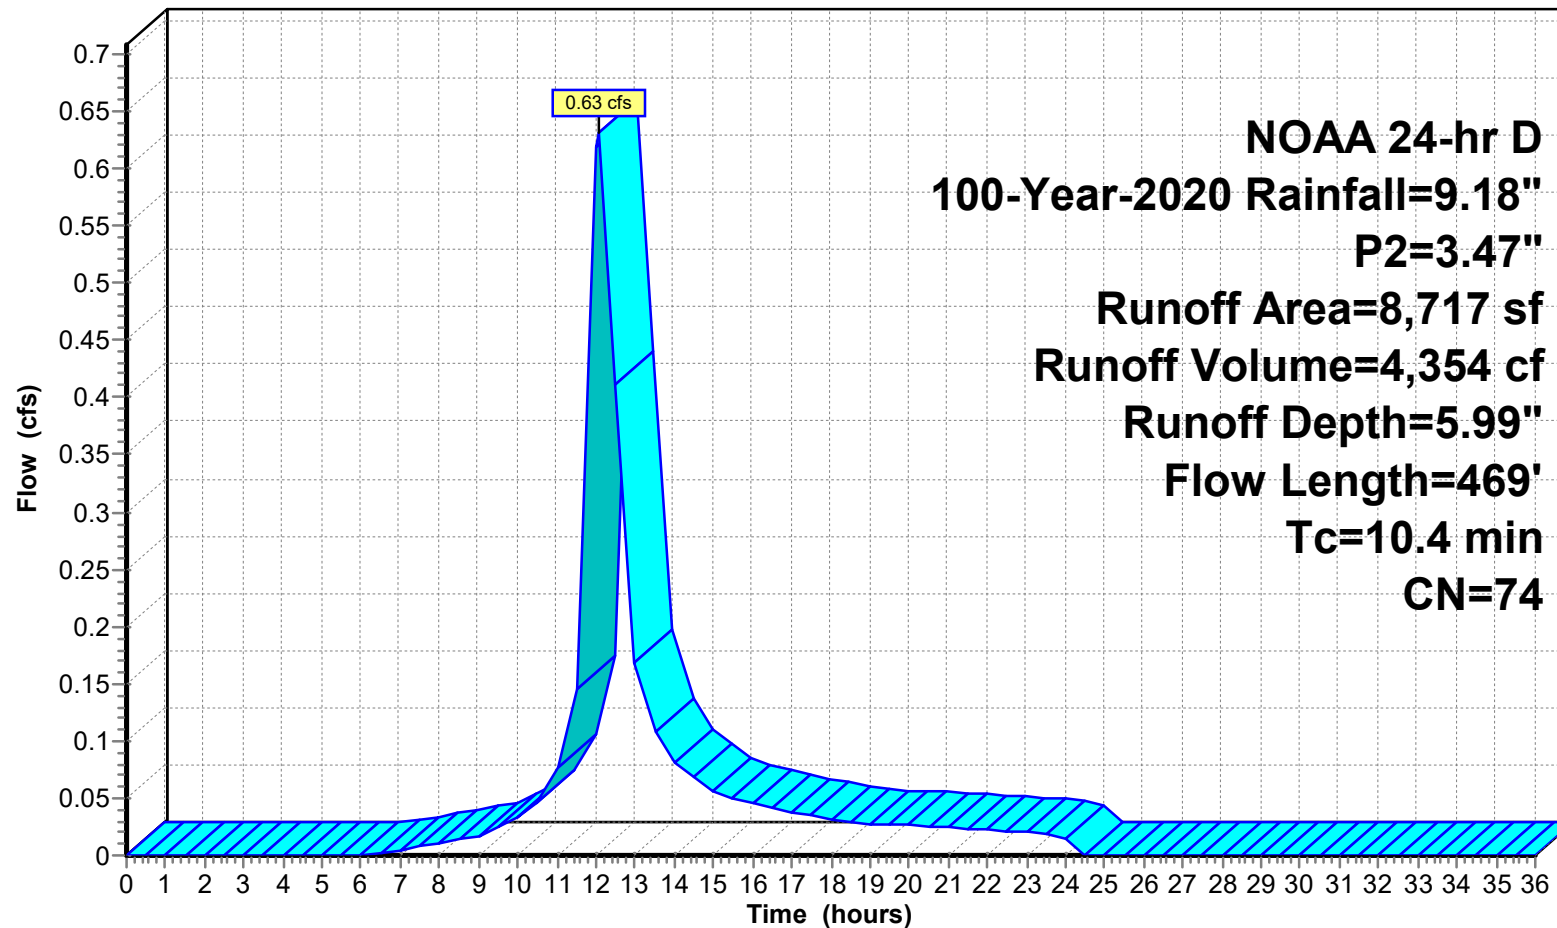

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 55

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 2.47 cfs @ 12.21 hrs, Volume= 18,963 cf, Depth= 5.87"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.3	100	0.0900	0.15		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 3.47"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
14.0	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 56

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

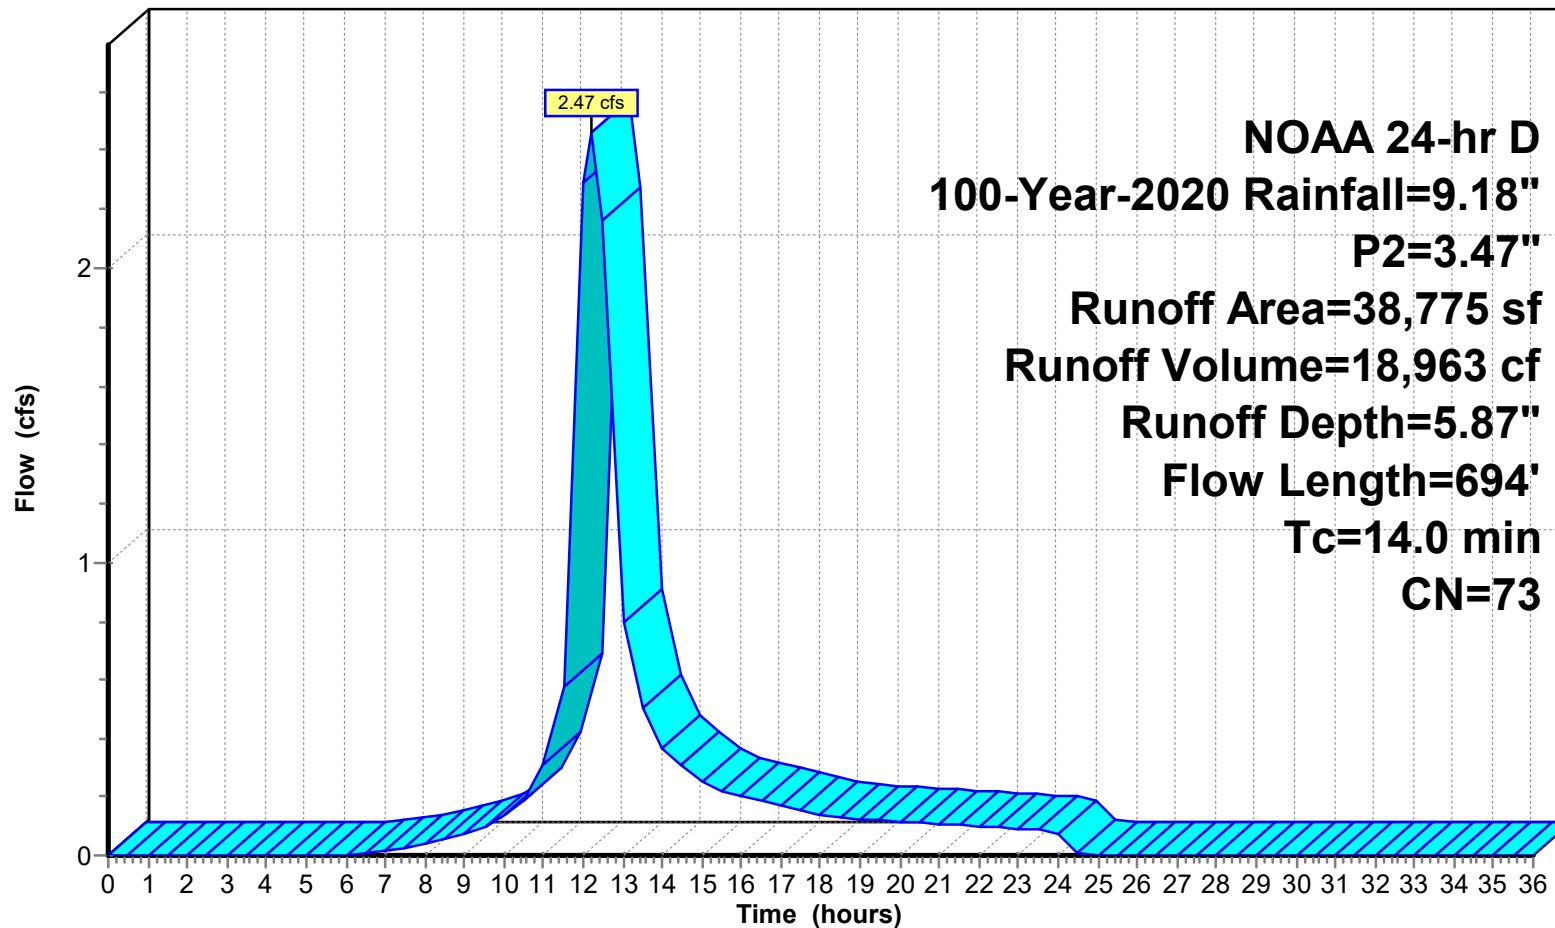

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 57

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.45 cfs @ 12.01 hrs, Volume= 3,010 cf, Depth= 8.94"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
* 4,040	98	DRIVE/SIDEWALK
4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	100	0.0500	2.07		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 3.47"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
2.0	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 58

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

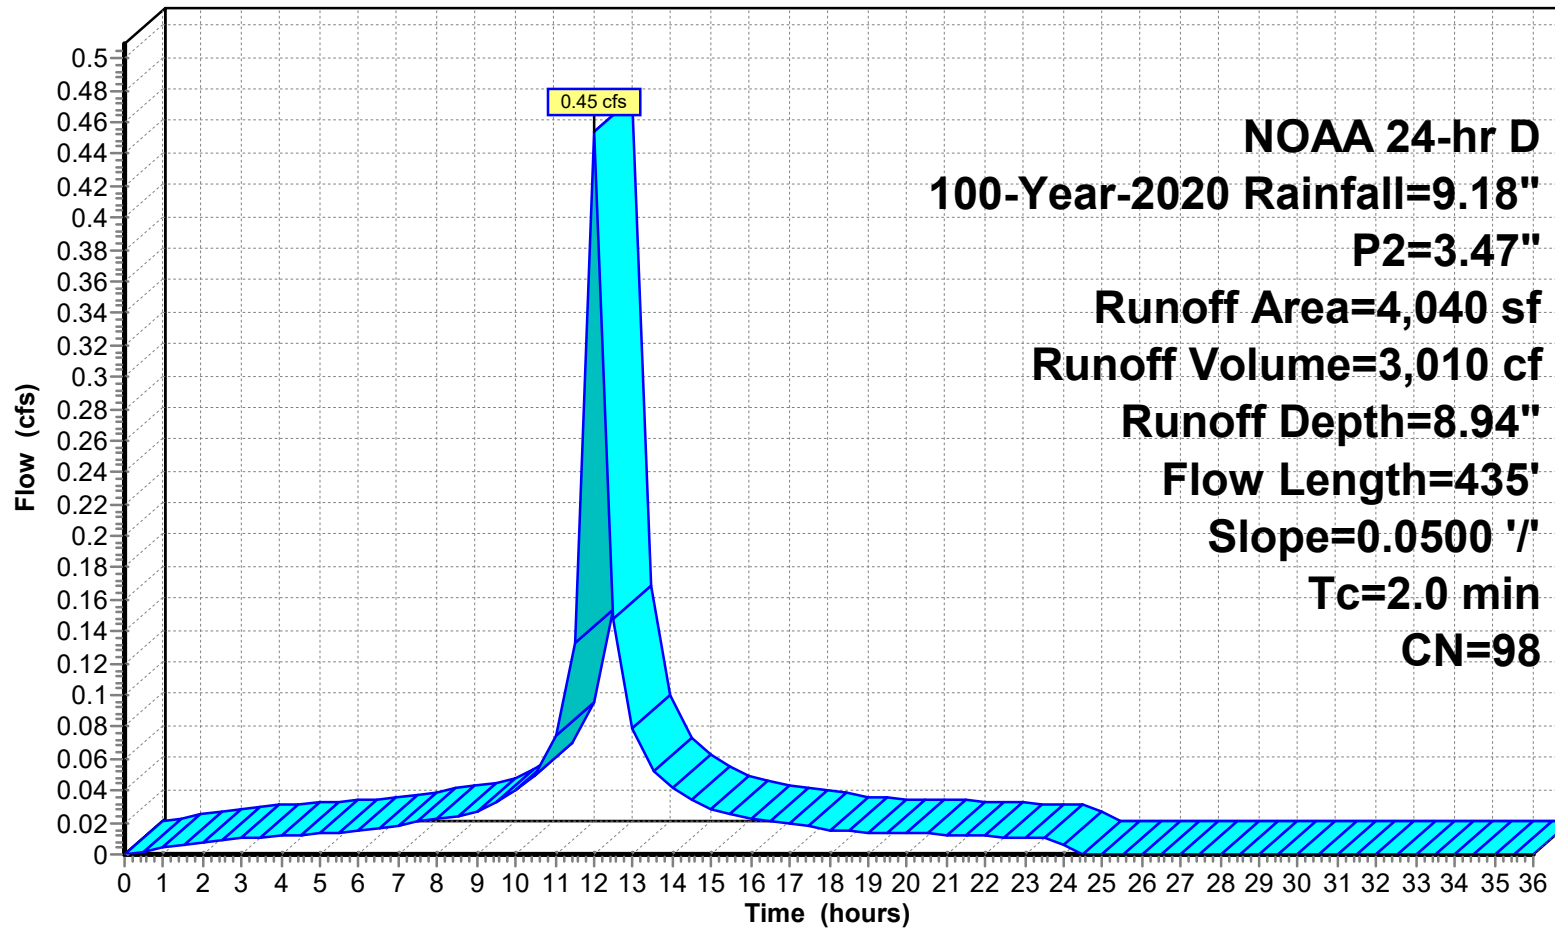

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 59

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.48 cfs @ 12.04 hrs, Volume= 2,961 cf, Depth= 5.99"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.1	100	0.0600	0.27		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
6.2	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 60

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

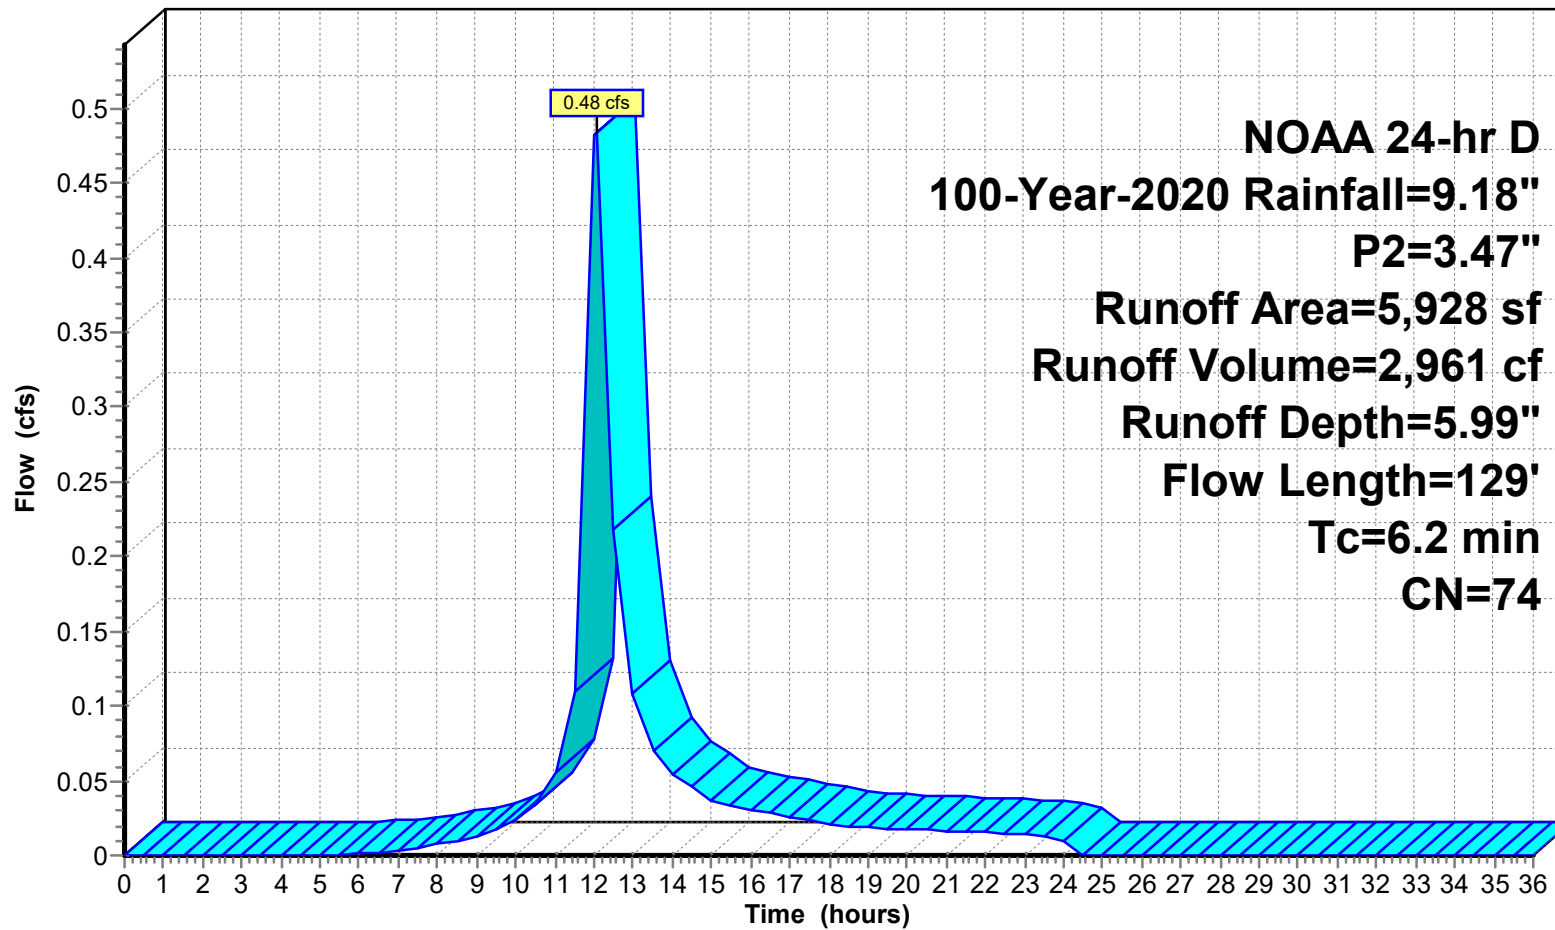

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 61

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.11 cfs @ 12.00 hrs, Volume= 730 cf, Depth= 8.94"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.61		Sheet Flow, sidewalk
					Smooth surfaces n= 0.011 P2= 3.47"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 62

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

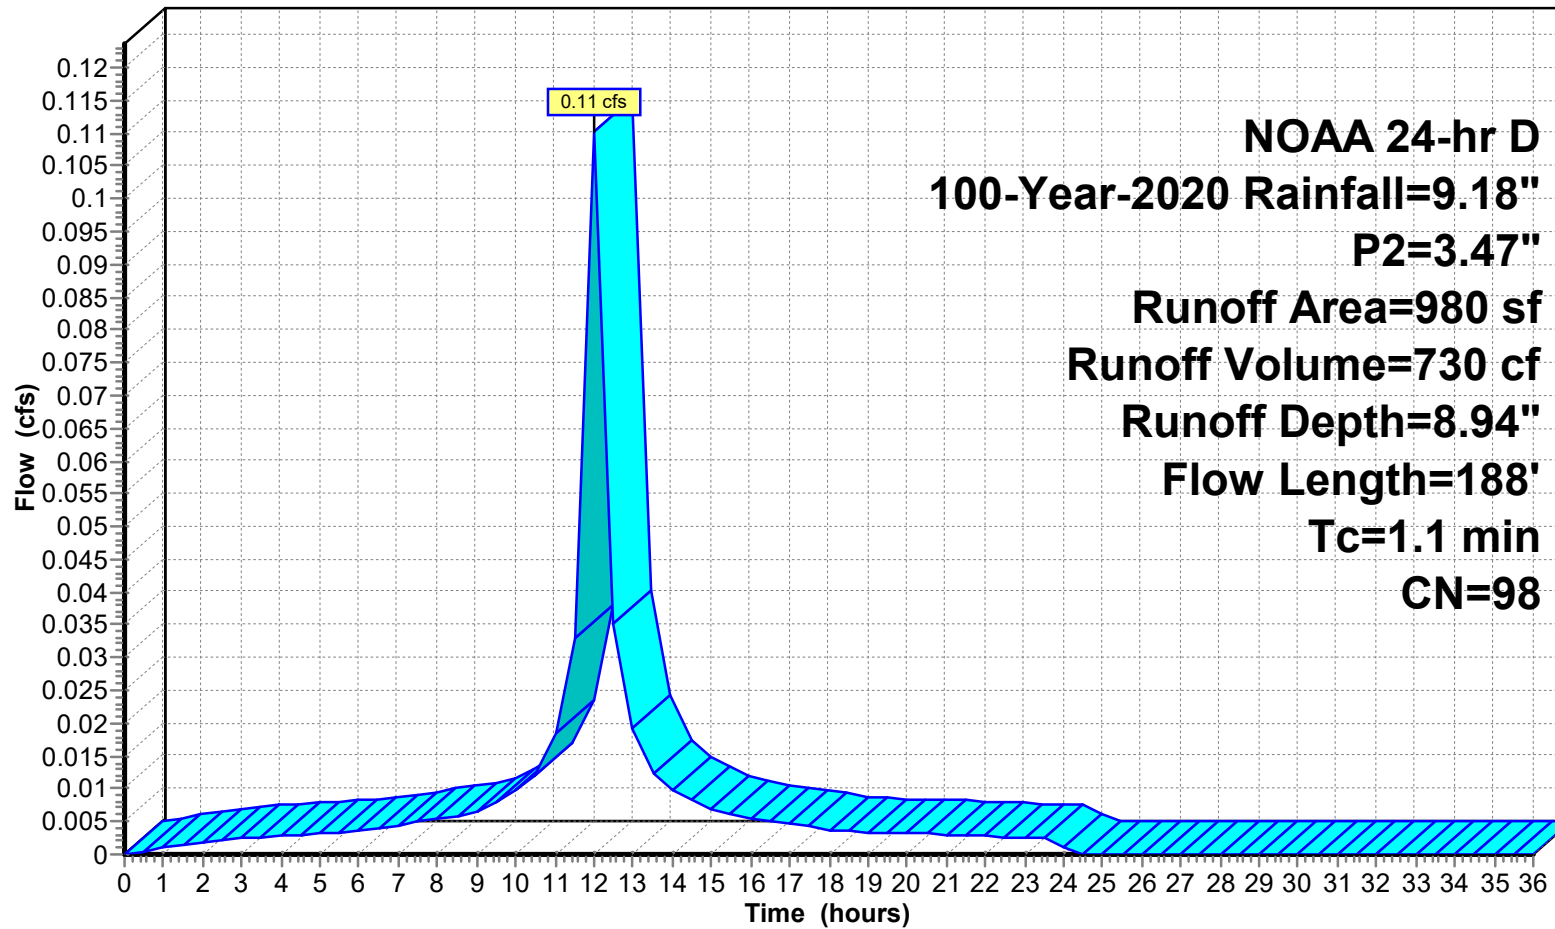

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 63

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.15 cfs @ 12.04 hrs, Volume= 939 cf, Depth= 5.99"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.2	100	0.0900	0.32		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 3.47"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.8	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 64

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

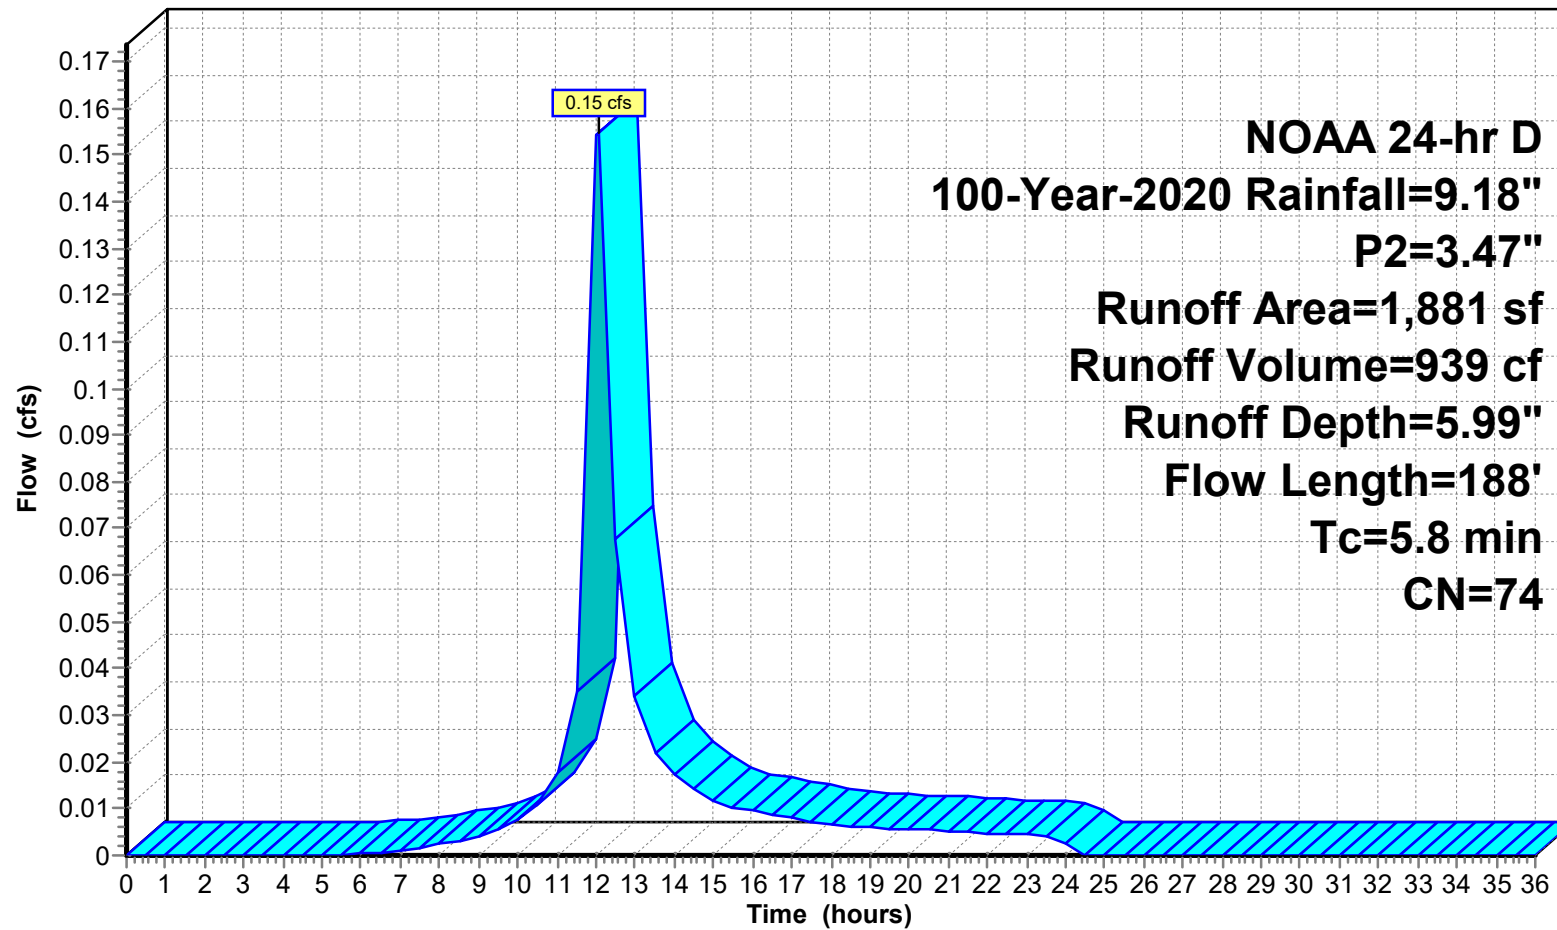

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 65

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.51 cfs @ 12.00 hrs, Volume= 3,352 cf, Depth= 8.94"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Area (sf)	CN	Description
* 4,500	98	Roof and Amenity Area
4,500		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	52	0.0100	0.95		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 3.47"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.1	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 66

Subcatchment P3C: P3C- Roof Area

Hydrograph

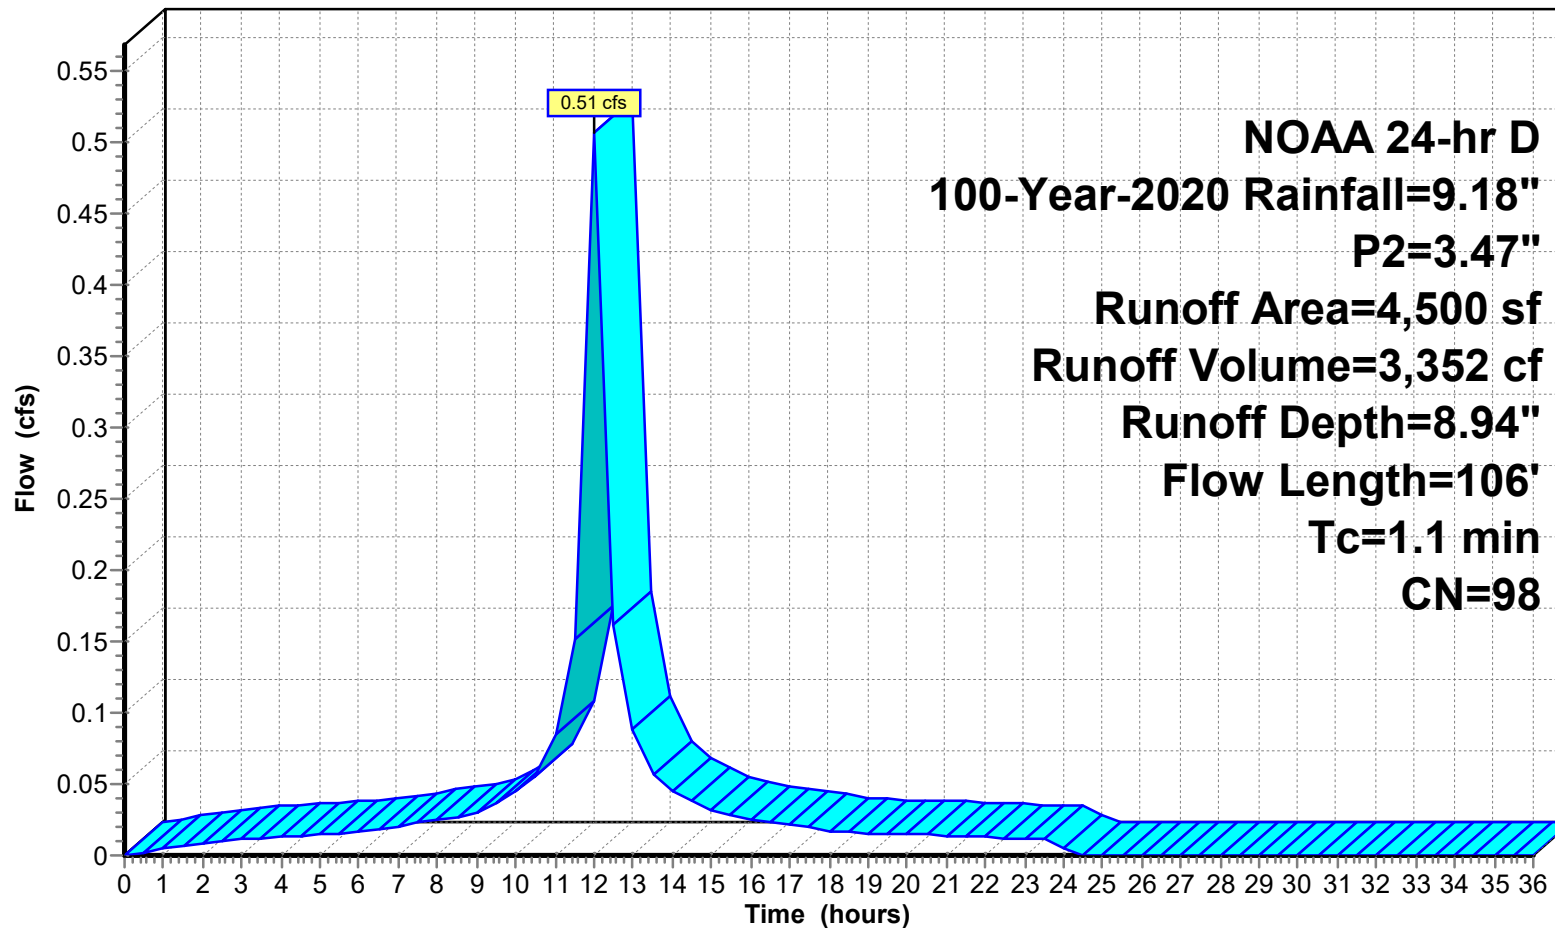

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 67


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 8.61" for 100-Year-2020 event
Inflow = 8.33 cfs @ 12.01 hrs, Volume= 55,393 cf
Primary = 8.33 cfs @ 12.01 hrs, Volume= 55,393 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

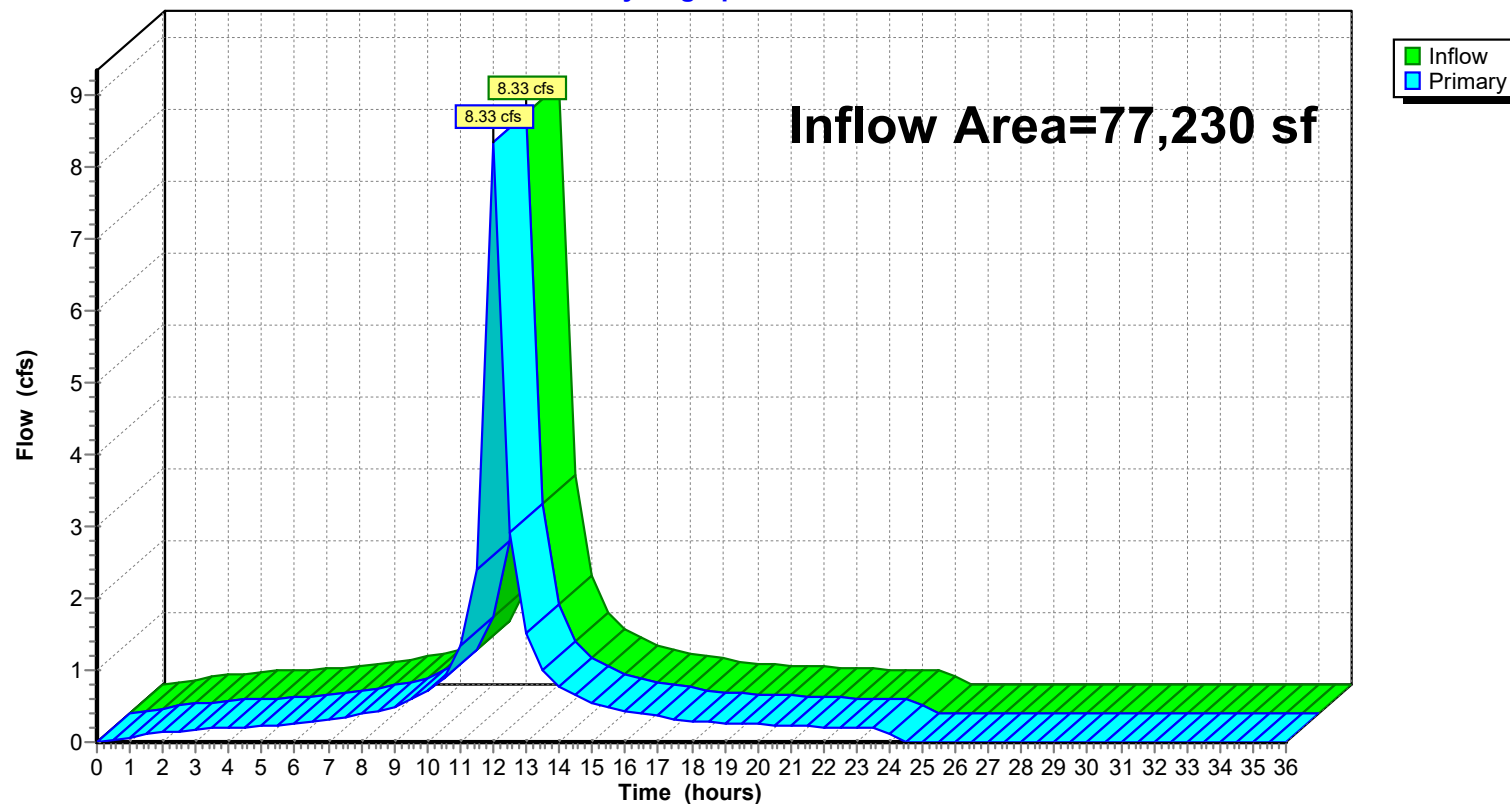

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 68


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 7.68" for 100-Year-2020 event
Inflow = 12.38 cfs @ 12.04 hrs, Volume= 85,348 cf
Primary = 12.38 cfs @ 12.04 hrs, Volume= 85,348 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

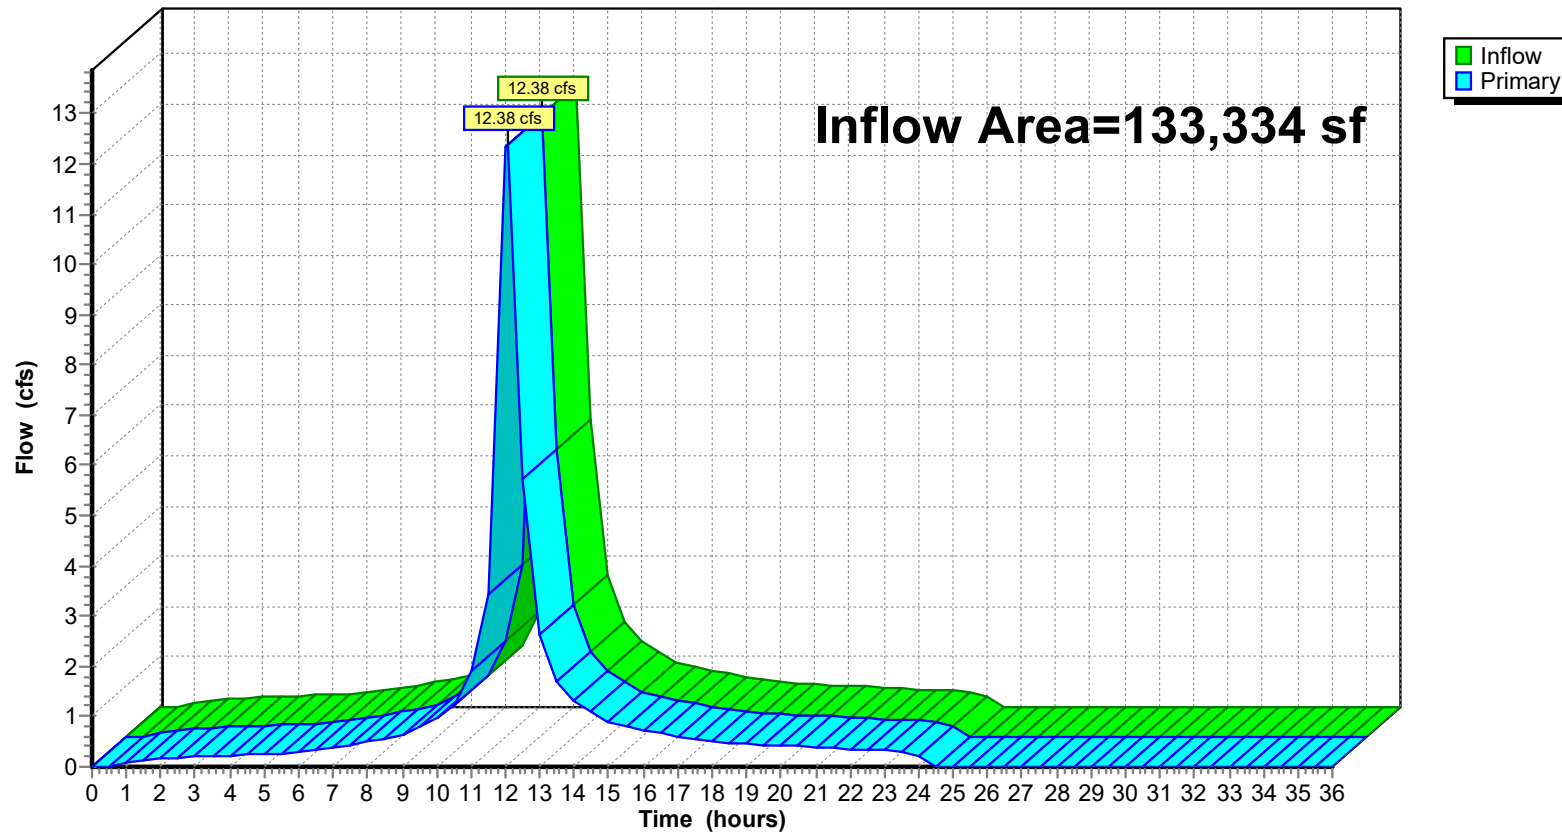

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 69


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 7.69" for 100-Year-2020 event
Inflow = 10.67 cfs @ 12.04 hrs, Volume= 74,356 cf
Primary = 10.67 cfs @ 12.04 hrs, Volume= 74,356 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

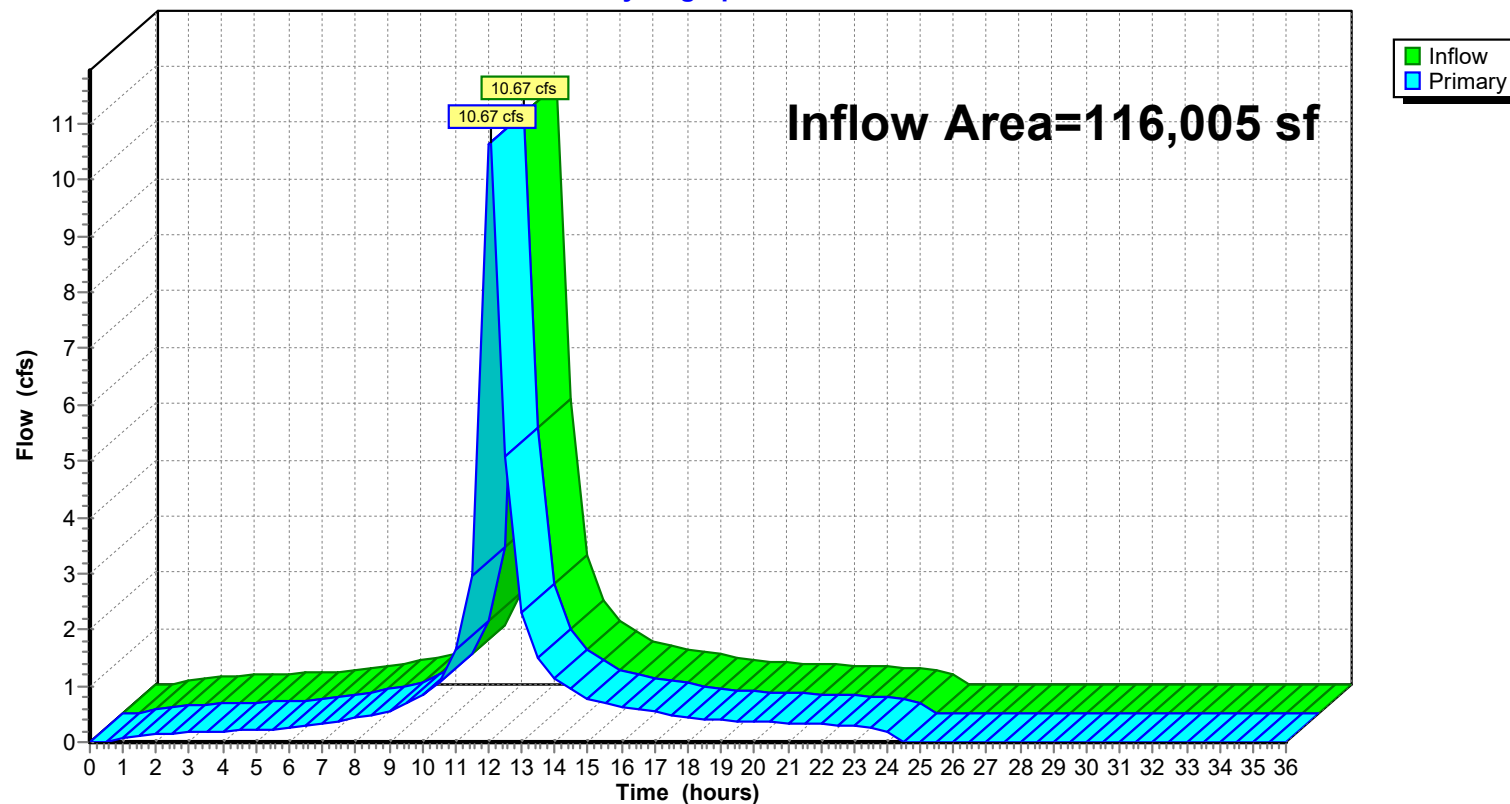

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2020 Rainfall=9.18", P2=3.47"

Printed 1/28/2026

Page 70


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 7.61" for 100-Year-2020 event
Inflow = 1.71 cfs @ 12.02 hrs, Volume= 10,992 cf
Primary = 1.71 cfs @ 12.02 hrs, Volume= 10,992 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2

Hydrograph

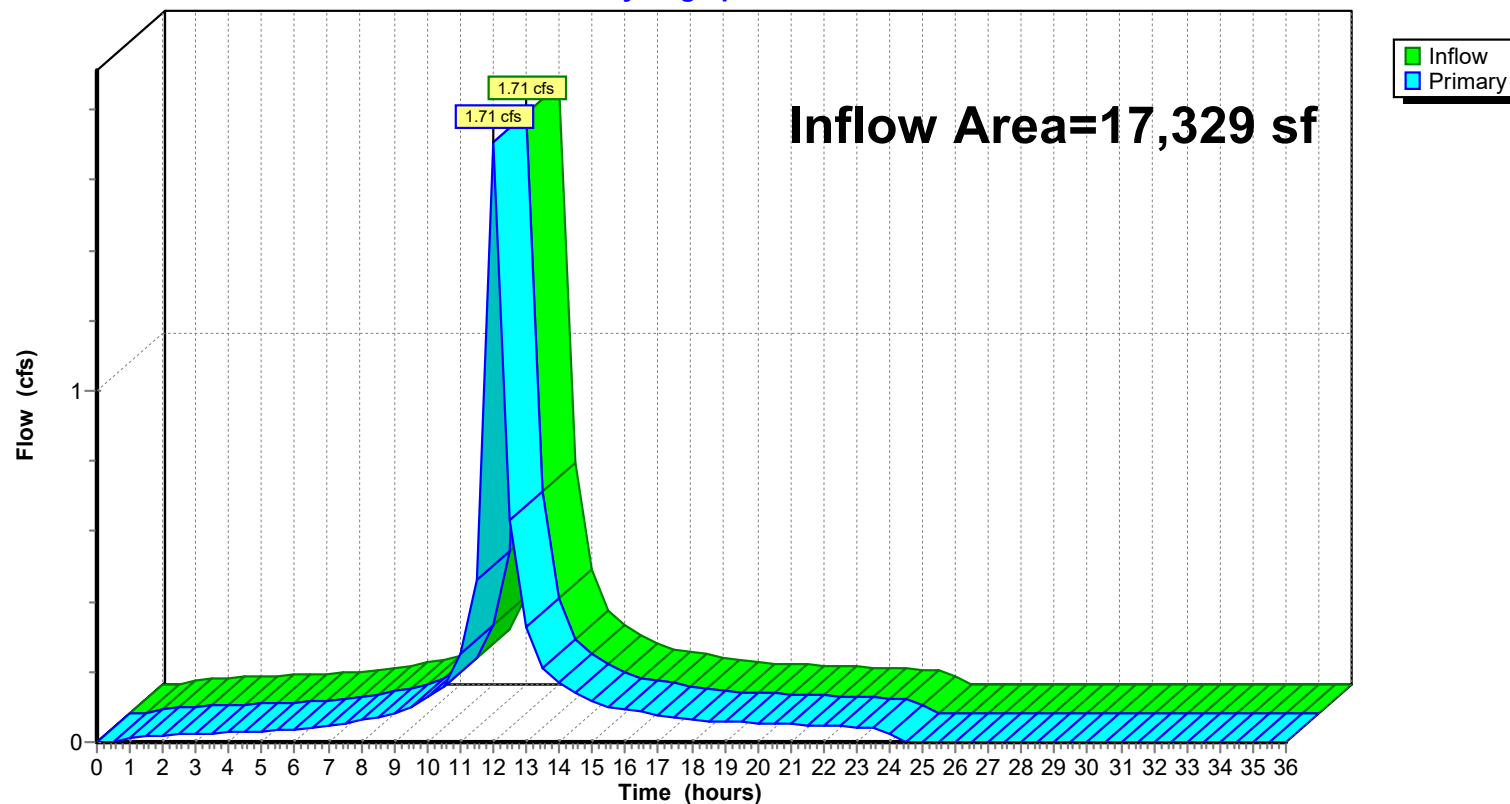

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 71

Summary for Subcatchment 1S: Roof

Runoff = 2.42 cfs @ 12.01 hrs, Volume= 15,592 cf, Depth= 3.85"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	53	0.0200	1.37		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.4	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 72

Subcatchment 1S: Roof

Hydrograph

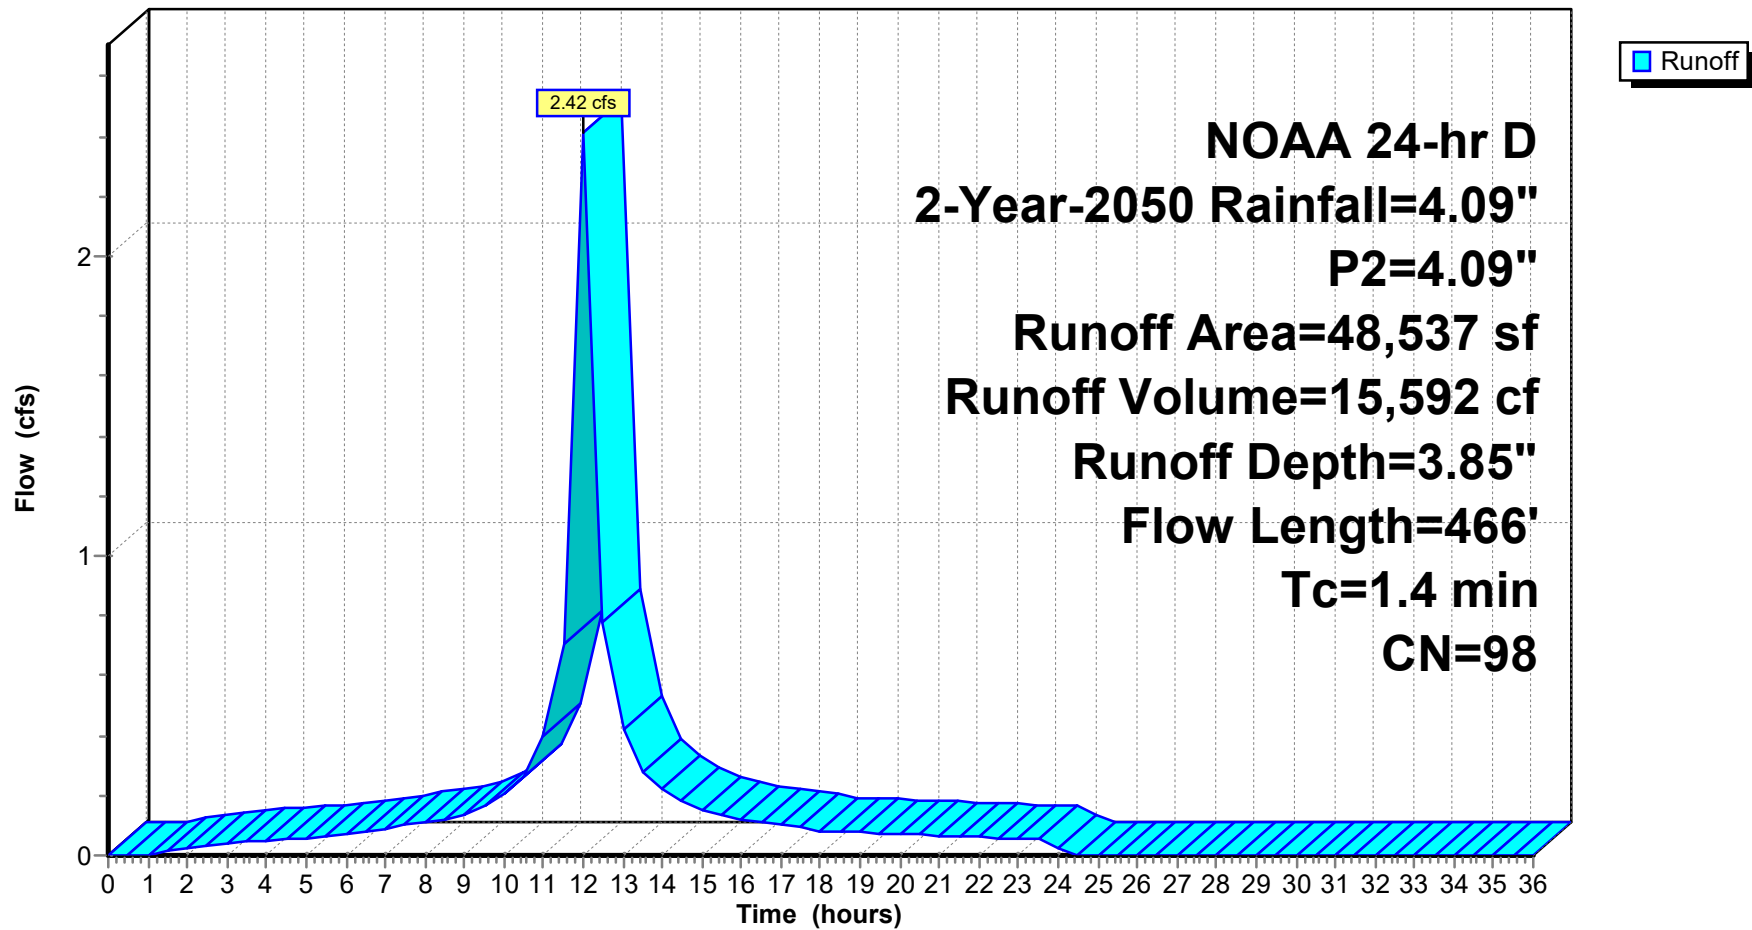

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 73

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 0.99 cfs @ 12.01 hrs, Volume= 6,417 cf, Depth= 3.85"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	100	0.0150	1.21		Sheet Flow, sheet flow Parking area n= 0.013 P2= 4.09"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.6	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 74

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

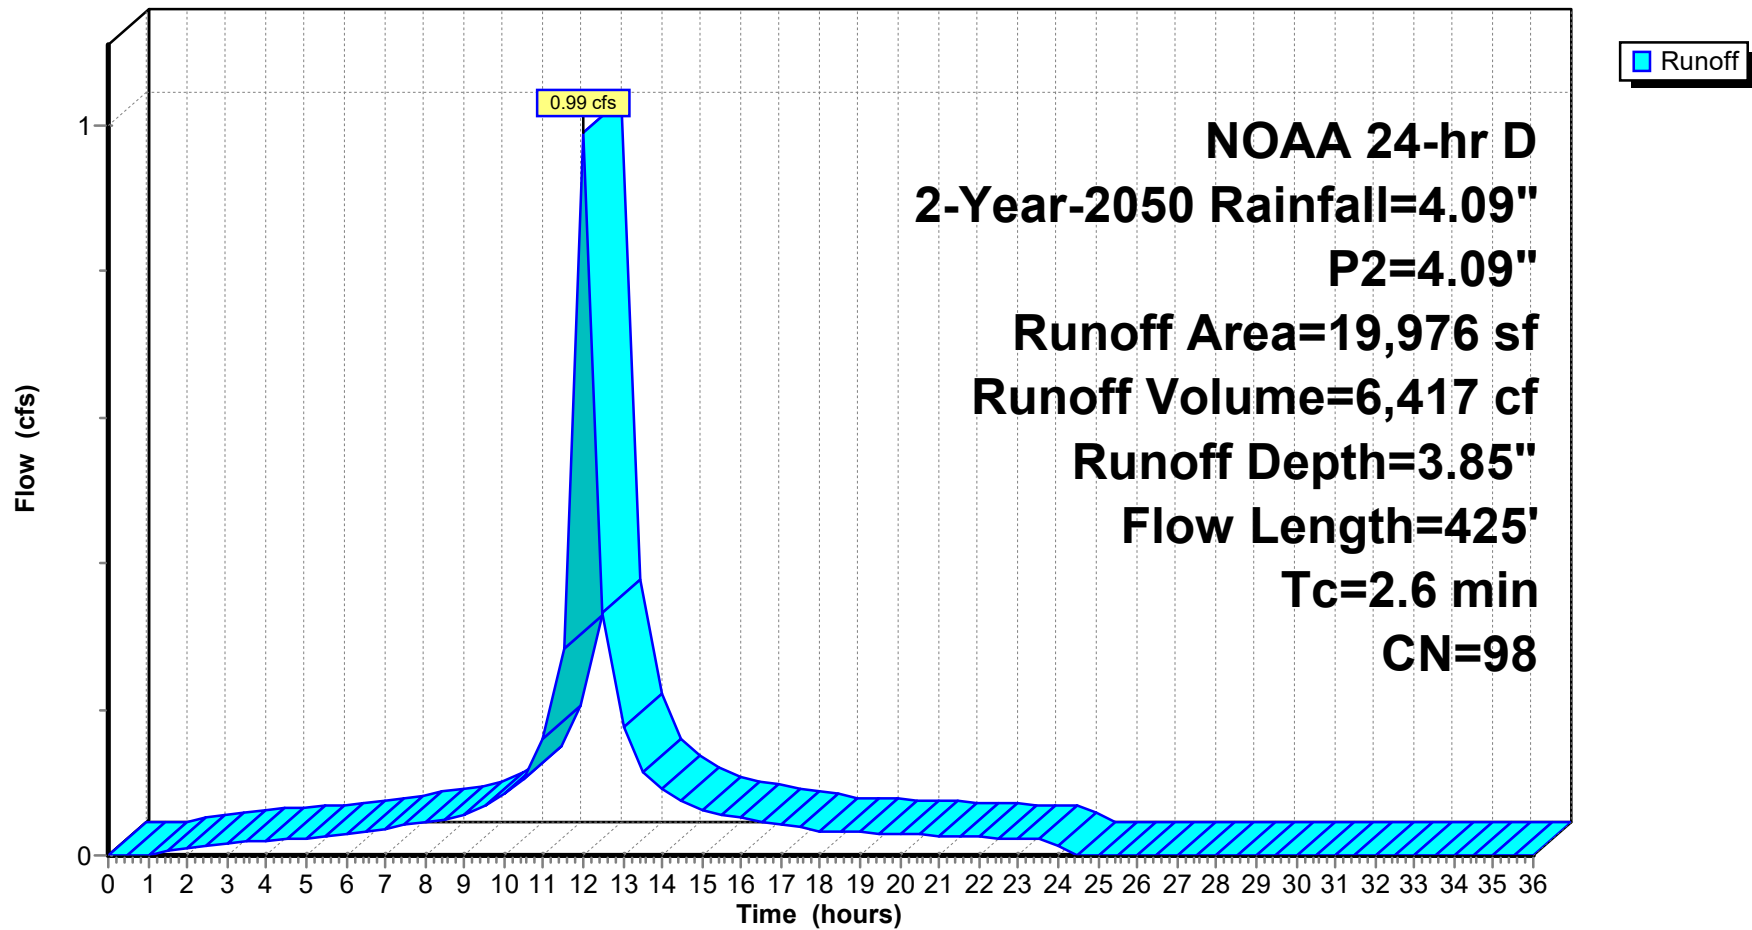

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 75

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.17 cfs @ 12.13 hrs, Volume= 1,208 cf, Depth= 1.66"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	100	0.0430	0.18		Sheet Flow, Grass: Dense n= 0.240 P2= 4.09"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
9.6	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 76

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

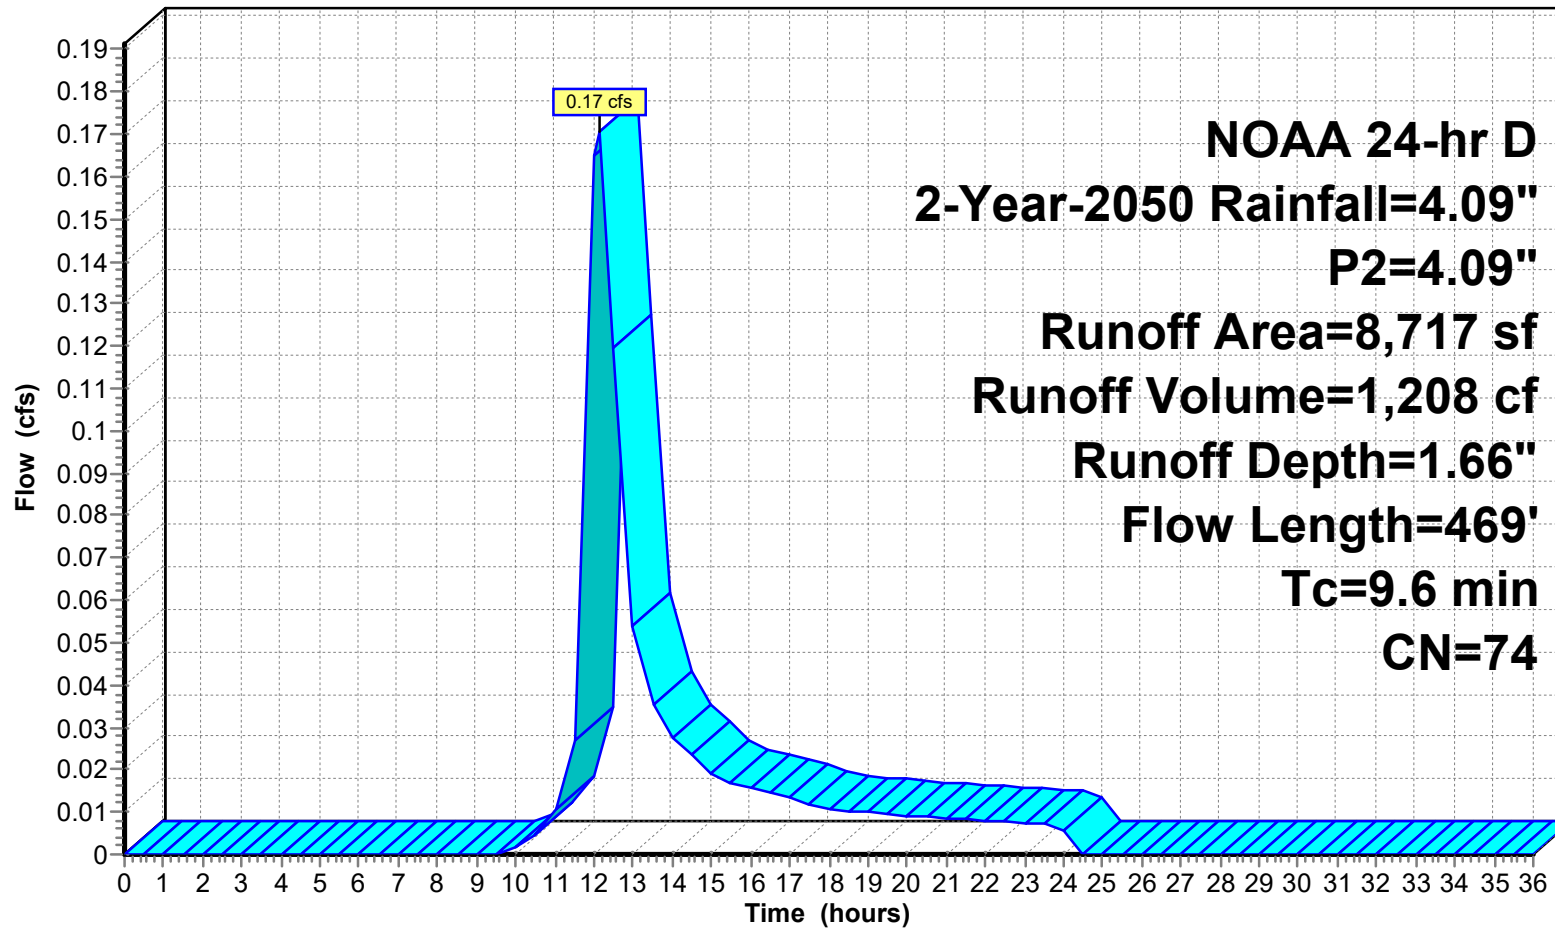

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 77

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 0.64 cfs @ 12.28 hrs, Volume= 5,145 cf, Depth= 1.59"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
13.1	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 78

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

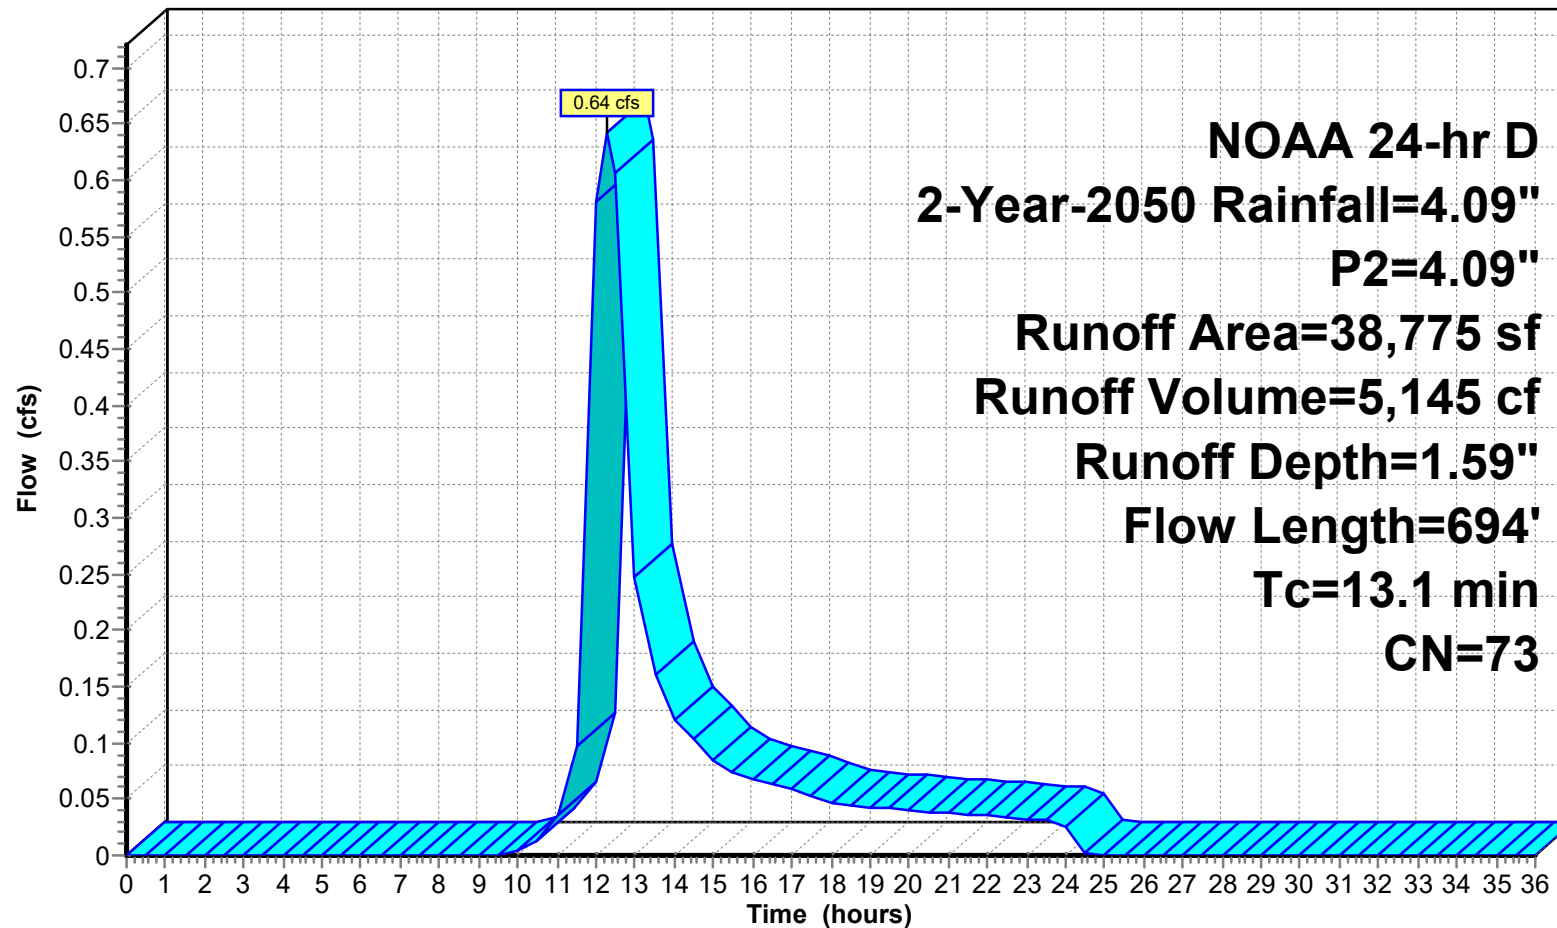

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 79

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.20 cfs @ 12.01 hrs, Volume= 1,298 cf, Depth= 3.85"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

	Area (sf)	CN	Description
*	4,040	98	DRIVE/SIDEWALK
	4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0500	2.24		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 80

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

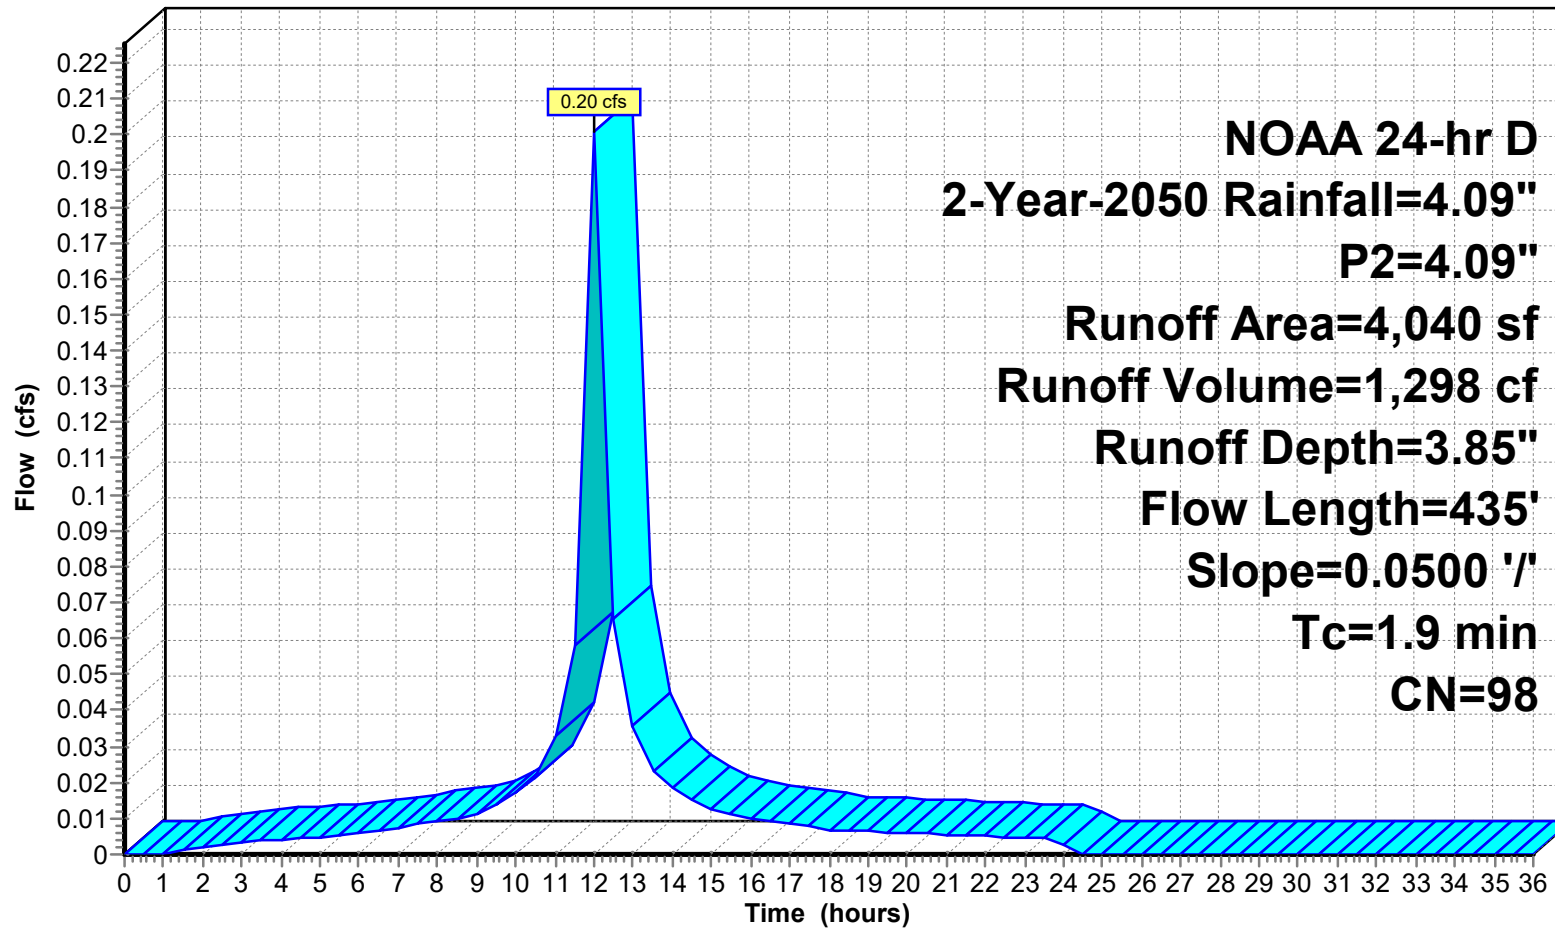

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 81

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.13 cfs @ 12.07 hrs, Volume= 821 cf, Depth= 1.66"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 82

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

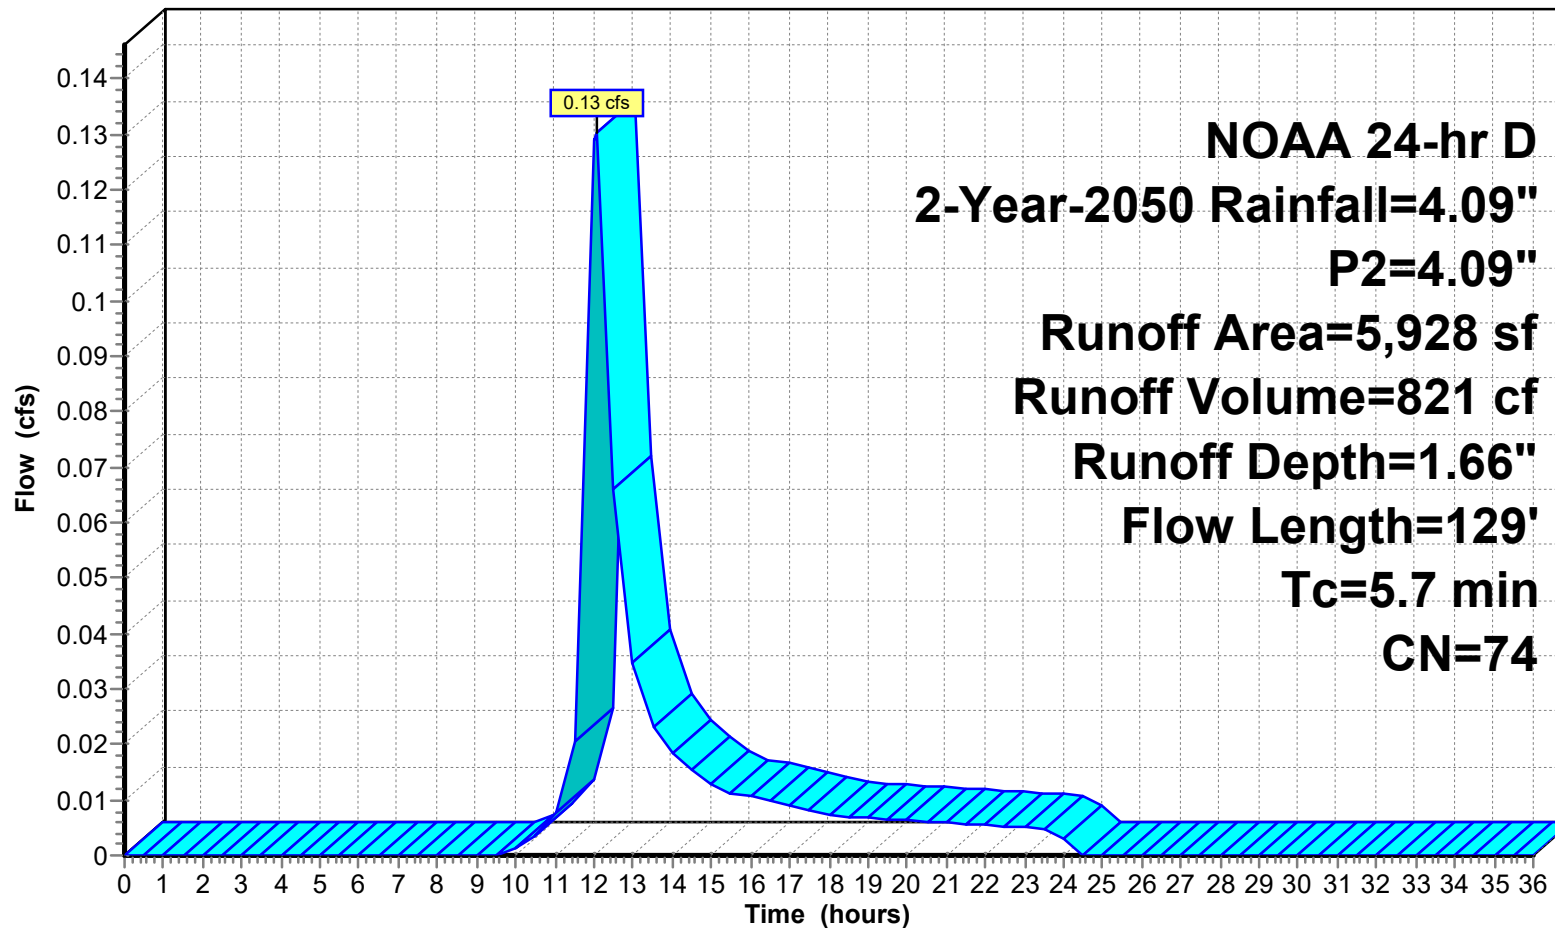

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 83

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.05 cfs @ 12.00 hrs, Volume= 315 cf, Depth= 3.85"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 84

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

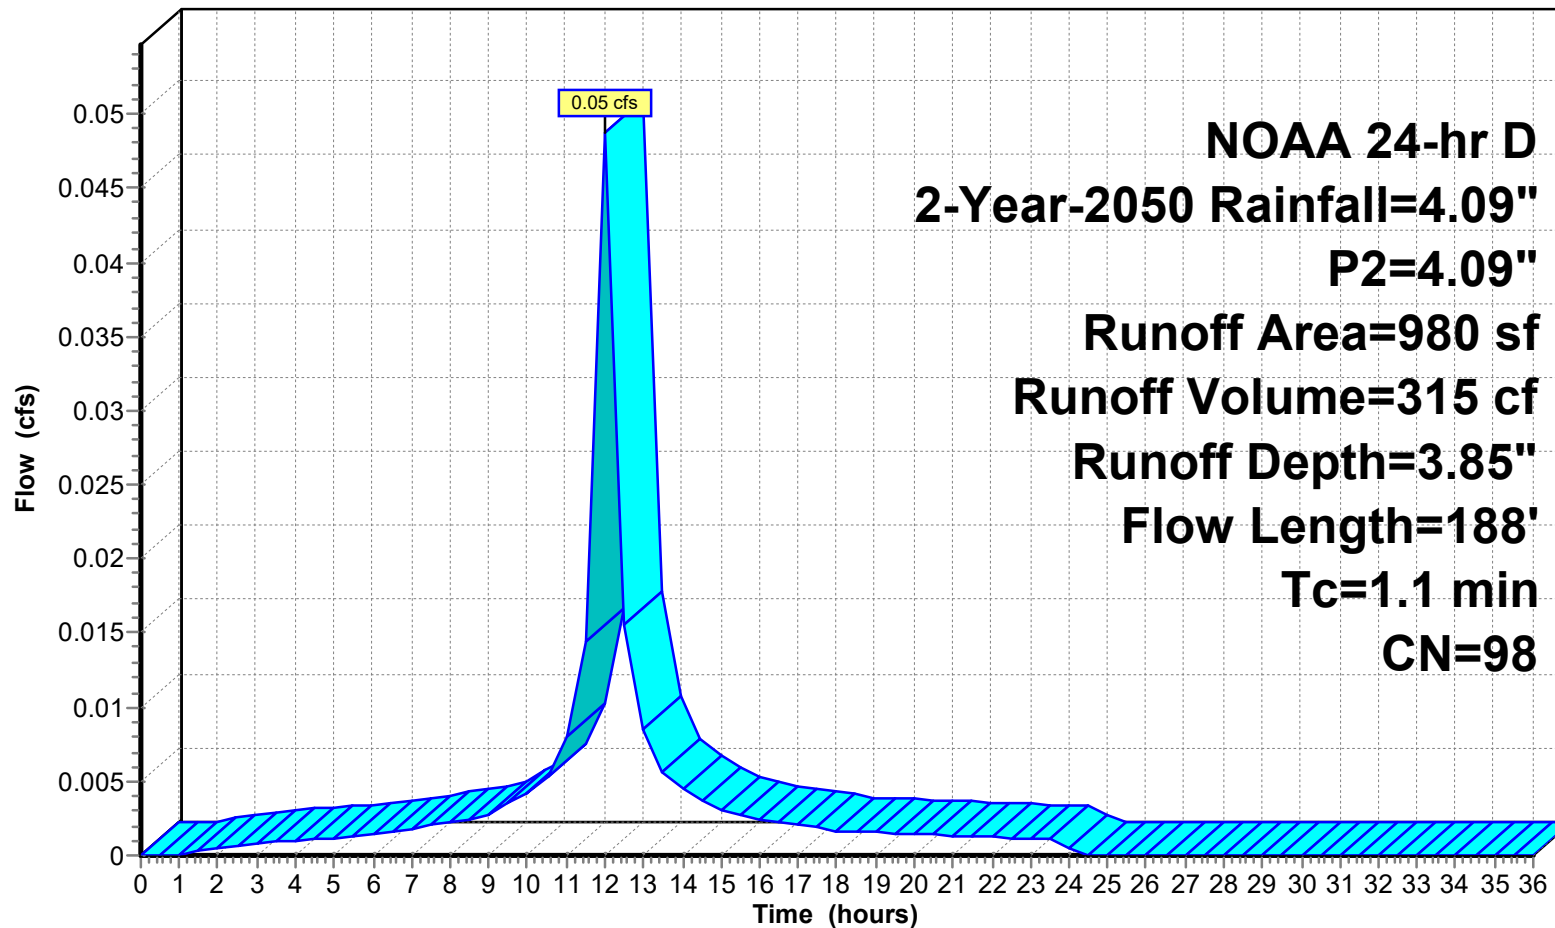

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 85

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.04 cfs @ 12.06 hrs, Volume= 261 cf, Depth= 1.66"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 86

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

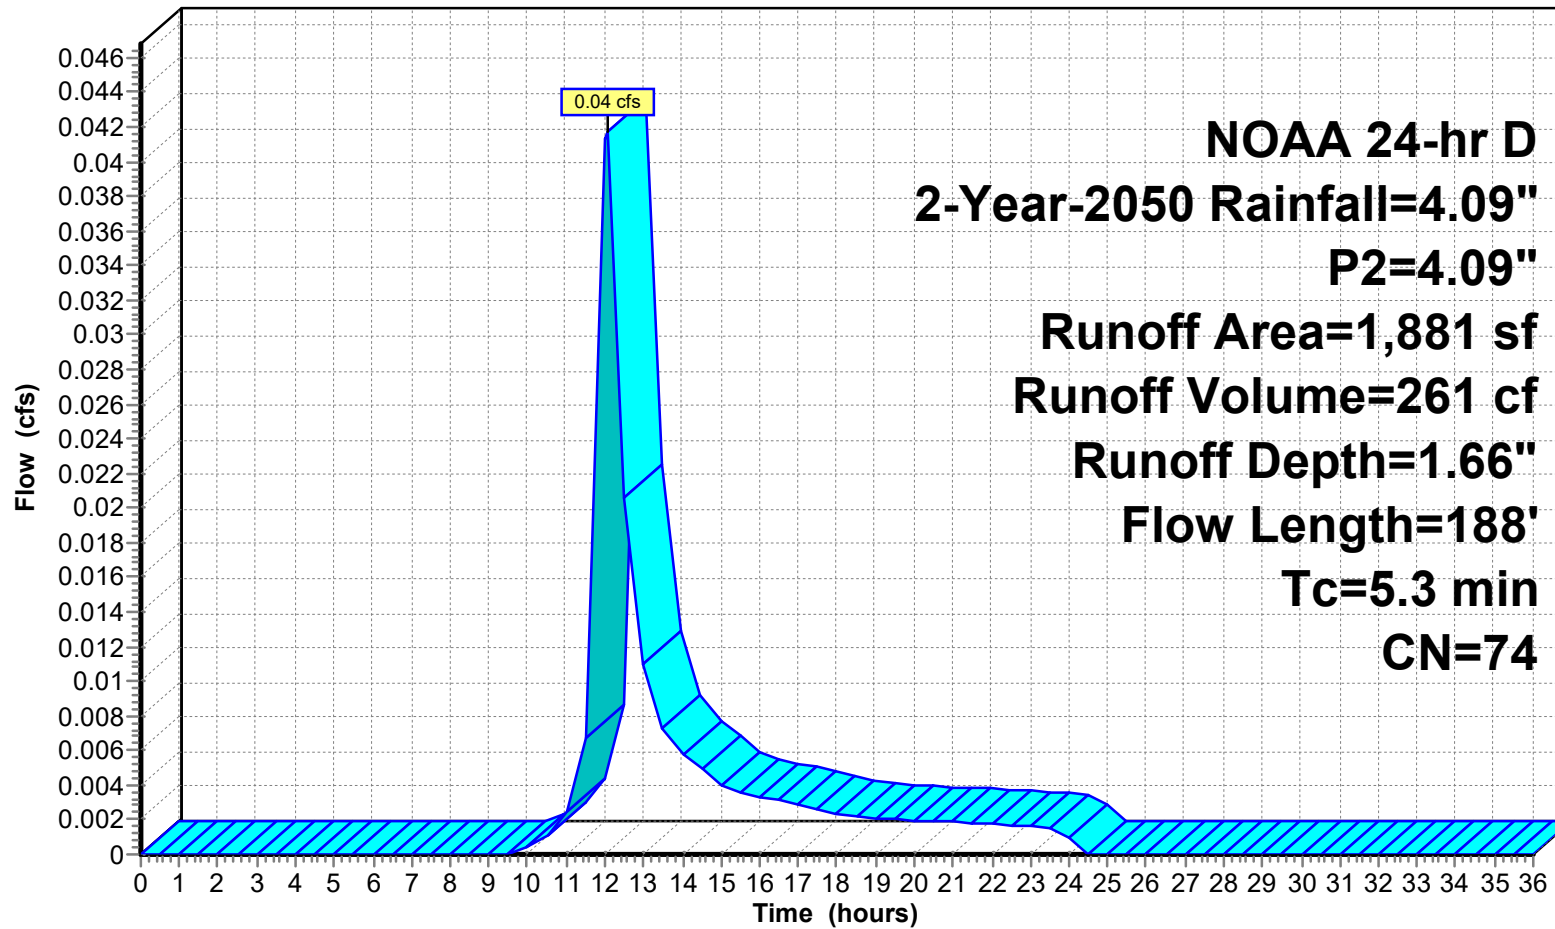

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 87

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.22 cfs @ 12.00 hrs, Volume= 1,446 cf, Depth= 3.85"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Area (sf)	CN	Description
* 4,500	98	Roof and Amenity Area
4,500		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	52	0.0100	1.03		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.0	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 88

Subcatchment P3C: P3C- Roof Area

Hydrograph

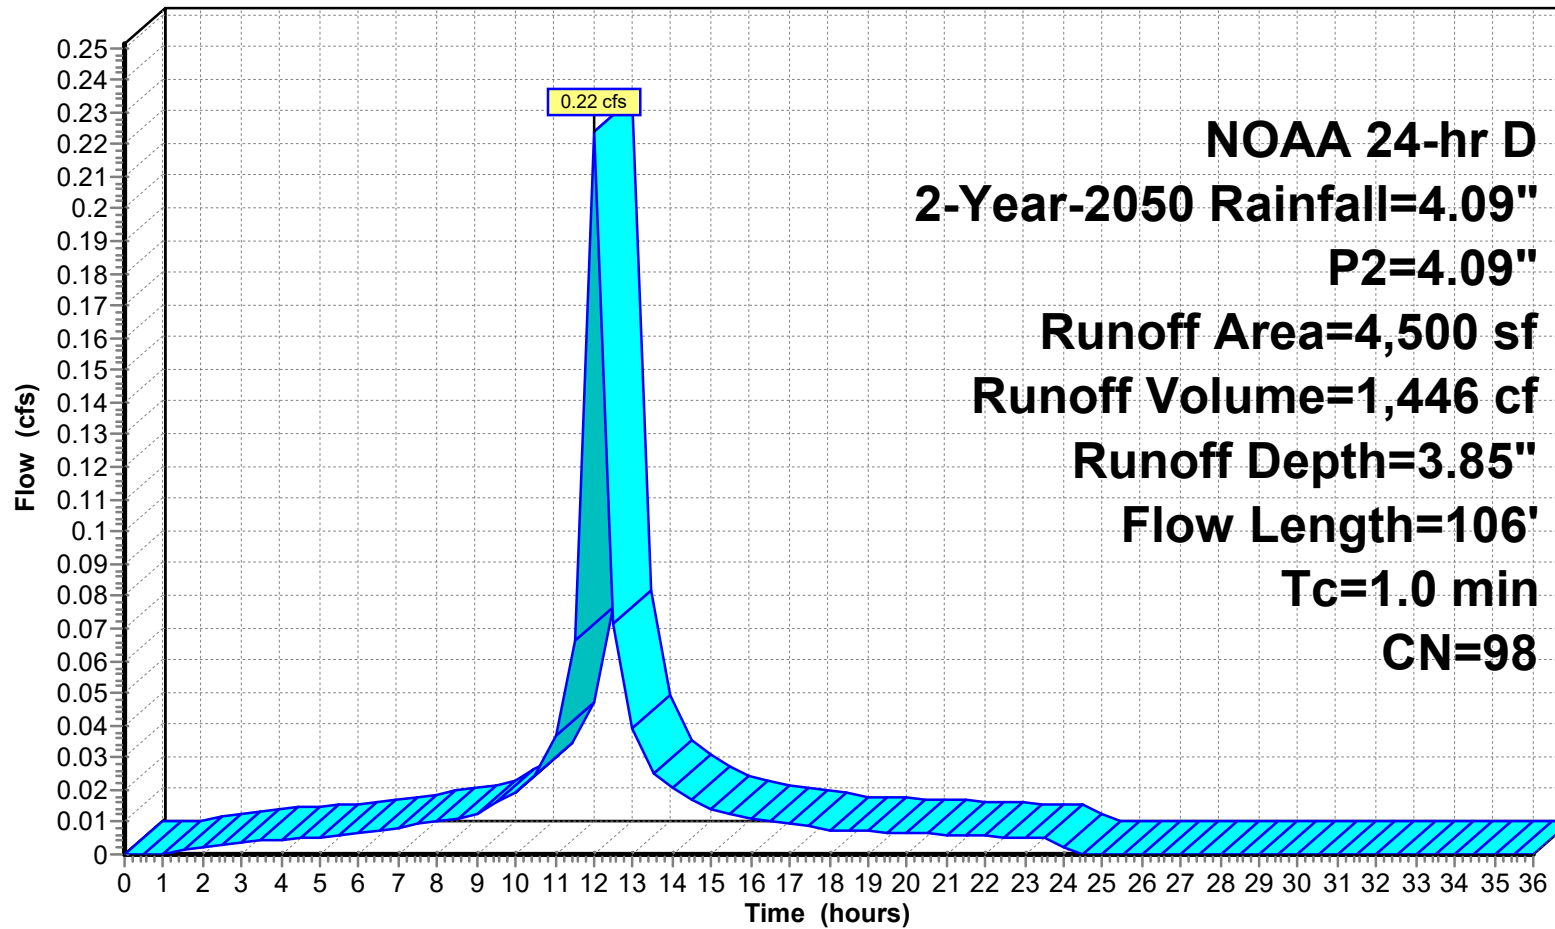

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 89


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 3.61" for 2-Year-2050 event
Inflow = 3.58 cfs @ 12.01 hrs, Volume= 23,217 cf
Primary = 3.58 cfs @ 12.01 hrs, Volume= 23,217 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

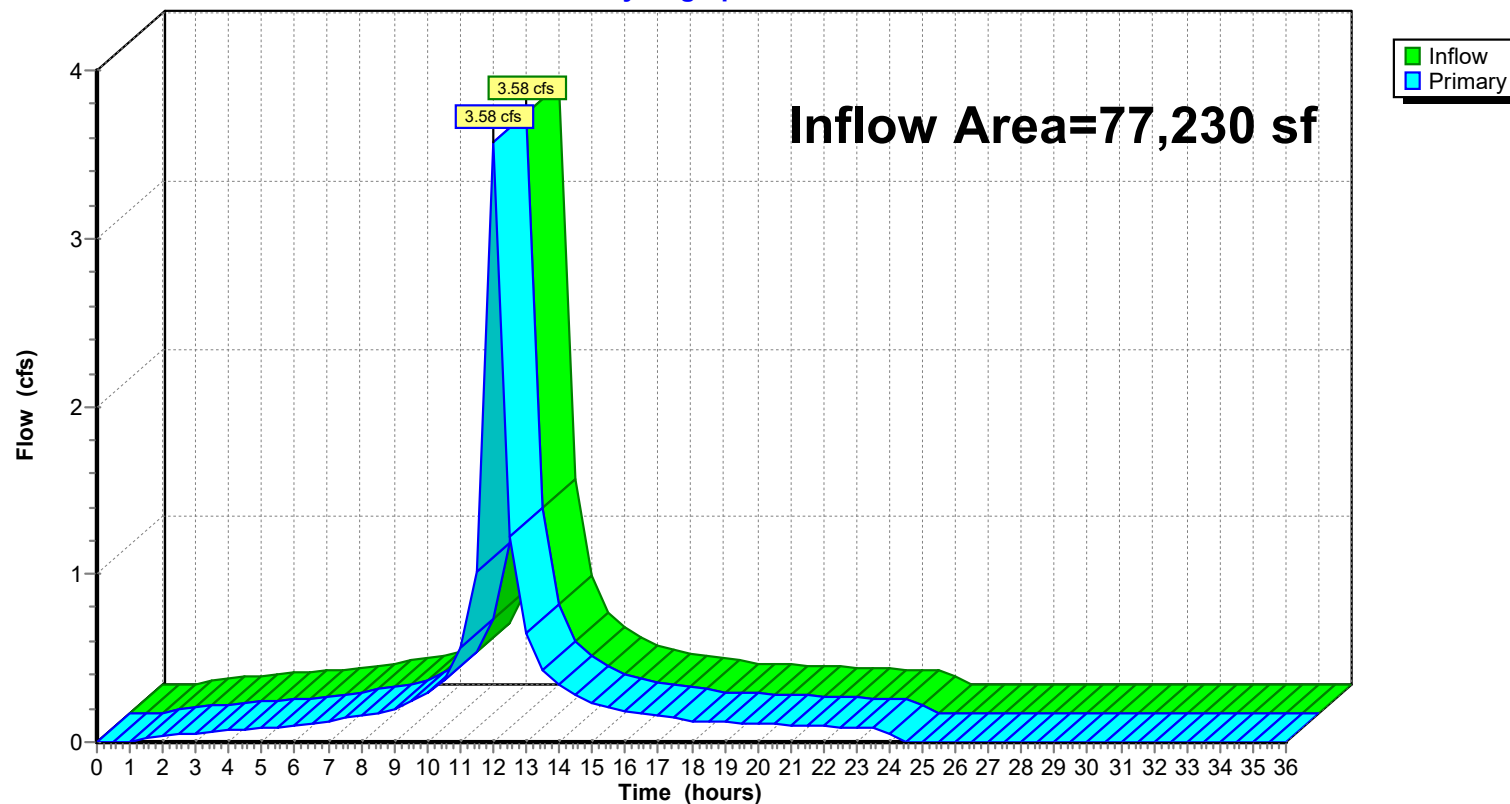

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 90


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 2.93" for 2-Year-2050 event
Inflow = 4.81 cfs @ 12.03 hrs, Volume= 32,502 cf
Primary = 4.81 cfs @ 12.03 hrs, Volume= 32,502 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

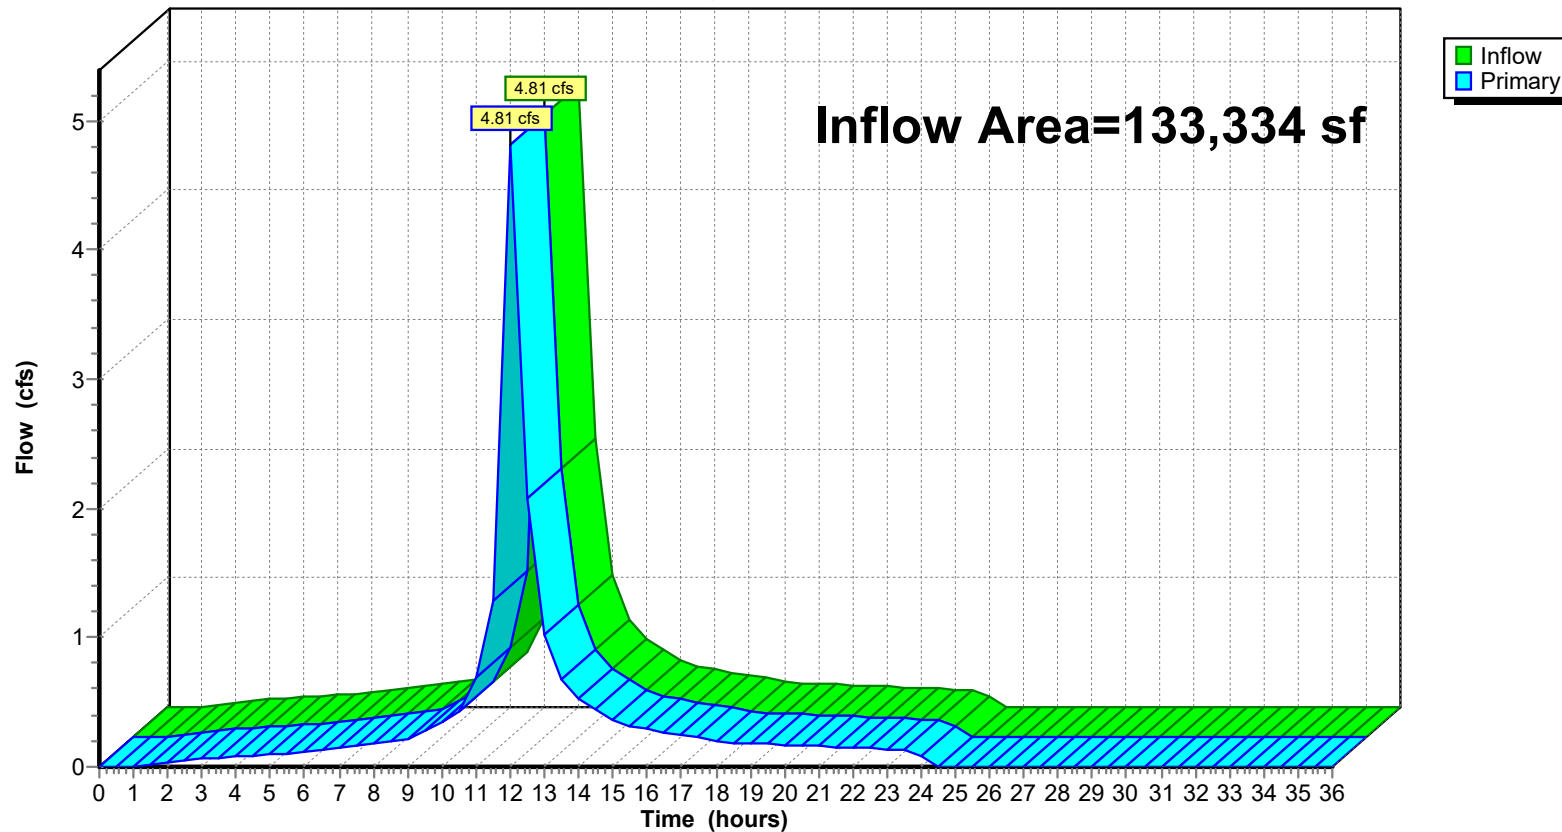

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 91


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 2.93" for 2-Year-2050 event
Inflow = 4.17 cfs @ 12.03 hrs, Volume= 28,362 cf
Primary = 4.17 cfs @ 12.03 hrs, Volume= 28,362 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

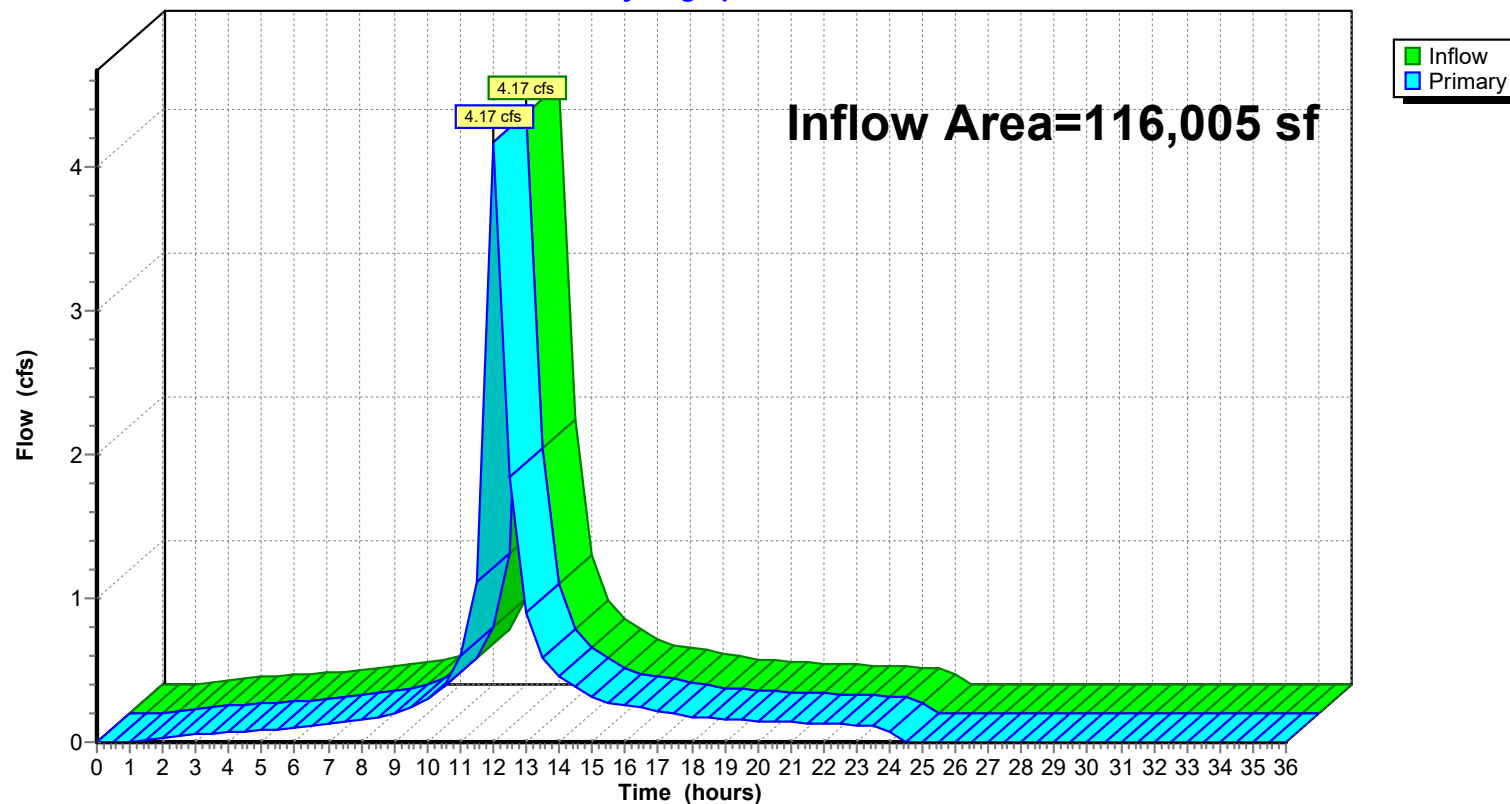

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 2-Year-2050 Rainfall=4.09", P2=4.09"

Printed 1/28/2026

Page 92


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 2.87" for 2-Year-2050 event
Inflow = 0.65 cfs @ 12.02 hrs, Volume= 4,140 cf
Primary = 0.65 cfs @ 12.02 hrs, Volume= 4,140 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2

Hydrograph

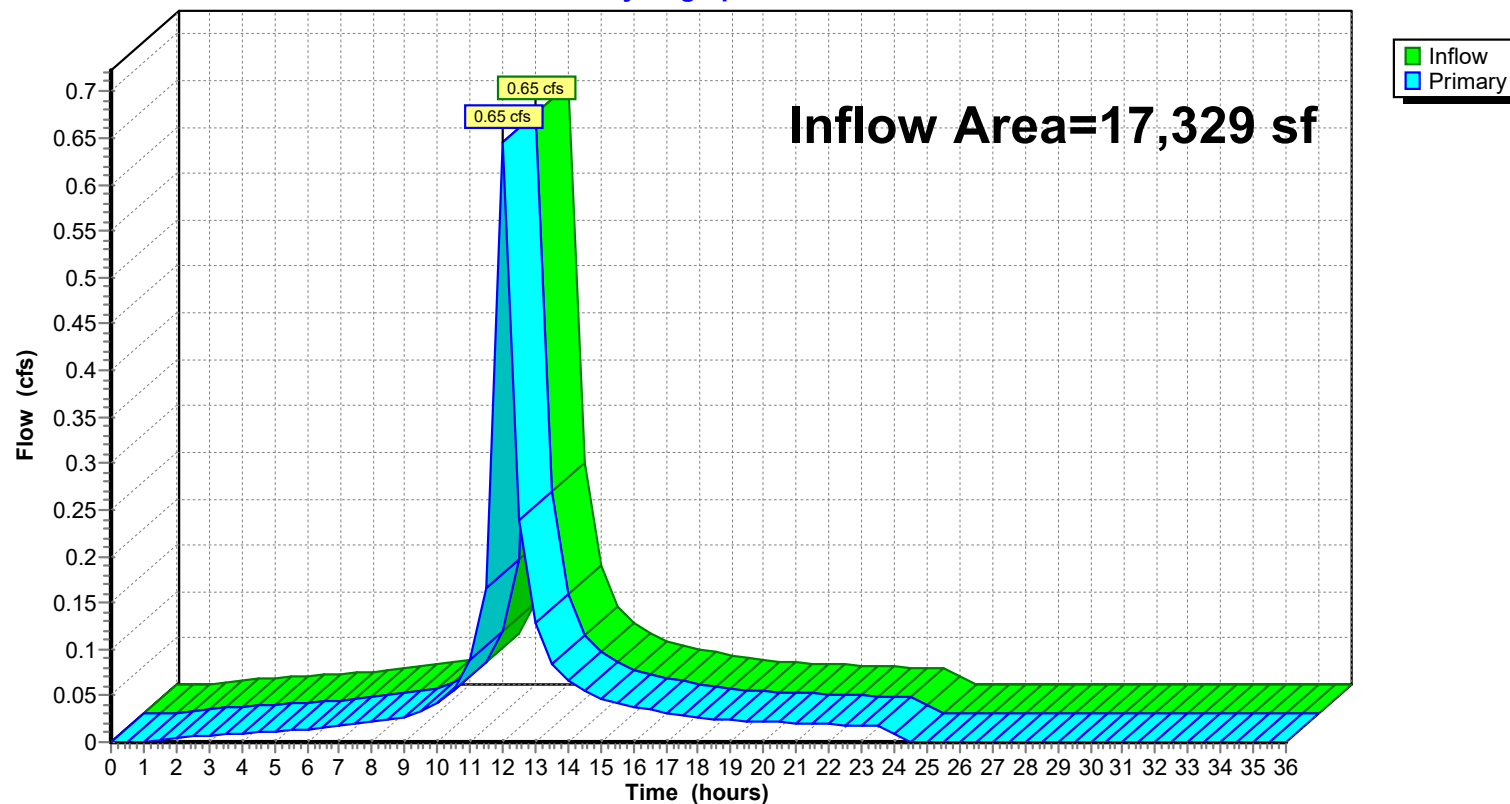

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 93

Summary for Subcatchment 1S: Roof

Runoff = 3.79 cfs @ 12.00 hrs, Volume= 24,800 cf, Depth= 6.13"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	53	0.0200	1.37		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.4	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 94

Subcatchment 1S: Roof

Hydrograph

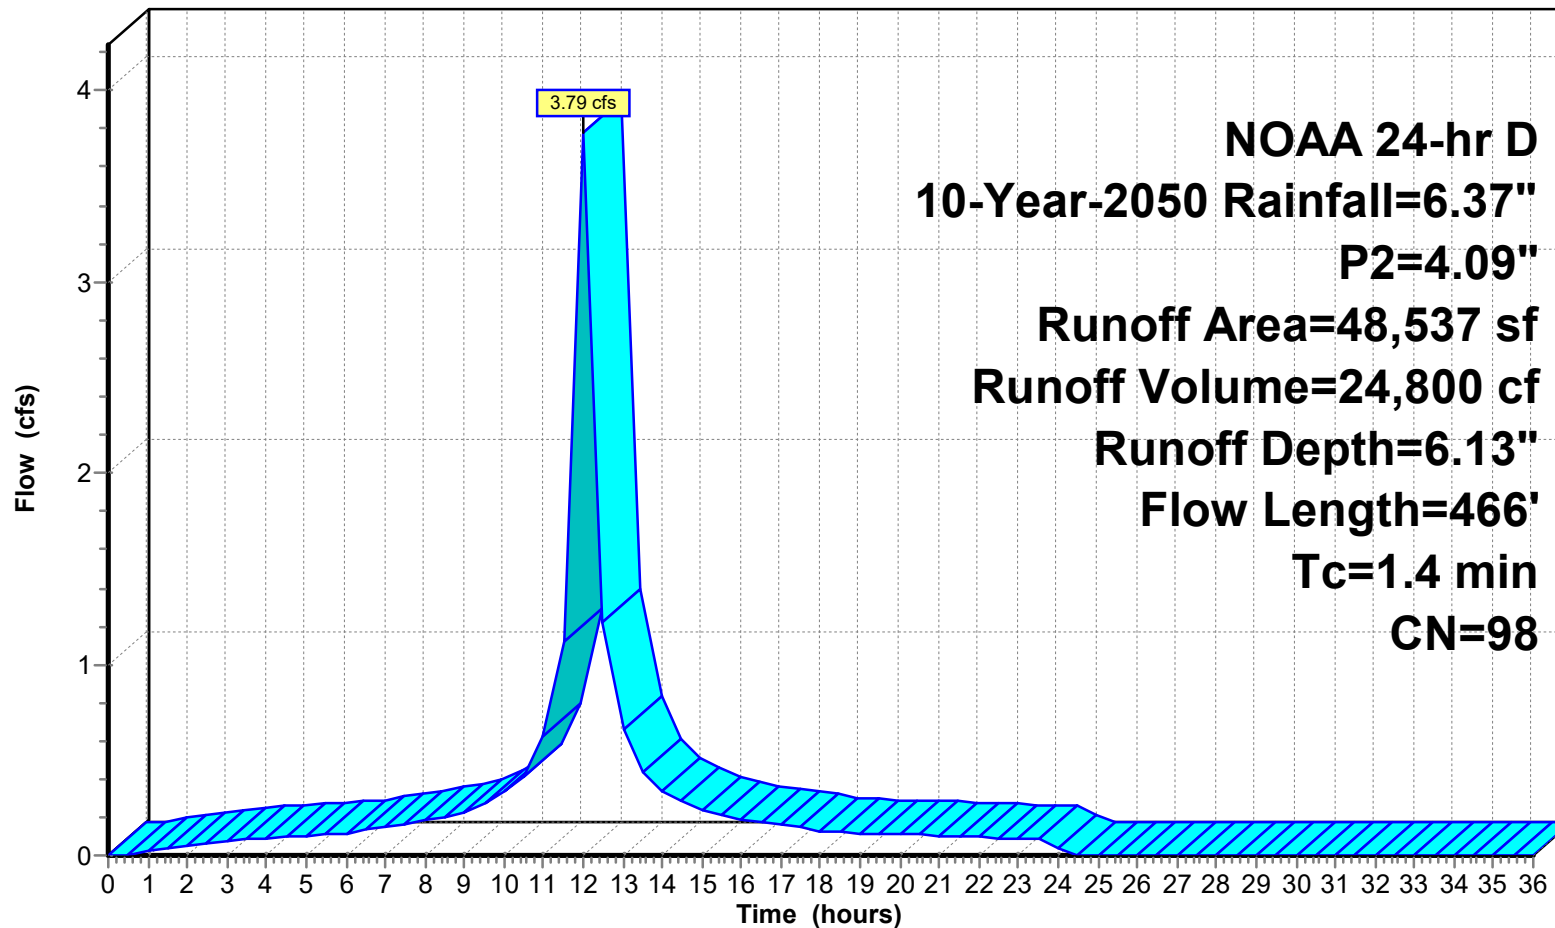

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 95

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 1.55 cfs @ 12.01 hrs, Volume= 10,207 cf, Depth= 6.13"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	100	0.0150	1.21		Sheet Flow, sheet flow Parking area n= 0.013 P2= 4.09"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.6	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 96

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

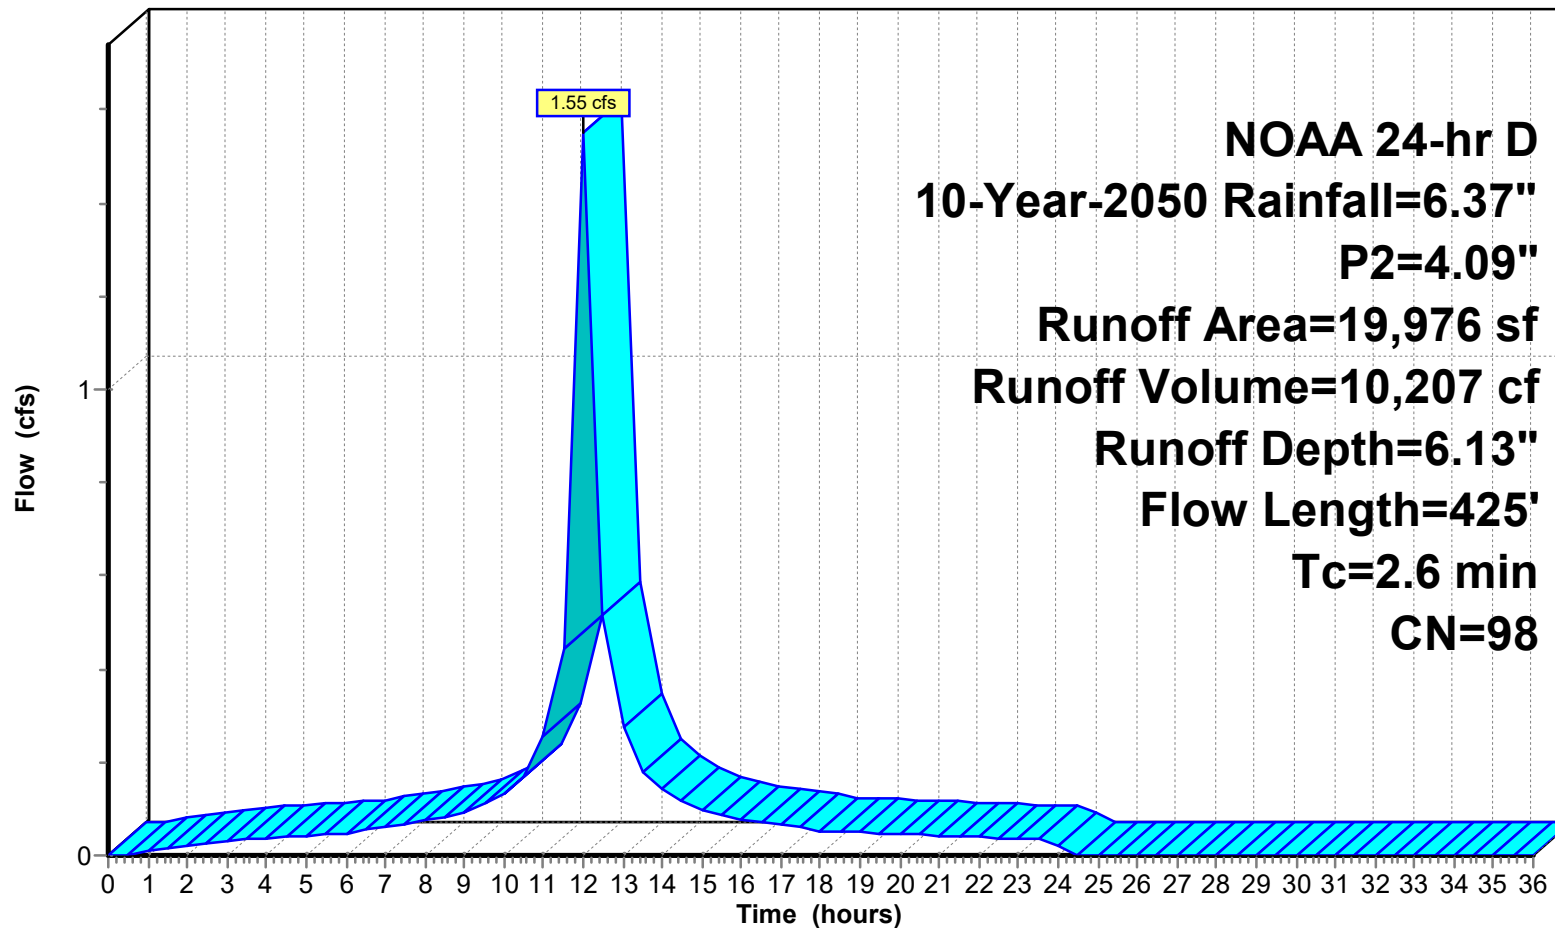

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 97

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.38 cfs @ 12.10 hrs, Volume= 2,541 cf, Depth= 3.50"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	100	0.0430	0.18		Sheet Flow, Grass: Dense n= 0.240 P2= 4.09"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
9.6	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 98

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

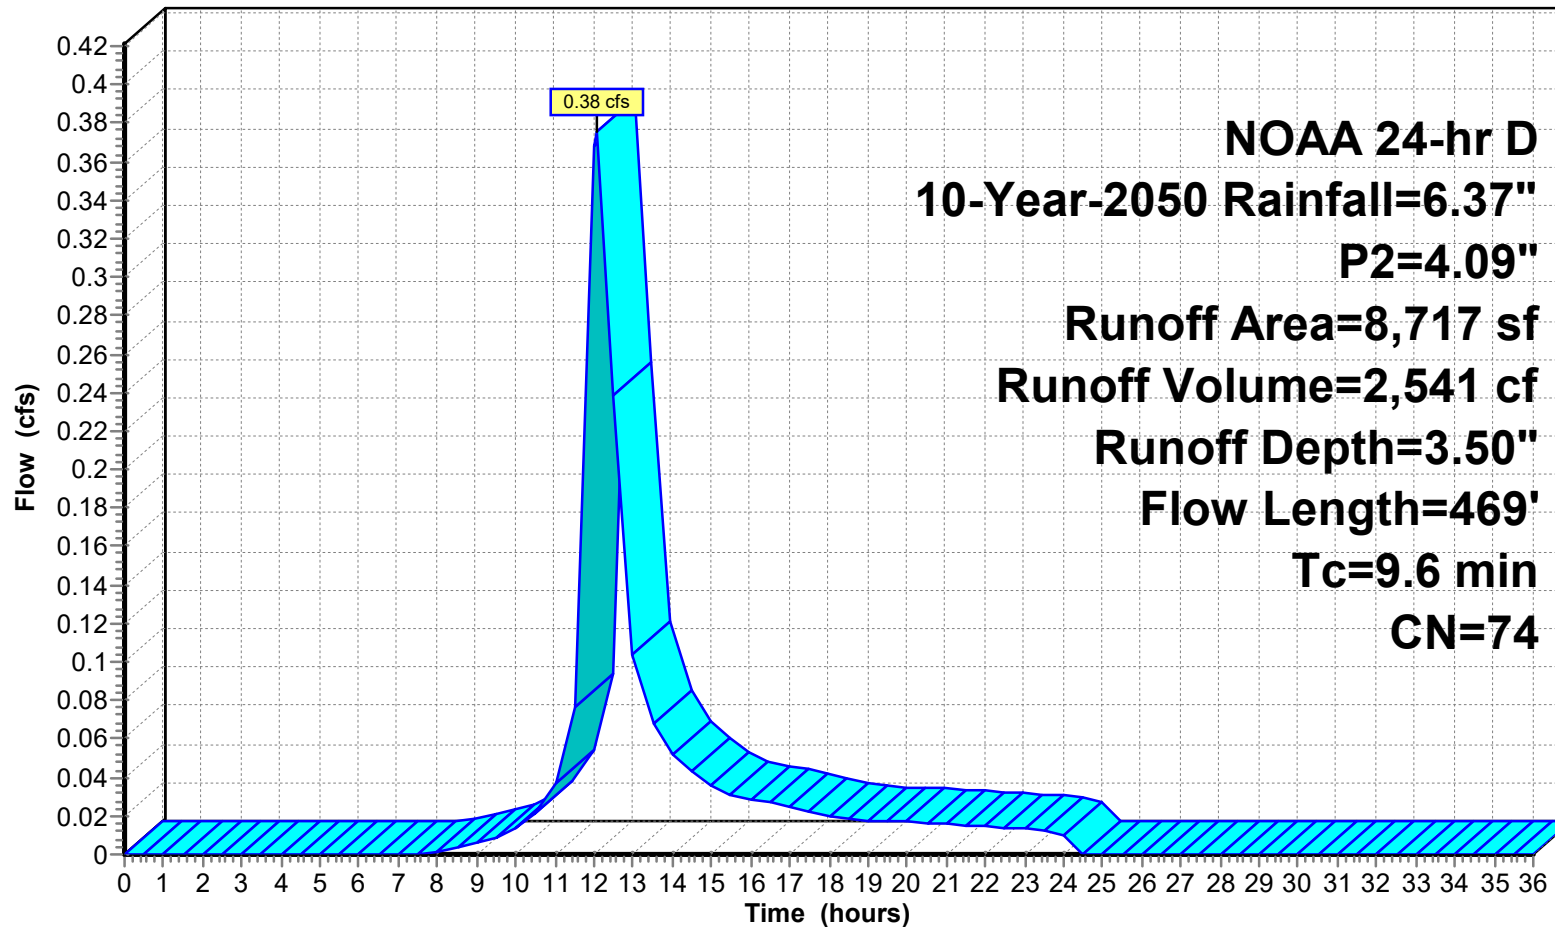

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 99

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 1.45 cfs @ 12.21 hrs, Volume= 10,980 cf, Depth= 3.40"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
13.1	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 100

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

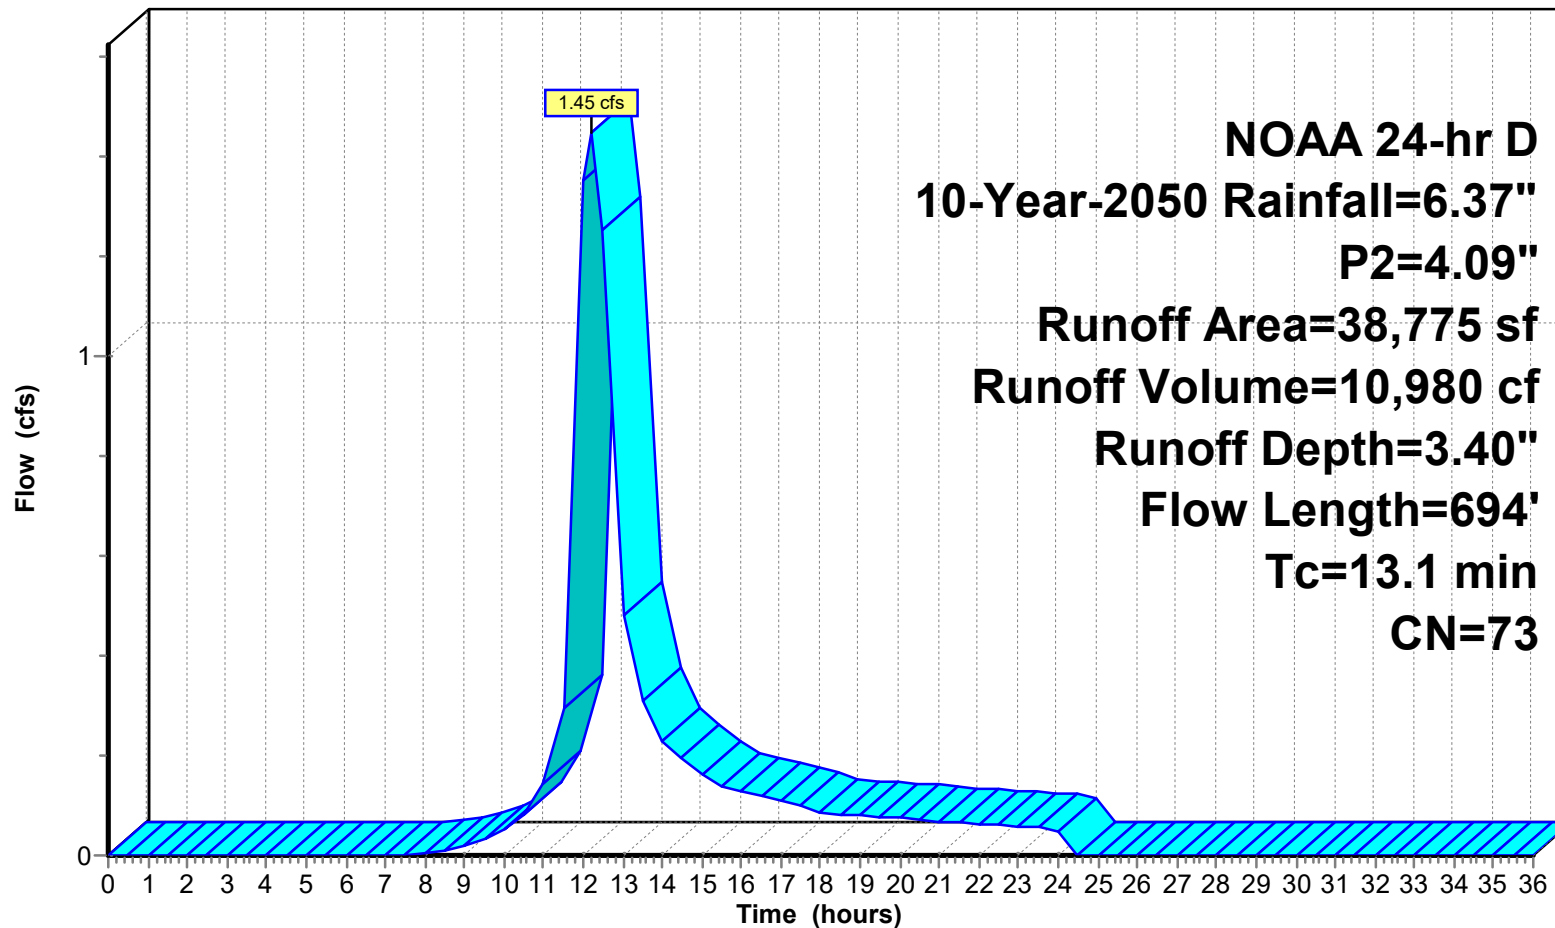

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 101

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.31 cfs @ 12.01 hrs, Volume= 2,064 cf, Depth= 6.13"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
* 4,040	98	DRIVE/SIDEWALK
4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0500	2.24		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 102

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

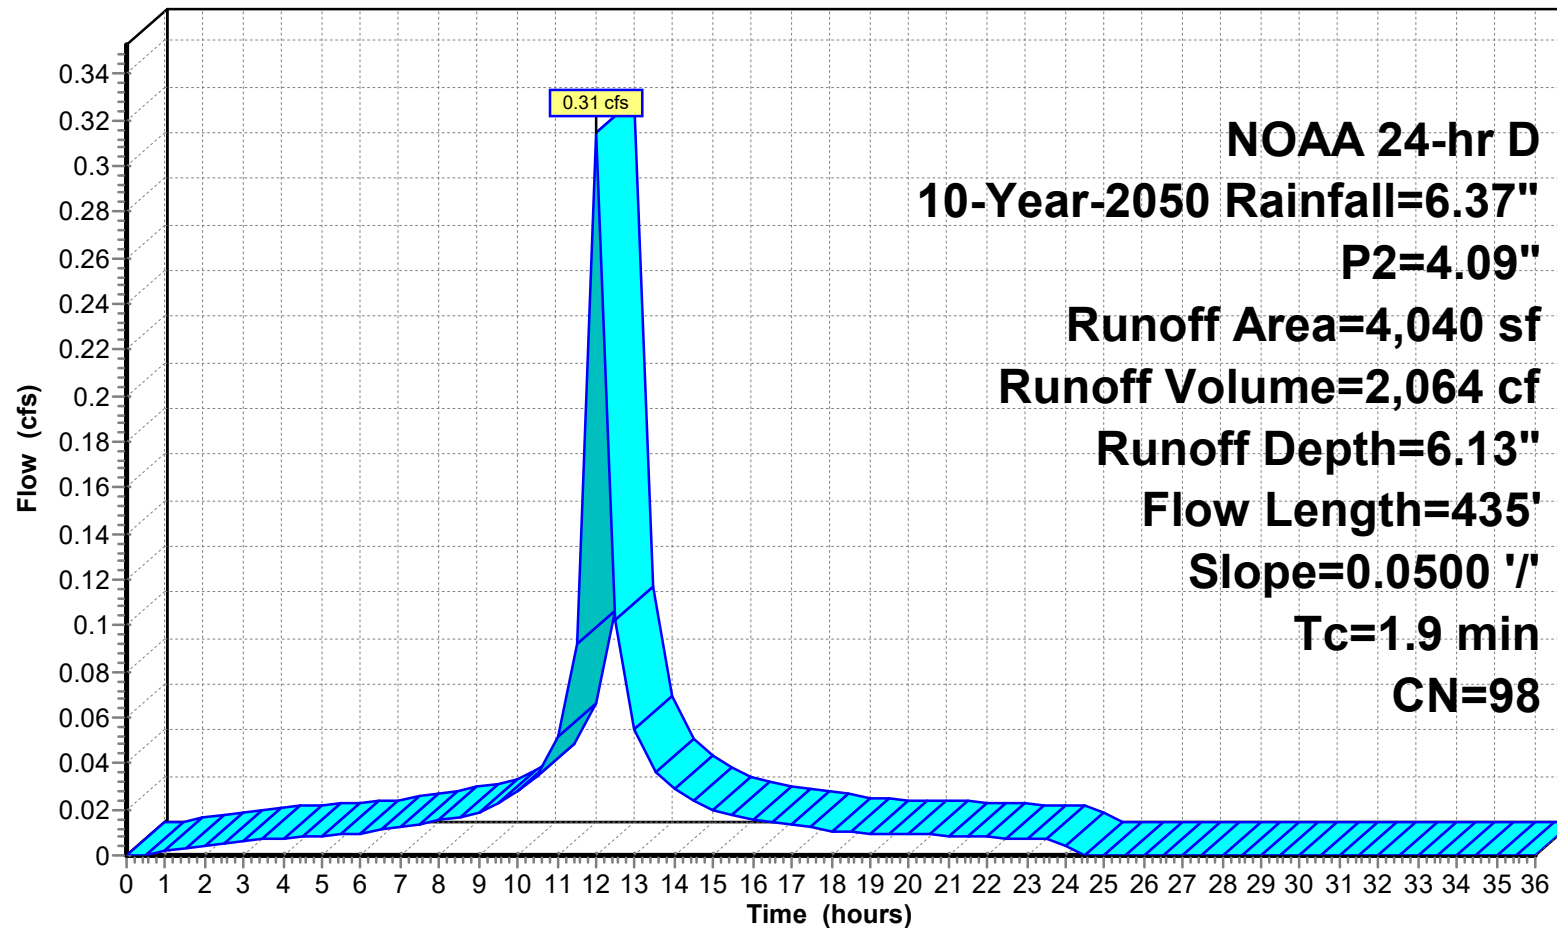

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 103

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.28 cfs @ 12.05 hrs, Volume= 1,728 cf, Depth= 3.50"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 104

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

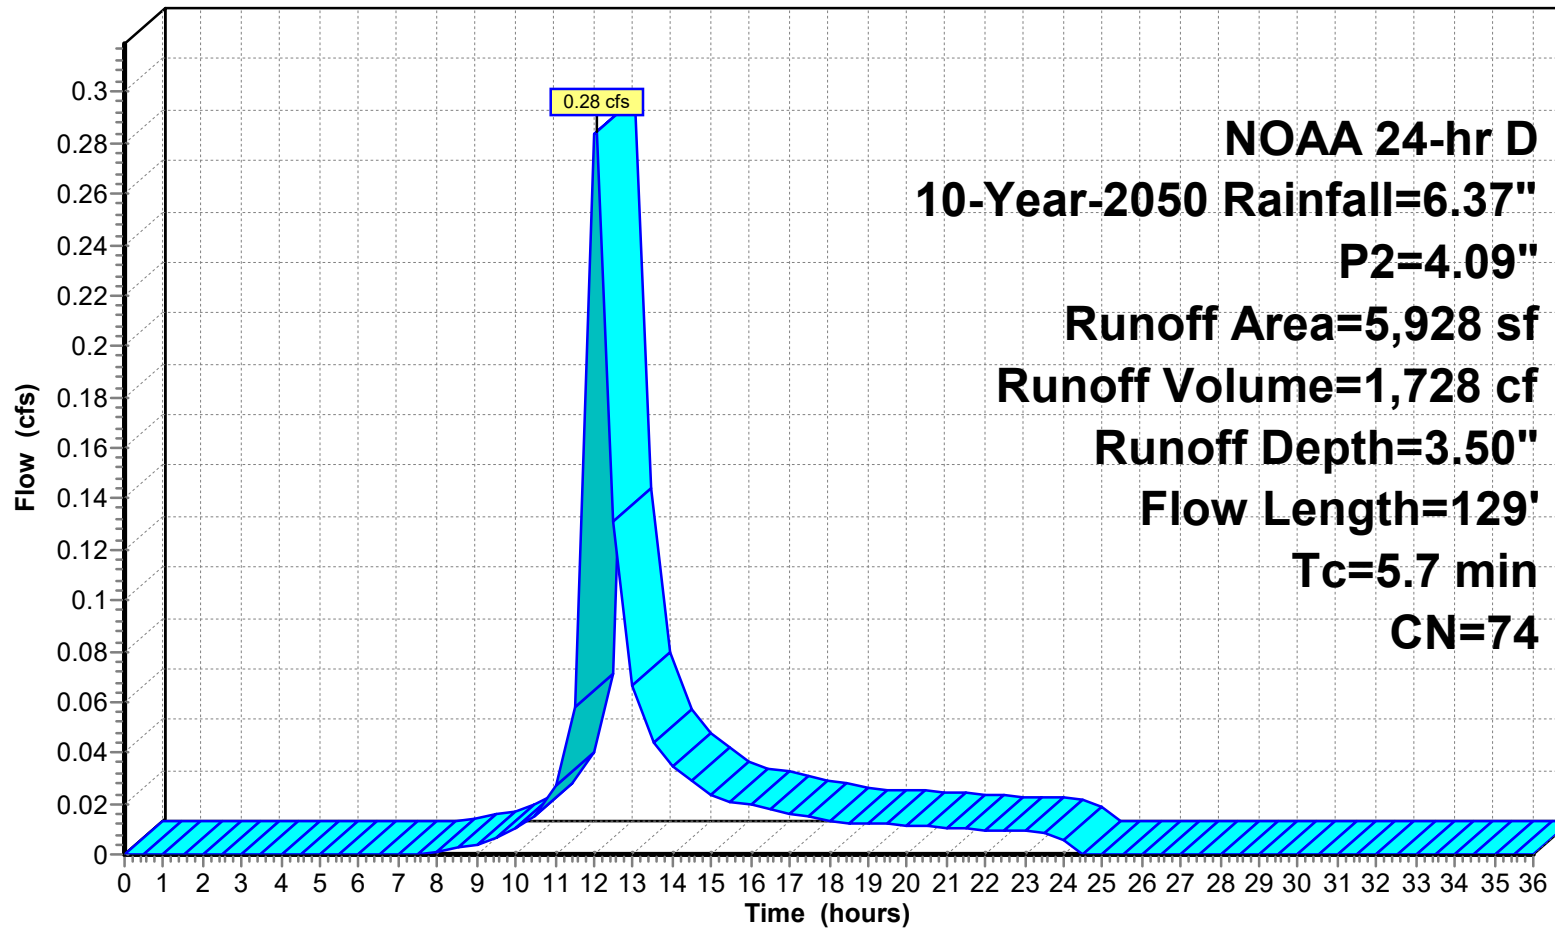

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 105

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.08 cfs @ 12.00 hrs, Volume= 501 cf, Depth= 6.13"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk
					Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 106

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

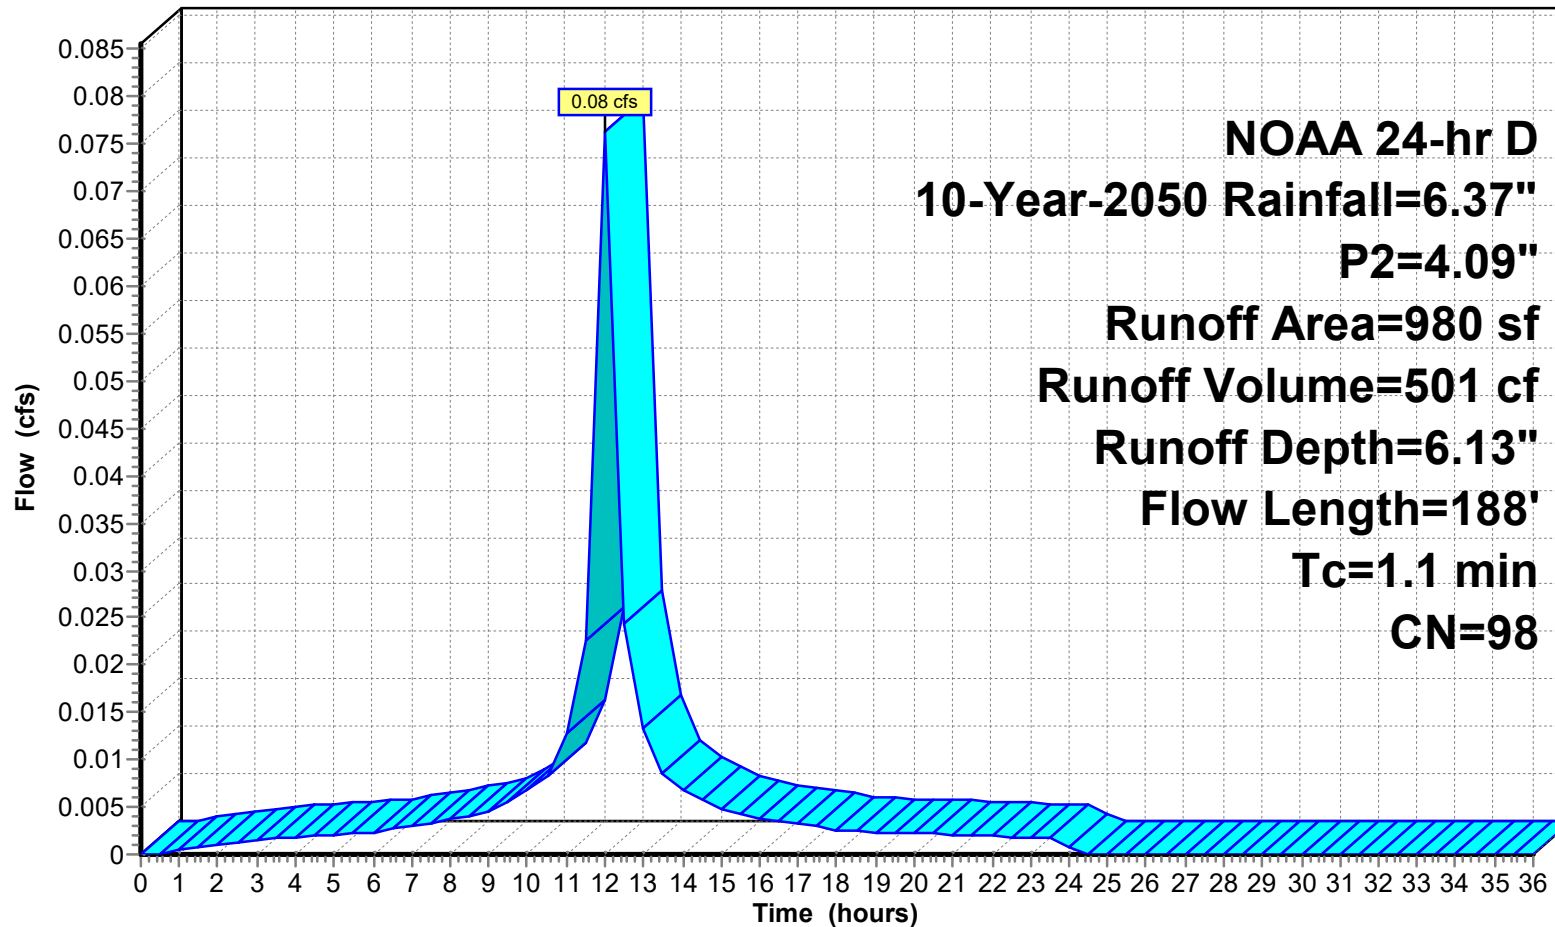

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 107

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.09 cfs @ 12.05 hrs, Volume= 548 cf, Depth= 3.50"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 108

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

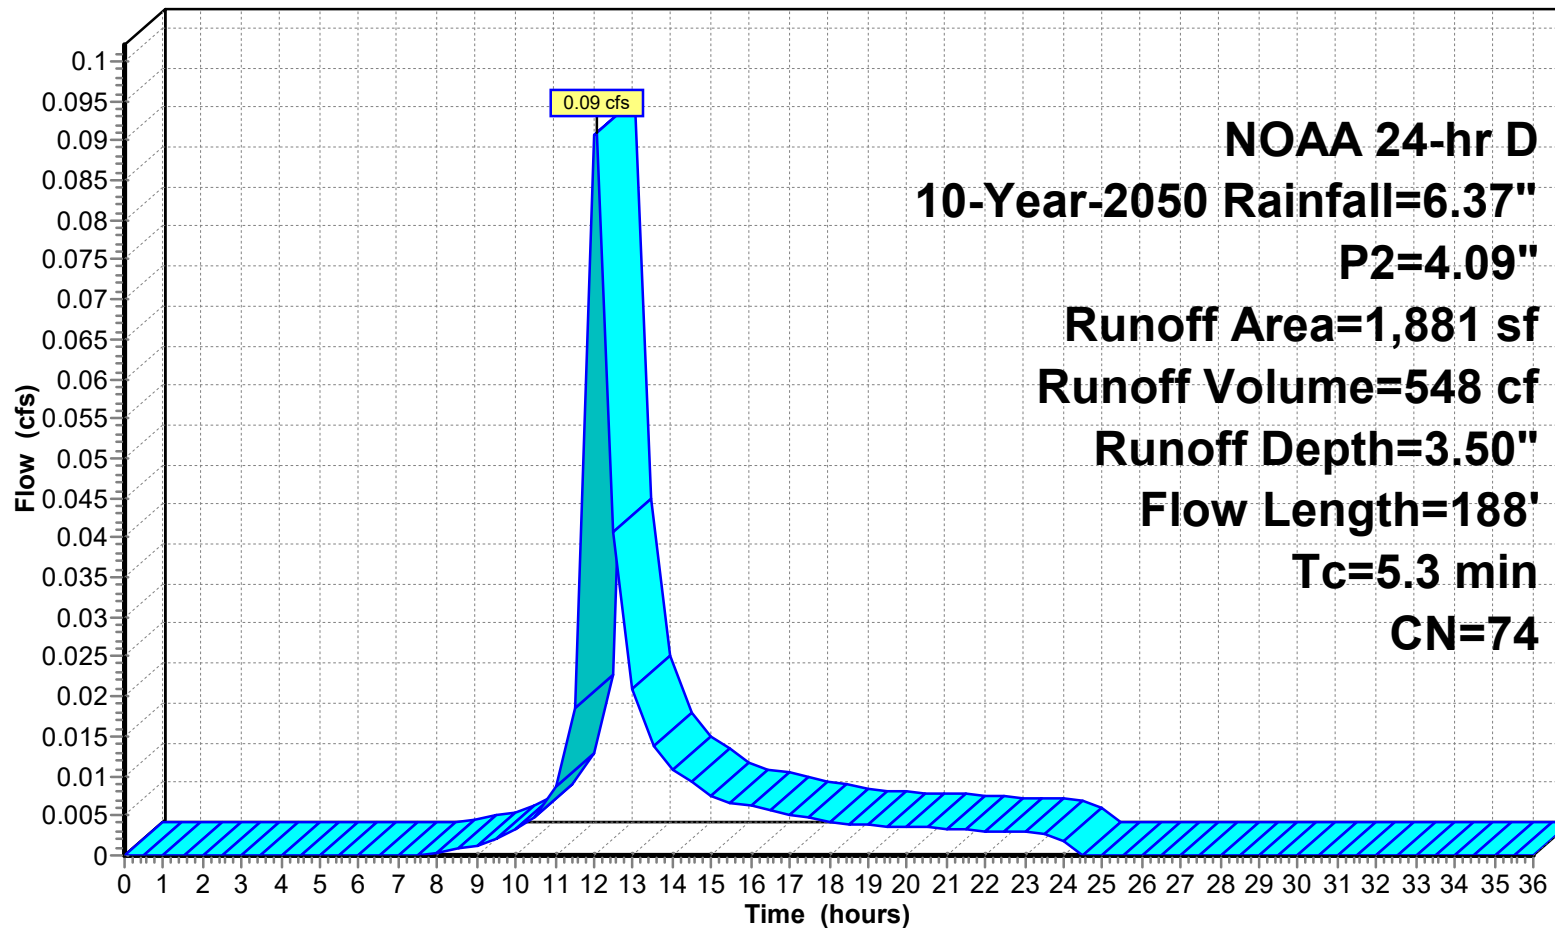

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 109

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.35 cfs @ 12.00 hrs, Volume= 2,299 cf, Depth= 6.13"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Area (sf)	CN	Description
* 4,500	98	Roof and Amenity Area
4,500		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	52	0.0100	1.03		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.0	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 110

Subcatchment P3C: P3C- Roof Area

Hydrograph

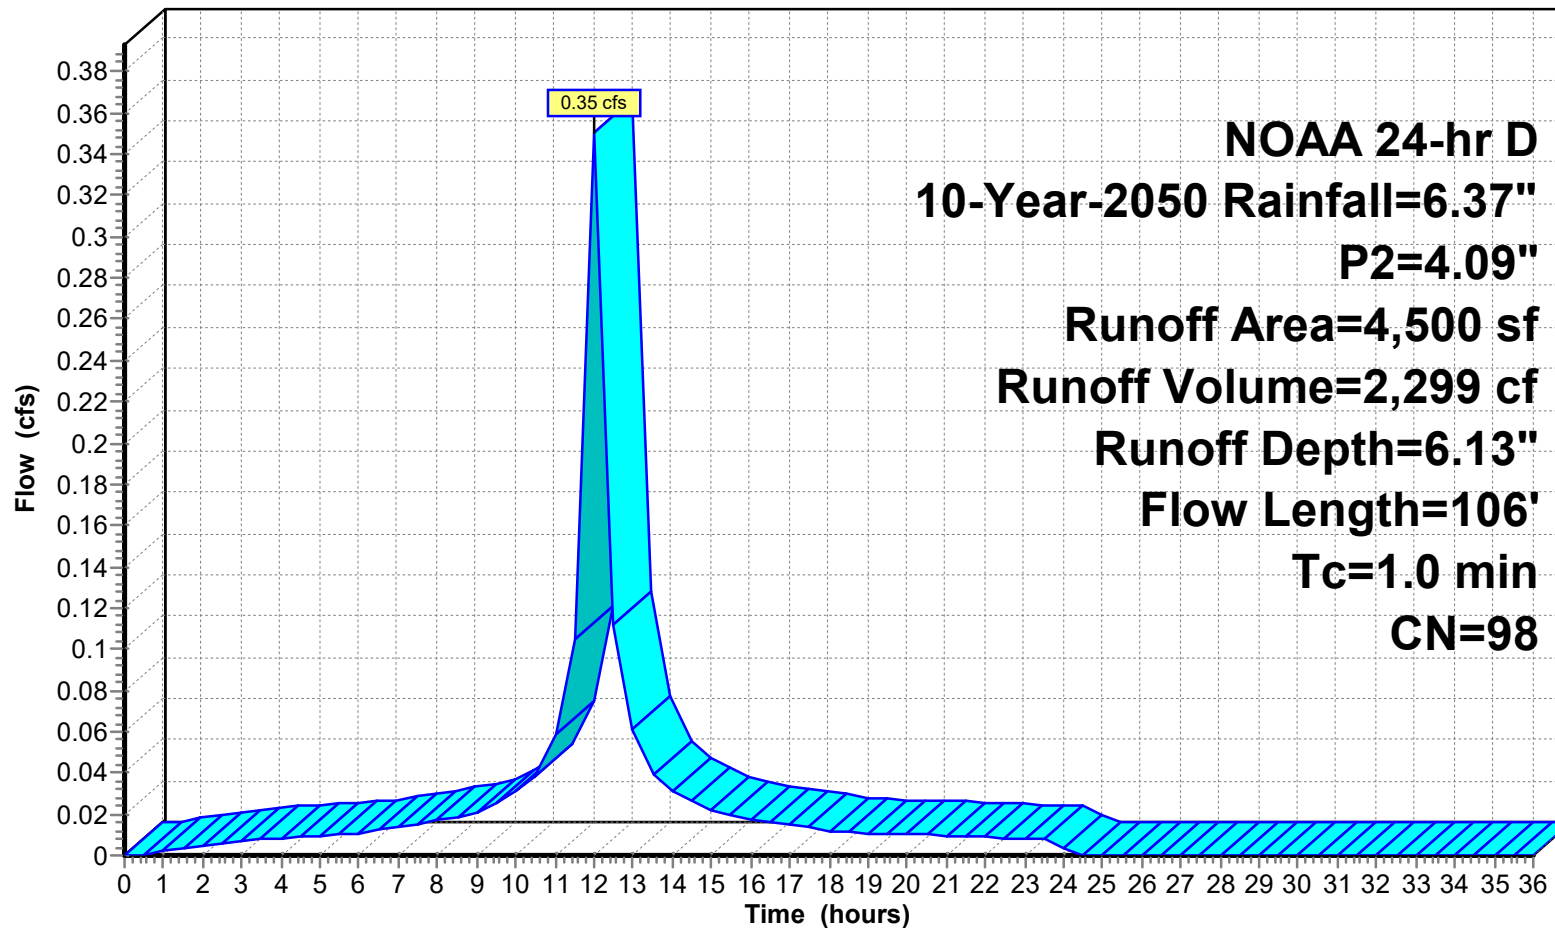

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 111


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 5.83" for 10-Year-2050 event
Inflow = 5.71 cfs @ 12.01 hrs, Volume= 37,548 cf
Primary = 5.71 cfs @ 12.01 hrs, Volume= 37,548 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

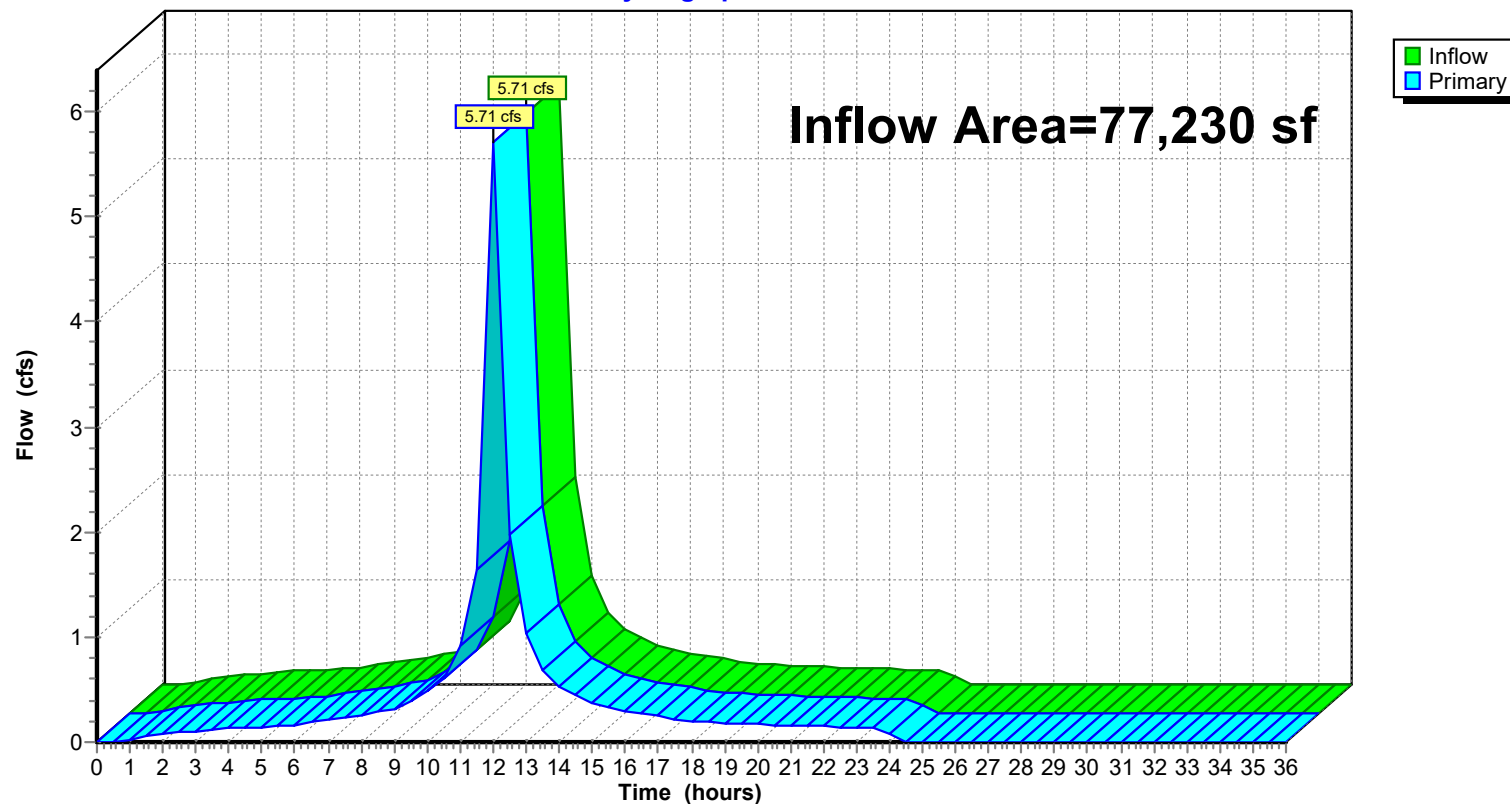

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 112


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 5.01" for 10-Year-2050 event
Inflow = 8.20 cfs @ 12.03 hrs, Volume= 55,669 cf
Primary = 8.20 cfs @ 12.03 hrs, Volume= 55,669 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

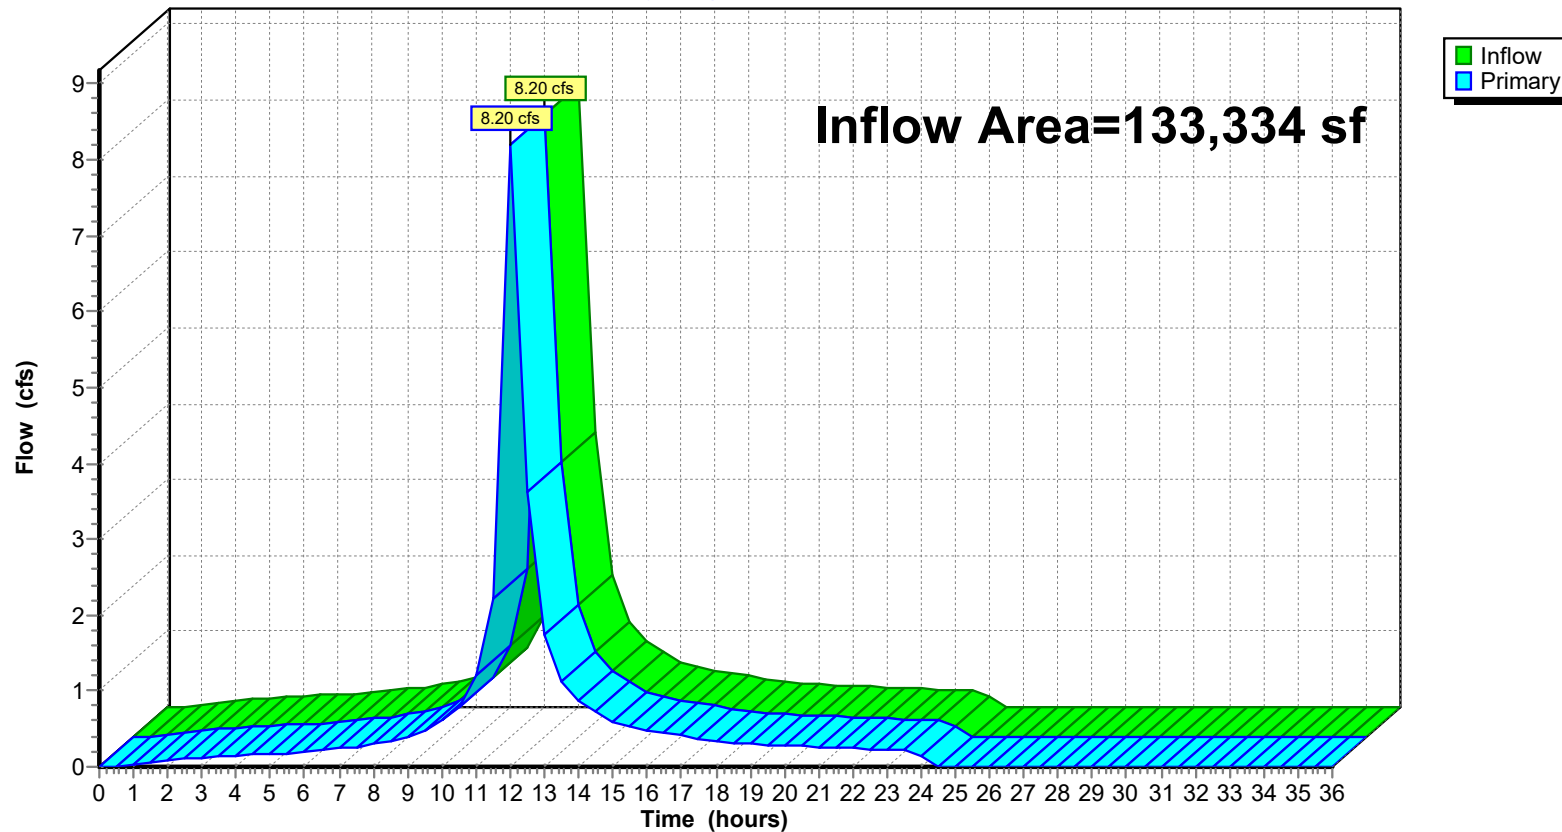

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 113


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 5.02" for 10-Year-2050 event
Inflow = 7.08 cfs @ 12.04 hrs, Volume= 48,528 cf
Primary = 7.08 cfs @ 12.04 hrs, Volume= 48,528 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

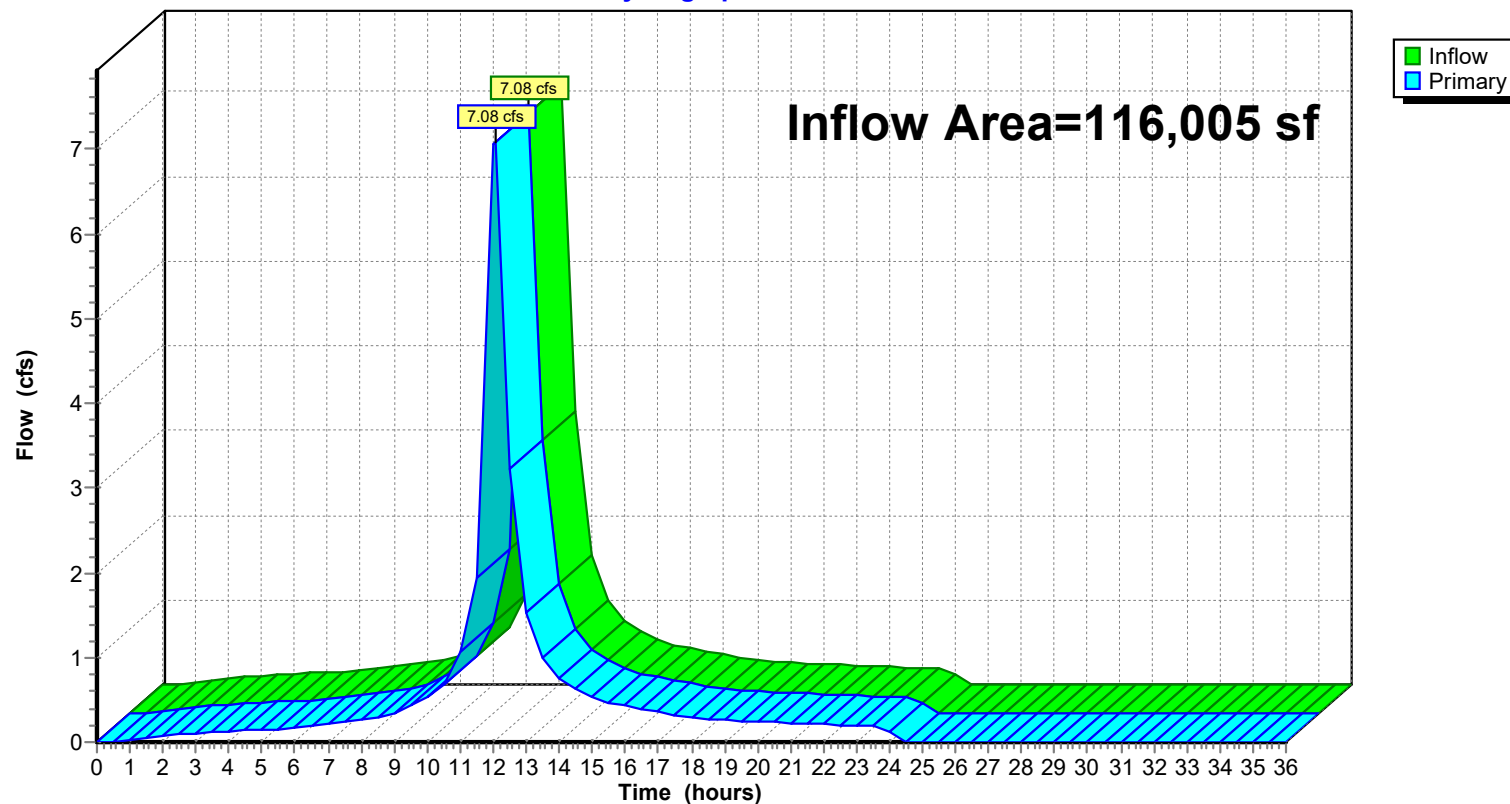

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 10-Year-2050 Rainfall=6.37", P2=4.09"

Printed 1/28/2026

Page 114


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 4.94" for 10-Year-2050 event
Inflow = 1.12 cfs @ 12.02 hrs, Volume= 7,141 cf
Primary = 1.12 cfs @ 12.02 hrs, Volume= 7,141 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2

Hydrograph

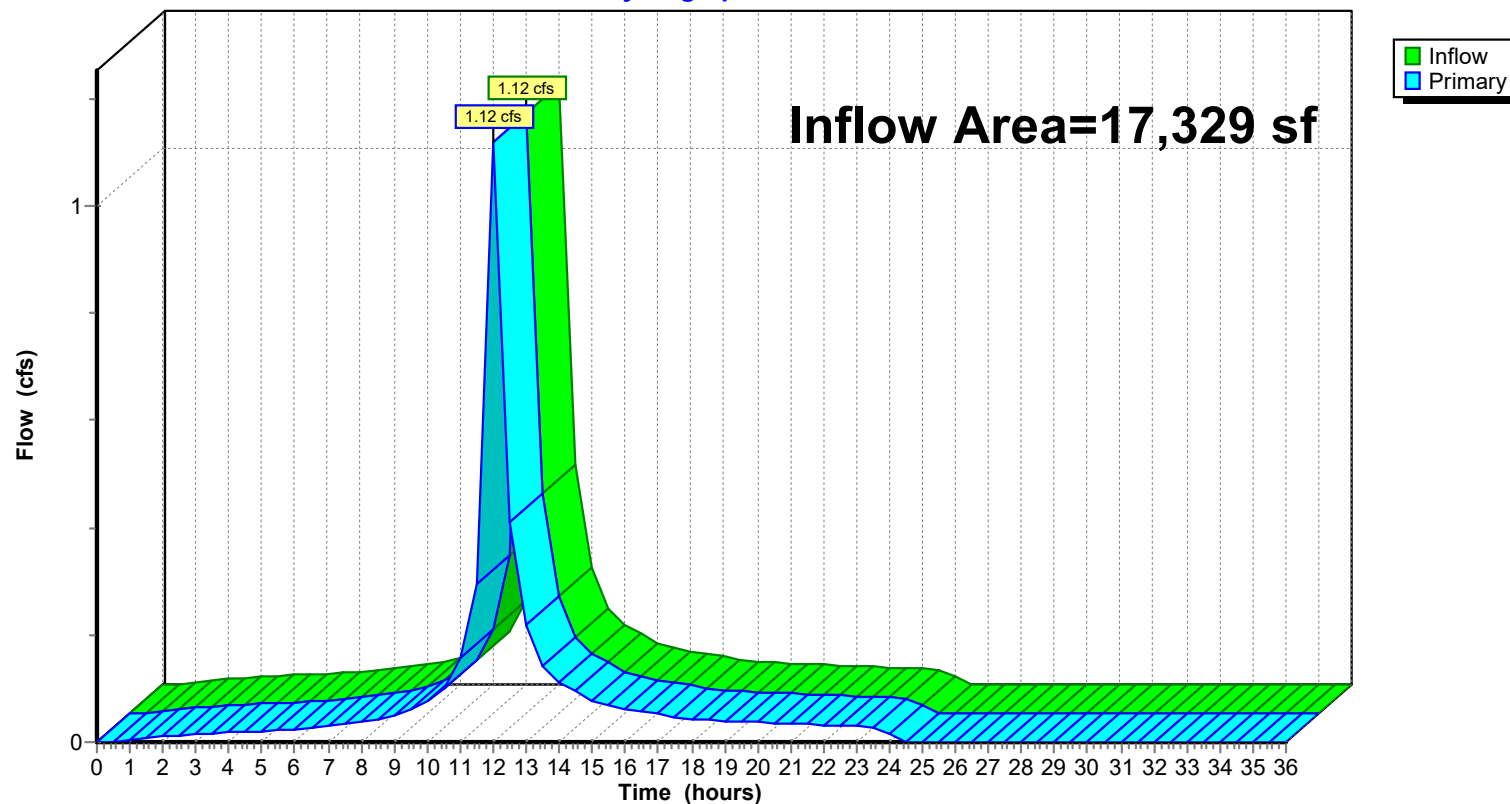

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 115

Summary for Subcatchment 1S: Roof

Runoff = 6.87 cfs @ 12.00 hrs, Volume= 45,619 cf, Depth=11.28"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 48,537	98	Roof and Amenity Area
48,537		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	53	0.0200	1.37		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.5	196	0.0200	6.95	5.46	Pipe Channel, 12 ROOF DRAIN 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.012
0.3	217	0.0424	11.74	14.41	Pipe Channel, 15 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
1.4	466	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 116

Subcatchment 1S: Roof

Hydrograph

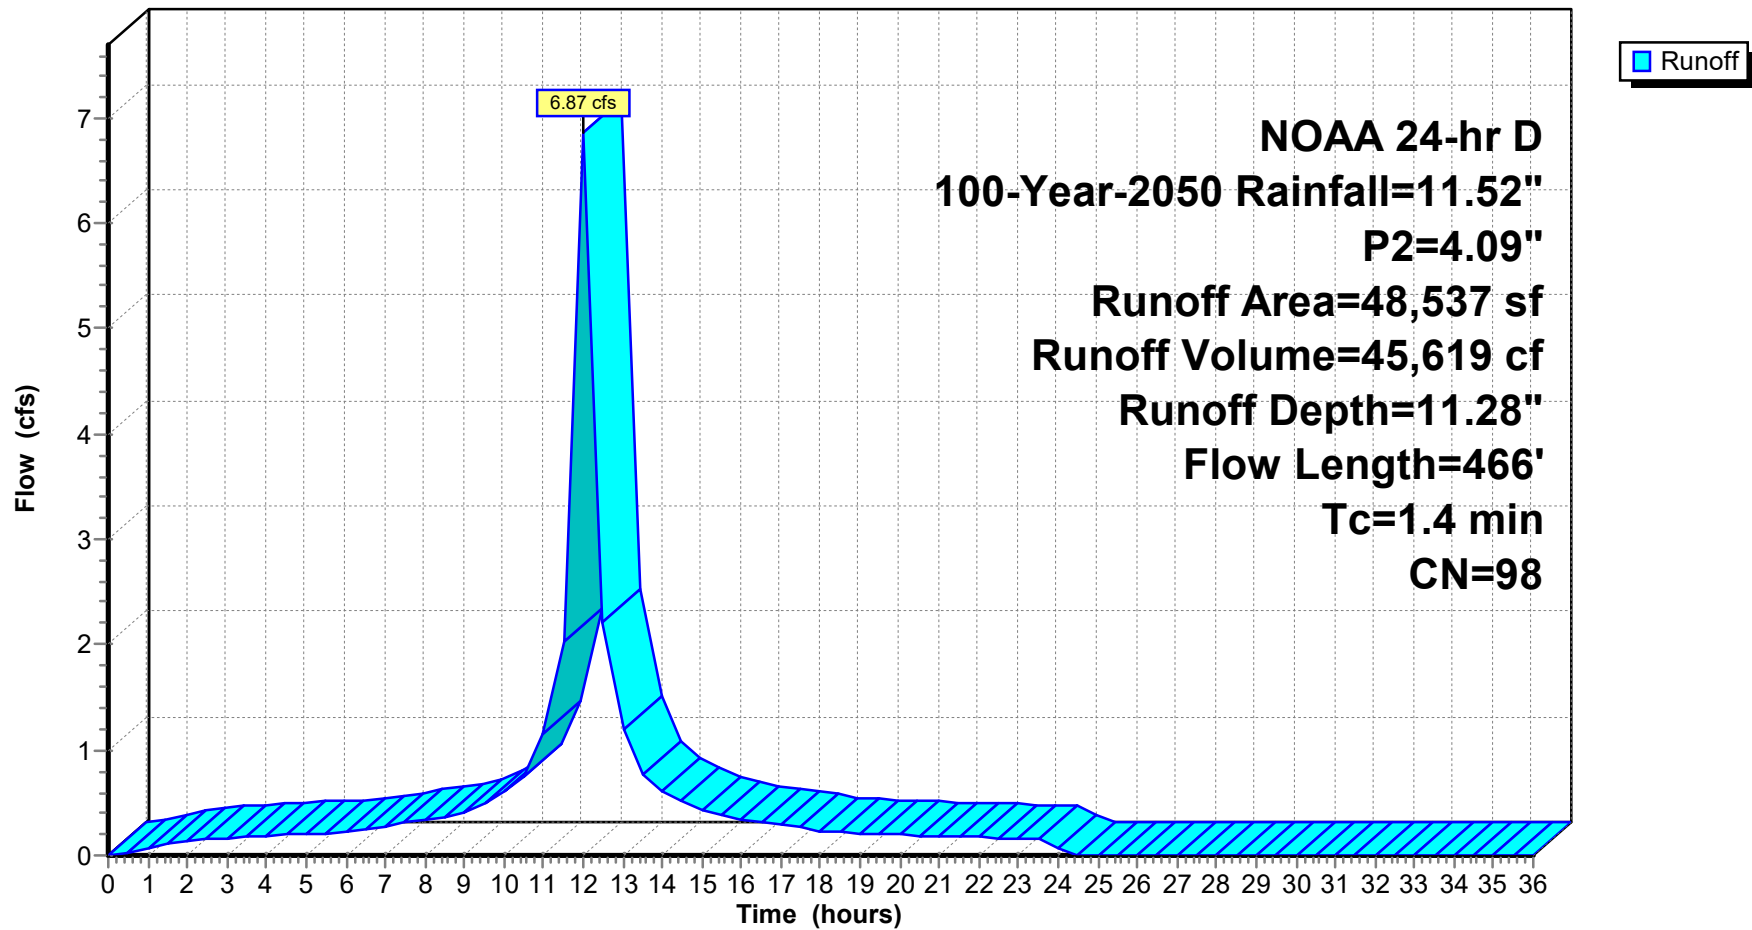

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 117

Summary for Subcatchment P1-I: P1 IMPERVIOUS PARKING

Runoff = 2.82 cfs @ 12.01 hrs, Volume= 18,775 cf, Depth=11.28"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 19,976	98	Uncovered Paved parking, HSG C
19,976		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	100	0.0150	1.21		Sheet Flow, sheet flow Parking area n= 0.013 P2= 4.09"
0.9	127	0.0150	2.49		Shallow Concentrated Flow, parking area Paved Kv= 20.3 fps
0.3	198	0.0449	12.08	14.83	Pipe Channel, Pipe flow 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
2.6	425	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 118

Subcatchment P1-I: P1 IMPERVIOUS PARKING

Hydrograph

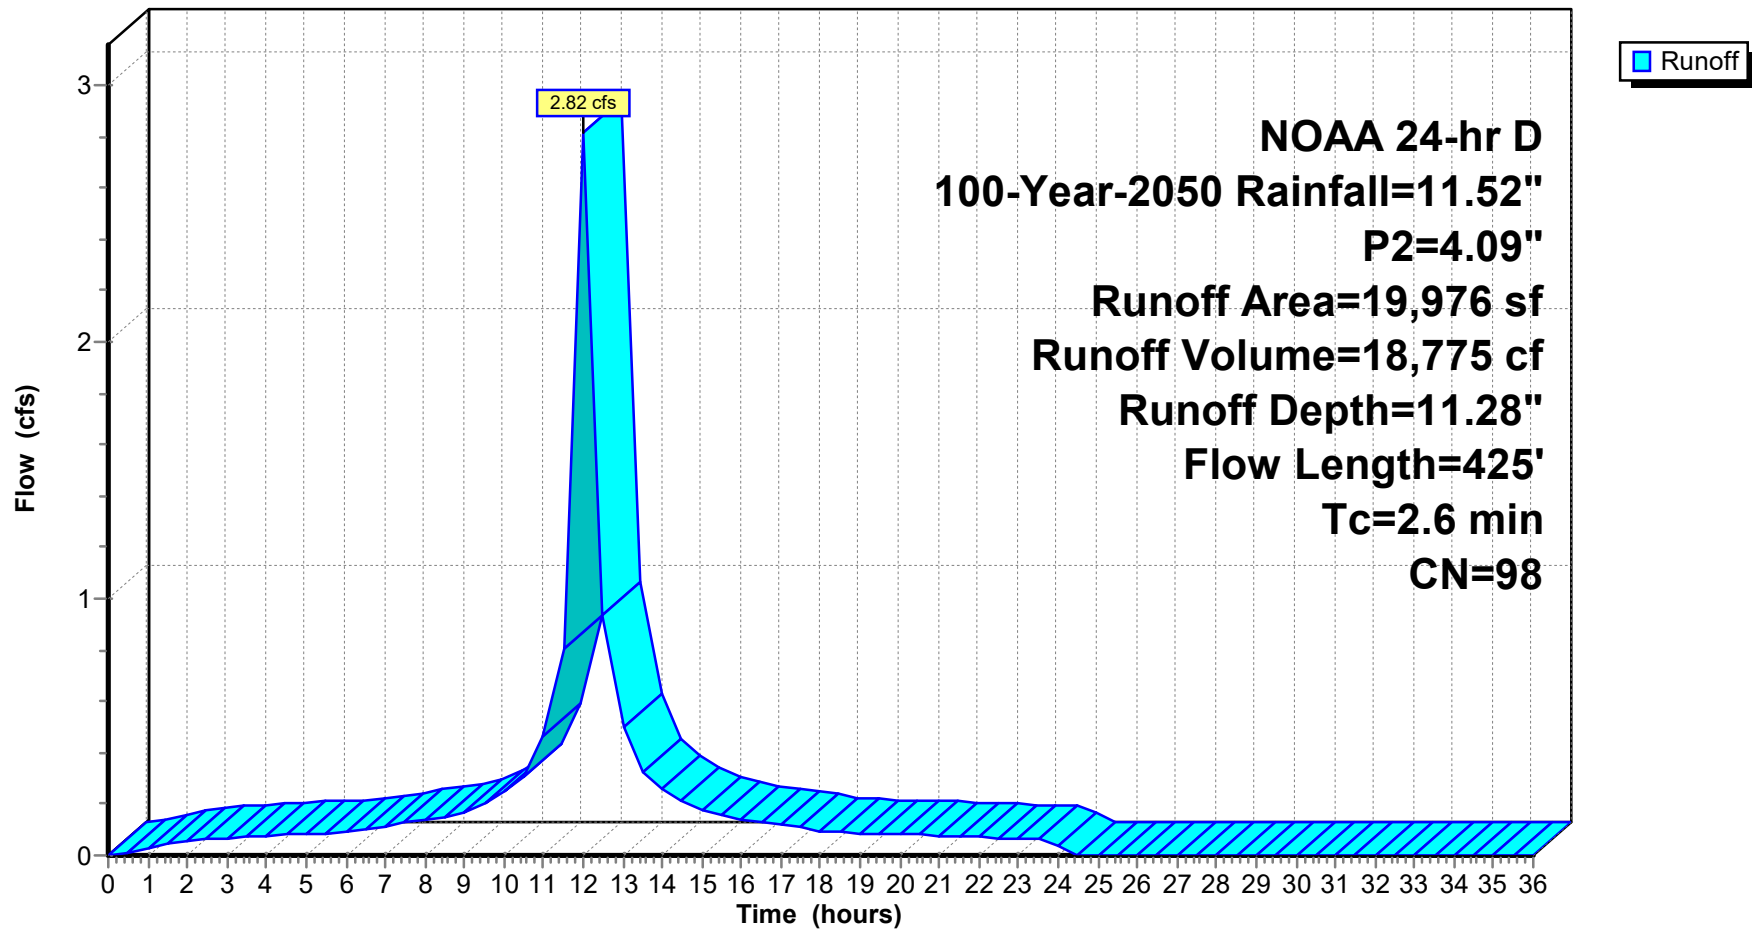

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 119

Summary for Subcatchment P1-P: P1 PERVIOUS

Runoff = 0.88 cfs @ 12.08 hrs, Volume= 5,931 cf, Depth= 8.17"
 Routed to Link 11L : Proposed Disturbed

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
8,717	74	>75% Grass cover, Good, HSG C
8,717		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	100	0.0430	0.18		Sheet Flow, Grass: Dense n= 0.240 P2= 4.09"
0.1	44	0.0470	12.36	15.17	Pipe Channel, Yard Inlet 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0450	31.77	898.40	Pipe Channel, 72" Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
9.6	469	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 120

Subcatchment P1-P: P1 PERVIOUS

Hydrograph

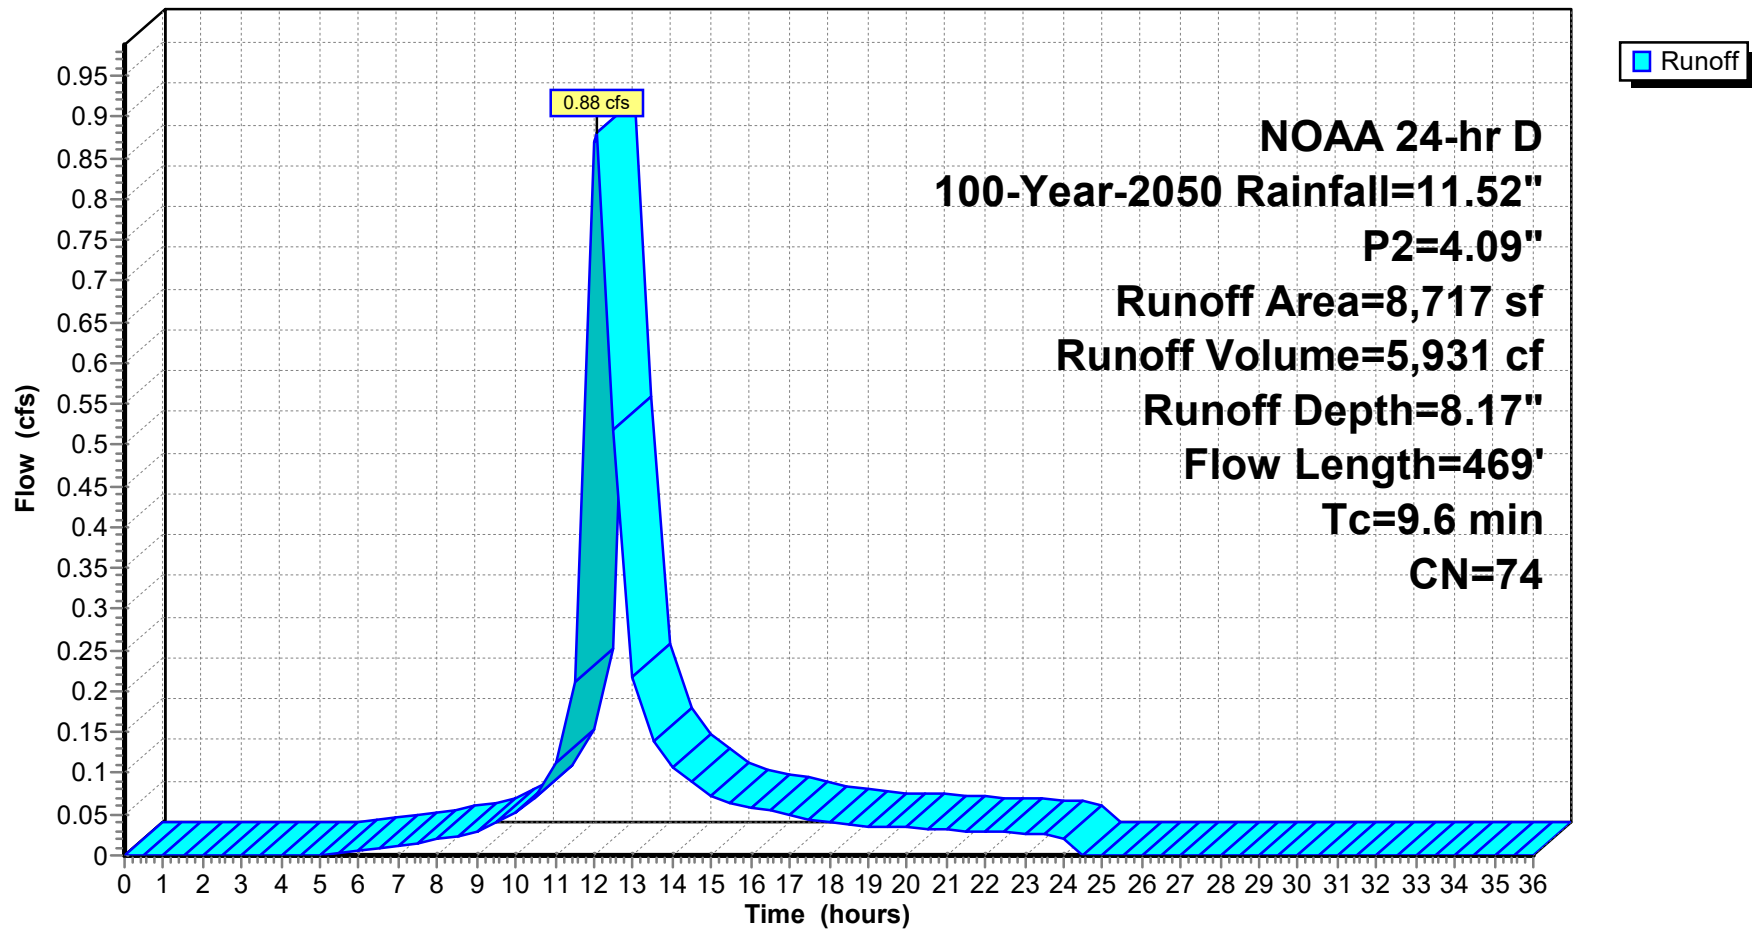

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 121

Summary for Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Runoff = 3.45 cfs @ 12.16 hrs, Volume= 25,935 cf, Depth= 8.03"
 Routed to Link P-DP 1 : PROP DP 1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

	Area (sf)	CN	Description
*	2,744	98	Roof-offsite
*	1,220	98	Impervious
	1,506	71	Meadow, non-grazed, HSG C
*	32,065	70	wooded
*	1,240	74	>75% Grass offsite
	38,775	73	Weighted Average
	34,811		89.78% Pervious Area
	3,964		10.22% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.4	100	0.0900	0.16		Sheet Flow, sheet flow Woods: Light underbrush n= 0.400 P2= 4.09"
1.8	110	0.0400	1.00		Shallow Concentrated Flow, SC Woodland Kv= 5.0 fps
0.6	115	0.0430	3.34		Shallow Concentrated Flow, Lawn Unpaved Kv= 16.1 fps
0.1	44	0.0500	12.75	15.65	Pipe Channel, Yard drains 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.012
0.2	325	0.0440	31.42	888.36	Pipe Channel, Culvert 72.0" Round Area= 28.3 sf Perim= 18.8' r= 1.50' n= 0.013
13.1	694	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 122

Subcatchment P2: P-2 Pervious-w-offsite-Undisturbed

Hydrograph

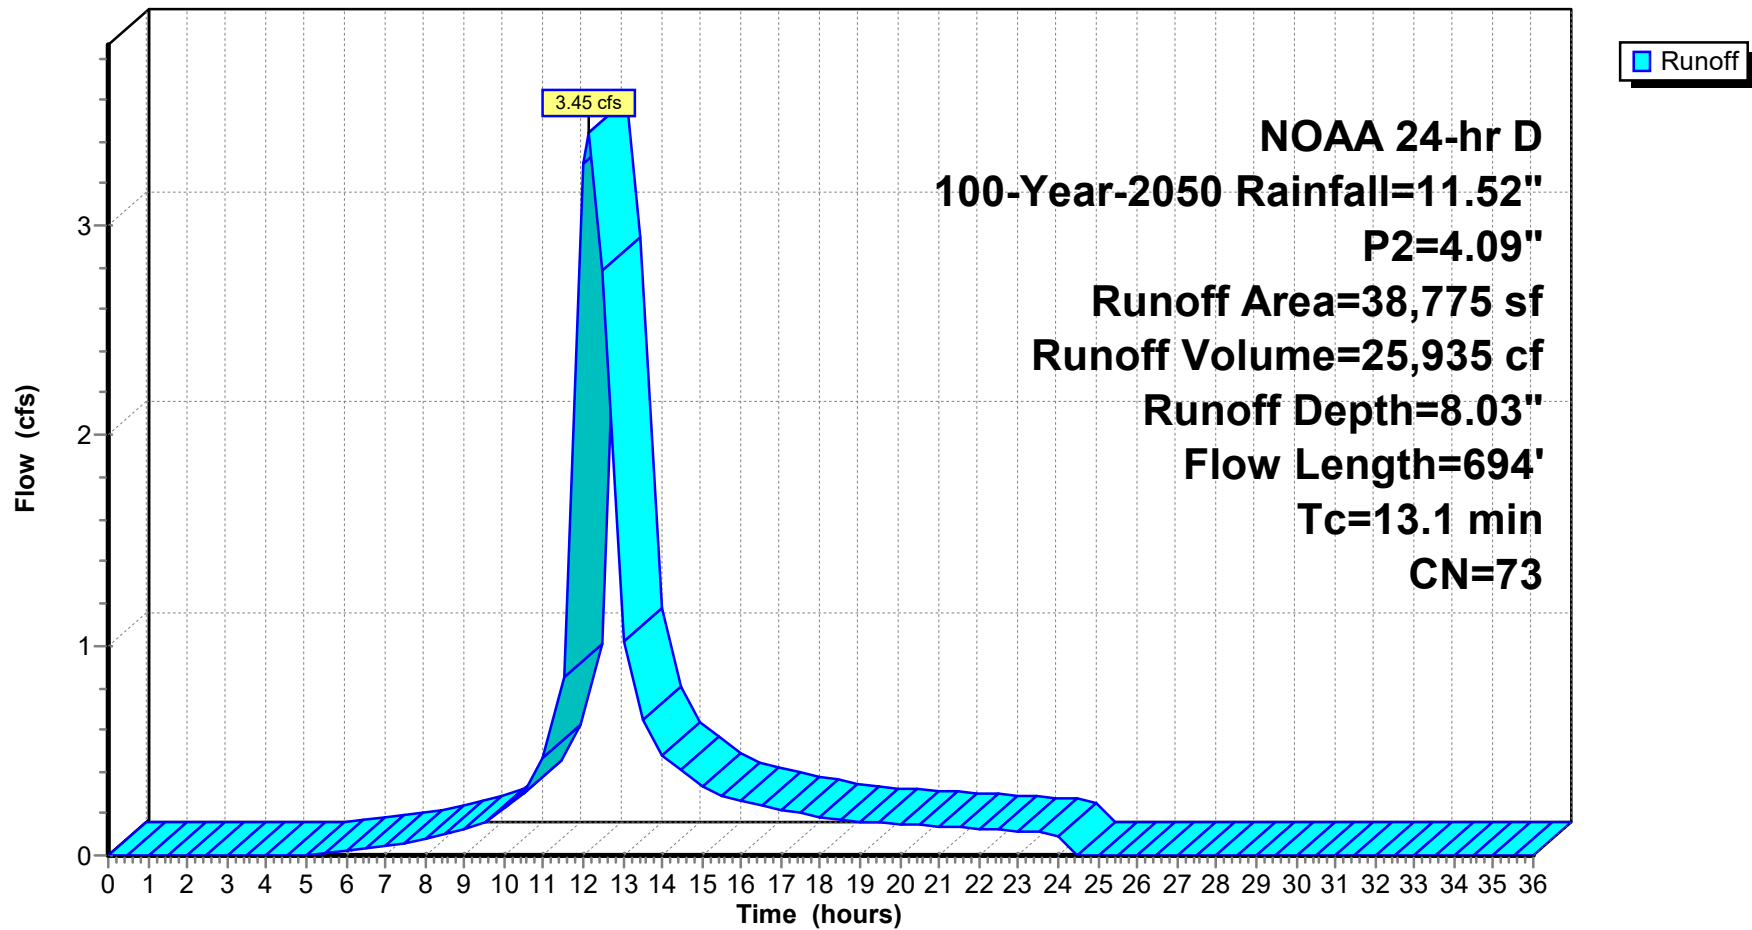

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 123

Summary for Subcatchment P3A-IMP: P3A IMPERVIOUS

Runoff = 0.57 cfs @ 12.01 hrs, Volume= 3,797 cf, Depth=11.28"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 4,040	98	DRIVE/SIDEWALK
4,040		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	100	0.0500	2.24		Sheet Flow, Pavement
					Smooth surfaces n= 0.011 P2= 4.09"
1.2	335	0.0500	4.54		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.9	435	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 124

Subcatchment P3A-IMP: P3A IMPERVIOUS

Hydrograph

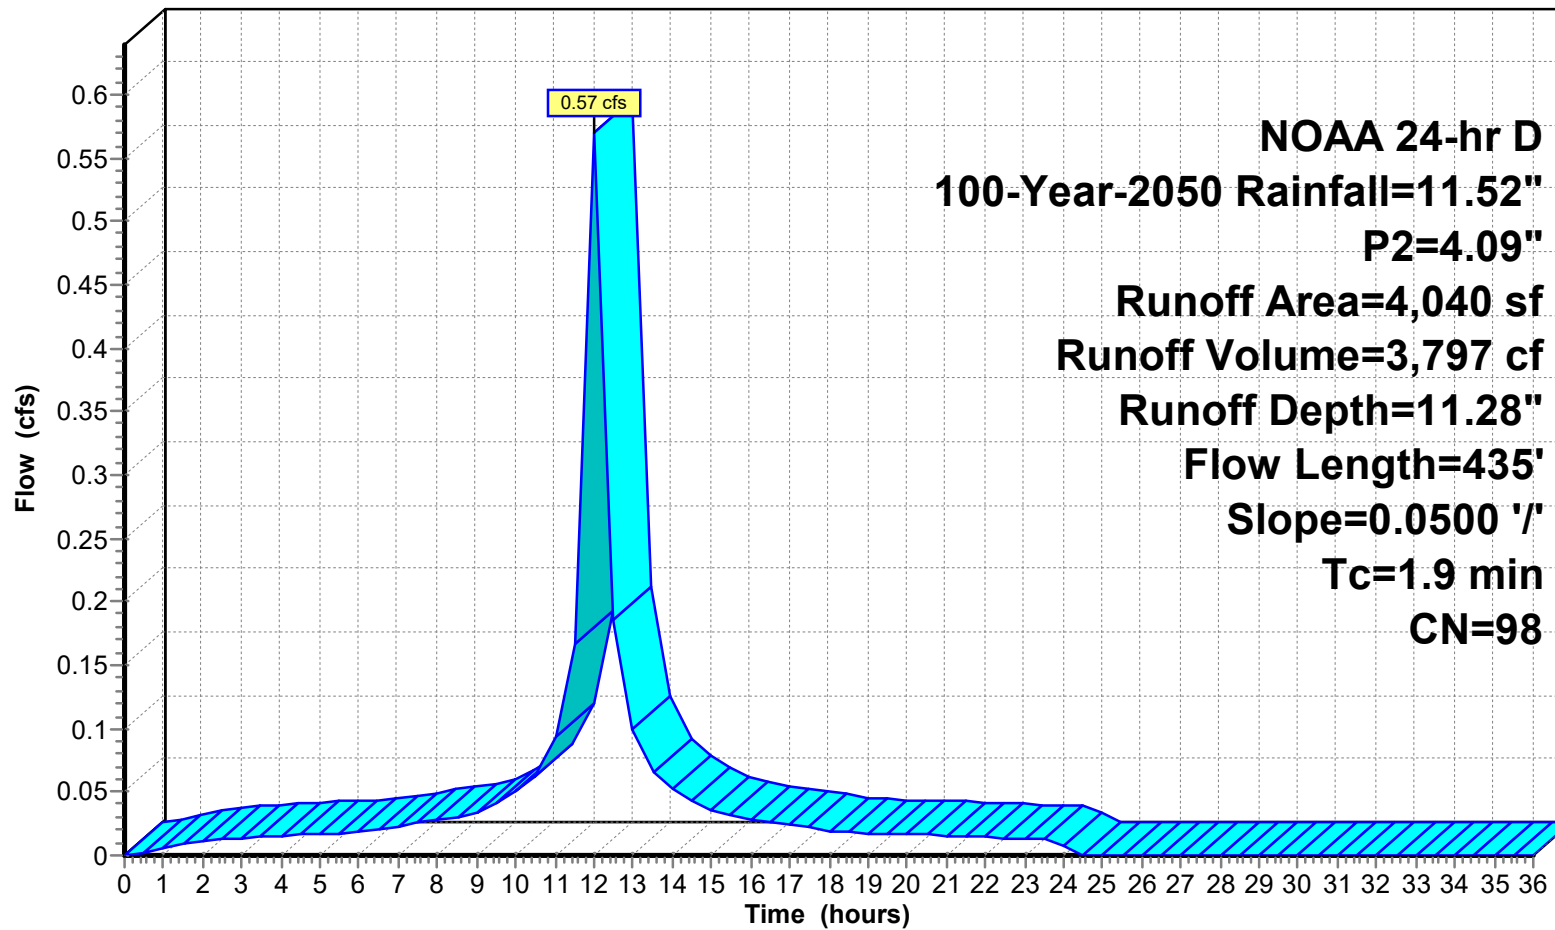

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 125

Summary for Subcatchment P3A-P: P3A PERVIOUS

Runoff = 0.66 cfs @ 12.03 hrs, Volume= 4,034 cf, Depth= 8.17"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
5,928	74	>75% Grass cover, Good, HSG C
5,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.6	100	0.0600	0.30		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.1	29	0.0550	3.78		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.7	129	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 126

Subcatchment P3A-P: P3A PERVIOUS

Hydrograph

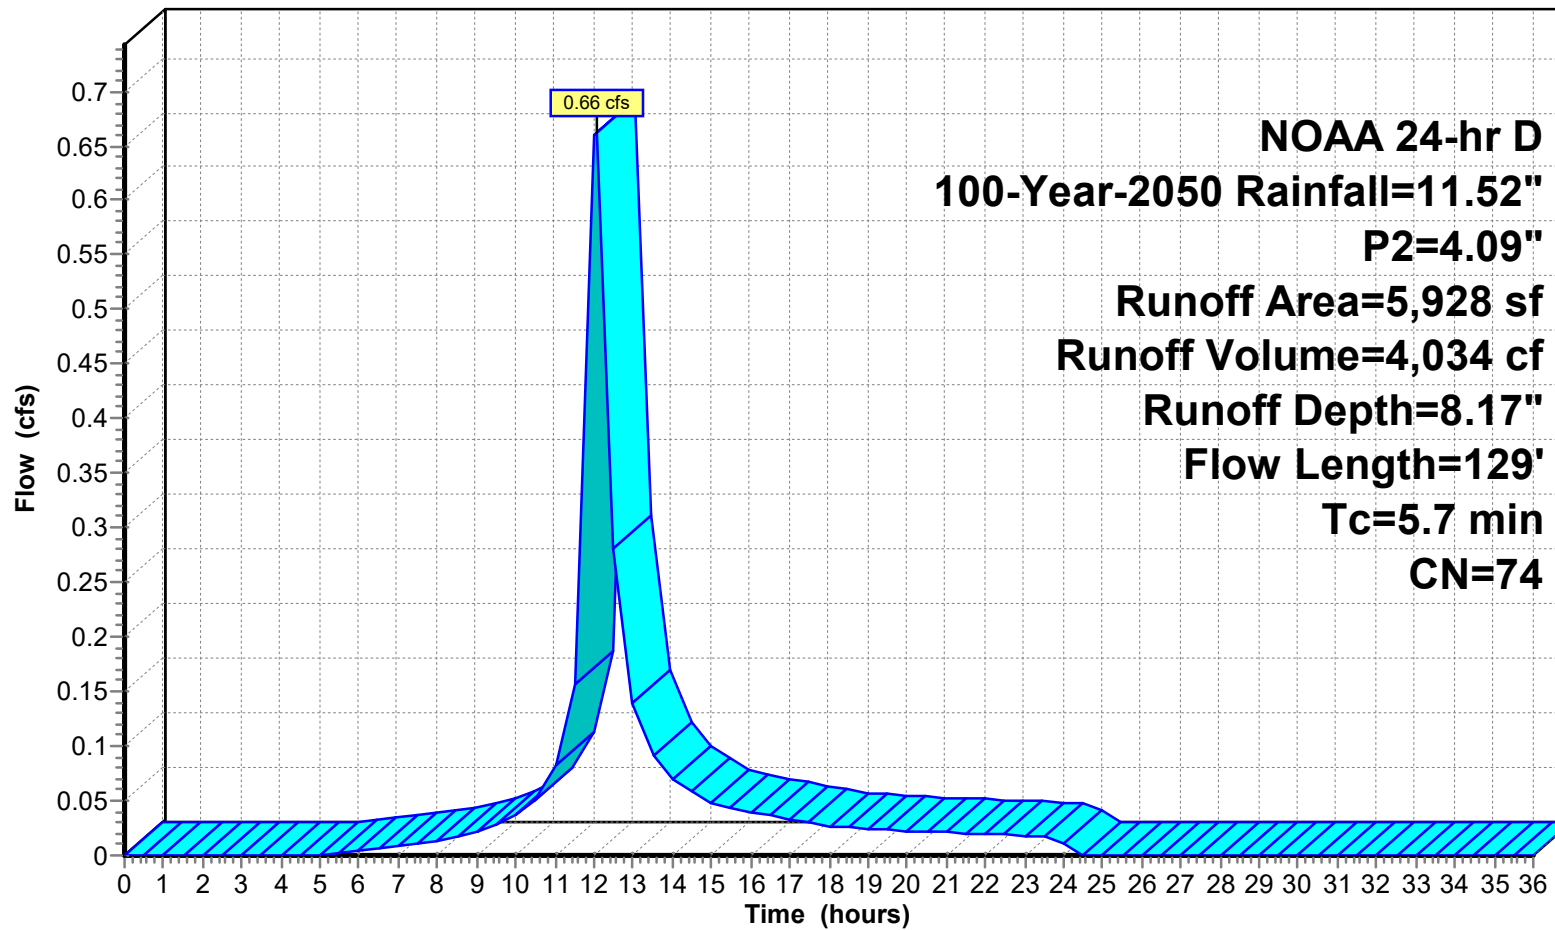

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 127

Summary for Subcatchment P3B-IMP: P3B IMPERVIOUS

Runoff = 0.14 cfs @ 12.00 hrs, Volume= 921 cf, Depth=11.28"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 980	98	SIDEWALK AREA
980		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.6	100	0.0900	2.84		Sheet Flow, sidewalk
					Smooth surfaces n= 0.011 P2= 4.09"
0.5	88	0.0220	3.01		Shallow Concentrated Flow, shadow concentrate
					Paved Kv= 20.3 fps
1.1	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 128

Subcatchment P3B-IMP: P3B IMPERVIOUS

Hydrograph

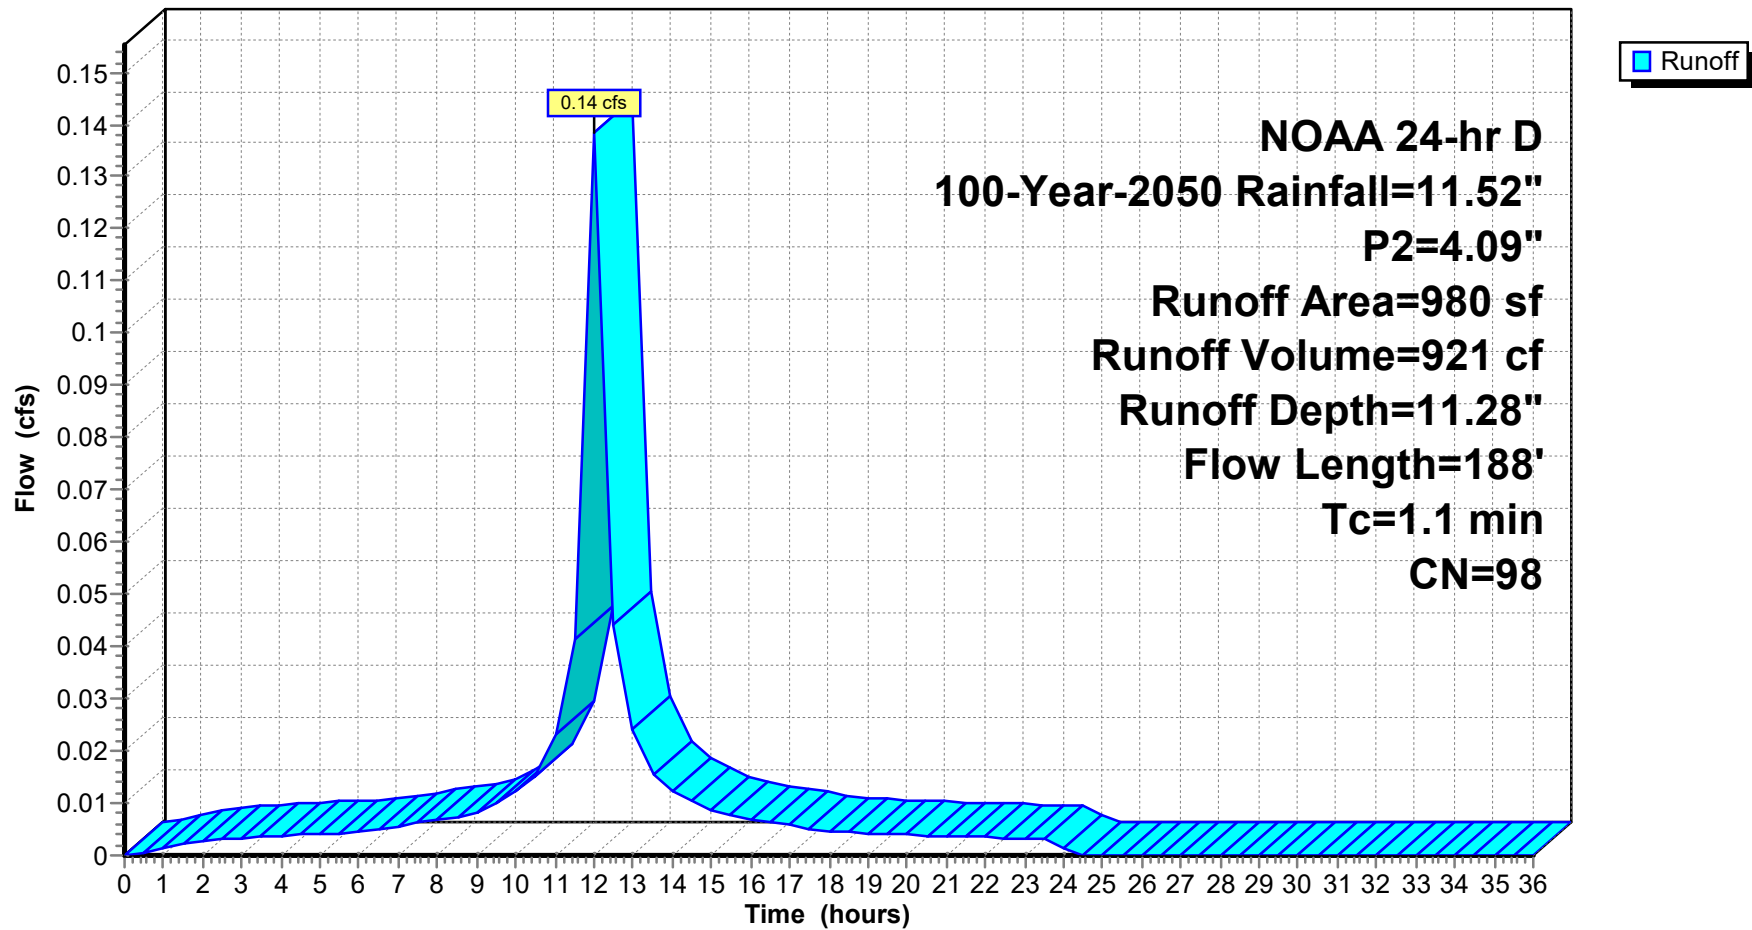

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Prepared by Jarmel Kizel Architects & Engrs

Printed 1/28/2026

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

Page 129

Summary for Subcatchment P3B-P: P3B PERVIOUS

Runoff = 0.21 cfs @ 12.03 hrs, Volume= 1,280 cf, Depth= 8.17"
 Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
 NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
1,881	74	>75% Grass cover, Good, HSG C
1,881		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.7	100	0.0900	0.35		Sheet Flow, sheet flow
					Grass: Short n= 0.150 P2= 4.09"
0.6	88	0.0230	2.44		Shallow Concentrated Flow, Lawn
					Unpaved Kv= 16.1 fps
5.3	188	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 130

Subcatchment P3B-P: P3B PERVIOUS

Hydrograph

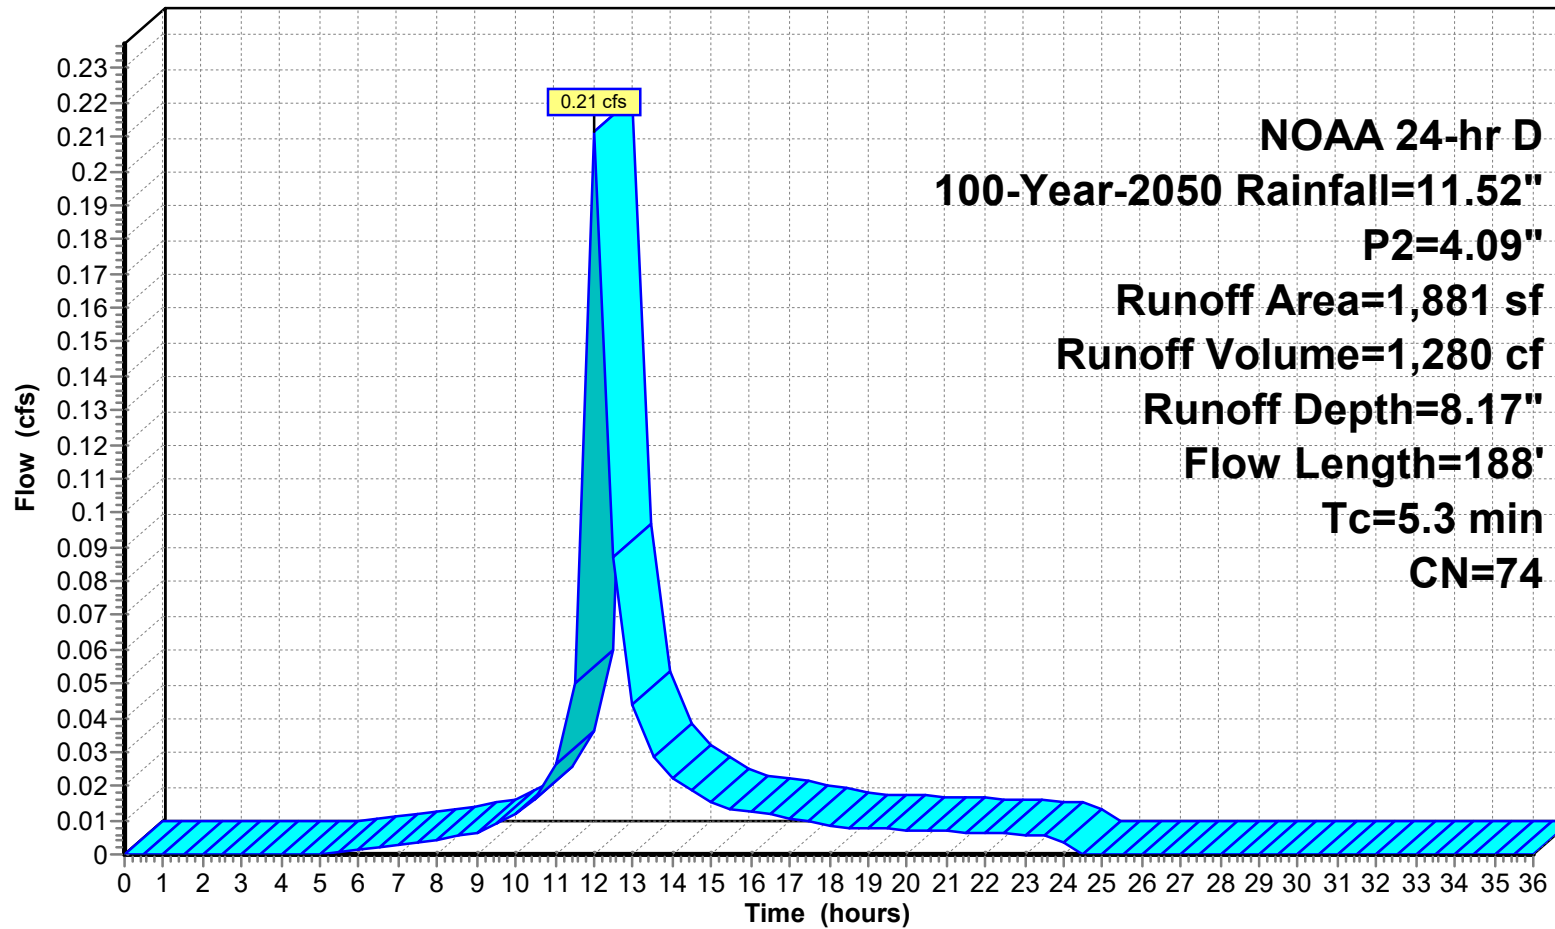

Runoff

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 131

Summary for Subcatchment P3C: P3C- Roof Area

Runoff = 0.64 cfs @ 12.00 hrs, Volume= 4,230 cf, Depth=11.28"
Routed to Link P-DP 2 : PROP DP 2

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs
NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Area (sf)	CN	Description
* 4,500	98	Roof and Amenity Area
4,500		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	52	0.0100	1.03		Sheet Flow, ROOF Smooth surfaces n= 0.011 P2= 4.09"
0.2	54	0.0216	5.51	1.92	Pipe Channel, 8 ROOF DRAIN 8.0" Round Area= 0.3 sf Perim= 2.1' r= 0.17' n= 0.012
1.0	106	Total			

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Eng'rs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC


NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 132

Subcatchment P3C: P3C- Roof Area

Hydrograph

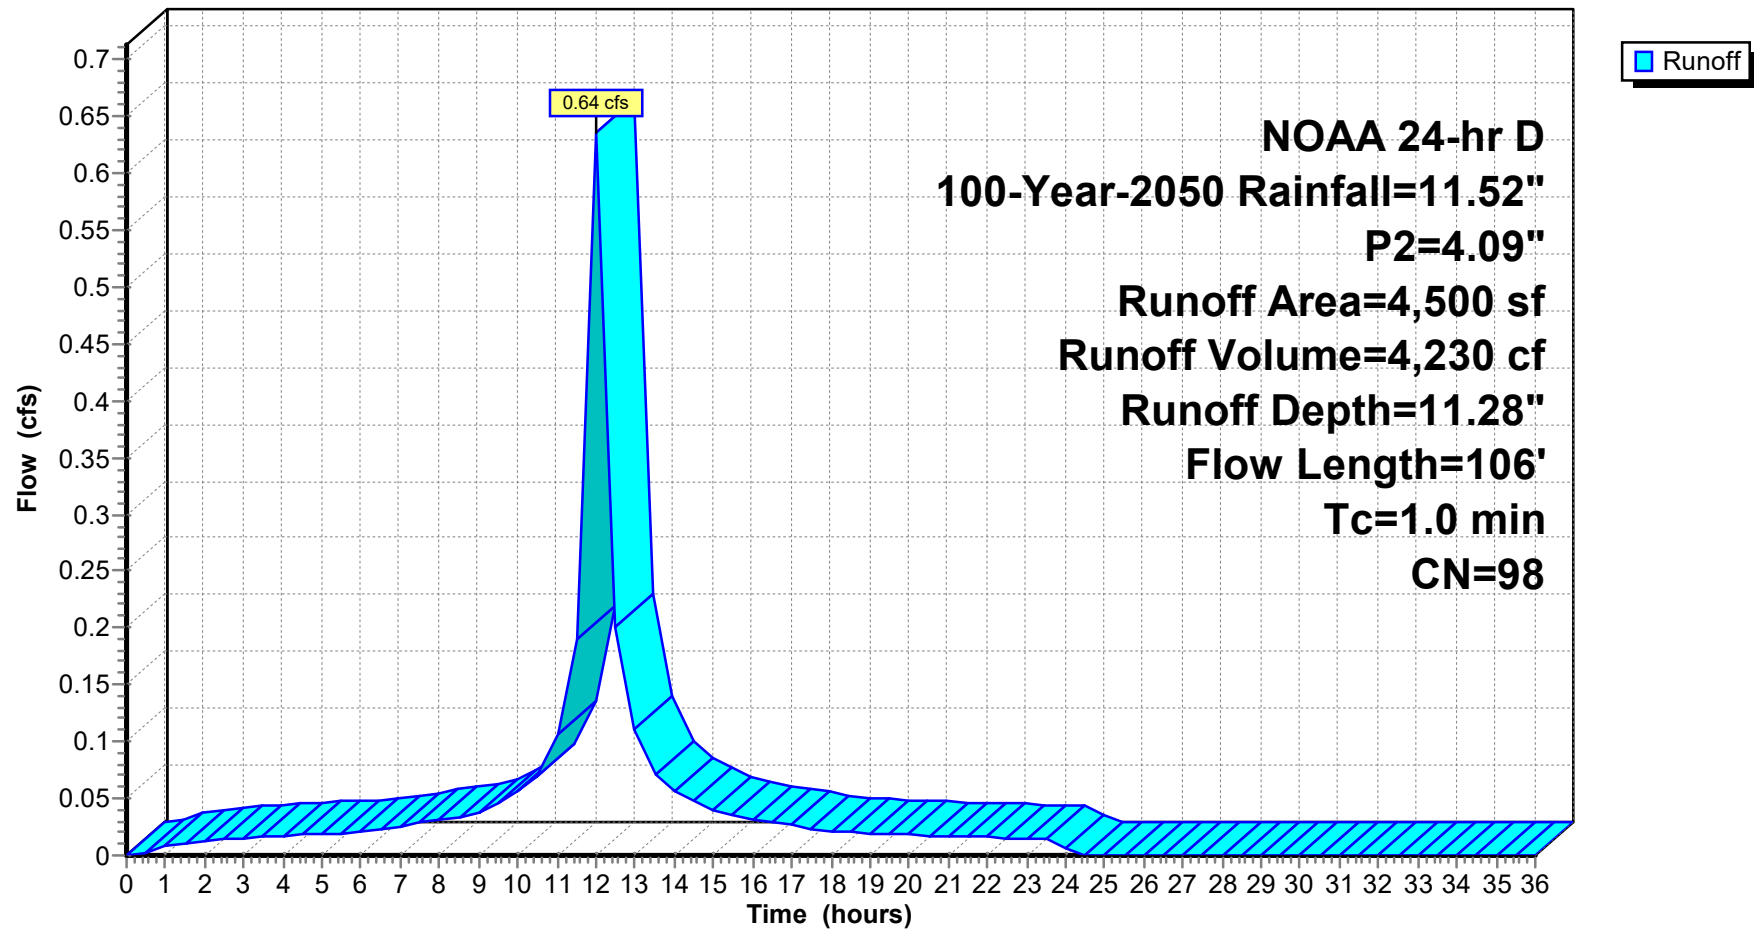

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 133


Summary for Link 11L: Proposed Disturbed

Inflow Area = 77,230 sf, 88.71% Impervious, Inflow Depth = 10.93" for 100-Year-2050 event
Inflow = 10.56 cfs @ 12.01 hrs, Volume= 70,326 cf
Primary = 10.56 cfs @ 12.01 hrs, Volume= 70,326 cf, Atten= 0%, Lag= 0.0 min
Routed to Link P-DP 1 : PROP DP 1

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 11L: Proposed Disturbed

Hydrograph

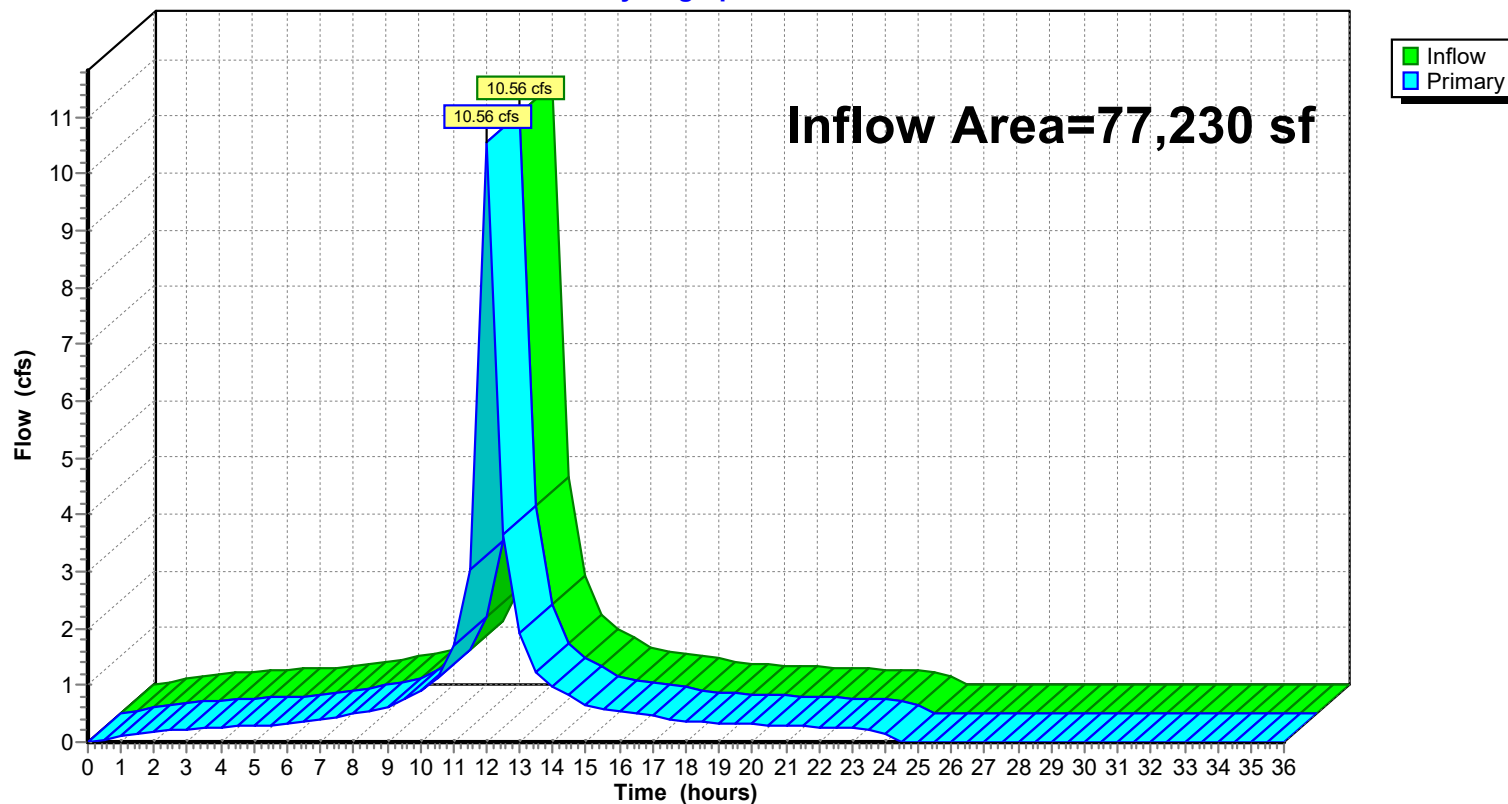

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engrs

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 134


Summary for Link 15L: TOTAL PROPOSED

Inflow Area = 133,334 sf, 61.50% Impervious, Inflow Depth = 9.95" for 100-Year-2050 event
Inflow = 16.11 cfs @ 12.03 hrs, Volume= 110,523 cf
Primary = 16.11 cfs @ 12.03 hrs, Volume= 110,523 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link 15L: TOTAL PROPOSED

Hydrograph

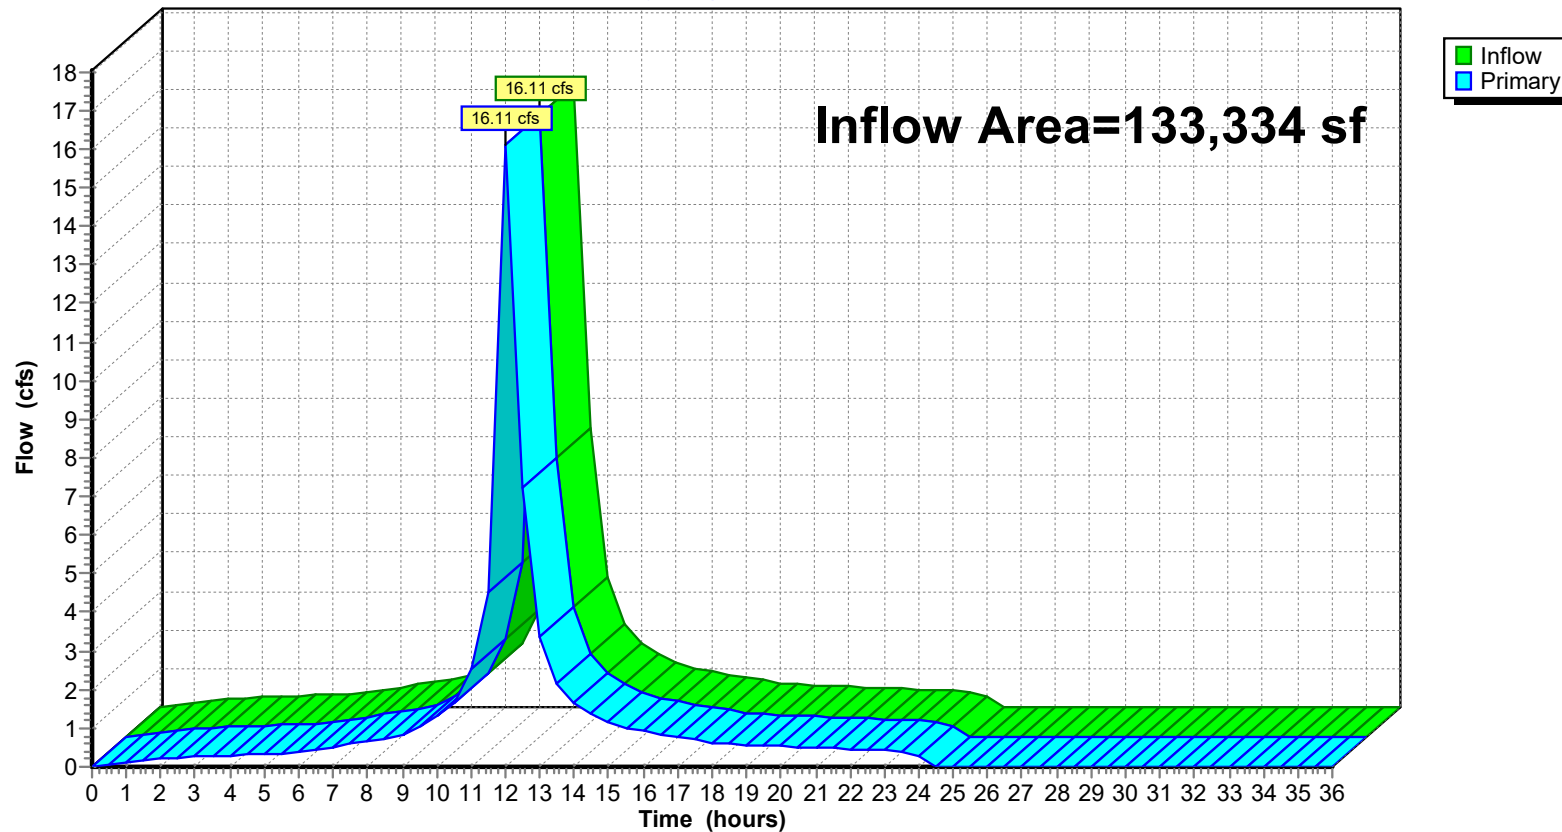

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 135


Summary for Link P-DP 1: PROP DP 1

Inflow Area = 116,005 sf, 62.48% Impervious, Inflow Depth = 9.96" for 100-Year-2050 event
Inflow = 13.89 cfs @ 12.04 hrs, Volume= 96,261 cf
Primary = 13.89 cfs @ 12.04 hrs, Volume= 96,261 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 1: PROP DP 1

Hydrograph

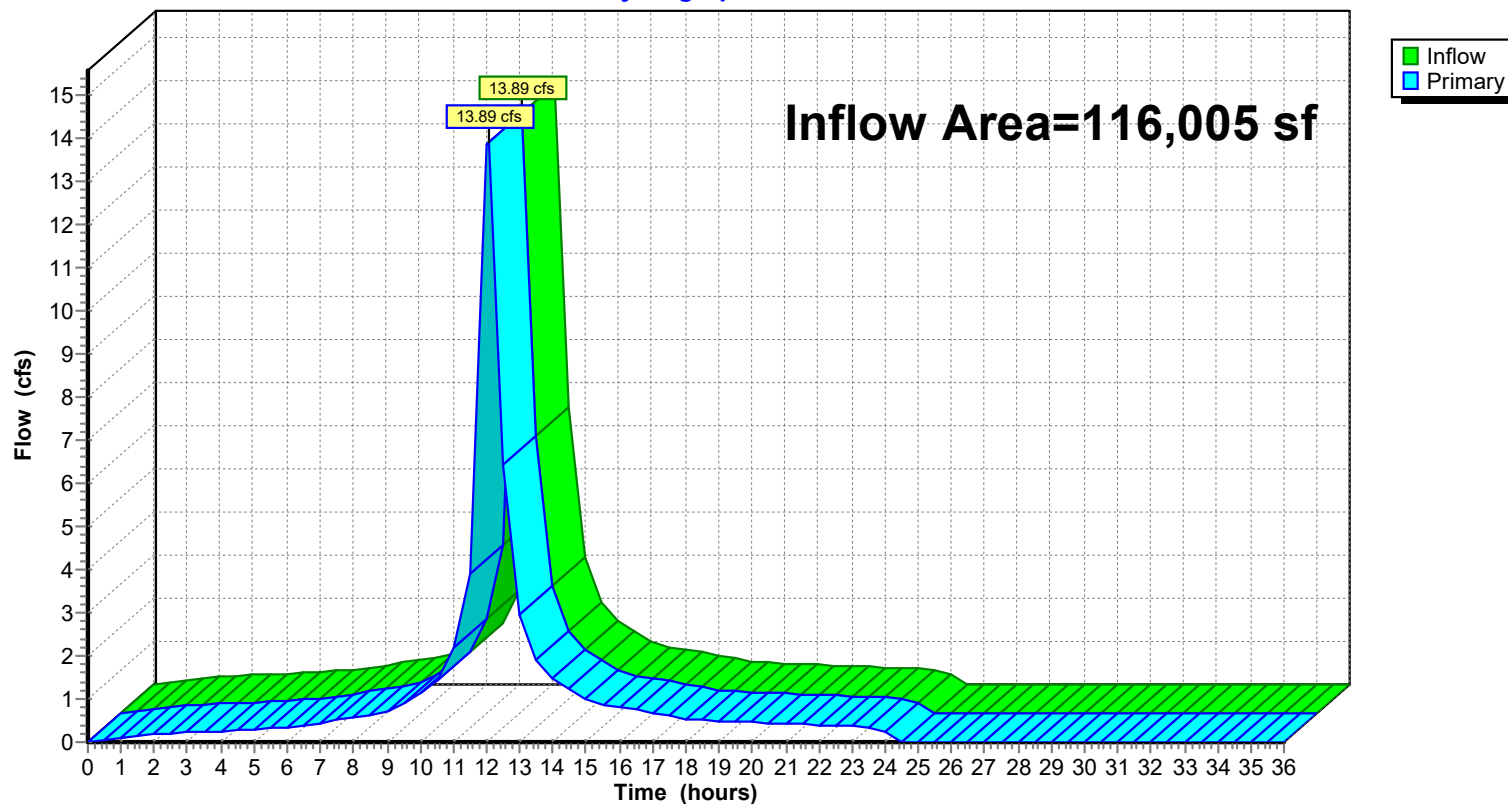

24-223 DRAINAGE DESIGN-PROPOSED-UPDATE

Prepared by Jarmel Kizel Architects & Engnr's

HydroCAD® 10.20-6a s/n 12607 © 2024 HydroCAD Software Solutions LLC

NOAA 24-hr D 100-Year-2050 Rainfall=11.52", P2=4.09"

Printed 1/28/2026

Page 136


Summary for Link P-DP 2: PROP DP 2

Inflow Area = 17,329 sf, 54.94% Impervious, Inflow Depth = 9.88" for 100-Year-2050 event
Inflow = 2.22 cfs @ 12.02 hrs, Volume= 14,261 cf
Primary = 2.22 cfs @ 12.02 hrs, Volume= 14,261 cf, Atten= 0%, Lag= 0.0 min
Routed to Link 15L : TOTAL PROPOSED

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.50 hrs

Link P-DP 2: PROP DP 2


Hydrograph

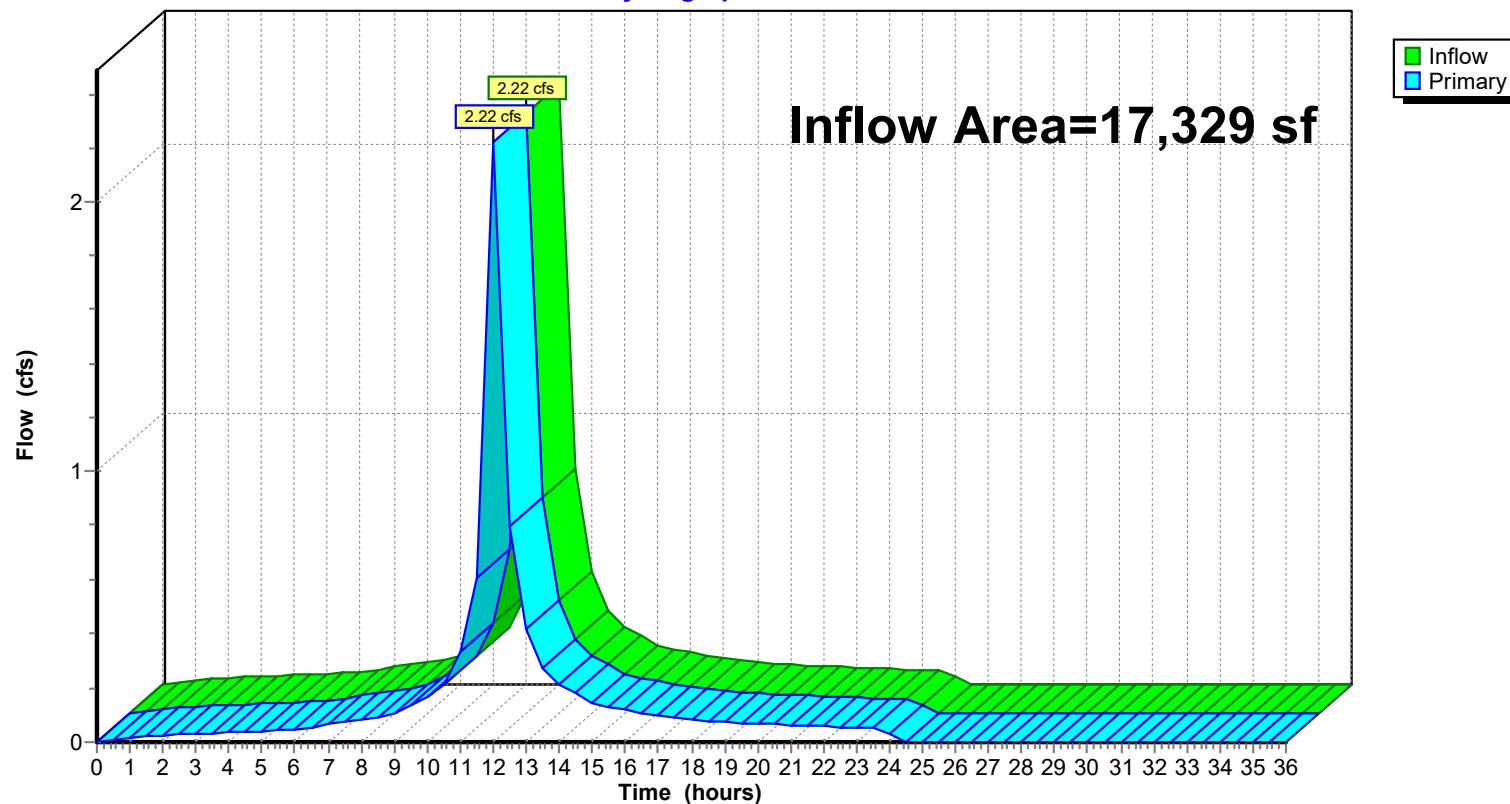

APPENDIX C

STORM SEWER CAPACITY CALCULATIONS

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

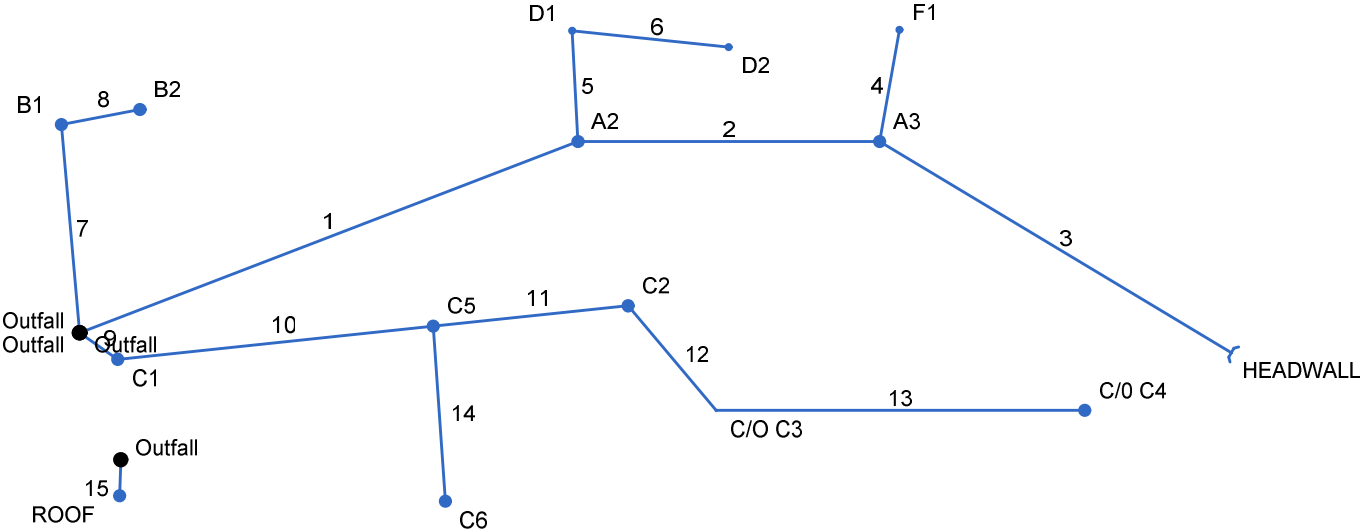


Storm Sewer Tabulation

Station		Len (ft)	Drng Area		Rnoff coeff (C)	Area x C		Tc		Rain (I) (in/hr)	Total flow (cfs)	Cap full (cfs)	Vel (ft/s)	Pipe		Invert Elev		HGL Elev		Grnd / Rim Elev		Line ID
Line	To Line		Incr (ac)	Total (ac)		Incr (min)	Total (min)	Inlet (in)	Slope (%)					Dn (ft)	Up (ft)	Dn (ft)	Up (ft)	Dn (ft)	Up (ft)			
1	End	207	0.09	0.97	0.99	0.09	0.54	6.0	60.3	2.9	456.6	926.3	16.72	72	4.78	370.30	380.20	375.85	385.75	382.22	391.30	A2-A1
2	1	117	0.07	0.53	0.99	0.07	0.29	6.0	60.2	2.9	455.8	901.5	16.69	72	4.53	380.20	385.50	385.75	391.05	391.30	395.76	A3-A2
3	2	159	0.00	0.00	0.00	0.00	0.00	60.0	60.0	0.0	455.0	976.5	16.66	72	5.31	385.50	393.95	391.05	399.50	395.76	403.50	HEADWALL-A3
4	2	44	0.46	0.46	0.47	0.22	0.22	6.0	6.0	9.1	1.97	15.68	6.21	15	5.02	393.25	395.46	393.55	396.02	395.76	399.48	F1-A3
5	1	43	0.14	0.35	0.47	0.07	0.16	6.0	7.4	8.6	1.41	7.16	3.94	15	1.05	387.00	387.45	387.38	387.92	391.30	403.00	D1-A2
6	5	61	0.21	0.21	0.47	0.10	0.10	6.0	6.0	9.1	0.90	15.62	4.92	15	4.98	391.00	394.04	391.20	394.41	403.00	398.80	D2-D1
7	End	81	0.00	0.21	0.00	0.00	0.10	6.0	6.7	8.8	0.87	19.13	3.07	15	7.48	378.29	384.35	378.63	384.72	382.22	390.20	MH B1-A1
8	7	31	0.21	0.21	0.47	0.10	0.10	6.0	6.0	9.1	0.90	15.64	3.82	15	5.00	384.45	386.00	384.72	386.37	390.20	389.00	B2-B1
9	End	18	0.58	1.43	0.99	0.57	1.41	2.0	6.6	8.9	12.55	26.54	7.83	18	5.44	378.50	379.48	379.73	380.81	382.22	383.73	C1-A1
10	9	123	0.00	0.85	0.00	0.00	0.84	0.0	6.3	9.0	7.56	14.41	6.43	15	4.24	379.60	384.82	380.81	385.91	383.73	388.13	C5-C1
11	10	76	0.08	0.65	0.98	0.08	0.64	6.0	6.0	9.1	5.85	14.40	5.37	15	4.24	384.80	388.02	385.91	389.00	388.13	400.04	C2-C5
12	11	53	0.00	0.57	0.00	0.00	0.56	0.0	2.3	9.5	5.36	6.47	8.12	12	2.81	394.50	395.99	395.19	396.92	400.04	400.29	C3-C2
13	12	143	0.57	0.57	0.99	0.56	0.56	2.0	2.0	9.5	5.36	6.03	7.05	12	2.44	396.00	399.49	396.92	400.42	400.29	402.49	C4-C3
14	10	68	0.20	0.20	0.99	0.20	0.20	2.0	2.0	9.5	1.88	4.66	3.23	12	1.46	385.00	385.99	385.91	386.57	388.13	388.50	C5-C5
15	End	14	0.10	0.10	0.99	0.10	0.10	2.0	2.0	9.5	0.94	1.92	3.66	8	2.14	378.00	378.30	378.46	378.76	379.77	382.00	Build to inlet
Project File: INLET.stm																Number of lines: 15				Run Date: 1/29/2026		
NOTES:Intensity = 150.20 / (Inlet time + 15.60) ^ 0.91; Return period =Yrs. 100 ; c = cir e = ellip b = box																						

APPENDIX D

NRCS SOIL MAPPING DATA

Soil Map—Essex County, New Jersey

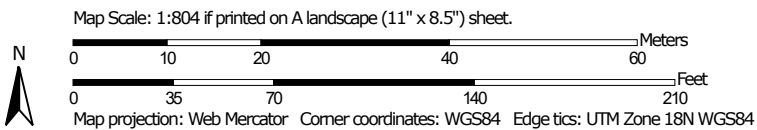

Natural Resources
Conservation Service

Web Soil Survey
National Cooperative Soil Survey

10/10/2025
Page 1 of 3

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

Water Features



Streams and Canals

Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

Background



Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:12,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Essex County, New Jersey

Survey Area Data: Version 21, Aug 28, 2025

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Oct 10, 2022—Oct 16, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
BouB	Boonton - Urban land, Boonton substratum complex, 0 to 8 percent slopes	2.6	100.0%
Totals for Area of Interest		2.6	100.0%

Essex County, New Jersey

BouB—Boonton - Urban land, Boonton substratum complex, 0 to 8 percent slopes

Map Unit Setting

National map unit symbol: b12f

Elevation: 50 to 500 feet

Mean annual precipitation: 30 to 64 inches

Mean annual air temperature: 46 to 79 degrees F

Frost-free period: 131 to 178 days

Farmland classification: Not prime farmland

Map Unit Composition

Boonton and similar soils: 50 percent

Urban land, boonton substratum: 40 percent

Minor components: 10 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Boonton

Setting

Landform: Ground moraines

Landform position (three-dimensional): Upper third of mountainflank, center third of mountainflank

Down-slope shape: Convex

Across-slope shape: Linear

Parent material: Coarse-loamy basal till derived from basalt

Typical profile

A - 0 to 5 inches: loam

BA - 5 to 8 inches: silt loam

BE - 8 to 17 inches: silt loam

Bt - 17 to 30 inches: silt loam

Btx1 - 30 to 40 inches: gravelly fine sandy loam

Btx2 - 40 to 47 inches: fine sandy loam

CBt1 - 47 to 58 inches: loamy sand

CBt2 - 58 to 72 inches: loamy sand

Properties and qualities

Slope: 0 to 8 percent

Depth to restrictive feature: 20 to 36 inches to fragipan

Drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water

(Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Available water supply, 0 to 60 inches: Low (about 4.4 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: C

Ecological site: F144AY037MA - Moist Dense Till Uplands

Hydric soil rating: No

Description of Urban Land, Boonton Substratum

Setting

Landform: Ground moraines

Landform position (three-dimensional): Lower third of mountainflank, upper third of mountainflank, center third of mountainflank

Down-slope shape: Convex

Across-slope shape: Linear

Parent material: Surface covered by pavement, concrete, buildings, and other structures underlain by disturbed and natural soil material

Typical profile

H1 - 0 to 12 inches: material

H2 - 12 to 47 inches: silt loam

2CBt1 - 47 to 58 inches: loamy sand

2CBt2 - 58 to 72 inches: loamy sand

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 8s

Hydric soil rating: Unranked

Minor Components

Udorthents, boonton substratum

Percent of map unit: 10 percent

Landform: Ground moraines

Landform position (three-dimensional): Lower third of mountainflank, upper third of mountainflank, center third of mountainflank

Down-slope shape: Convex

Across-slope shape: Linear

Hydric soil rating: No

Data Source Information

Soil Survey Area: Essex County, New Jersey

Survey Area Data: Version 21, Aug 28, 2025

APPENDIX E

GEOTECHNICAL REPORT



CONSULTANTS, INC.
4405 South Clinton Avenue
South Plainfield, NJ 07080

Tel: (800) 545-ATUL
(908) 754-8383
Fax: (908) 754-8633

NJ EDA Approved Testing Laboratory • MBE/DBE Certified • NJ DEP Certified
www.ANSConsultants.net

Soil, Concrete, Masonry, Rebar, Asphalt, Structural Steel, Precast, Piles, Carsons, Fire-proofing, Roofing, Soil Boring, Concrete/Rock Coring, UST Removal, Environmental Testing & Reports

September 03, 2024

Gomes Management
P.O. Box 5277
Newark, NJ 07105

Attn: Mr. Jose Pacheco

Re: **Subsurface Soil Investigation & Foundation Recommendation Report**
Proposed 1-story retail building
525 Northfield Avenue
West Orange, NJ 07052
Block # 159 04, Lot # 1 01, 1 02 & 1 03

Dear Mr. Pacheco,

Enclosed, please find three (3) copies of the Subsurface Soil Investigation & Foundation Recommendation Report for the total of eight (8) Soil Borings performed on August 19, 2024, August 20, 2024 and August 21, 2024 at the project referenced above.

Soil samples collected during soil boring program will be discarded after thirty (30) days from the date of this report, if not requested in advance to do otherwise. We thank you very much for providing us an opportunity to service you on this project.

Should you have any questions or require additional information, please do not hesitate to contact the undersigned at (908)754-8383

Sincerely,
ANS Consultants, Inc.

Atulkumar N. Shah, PE, PP, F. ASCE
President
NJ PE License #24GE03443900
ANS/RM

Reported Gomes Management— (3); File — (1)

File ANV-6549_01 SB

TABLE OF CONTENTS

	<u>Page No</u>
SCOPE OF SERVICES	01
PROPOSED CONSTRUCTION	01
SITE CONDITIONS	01
FIELD INVESTIGATION	02
LABORATORY TESTING	02
SUBSURFACE CONDITIONS	03
SUMMARY OF FINDINGS	04
GROUNDWATER	06
SEASONAL HIGHWATER TABLE	06
CONCLUSIONS	06
FOUNDATION DESIGN CRITERIA	07
FLOOR SLAB DESIGN CRITERIA	08
BELOW GRADE WALLS	08
RECOMMENDED SERVICES FOR EARTHWORK	08
MINIMUM PAVEMENT DESIGN SECTIONS. ..	09
RECOMMENDED SERVICES	09
LIMITATIONS	09-10
APPENDIX - A	11
GOOGLE MAP	12
SOIL BORING LOCATION PLAN	13
SOIL BORING LOGS B-1 to B-8	14-22
GENERALIZED SOIL PROFILE	23-24
SPT N-VALUE GRAPH	25-26
SEISMIC PARAMETERS	27 32
SOIL CLASSIFICATION	33
APPENDIX - B	34
SIEVE ANALYSIS REPORT, SAMPLE # 1 to # 8	35-43
APPENDIX - C	44
SOIL BORING PHOTOGRAPHS	45-48



CONSULTANTS, INC.
4405 South Clinton Avenue
South Plainfield, NJ 07080

Tel: (800) 545-ATUL
(908) 754-8383
Fax: (908) 754-8633

NJ EDA Approved Testing Laboratory • MBE/DBE Certified • NJ DEP Certified

www.ANSConsultants.net

Soil, Concrete, Masonry, Rebar, Asphalt, Structural Steel, Precast, Piles, Caissons, Fire-proofing, Roofing, Soil Boring, Concrete/Rock Coring, UST Removal, Environmental Testing & Reports

September 03, 2024

Gomes Management
P O Box 5277
Newark, NJ 07105

Attn: Mr. Jose Pacheco

Re: **Subsurface Soil Investigation & Foundation Recommendation Report**
Proposed 1-story retail building
525 Northfield Avenue
West Orange, NJ 07052
Block # 159 04, Lot # 1 01, 1 02 & 1.03

Dear Mr. Pacheco,

Enclosed, please find three (3) copies of the Subsurface Soil Investigation & Foundation Recommendation Report for the total of eight (8) Soil Borings performed on August 19, 2024, August 20, 2024 and August 21, 2024 at the project referenced above. The soil boring work was performed in accordance with our signed revised proposal dated July 25, 2024.

Our **Scope of Services** included the following:

1. Drilling and full-time inspection of total of eight (8) borings, down to 27'-0" deep or to refusal whichever comes first, recording of groundwater level or depth to bedrock if encountered in the contracted depth.
2. Performance of engineering evaluation to determine the stratification and physical properties of the subsurface materials and to develop and recommend appropriate type of foundation systems.
3. Preparation of a written report summarizing all findings and recommendations.

PROPOSED CONSTRUCTION:

The project site is located at 525 Northfield Avenue, West Orange, NJ in Essex County. At the present time, the subject site consists of 2-story masonry restaurant building with parking lot. We understand that a 1-story retail building is proposed at the subject site. Our recommendations are based upon NJ IBC-2021 ASCE 7-22 and construction material loads for the Building Construction based upon American National Standards. Please see location plan in Appendix-A for the exact location and photographs in Appendix-C for the existing site conditions.

SITE CONDITIONS:

The subject site is located towards north side of Northfield Avenue. The site was noted to be fairly leveled during soil boring activities. The subject site is noted to be primarily surrounded by commercial and residential properties. The subject property is located at approximately Latitude N 40° 46' 13.75", Longitude W 74° 16' 38.96" on the USGS Digital elevation Model. It is at an approximate elevation of 385' above mean sea level. See the site location plan in Appendix-A for more details.

FIELD INVESTIGATION

The soil boring locations were selected and marked by an ANS field representative based upon the location plan provided by the client and also based upon the equipment access. Surface utility mark-out was performed by New Jersey One-Call System. Underground utilities were also cleared by GPR solutions, a Private Utility Mark out Company on August 19, 2024. Once cleared, the soil boring work began on August 19, 2024.

A total of eight (8) soil borings, B-1 to B-8 were drilled during the geo-technical investigation at the site are as follows:

Boring Number	Date Performed	Depth to Groundwater (feet)	Depth of Refusal (feet)
B-1	8/21/2024	-	11'-4"
B-2/2A	8/21/2024	Hole collapsed at 7'-5"	11'-4"
B-3	8/21/2024	Hole collapsed at 7'-2"	9'-5"
B-4	8/20/2024	Hole collapsed at 4'-4"	11'-2"
B-5/5A	8/20/2024	Hole collapsed at 9'-2"	19'-9"
B-6	8/20/2024	11'-1"	25'-7"
B-7	8/19/2024	-	14'-2"
B-8	8/19/2024	8'-9"	19'-2"

The soil boring locations are shown in the Soil Boring Location Plan which is included in Appendix-A. Soil boring work was performed under the direction and supervision of field Engineer Mr. Syed Abbas and Mr. Krunal Parmar. The borings were drilled using a 3" diameter hollow stem auger. Soil encountered was sampled continuously down to a depth of 12'-0" and then at 5'-0" interval down to auger refusal noted between 9'-5" to 19'-9" depth in borings B-1 to B-5, B-7 & B-8. Soil encountered was sampled continuously down to a depth of 12'-0" and then at 5'-0" interval down to spoon refusal noted at 25'-7" depth in boring B-6. Soil samples were extracted using a 2" diameter split spoon sampler as per the procedure specified in ASTM 1586-99.

Samples for the boring were obtained by the Standard Penetration Test (SPT) Method (ASTM D 1586), which consists of driving a 2-inch outside-diameter split-spoon sampler into the soil with a 140-pound weight falling freely from a distance of 30 inches. The samplers were driven in four successive 6-inch increments, with the number of blows per increment being recorded. The number of blows required to advance the sampler in the middle 12 inches is termed as the Standard Penetration Resistance (N-value) and is presented on the Field Test Boring Logs in Appendix-A.

During drilling operations, extracted soil samples were visually examined and classified by our Field Engineer. The soil sample description, Standard penetration test (SPT) blow counts and locations, strata changes, groundwater depth and other pertinent information were recorded on a detailed field log. Soil samples obtained from the split spoon sampler were visually classified according to the Unified Soil Classification System (USCS).

LABORATORY TESTING:

A total of eight (8) soil samples, one each from borings B-1 to B-8 were laboratory tested to determine in-place moisture content and to classify the soil as per Unified Soil Classification System, ASTM-D2487-93. The findings are summarized below. Laboratory test report are enclosed in Appendix -B.

Soil Boring Number	Soil Sample No.	Depth collected	Moisture Content (%)	Fines thru #200 Sieve	USCS Symbol
B-1	S-1	2'- 4'	10.9	31.1	GM
B-2A	S-2	4' - 6'	10.1	19.1	SM
B-3	S-3	6'- 8'	5.5	1.9	GP
B-4	S-4	8' - 10'	8.2	21.0	GM
B-5A	S-5	10'- 12'	5.8	24.7	SM
B-6	S-6	15'- 17'	13.3	28.8	SM
B-7	S-7	4' - 6'	7.5	23.7	SM
B-8	S-8	6'- 8'	14.2	26.3	SM

GM: silty gravels

SM: silty sands

GP: poorly graded gravels

SUBSURFACE CONDITIONS:

Detailed description of the soil encountered in the test boring is documented in the boring log which is presented in Appendix-A. The following gives a general description of the subsurface conditions encountered at the borings. While the borings may indicate that the subsurface conditions appear to be relatively uniform across the site, it should be recognized that the size of borings was small compared to the size of the site, and that the existence of anomalies cannot be precluded.

According to NJ Geoweb website, the geological formation is Rahway Till and geologic age is late Pleistocene, late Wisconsinan deposited directly from glacial ice during the late Wisconsinan glaciation. It consists of clayey silt to sandy silt with some to many pebbles and cobbles and few boulders, reddish brown, reddish yellow, yellowish brown, brown. As much as 100 feet thick, generally less than 40 feet thick.

Based on the results of soil borings and our geo-technical laboratory testing, we estimate the general stratigraphy of the site to consist of the following major units, in an increasing order of depth:

Stratum-1: Fill material containing very dark gray, brown/black silt, trace f/c sand, trace f/c gravel, trace wood chip, trace fragments of concrete, and fill material containing brown, black silty f/c sand, trace f/c gravel, trace fragments of asphalt & glass, plastic and fill material containing grayish brown f/c sand, trace silt, some f/c gray crushed stone and fill material containing dark gray, greenish gray clayey silt, trace f/c sand, trace fine gravel, trace fragments of asphalt was noted under this stratum in top 2'-6" in boring B-1, in top 4' in B-2/2A, in top 4'-11" in B-3, in top 5" in B-4, in top 2' in B-5/5A and in top 9" in B-8. No fill was noted in boring B-6 & B-7. The relative density of this material varied between loose to medium dense condition. The relative stiffness of this material varied between soft to medium stiff condition.

Stratum-2: Brown silt, trace f/c sand, reddish brown silty f/c sand & f/c gravel, trace silt and reddish brown silt, trace f/c sand. trace f/m gravel was noted under this stratum between 4 feet to spoon refusal @ 4'-3" in boring B-1, between 10 feet to spoon refusal @ 10'-9" in boring B-2/2A, between 2 feet to 4 feet & then between 6 feet to 10 feet in B-4, between 4 feet to down to spoon refusal @ 15'-3" in B-5/5A, between 2 feet to down to spoon refusal @ 25'-7" in B-6, down to 12 feet in B-7, between 2 feet to 11 feet & then between 15 feet to 17 feet in B-8. The relative density of this material varied between very loose to very dense condition. The relative stiffness of this material varied between soft to stiff condition.

Stratum-3: Reddish brown, purple f/c sand & f/c gravel, trace silt, was noted under this stratum between 6 feet to 10 feet in B-1, between 6 feet to 10 feet in boring B-2, between 8 feet to down to 9'-2" in B-3, between 10 feet to down to spoon refusal @ 10'-10" in B-4. The relative density of this material varied between medium dense to dense condition.

Stratum-4: Brown f/c sand, trace silt, some f/m gravel, f/c fragments of gray stone, some f/c gravel was noted under this stratum between 10 feet to down to spoon refusal @ 10'-8" in boring B-1, between 6 feet to 8 feet in boring B-3 and in top 24 inches in B-6. The relative density of this material was noted to be in medium dense condition.

Stratum-5: Augur Refusal indicating possible bedrock was encountered between 9'-5" to 19'-9" depth in borings B-1 to B-5, B-7 & B-8.

SUMMARY OF FINDINGS:

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-1	0 - 2	8	FILL	1200	1000
B-1	2 - 4	13	FILL	2600	2500
B-1	4 - 4'-3"	50/3	SM/GM	+5000	4000
B-1	6 - 7'-5"	137/11	SP/GP	+5000	5000
B-1	8 - 10	53	SP/GP	+5000	5000
B-1	10 - 10'-8"	50/2	SP-SM	+5000	5000
B-1	@11'-4"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-2/2A	0 - 1' 11"	25	FILL	5000	2500
B-2/2A	2 - 4	12	FILL	2400	2500
B-2/2A	4 - 6	25	FILL	5000	4000
B-2/2A	6 - 8	21	SP/GP	4200	4000
B-2/2A	8 - 10	39	SP/GP	+5000	4500
B-2/2A	10 - 10'-9"	54/3	SM/GM	+5000	5000
B-2/2A	@11'-4"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-3	0 - 2	14	FILL	2800	1500
B-3	2 - 4	7	FILL	1400	1500
B-3	4 - 6	30	FILL	+5000	4000
B-3	6 - 8	19	SP-SM	3800	4000
B-3	8 - 9'-2"	44/2	SP/GP	+5000	5000
B-3	@ 9'-5"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-4	0 - 2	9	FILL	1800	1000

B-4	2 - 4	15	SM/GM	3000	2500
B-4	4 - 5'-2"	45/2	GM-SM	+5000	4500
B-4	6 - 8	62	SM/GM	+5000	5000
B-4	8 - 10	94	SM/GM	+5000	5000
B-4	10 - 10'-10"	52/4	SP/GP	+5000	5000
B-4	@11'-2"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-5/5A	0 - 1'-8"	26	FILL	+5000	1500
B-5/5A	2 - 4	6	FILL	1200	1500
B-5/5A	4 - 6	15	SM/GM	3000	3000
B-5/5A	6 - 8	19	SM/GM	3800	4000
B-5/5A	8 - 10	55	SM/GM	+5000	5000
B-5/5A	10 - 11'-1"	93/7	SM/GM	+5000	5000
B-5/5A	15 - 15'-3"	78/3	SM/GM	+5000	5000
B-5/5A	@19'-9"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-6	0 - 2	21	SP-SM	4200	1500
B-6	2 - 4	8	SM/GM	1600	1500
B-6	4 - 6	6	SM/GM	1200	1500
B-6	6 - 8	5	SM/GM	1000	1000
B-6	8 - 10	13	SM/GM	2600	2500
B-6	10 - 12	28	SM/GM	+5000	5000
B-6	15 - 17	52	SM/GM	+5000	5000
B-6	20 - 22	47	SM/GM	+5000	5000
B-6	25 - 25'-7"	50/1	SM/GM	+5000	6000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-7	0 - 2	16	SM/GM	3200	3000
B-7	2 - 4	17	SM/GM	3400	3500
B-7	4 - 6	23	SM/GM	4600	4000
B-7	6 - 8	7	SM/GM	1400	1500
B-7	8 - 10	10	SM/GM	2000	2000
B-7	10 - 12	18	SM/GM	3600	4000
B-7	@14'-2"	Augur Refusal	-	+5000	8000

Boring Number	Depth in (feet)	Penetration Resistance N-Value	Soil Type	In-Place Soil Bearing Capacity (PSF)	Recommended Soil Bearing Capacity (PSF)
B-8	0 - 2	15	FILL	3000	1500
B-8	2 - 4	25	SM/GM	5000	1500
B-8	4 - 6	5	SM/GM	1000	1000
B-8	6 - 7'-9"	5	SM/GM	1000	1000
B-8	9 - 11	6	SM/GM	1200	1500
B-8	11 - 13	19	SP/GP	3800	3500
B-8	15 - 17	44	SM/GM	+5000	4500
B-8	@19'-2"	Augur Refusal	-	+5000	6000

GROUNDWATER:

Groundwater was encountered in only two borings B-6 & B-8 below existing grade surface as follows

Boring Number	Depth to Groundwater (feet)	Boring Number	Depth to Groundwater (feet)
B-1	-	B-5	Hole collapsed at 9'-2"
B-2	Hole collapsed at 7'-5"	B-6	11'-1"
B-3	Hole collapsed at 7'-2"	B-7	-
B-4	Hole collapsed at 4'-4"	B-8	8'-9"

It should be noted that groundwater level will fluctuate due to variations in rainfall or other factors not evident at the time of our investigation.

SEASONAL HIGH WATER TABLE:

Signs of black mottling was noted at 6 feet depth in only boring B-7, indicating SHWT below 6 feet

CONCLUSIONS:

1. Groundwater was encountered at 11'- 1" in B-6 and at 8'- 9" in B-8 below existing grade surface. Consequently, we anticipate that groundwater management during construction will be critical.
2. Signs of black mottling was noted at 6 feet depth in only boring B-7, indicating SHWT below 6 feet
3. Fill was noted in top 2'-6" in boring B-1, in top 4' in B-2/2A, in top 4'-11" in B-3, in top 5' in B-4, in top 2' in B-5/5A and in top 9" in B-8. Below fill, the majority of the on-site soil consists of silt with trace f/c sand & trace f/m gravel. The on-site soil will be suitable as structural fill. Depending upon the time of the year when the actual construction takes place, drying of excavated sandy soil and aeration may be required to reduce the moisture content. In-situ moisture content of soil varied between 5.5 % to 14.2 % which is generally considered moist.
4. The following parameters should be used for seismic design of the building in accordance with **IBC-2021 ASCE 7-22**

Description	Parameter	Recommended value
Mapped Spectral Acceleration for short periods	S _s	0.27
Mapped Spectral Acceleration for 1-sec period	S ₁	0.05
Site Class	C	Very dense Soil & Soft Rock
5 percent damped Design spectral response acceleration at short periods	S _{DS}	0.18
5 percent damped Design spectral response acceleration at 1-sec periods	S _{D1}	0.043

The following parameters should be used for seismic design of the building in accordance with **IBC-2018- ASCE 7-16**.

Description	Parameter	Recommended Value
Mapped Spectral Acceleration for short periods	S _s	0.282
Mapped Spectral Acceleration for 1-sec period.	S ₁	0.059
Site Class:	C	Very dense Soil & Soft Rock
Site Coefficient	F _a	1.3
Site Coefficient.	F _v	1.5
5 percent damped Design spectral response acceleration at short periods	S _{DS}	0.245
5 percent damped Design spectral response acceleration at 1-sec periods	S _{D1}	0.059

5. Any fill used as backfill material within the building and pavement areas should consist of approved portions of the on-site granular soils which have been maintained at moisture contents suitable for compaction or select fill should be imported. All fill should be placed in lift in the order of twelve (12) inches in loose thickness and be uniformly compacted to at least 95% of its maximum dry density as determined by the modified proctor density values derived based upon ASTM D-1557-98 test procedure.

In addition, we recommend that backfill soil placed in confined areas, such as foundation or utility excavations, should be spread in lifts in the order of six (6) to eight (8) inches in loose thickness and it should be compacted to the same degree using manually operated vibratory compaction equipment. We recommend that temporary construction slopes be established at one vertical to two horizontal, or flatter, or as required by the governing safety codes.

FOUNDATION DESIGN CRITERIA:

As per the r2-coastal-fema hub arcgis.com website and FIRM-(flood insurance rate map), the Effective Flood Zone of the subject property is AE. The properties in these flood zones have a 1% chance of flooding each year.

Fill was noted in top 2'-6" in boring B-1, in top 4' in B-2/2A, in top 4'-11" in B-3, in top 5" in B-4, in top 2' in B-5/5A and in top 9" in B-8. We recommend that the foundation for the proposed 1-story retail building shall be supported by conventional shallow foundations established on the medium dense soil noted at 4' to 6' depth below grade. Foundation should be designed to impose maximum allowable net bearing pressure of 2,000 pounds per square foot. Excavation down to 10 feet depth will be required in borings B-6, B-7 & B-8 to get net bearing pressure of 4,000 psf. A complete removal of fill is recommended.

Any pockets of localized unsuitable soil encountered during foundation excavation should be completely removed. The over excavated area should be backfilled utilizing either controlled compacted fill or 3/4" size clean gravels. Any footing or slab placed in this area will require over excavation, removal of unsuitable material and backfilling with ¾ size stones or controlled compacted fill. Placing additional reinforcing steel to strength the footing over soft soil may be required.

We recommend that exterior foundations be established at least three feet six inches below the adjacent exterior grade, or as required by local ordinance, to provide protection from frost penetration. The maximum post-construction settlements of foundations designed and constructed in accordance with our recommendations will be in the order of ¾" or less.

FLOOR SLAB DESIGN CRITERIA:

Removal of fill from top 2'-6" in boring B-1, from top 4' in B-2/2A, from top 4'-11" in B-3, from top 5" in B-4, from top 2' in B-5/5A and from top 9" in B-8 will be required. The floor slab or patio slab shall be supported directly on the compacted sub-grade of onsite material or controlled compacted structural fill. Compaction of the sand below the floor slab sub-grade to 95% of its optimum density will be required. We recommend performing compaction test at the rate of one test per 200-sq ft area. Recommended Modulus of Sub-Grade reaction is 75 pci.

Any back fill required for the structural area to be off site or $\frac{3}{4}$ " clean crushed stones may be utilized to minimize the influence of moisture on the first fill layer. All off-site fill should be composed of relatively well graded sand and gravel containing less than 15% by weight passing U.S. Standard #200 sieve and having a maximum particle size of six inches.

Acceptable soil materials for backfill and fill should be free of clay, rock or gravel larger than six (6) inches in any dimension, debris, waste, frozen materials, vegetable and other deleterious matter and it should comply with ASTM D-2487-91 soil classification groups GW, GP, SM, SW and SP.

All fill should be placed in lifts in the order of twelve (12) inches in loose thickness and it should be uniformly compacted to at least 95% of its maximum dry density as determined by the modified proctor density values derived based upon ASTM D-1557-93 test procedure. In addition, we recommend that backfill soils placed in confined areas, such as foundation or utility excavations, should be spread in lifts in the order of six to eight inches in loose thickness and be compacted to the same degree using manually operated vibratory compaction equipment.

BELOW GRADE WALLS:

We recommend that the exterior building walls should be constructed with a continuous perimeter foundation drain to convey localized groundwater seepage away from the building and prevent the hydrostatic pressures built-up against the walls. The drain could consist of a 6 to 8 inch diameter PVC pipe surrounded on all sides by a minimum of six (6) inches of clean $\frac{3}{8}$ " crushed gravel. The pipe should drain by gravity to the site storm water system, if feasible, or should be connected to a sump pit where any water could be removed by pumping.

Soil Unit weight (total):	120 pcf
Angle of Internal Friction:	31 degrees
Coefficient of sliding friction	0.4
Coefficient of active earth pressure	0.28
Coefficient of passive earth pressure	3.57

RECOMMENDATIONS FOR THE EARTHWORK FOUNDATION CONSTRUCTION:

Clearing and Stripping: Clearing and stripping would include removing vegetation and any boulders or any loose or unsuitable soil at the distance of 5 feet beyond the limits of the proposed building excavation, structure and paved areas. Limits of stripping should conform to construction permit limitations.

Soil Erosion and Sediment Control: Clearing and stripping should be performed in accordance with the requirements of the soil erosion and sediment control plan and environment permits.

Protection of Utilities: Existing utilities, in the area of construction should be marked to protect from damage during excavation and foundation construction. Excavations should be stopped if they could potentially undermine existing utilities.

Excavation & side slope: An unbraced excavation slope of 2:0 horizontal to 1 vertical or flatter may be considered in the planning for construction. Sheet piling and bracing, and/or slope stabilization systems should be used wherever the unbraced slope passes beneath utilities or structures, the active roadway abutments and/or where it is found to be necessary or more cost effective to use sheet piling in order to limit the size of the excavations and maintain traffic. Sheet piling and bracing systems and excavation slopes may be designed using the soil properties presented in summary table provided earlier.

Proof rolling and compaction of Pavement and Fill Subgrades: Following stripping or excavation to plan elevations, all subgrades for placement of new foundation or parking lot pavement should be proof rolled using a vibratory roller with minimum 1 ton static weight in confined areas along side walls and 10 tons static weight in the footprint of the building and general roadway paved areas. Footing subgrades should be compacted with small area vibratory plate compactors. Proof rolling should be observed and evaluated by a qualified Geotechnical engineer or technician familiar with site conditions.

MINIMUM PAVEMENT DESIGN SECTIONS:

ACCESS ROAD AND TRUCK TRAFFIC AREAS

Bituminous Concrete Surface Course (NJDOT I-5)	2 inches
Bituminous Concrete Base Course (NJDOT I-2)	4 inches
Quarry Process Sub-Base Course (NJ DOT DGA)	6 inches
TOTAL SECTION THICKNESS	12 inches

AUTOMOBILE PARKING AREAS

Bituminous Concrete Surface Course (NJDOT I-5)	2 inches
Bituminous Concrete Base Course (NJDOT I-2)	3 inches
Quarry Process Sub-Base Course (NJ DOT DGA)	4 inches
TOTAL SECTION THICKNESS	9 inches

As previously discussed, it is recommended that the loose soils at the surface should be proof rolled and densified with a heavy vibratory compactor. With this recommended compaction, a CBR value of six (6) would be appropriate for use in the design of flexible pavements over site soils with imported granular fill, the CBR could be about eight (8).

RECOMMENDED SERVICES:

It is recommended that we should be retained to provide continuous observation and Soil engineering services during the excavation and foundation construction phases of the work. This is to observe compliance with the design concepts, specifications and recommendations, and to allow design changes in the event that subsurface conditions differ from those anticipated prior to start of construction.

LIMITATIONS:

The recommendations contained in this report are our best professional judgment as

to be followed in the design and construction of the proposed project. There may be subsurface conditions not disclosed by the explorations adequately identify subsurface conditions for the purpose of this study. If during construction any differences are found between the report of the explorations and the actual subsurface conditions, they should be brought to our attention immediately so that the effect in our recommendations can be evaluated.

This report has been prepared in accordance with generally accepted Geo-technical Engineering practices for the exclusive use of our client, Gomes Management and their designated representative(s). No other warranty, express or implied, is made. Contractors' wishes to use the soil boring information may do at their own risk. Unless specifically indicated to the contrary in this report, this report does not address environmental considerations, which may affect the site development. The conclusions and recommendations of this report are not intended to supersede or overlook any N.J.D.E.P. Environmental conditions, which should be reflected in the site planning.

Should you have any questions or require additional information, please do not hesitate to contact the undersigned at (908)754-8383.

Sincerely,
ANS Consultants, Inc.




Atulkumar N. Shah, PE, PP, F. ASCE
President
NJ PE License #24GE03443900
ANS/RM

Reported Gomes Management-- (3), File -- (1)

Appendix - A

GOOGLE MAP

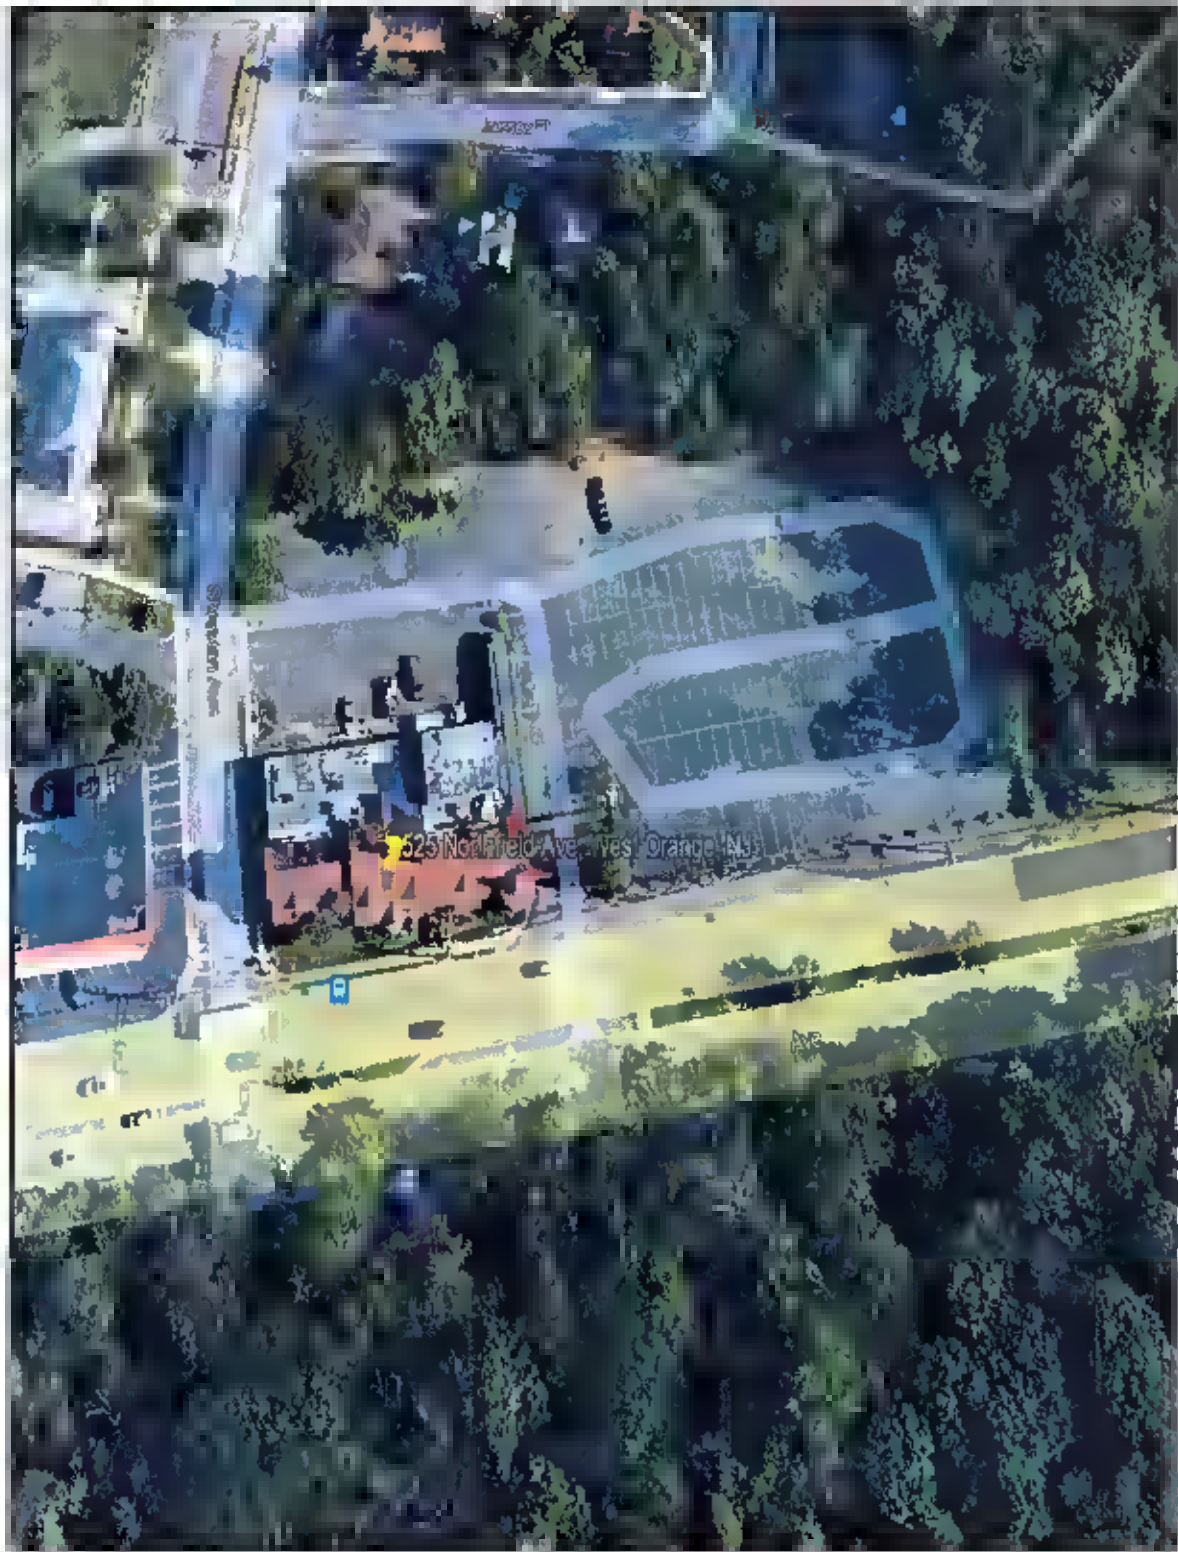

Client: Gomes Management
Project: 525 Northfield Avenue
West Orange, NJ



CONSULTANTS, INC.
4405 South Clinton Avenue
South Plainfield, NJ 07080

 Soil Boring Location

SCALE: N.T.S.

BY Manav Doshi	DATE 9/3/2024
	Project No ANY 6549

DRILL HOLE LOG

BORING NO.: B-1

PROJECT: Proposed 1-story retail building
 CLIENT: Gomes Management
 LOCATION: 525 Northfield Avenue, West Orange, NJ
 DRILLER: JESUS, David & A. SHAH
 DRILL RIG: ACKER XLS
 DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: ANV-6549
 DATE: 8-21-2024
 ELEVATION: N/A
 LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

ELEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0									10 30 50
		2- 3- 3- 1	FILL	Fill material containing very dark gray, brown silt, trace f/c gravel, trace wood chip, moist, soft.			0'-2'	6	
		2- 3- 10 - 26	FILL	Fill material containing brown, black silt, trace fine gravel, trace wooden chip, moist, medium stiff. @ 2'-7": Brown silt, trace f/c sand, some f/c gravel, moist, medium stiff.			2'-4'	13	
3		50/ 3	SM/GM	Brown silt, trace f/c sand, coarse gravel at tip of the spoon, moist, dense.			4'-4'3"	50/	
6		30- 60-	SP/GP	Spoon Refusal @ 4'-3". Augured down to 6 feet.			6'-7'5"	137	13"
		77/ 5	SP/GP	Reddish brown and purple f/c sand and f/c gravel, trace silt, slightly moist, very dense.			8'-10'	53	
9		28- 28- 25- 45	SP/GP	Spoon Refusal @ 7'-5". Augured down to 8 feet. Reddish brown f/c sand and f/c gravel, trace silt, slightly moist, very dense.			10'-10'8"	50/	
12		63- 50/ 2	SP-SM	Brown f/c sand, trace silt, some f/m gravel, slightly moist. Spoon Refusal @ 10'-8". Augur Refusal @ 11'-4". End of boring.					
15									
16									
21									

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-2/B-2A

PROJECT: Proposed 1-story retail building
 CLIENT: Gomes Management
 LOCATION: 525 Northfield Avenue, West Orange, NJ
 DRILLER: JESUS, David & A. SHAH
 DRILL RIG: ACKER XLS
 DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: ANV-6549
 DATE: 8-21-2024
 ELEVATION: N/A
 LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

ELEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
									10 30 50
0				Asphalt: 4.5".			0'-1'11"	25	
			FILL	Fill material containing reddish brown f/c sand, trace silt, some f/c gravel, moist.					
				Spoon refusal @ 1'-11".			2'-4'	12	
			FILL	Augur refusal @ 1'-11"					
3				Augured down to 2 feet.					
			FILL	Fill material containing brown silt, trace f/c sand, trace fine gravel, trace fragments of concrete, moist, medium stiff.			4'-6'	25	
				Fill material containing brown, black silty f/c sand, trace f/c gravel, trace fragments of asphalt, moist, medium dense.			6'-8'	21	
6			SP/GP	Reddish brown f/c sand and f/c gravel, trace silt, moist, medium dense.					
				Reddish brown f/c sand and f/c gravel, trace silt, moist, dense.			8'-10'	39	
9			SP/GP						
			SM/GM	Reddish brown silty f/c sand and f/c gravel, trace silt, moist, very dense.			10'-10'9"	54/	
				Spoon Refusal @ 10'-9".					
				Augur Refusal @ 11'-4".					
12				End of boring.					
15									
18									
21									

Augur refusal was encountered at 1'-11" at B-2 location, so the location was moved to B-2A.
 (Please refer location plan).

Hole collapsed at 7'-5" for Ground Water.

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-3

PROJECT: Proposed 1-story retail building
CLIENT: Gomes Management
LOCATION: 525 Northfield Avenue, West Orange, NJ
DRILLER: JESUS, David & A. SHAH
DRILL RIG: ACKER XLS
DEPTH TO WATER> INITIAL $\frac{\pi}{4}$:

PROJECT NO.: ANV-6549
DATE: 8-21-2024
ELEVATION: N/A
LOGGED BY: Krunal Parmar

DEPTH TO WATER> INITIAL :

[illegible]

Note: Hole collapsed at 7'-2" for Ground Water.

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-4

PROJECT: Proposed 1-story retail building
CLIENT: Gomes Management
LOCATION: 525 Northfield Avenue, West Orange, NJ
DRILLER: JESUS, David & A. SHAH
DRILL RIG: ACKER XLS
DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: ANV-6549
DATE: 8-20-2024
ELEVATION: N/A
LOGGED BY: Krunal Parmar

DEPTH TO WATER> INITIAL ∇ :

AT COMPLETION :

[illegible]

Hole collapsed at 4'-4" for Ground Water.

This information pertains only to this boring and should not be interpreted as being indicative of the site.

DRILL HOLE LOG

BORING NO.: B-5/B-5A

PROJECT: Proposed 1-story retail building
 CLIENT: Gomes Management
 LOCATION: 525 Northfield Avenue, West Orange, NJ
 DRILLER: JESUS, David & A. SHAH
 DRILL RIG: ACKER XLS
 DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: ANV-6549
 DATE: 8-20-2024
 ELEVATION: N/A
 LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

ELEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0									10 30 50
		8-11-	FILL	Asphalt-3".			0'-1'8"	26	
		15-10/2	FILL	Fill material containing reddish brown silty f/m sand and f/c gravel, moist, medium dense. Spoon refusal @ 1'-8"					
		1-2-		Augur refusal @ 1'-8"			2'-4'	6	
3		2-4-19		Augured down to 2 feet.					
				Fill material containing dark brown silty f/c sand, little f/c gravel, trace fragments of asphalt, moist, loose.			4'-6'	15	
		21-8-7-7	SM/GM	Reddish brown silty f/c sand, some f/c gravel, moist, slightly compact. Augured down to 6 feet.					
6		4-7-12-12	SM/GM	Reddish brown silt, little f/c sand, trace f/c gravel, moist, stiff.			6'-8'	19	
		12-25-	SM/GM	Reddish brown silty f/c sand, some f/c gravel, moist, very dense.			8'-10'	55	
9		30-35							
		26-62-	SM/GM	Reddish brown silty f/c sand, little f/c gravel, moist, very dense.			10'-11'	93/	93/
		31/1		Spoon Refusal @ 11'-1". Augured down to 15 feet.					
12									
15		78/3	SM/GM	Reddish brown silty f/c sand, little f/m gravel, moist. Spoon Refusal @ 15'-3". Augur Refusal @ 19'-9".			15'-15'3"	78/	78/
18									
21				End of boring.					

Augur refusal was encountered @ 1'-8" at B-5 location, so the location was moved to B-5A location.
 (Please refer location plan).

Hole collapsed at 9'-2" for Ground Water.

This information pertains only to this boring and should not be interpreted as being indicative of the site.


DRILL HOLE LOG

BORING NO.: B-6

PROJECT: Proposed 1-story retail building
 CLIENT: Gomes Management
 LOCATION: 525 Northfield Avenue, West Orange, NJ
 DRILLER: JESUS, David & A. SHAH
 DRILL RIG: ACKER XLS
 DEPTH TO WATER> INITIAL ∇ : 11'-1"

PROJECT NO.: ANV-6549
 DATE: 8-20-2024
 ELEVATION: N/A
 LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

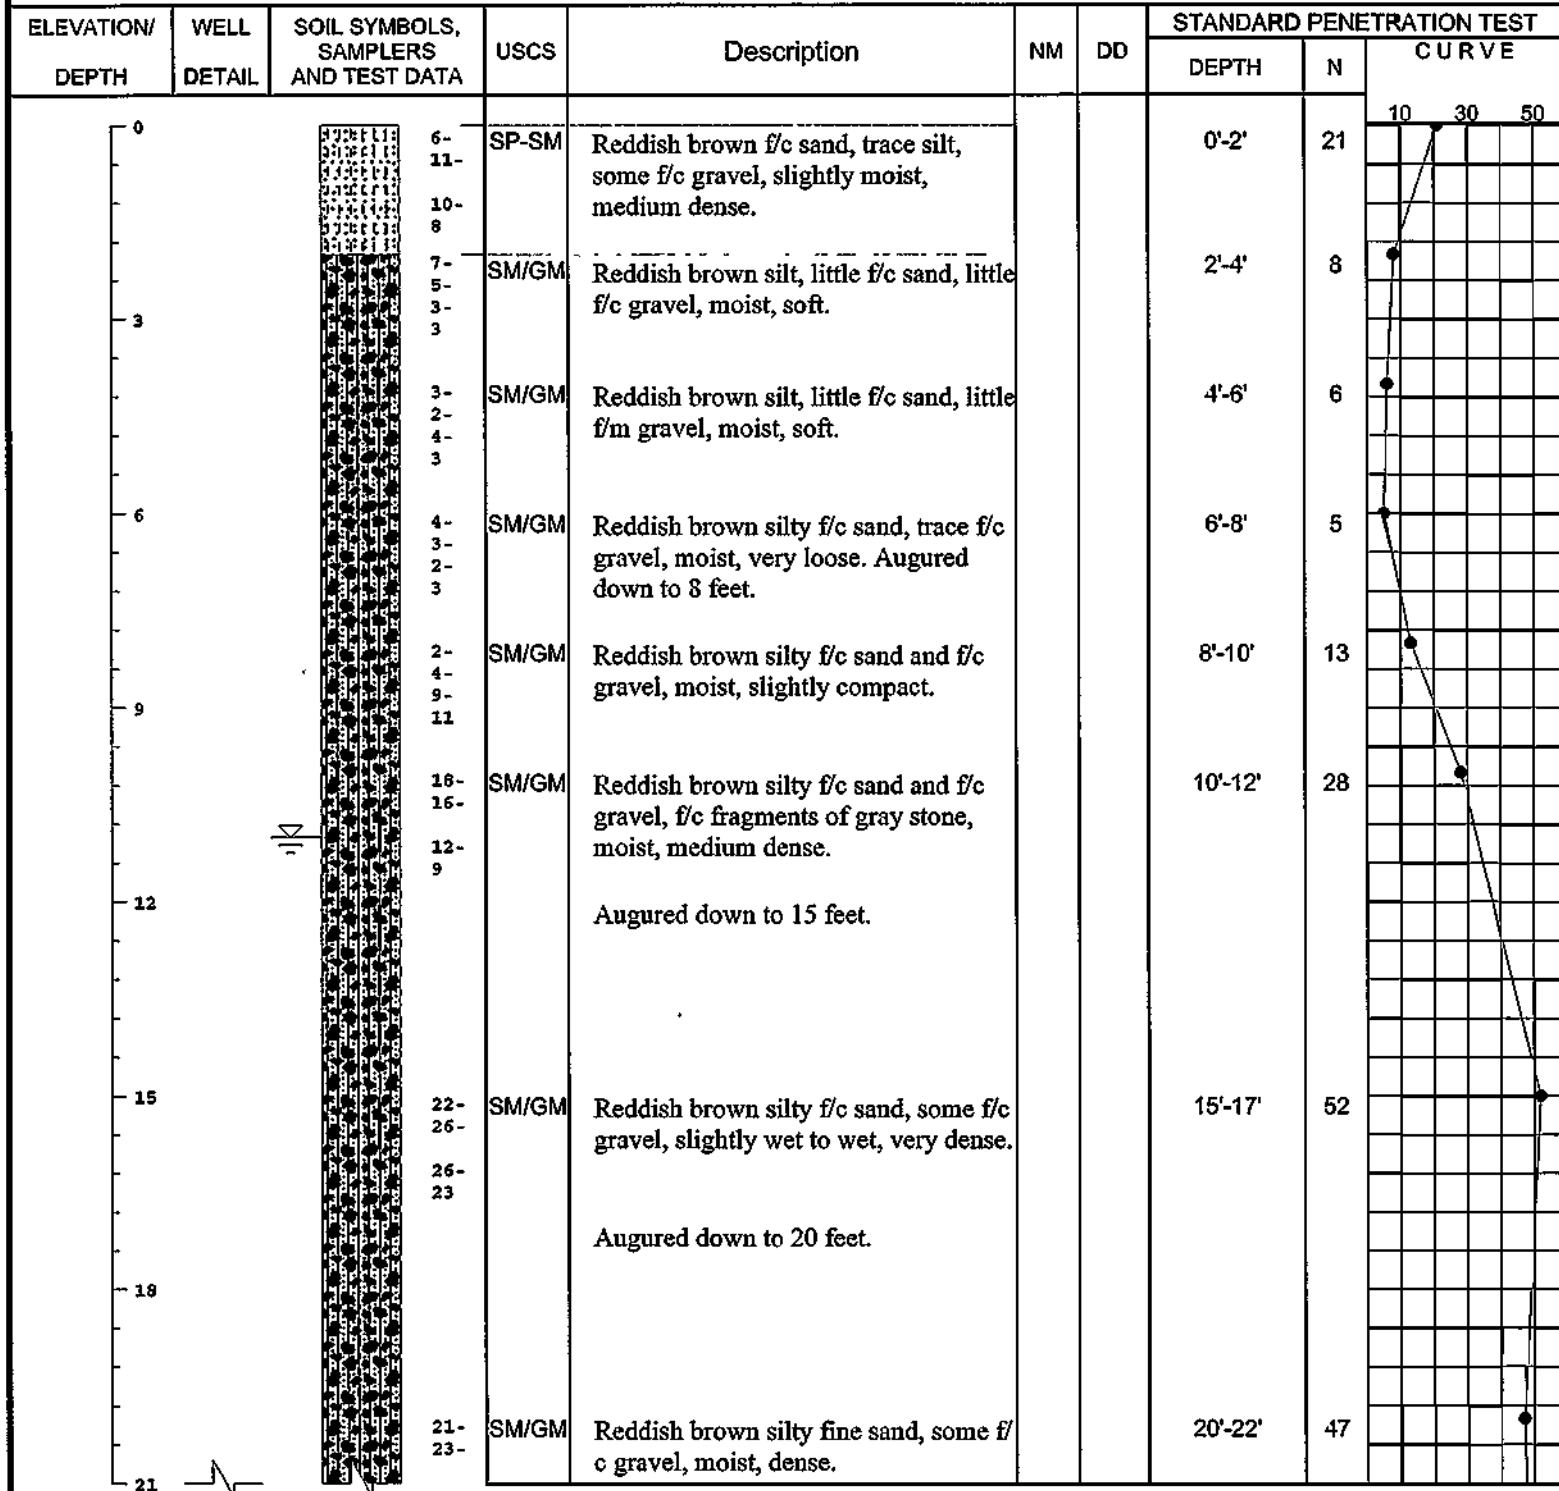

This information pertains only to this boring and should not be interpreted as being indicative of the site.

BORING NO.: B-6

PROJECT NO.: ANV-6549

ANS CONSULTANTS, INC.

DRILL HOLE LOG

BORING NO.: B-7

PROJECT: Proposed 1-story retail building
CLIENT: Gomes Management
LOCATION: 525 Northfield Avenue, West Orange, NJ
DRILLER: JESUS, David & A. SHAH
DRILL RIG: ACKER XLS
DEPTH TO WATER> INITIAL ∇ :

PROJECT NO.: ANV-6549
DATE: 8-19-2024
ELEVATION: N/A
LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

ELEVATION/ DEPTH	WELL DETAIL	SOIL SYMBOLS, SAMPLERS AND TEST DATA	USCS	Description	NM	DD	STANDARD PENETRATION TEST		
							DEPTH	N	CURVE
0									10 30 50
		16-10-	SM/GM	Asphalt-2.5".			0'-2'	16	
		6-7		Dark brown silty f/c sand, some f/c gravel, moist, slightly compact.					
		9-8-9-5	SM/GM	Reddish brown silty f/c sand and f/c gravel, moist, medium dense.			2'-4'	17	
3		6-9-14-7	SM/GM	Reddish brown silty f/c sand, some f/c gravel, moist, medium dense. Augured down to 6 feet.			4'-6'	23	
6		6-4-3-5	SM/GM	Brown silty f/c sand, some f/c gravel, black sign of mottling, moist, loose.			6'-8'	7	
		5-4-6-5	SM/GM	Reddish brown silty f/c sand, little f/c gravel, moist, loose.			8'-10'	10	
9		10-9-9-17	SM/GM	Dark brown silty f/c sand, some f/c gravel, moist to slightly moist, medium dense.			10'-12'	18	
12				Augur Refusal @ 14'-2".					
15				End of boring.					
18									
21									

This information pertains only to this boring and should not be interpreted as being indicative of the site.


DRILL HOLE LOG

BORING NO.: B-8

PROJECT: Proposed 1-story retail building
CLIENT: Gomes Management
LOCATION: 525 Northfield Avenue, West Orange, NJ
DRILLER: JESUS, David & A. SHAH
DRILL RIG: ACKER XLS
DEPTH TO WATER> INITIAL ∇ : 8'-9"


PROJECT NO.: ANV-6549
DATE: 8-19-2024
ELEVATION: N/A
LOGGED BY: Krunal Parmar

AT COMPLETION ∇ :

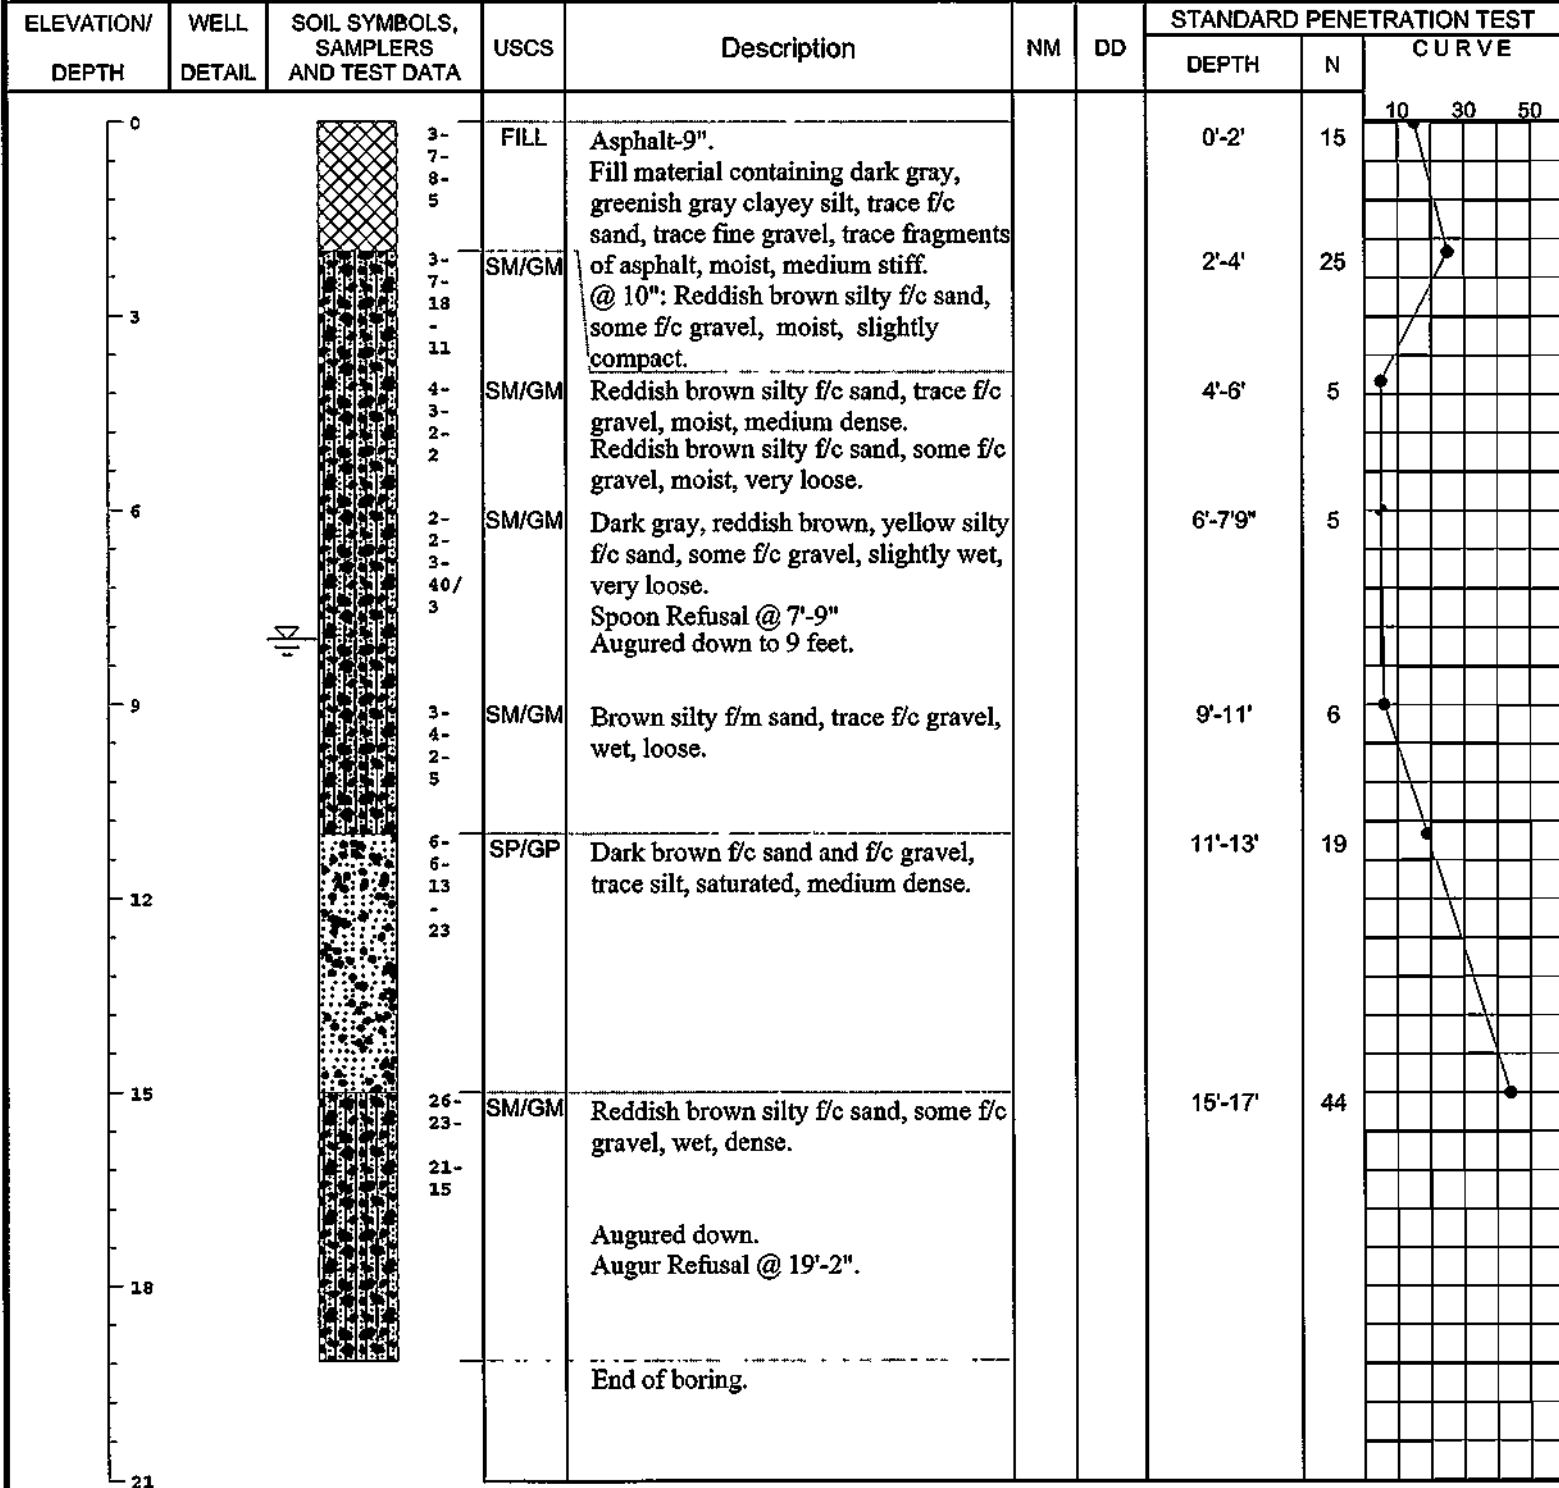

This information pertains only to this boring and should not be interpreted as being indicative of the site.

Depth in Feet

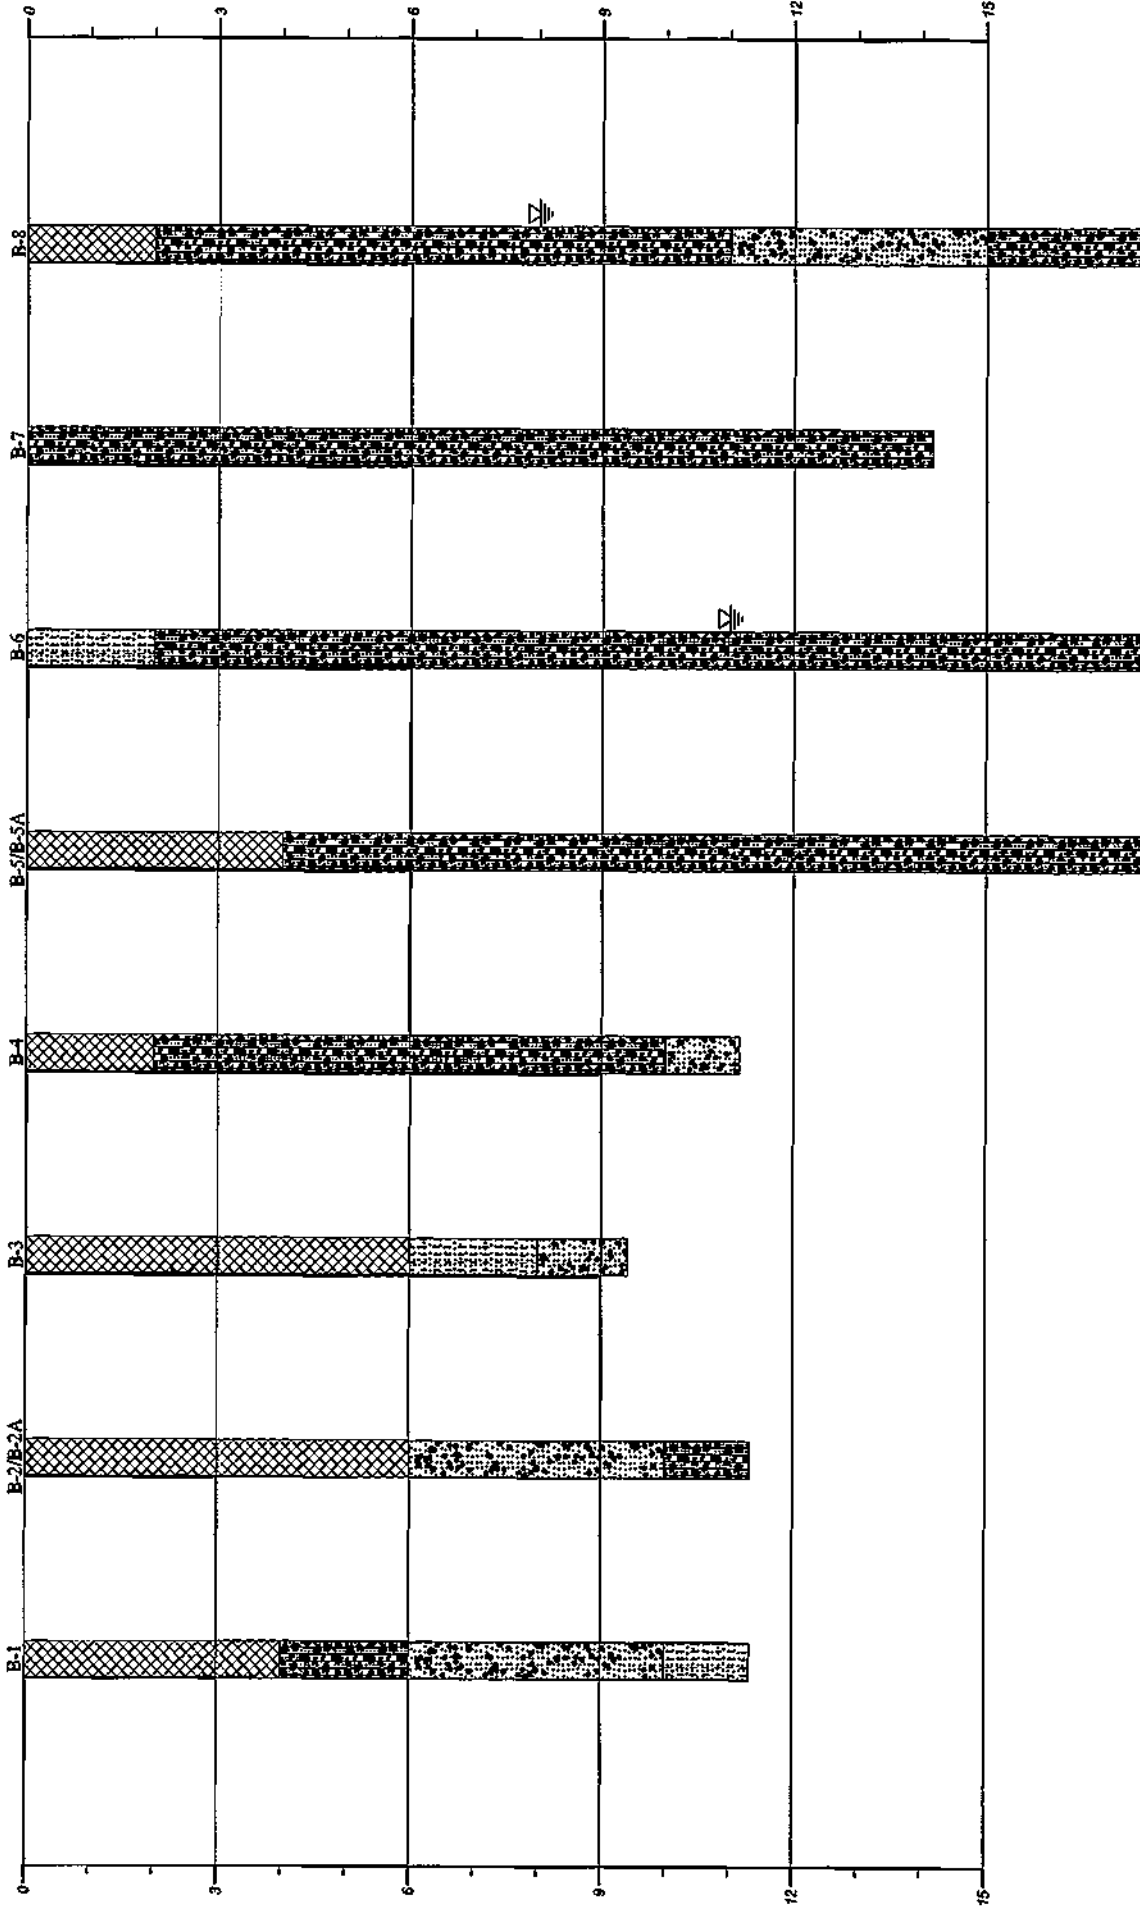

Plan View

Strata symbols

Blank

- Fill
- Silty sand and gravel
- Poorly graded sand and gravel
- Poorly graded sand with silt

ANS CONSULTANTS, INC.
GENERALIZED SOIL PROFILE

HORIZONTAL SCALE: 1"=30'
VERTICAL SCALE: 1"=3'
DRAWN BY/APPROVED BY: PPP
DATE DRAWN: 9/3/2024

Proposed 1-story retail building

PROJECT NO. ANV-6549

FIGURE NUMBER

KEY TO SYMBOLS

Symbol Description

Strata symbols



Fill



Silty sand and gravel



Poorly graded sand
and gravel



Poorly graded sand
with silt



Blank



Misc. Symbols



Water table during
drilling

Notes:

1. Exploratory borings were drilled on 8-19-2024 using a 4-inch diameter continuous flight power auger.
2. No free water was encountered at the time of drilling or when re-checked the following day.
3. Boring locations were taped from existing features and elevations extrapolated from the final design schematic plan.
4. These logs are subject to the limitations, conclusions, and recommendations in this report.
5. Results of tests conducted on samples recovered are reported on the logs.

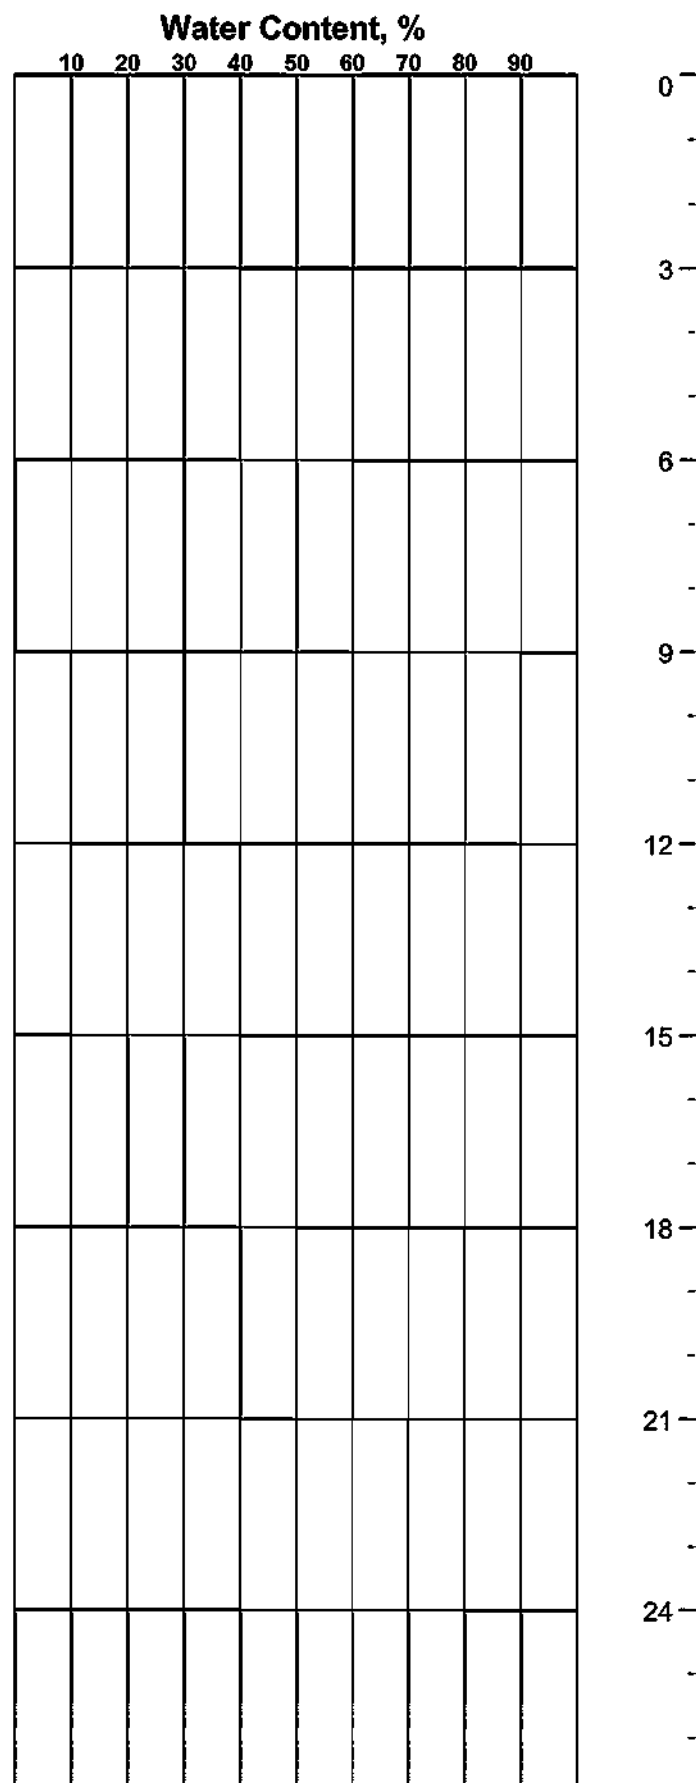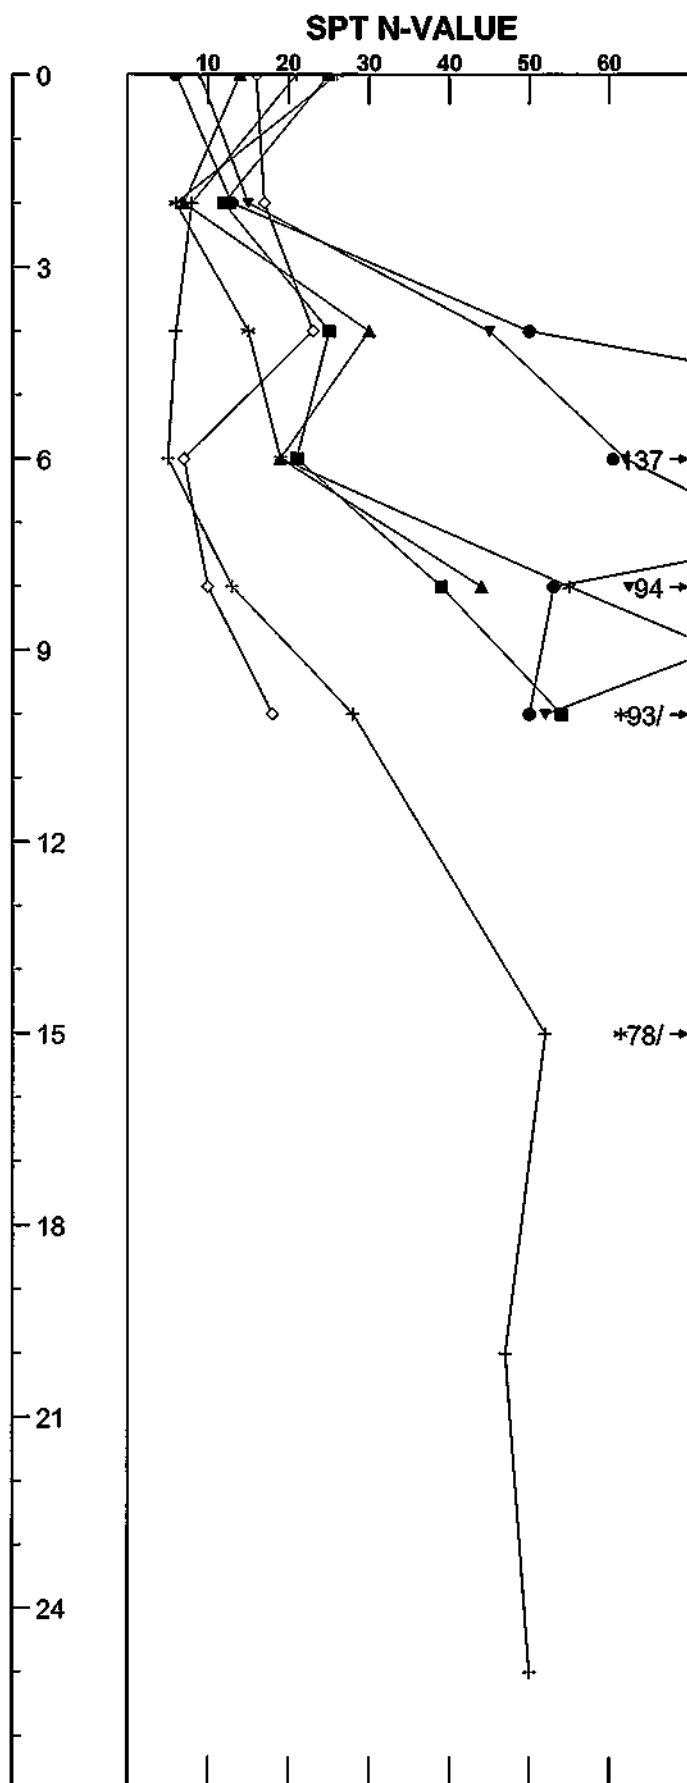

Key to Borings



- B-1 ▲ B-3 * B-5/B-5A ◇ B-7
- B-2/B-2A ▼ B-4 + B-6

ANS CONSULTANTS, INC.

Proposed 1-story retail building

Vertical Scale: 1 to 3

Figure:

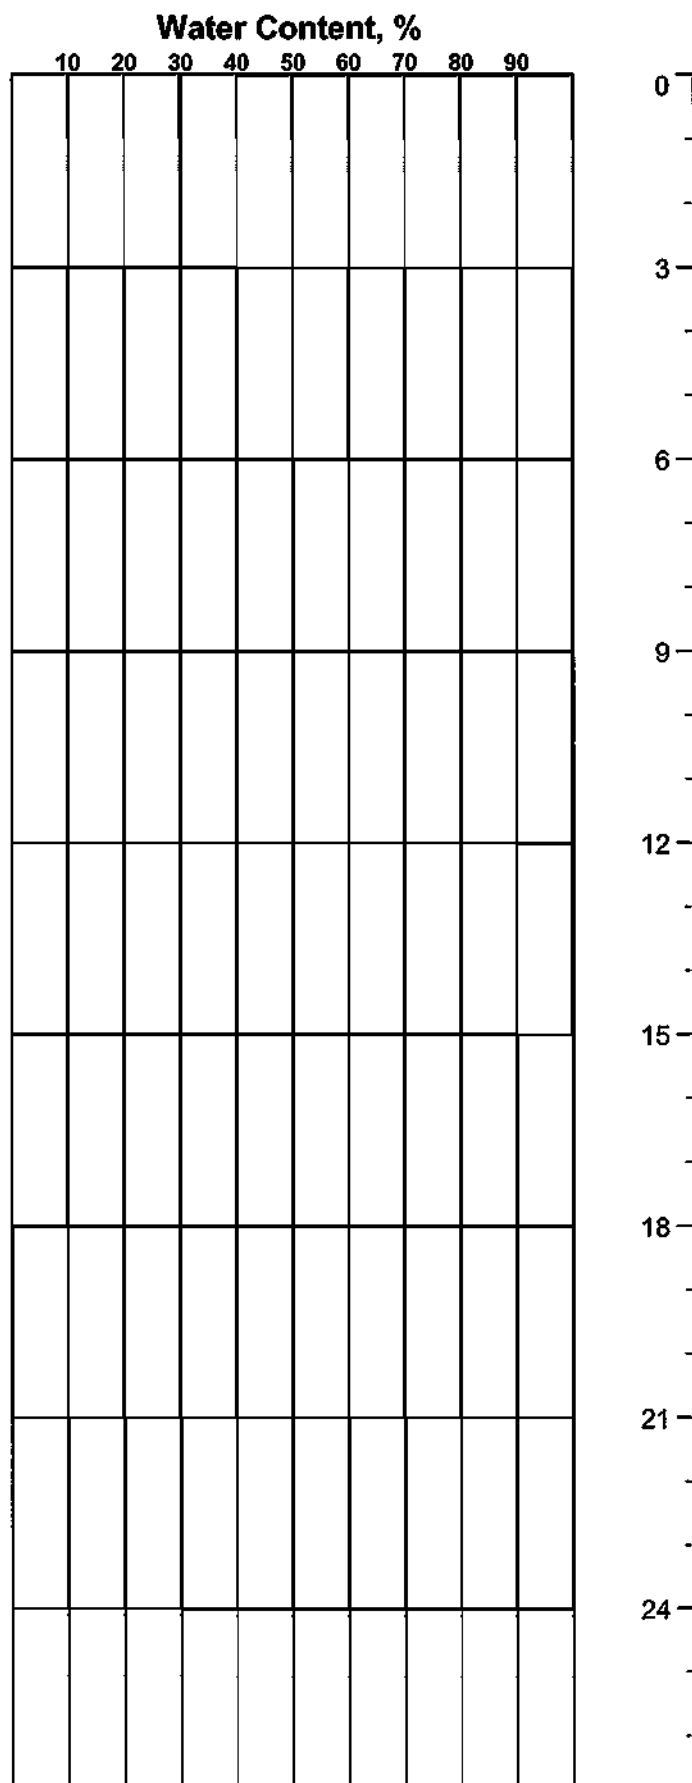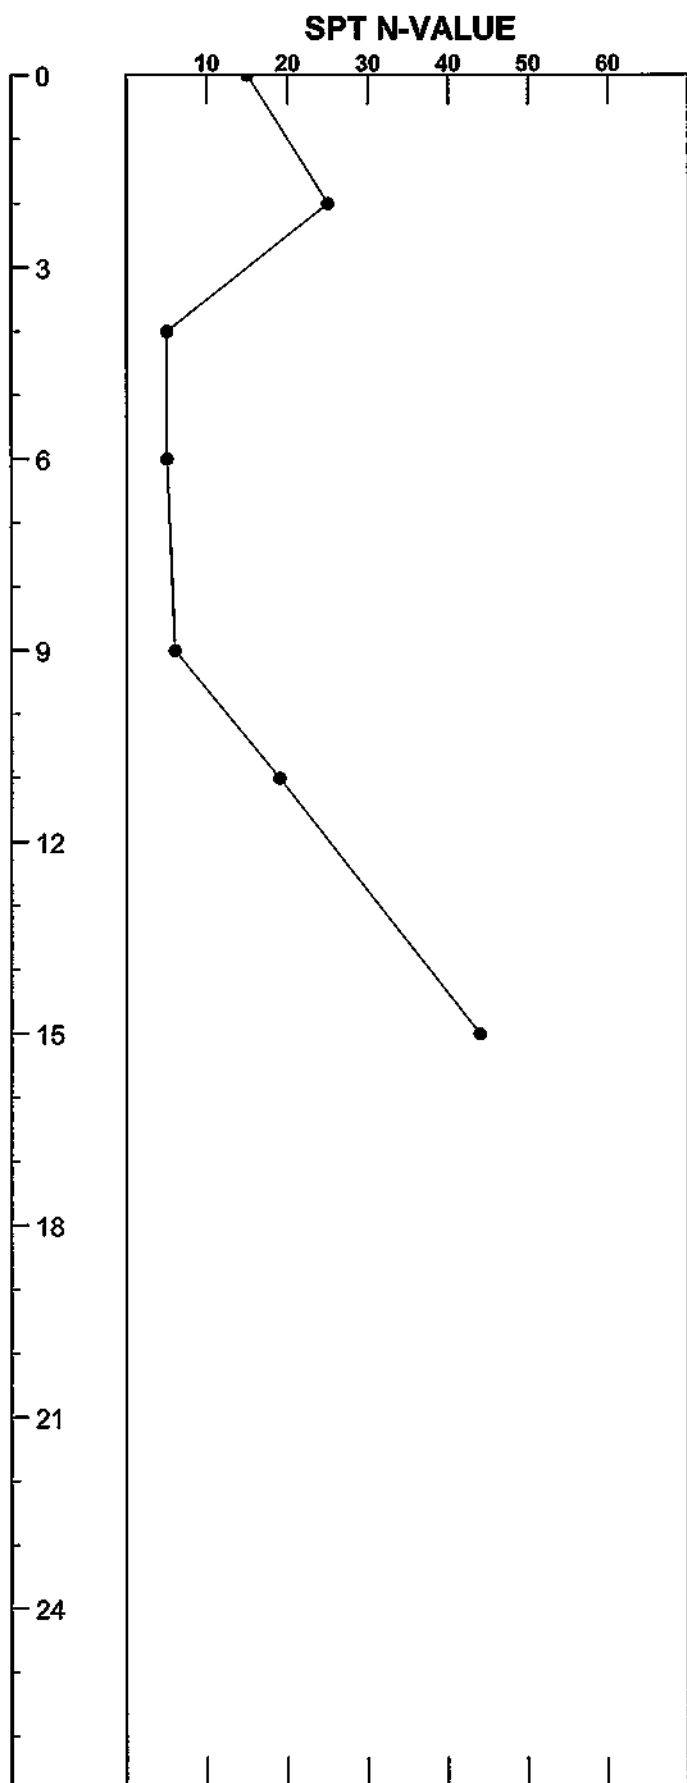

Key to Borings

- B-8

ANS CONSULTANTS, INC.

Proposed 1-story retail building

Vertical Scale: 1 to 3

Figure:



Address:
525 Northfield Ave
West Orange, New Jersey
07052

ASCE Hazards Report

Standard: ASCE/SEI 7-22


Risk Category: II

Soil Class: C - Very Dense
Soil and Soft Rock

Latitude: 40.770448

Longitude: -74.277032

Elevation: 391.14172377309643 ft
(NAVD 88)




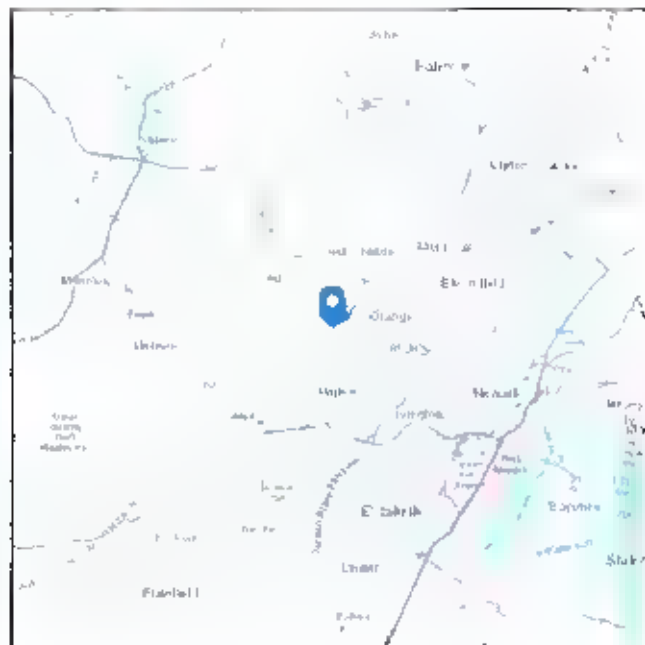


Site Soil Class: C - Very Dense Soil and Soft Rock

Results:

PGA _M	0.17	T _L	6
S _{MS}	0.27	S _S	0.27
S _{M1}	0.064	S ₁	0.05
S _{D5}	0.18	V ₃₃₀	530
S _{D1}	0.043		

Seismic Design Category: B

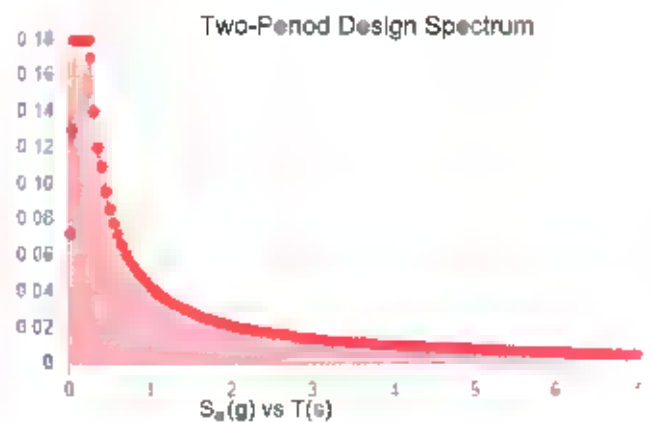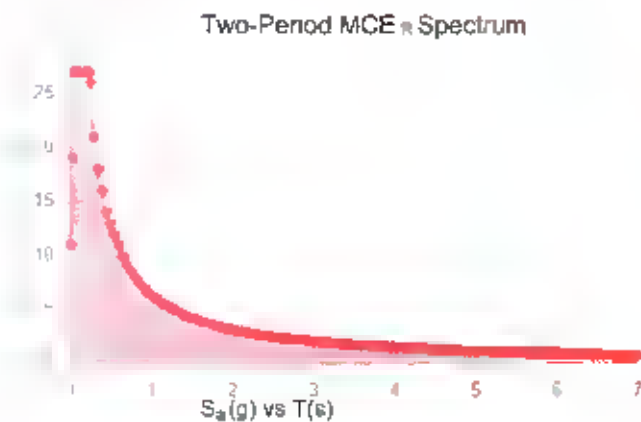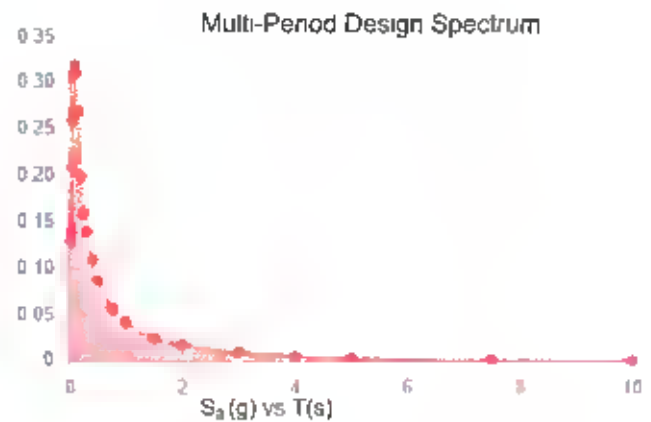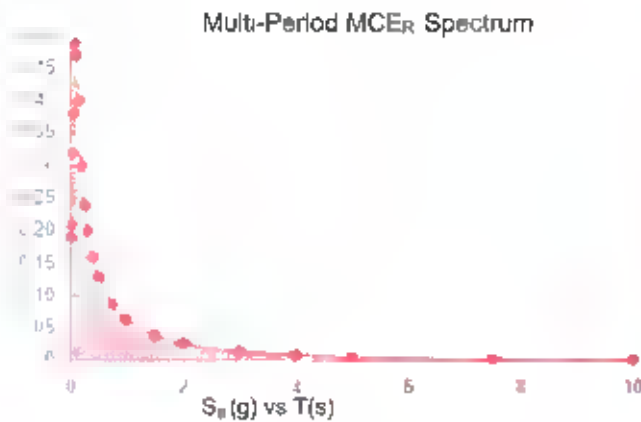

MCE_R Vertical Response Spectrum
Vertical ground motion data has not yet been made available by USGS

Design Vertical Response Spectrum
Vertical ground motion data has not yet been made available by USGS



Data Accessed: Tue Aug 27 2024

Date Source:

USGS Seismic Design Maps based on ASCE/SEI 7-22 and ASCE/SEI 7-22 Table 1.5-2. Additional data for site-specific ground motion procedures in accordance with ASCE/SEI 7-22 Ch. 21 are available from USGS.

The ASCE Hazard Tool is provided for your convenience for informational purposes only and is provided "as is" and without warranties of any kind. The location data included herein has been obtained from information developed, produced and maintained by third party providers or has been extrapolated from maps incorporated in the ASCE standard. While ASCE has made every effort to use data obtained from reliable sources or methodologies, ASCE does not make any representations or warranties as to the accuracy, completeness, reliability, currency, or quality of any data provided herein. Any third-party links provided by this Tool should not be construed as an endorsement, affiliation, relationship, or sponsorship of such third party content by or from ASCE.

ASCE does not intend nor should anyone interpret the results provided by this Tool to replace the sound judgment of a competent professional having knowledge and experience in the appropriate field(s) of practice nor to substitute for the standard of care required of such professionals in interpreting and applying the contents of this Tool or the ASCE standard.

In using this Tool, you expressly assume all risks associated with your use. Under no circumstances shall ASCE or its officers, directors, employees, members, affiliates, or agents be liable to you or any other person for any direct, indirect, special, incidental, or consequential damages arising from or related to your use of, or reliance on, the Tool or any information obtained therein. To the fullest extent permitted by law, you agree to release and hold harmless ASCE from any and all liability of any nature arising out of or resulting from any use of data provided by the ASCE Hazard Tool.


ATC Hazards by Location

Search Information


Address	525 Northfield Ave, West Orange, NJ 07052, USA
Coordinates:	40.7705012, -74.2774591
Elevation	385 ft
Timestamp	2024-08-27T17:48:58.307Z
Hazard Type	Seismic
Reference Document	ASCE 7-16
Risk Category	II
Site Class	C



MCER Horizontal Response Spectrum

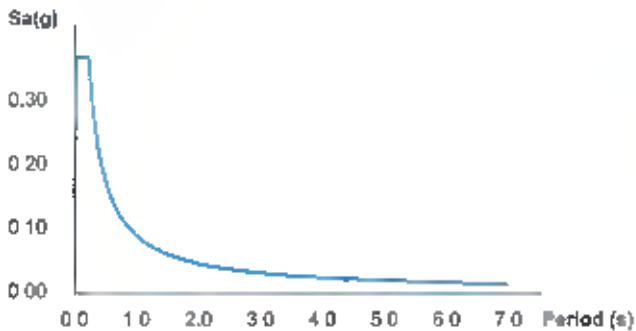

Design Horizontal Response Spectrum

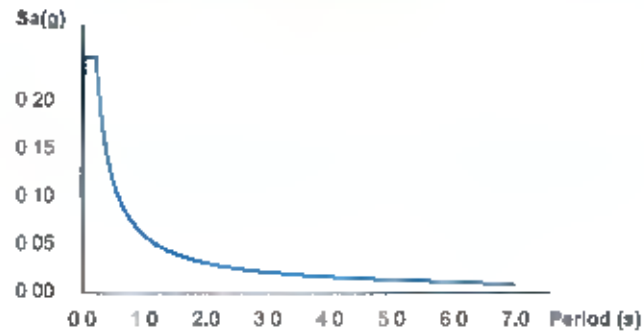

Basic Parameters

Name	Value	Description
S_S	0.262	MCE_R ground motion (period=0.2s)
S_1	0.059	MCE_R ground motion (period=1.0s)
S_{MS}	0.367	Site-modified spectral acceleration value
S_{M1}	0.089	Site-modified spectral acceleration value
S_{DS}	0.245	Numeric seismic design value at 0.2s SA
S_{D1}	0.059	Numeric seismic design value at 1.0s SA

Additional Information

Name	Value	Description
SDC	B	Seismic design category
F_a	1.3	Site amplification factor at 0.2s
F_v	1.5	Site amplification factor at 1.0s
CR_S	0.935	Coefficient of risk (0.2s)
CR_1	0.944	Coefficient of risk (1.0s)
PGA	0.173	MCE_B peak ground acceleration

F_{PGA}	1.227	Site amplification factor at PGA
PGA_M	0.213	Site modified peak ground acceleration
T_L	6	Long-period transition period (s)
$SsRT$	0.282	Probabilistic risk-targeted ground motion (0.2s)
$SsUH$	0.302	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
SsD	1.5	Factored deterministic acceleration value (0.2s)
$S1RT$	0.059	Probabilistic risk-targeted ground motion (1.0s)
$S1UH$	0.063	Factored uniform-hazard spectral acceleration (2% probability of exceedance in 50 years)
$S1D$	0.6	Factored deterministic acceleration value (1.0s)
$PGAd$	0.5	Factored deterministic acceleration value (PGA)

The results indicated here DO NOT reflect any state or local amendments to the values or any delineation lines made during the building code adoption process. Users should confirm any output obtained from this tool with the local Authority Having Jurisdiction before proceeding with design.

Please note that the ATC Hazards by Location website will not be updated to support ASCE 7-22. [Find out why.](#)

Disclaimer

Hazard loads are provided by the U.S. Geological Survey [Seismic Design Web Services](#).

While the information presented on this website is believed to be correct, ATC and its sponsors and contributors assume no responsibility or liability for its accuracy. The material presented in the report should not be used or relied upon for any specific application without competent examination and verification of its accuracy, suitability and applicability by engineers or other licensed professionals. ATC does not intend that the use of this information replace the sound judgment of such competent professionals, having experience and knowledge in the field of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the results of the report provided by this website. Users of the information from this website assume all liability arising from such use. Use of the output of this website does not imply approval by the governing building code bodies responsible for building code approval and interpretation for the building site described by latitude/longitude location in the report.

FIELD SOIL CLASSIFICATION SYSTEM

PARTICLE SIZE IDENTIFICATION

Boulders . . . 8 inch diameter or greater
 Cobbles . . . 3 to 8 inch diameter
 Gravel . . . Coarse - 1 to 3 inch
 Medium -- 1/2 to 1 inch
 Fine -- 4.75 mm to 1/2 inch
 Sand . . . Coarse -- 2.0 mm to 4.75 mm
 (dia. of pencil lead)
 Medium -- 0.425 mm to 2.0 mm
 (dia. of broom straw)
 Fine -- 0.075 mm to 0.425 mm
 (dia. of human hair)
 Silt & Clay . . . Smaller than 0.075 mm

RELATIVE PORTIONS

Descriptive Term	Percent
Trace - tr	1 - 10
Some - sm	11 - 20
Adjective - ly	21 - 35
And - &	36 - 50

ABBREVIATIONS

Bn - Brown	
Gy - Gray	
Blk - Black	
Rd - Red	
Or - Orange	
Bl - Blue	
Lt - Light	Coarse grained - c
Dk - Dark	Medium grained - m
Multi - Multi colored	Fine grained - f

COHESIONLESS SOIL

(Gravel, Sand, Silt and Combinations)

DENSITY

Very Loose	05 blows / ft or less
Loose	06 to 10 blows / ft
Medium Dense	11 to 30 blows / ft
Dense	31 to 50 blows / ft
Very Dense	51 blows / ft or more

COHESIVE SOIL

(Clay, Silt and Combinations)

CONSISTENCY

Very Soft	01 blow / ft or less
Soft	02 to 4 blows / ft
Medium Stiff	05 to 8 blows / ft
Stiff	09 to 15 blows / ft
Very Stiff	16 to 30 blows / ft
Hard	31 blows / ft or greater


ROCK

RQD	Rock Quality
00 - 25	Very Poor
25 - 50% . . .	Poor
50 - 75% . . .	Fair
75 - 90% . . .	Good
90 - 100% . . .	Excellent

HSA - Hollow Stem Auger
 SS- Split Spoon Sampler
 WOR - Weight of Rods
 WOH - Weight of Hammer
 NR - No Recovery of Sample

Appendix-B

Particle Size Distribution Report As per ASTM D 6913

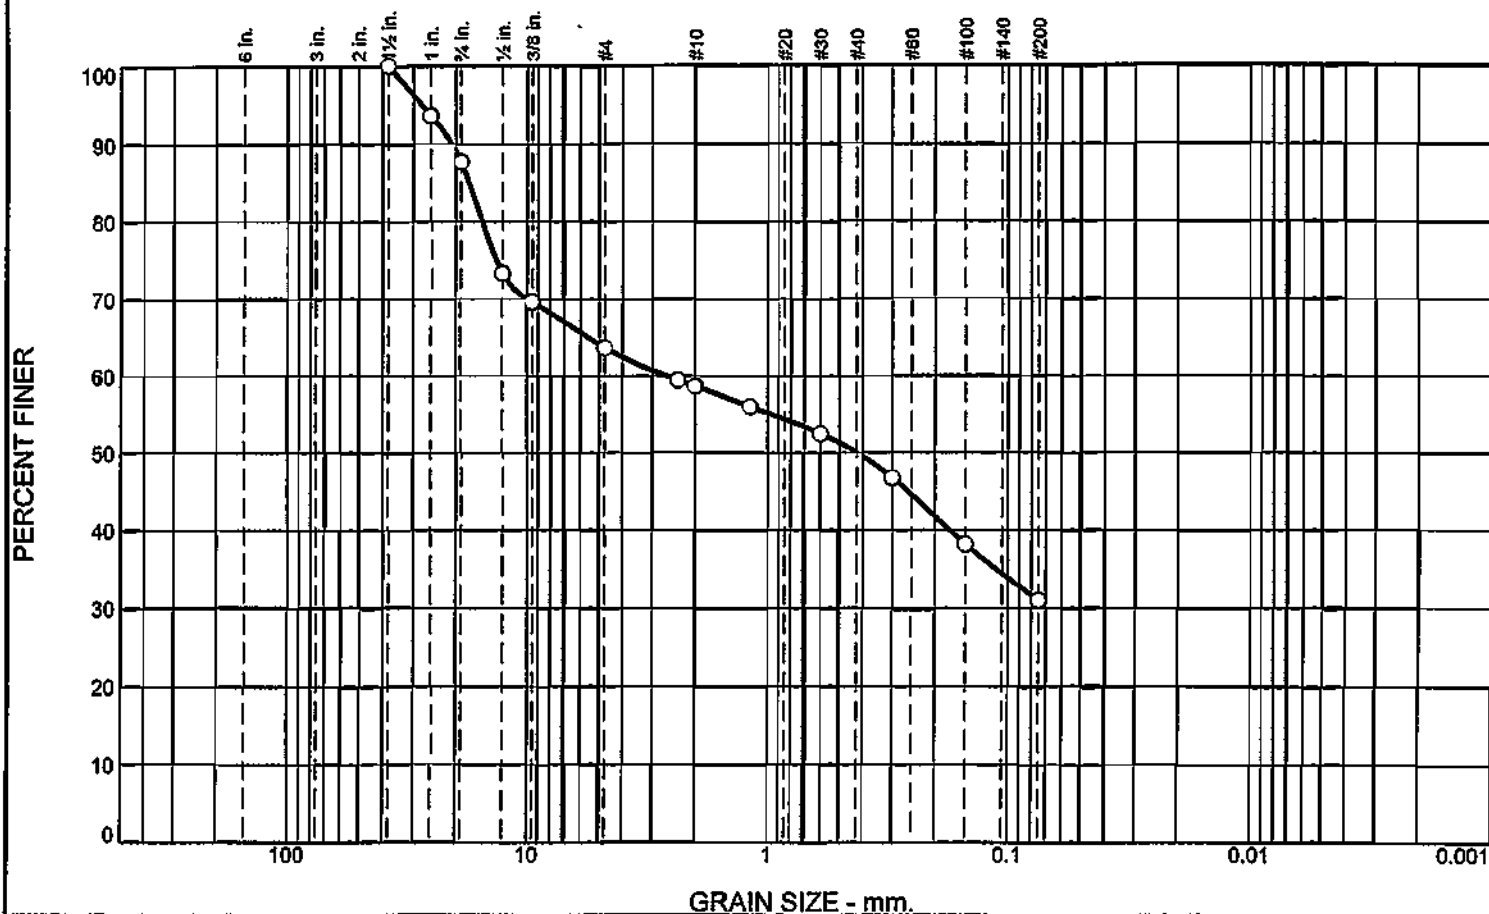

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	12.2	24.1	5.0	8.7	18.9	31.1	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1.5	100.0		
1	93.7		
3/4	87.8		
1/2	73.3		
3/8	69.7		
#4	63.7		
#8	59.5		
#10	58.7		
#16	56.0		
#30	52.5		
#50	46.7		
#100	38.2		
#200	31.1		

* (no specification provided)

Material Description

Brown in color. silty gravel with sand

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 20.7274

D₈₅= 17.5640

D₆₀= 2.6310

D₅₀= 0.4243

D₃₀=

D₁₅=

D₁₀=

C_u=

C_c=

Classification

USCS= GM

AASHTO= A-2-4(0)

Remarks

Sample was collected on 08/21/24 and tested on 08/26/24. In-Situ
%MC=10.9
F.M.=3.26

Location: B-1

Sample Number: S-1

Depth: 2'-4'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 1 F 1

Particle Size Distribution Report As per ASTM D 6913

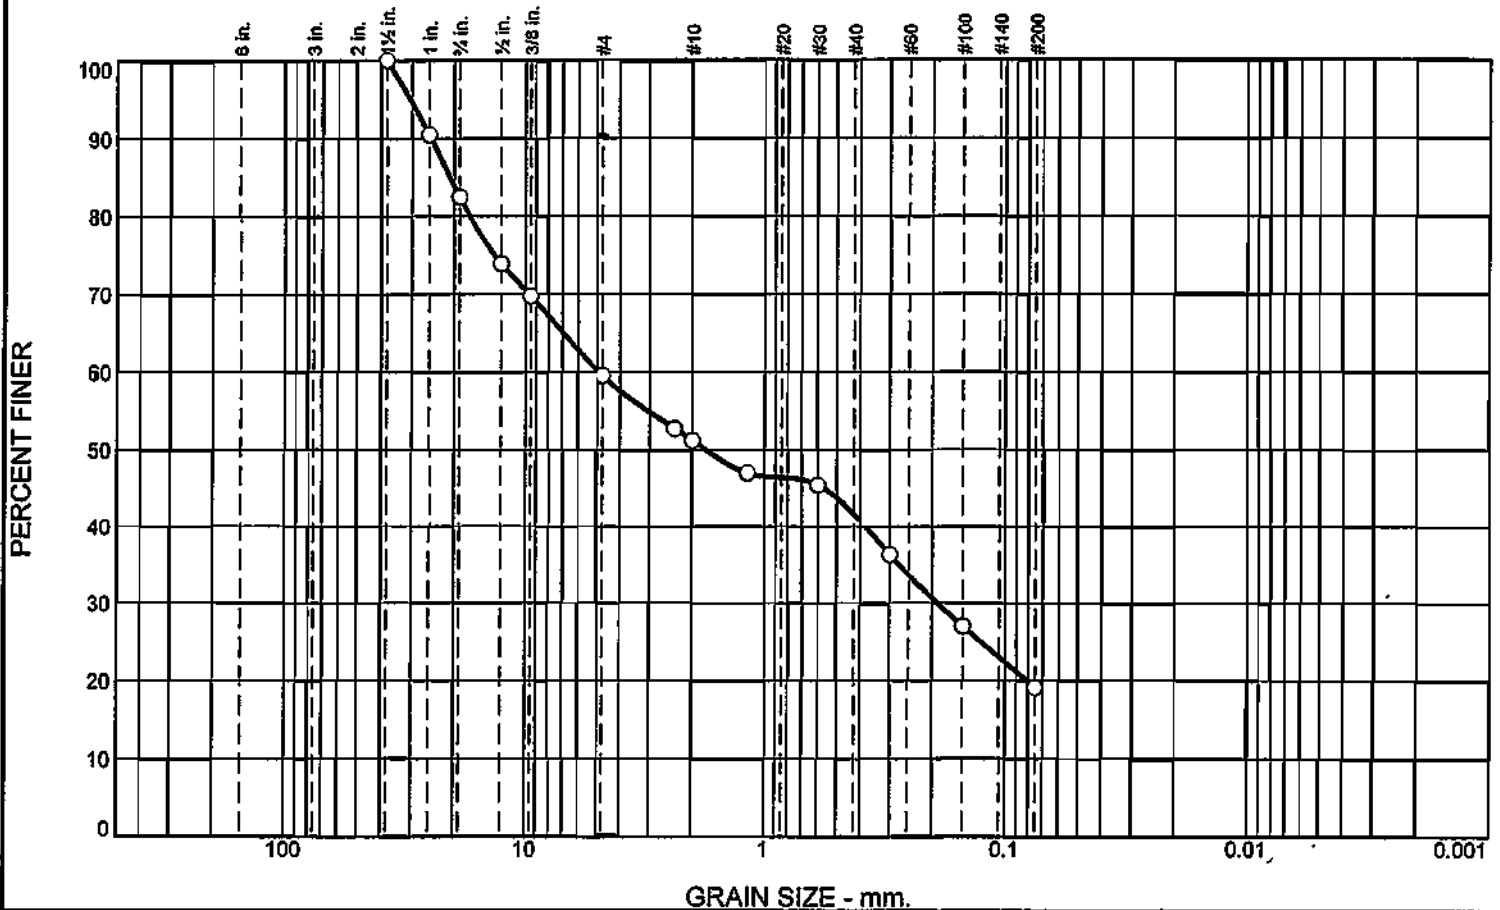

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	17.5	22.9	8.4	9.6	22.5	19.1	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1.5	100.0		
1	90.4		
3/4	82.5		
1/2	73.9		
3/8	69.8		
#4	59.6		
#8	52.7		
#10	51.2		
#16	47.0		
#30	45.4		
#50	36.3		
#100	27.0		
#200	19.1		

* (no specification provided)

Material Description

Dark brown in color, silty sand with gravel

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 25.0083

D₈₅= 20.9050

D₆₀= 4.9198

D₅₀= 1.7641

D₃₀= 0.1912

D₁₅=

D₁₀=

C_u=

C_c=

Classification

USCS= SM

AASHTO= A-1-b

Remarks

Sample was collected on 08/21/24 and tested on 08/26/24. In-Situ
%MC=10.1
F.M.=3.80

Location: B-2A

Sample Number: S-2

Depth: 4'-6'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 2 F 1

Particle Size Distribution Report As per ASTM D 6913

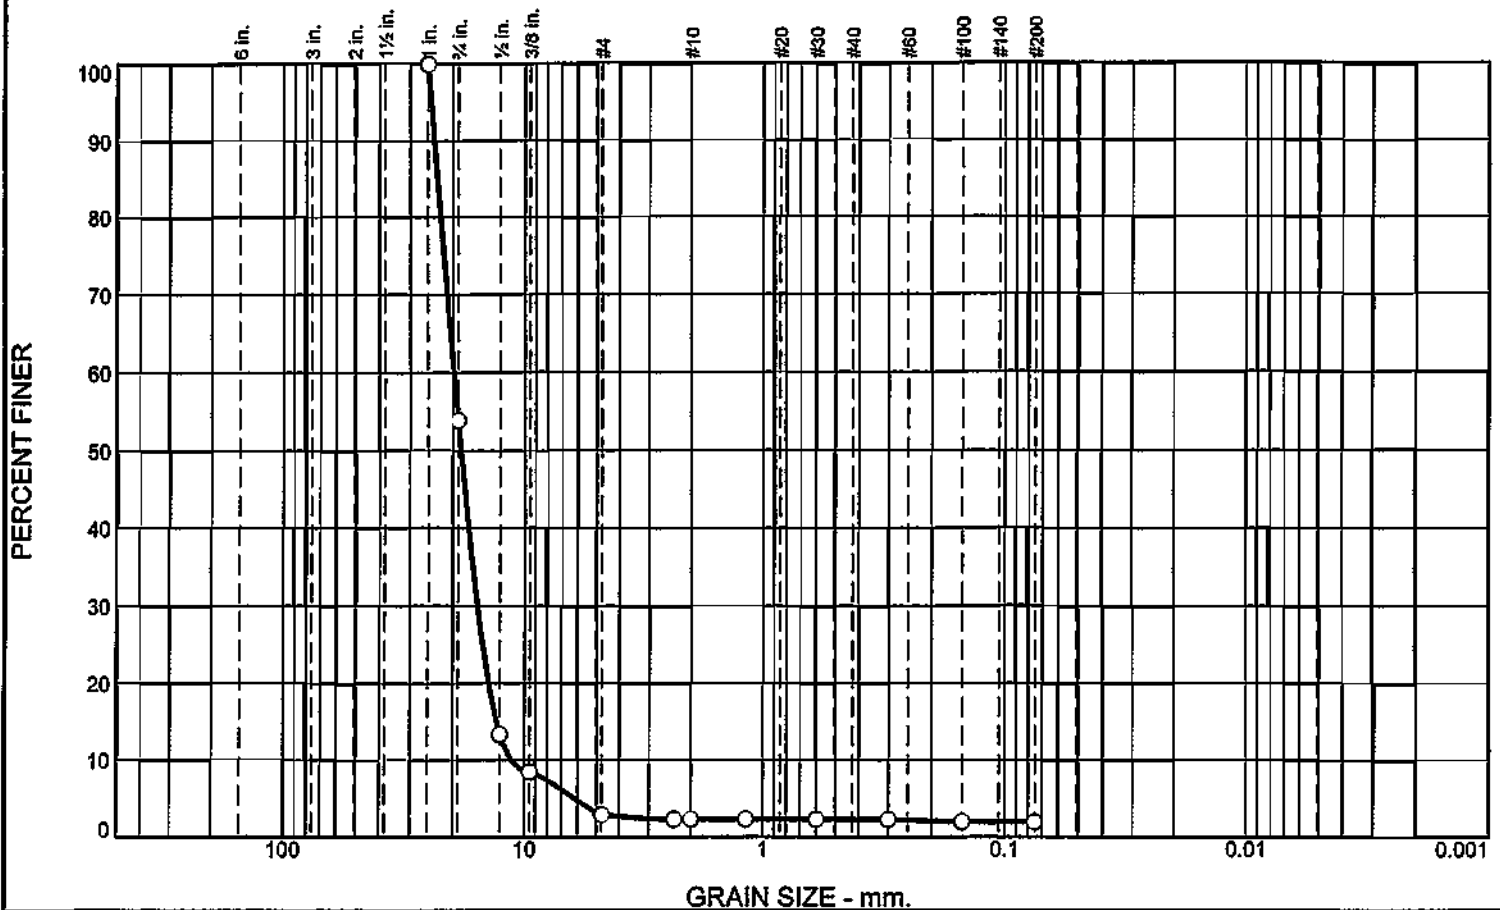

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	46.1	51.0	0.6	0.0	0.4	1.9	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1	100.0		
3/4	53.9		
1/2	13.3		
3/8	8.4		
#4	2.9		
#8	2.3		
#10	2.3		
#16	2.3		
#30	2.3		
#50	2.3		
#100	1.9		
#200	1.9		

* (no specification provided)

Material Description

Grey in color. poorly graded gravel

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 23.9319

D₈₅= 23.2246

D₆₀= 19.8550

D₅₀= 18.5338

D₃₀= 15.7605

D₁₅= 13.1263

D₁₀= 11.4351

C_u= 1.74

C_c= 1.09

Classification

USCS= GP

AASHTO= A-1-a

Remarks

Sample was collected on 08/21/24 and tested on 08/26/24. In-Situ
%MC=5.5
F.M.=7.24

Location: B-3

Sample Number: S-3

Depth: 6'-8'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 3 F 1

Particle Size Distribution Report As per ASTM D 6913

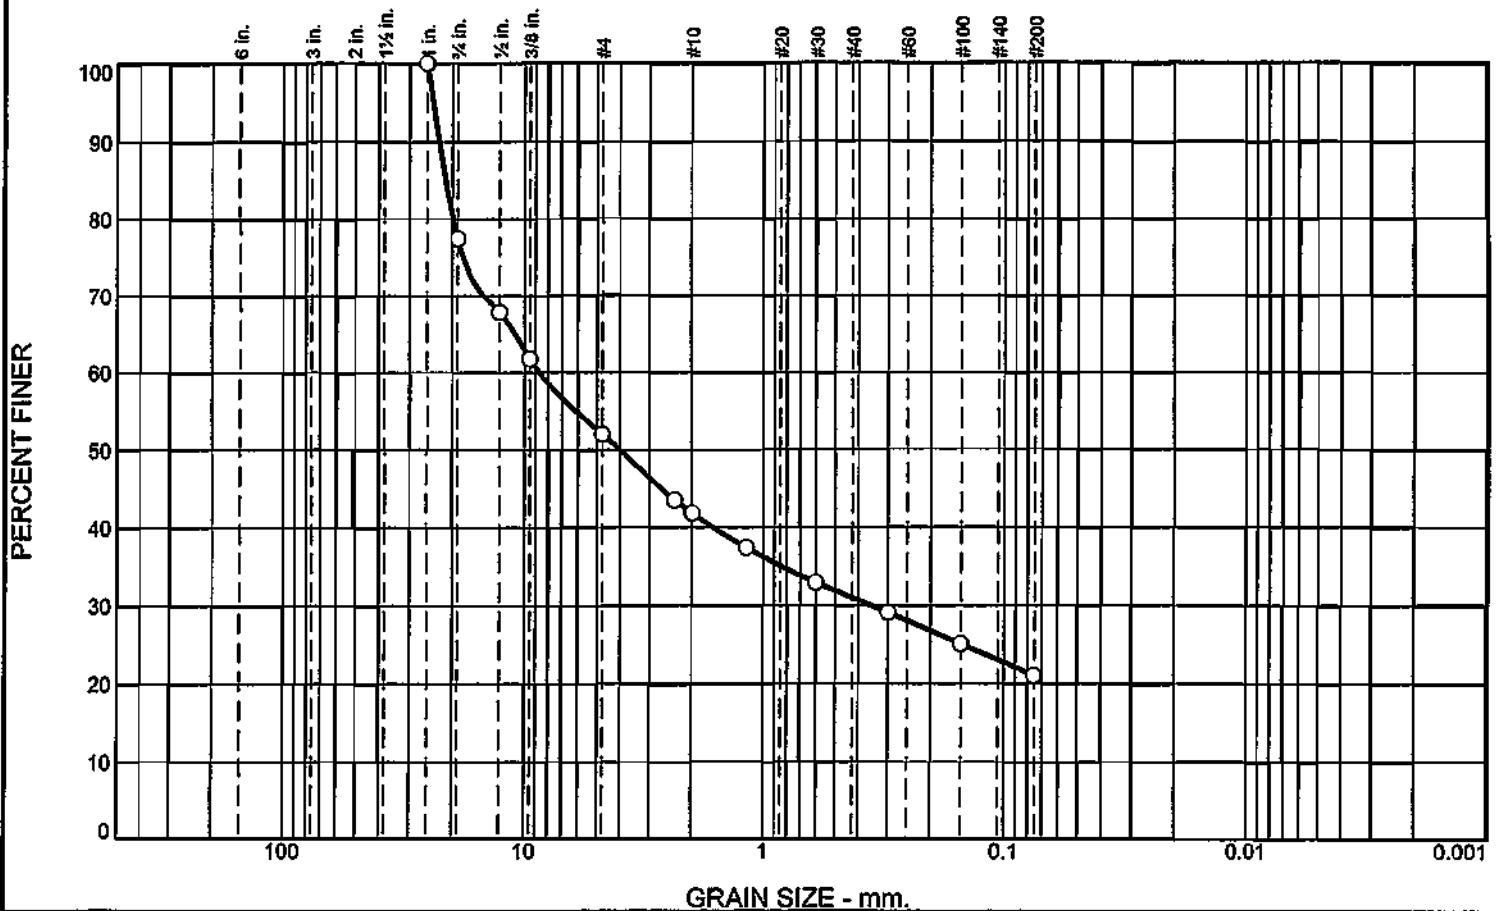

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	22.5	25.5	10.1	10.9	10.0	21.0	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1	100.0		
3/4	77.5		
1/2	67.9		
3/8	61.8		
#4	52.0		
#8	43.5		
#10	41.9		
#16	37.4		
#30	32.9		
#50	29.1		
#100	25.1		
#200	21.0		

* (no specification provided)

Material Description

Brown in color. silty gravel with sand

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 22.6921

D₈₅= 21.3376

D₆₀= 8.7032

D₅₀= 4.0095

D₃₀= 0.3519

D₁₅=

D₁₀=

C_u=

C_c=

Classification

USCS= GM

AASHTO= A-1-b

Remarks

Sample was collected on 08/20/24 and tested on 08/26/24 In-Situ
 %MC=8.2
 F.M.=4.41

Location: B-4

Sample Number: S-4

Depth: 8'-10'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 4 F 1

Particle Size Distribution Report As per ASTM D 6913

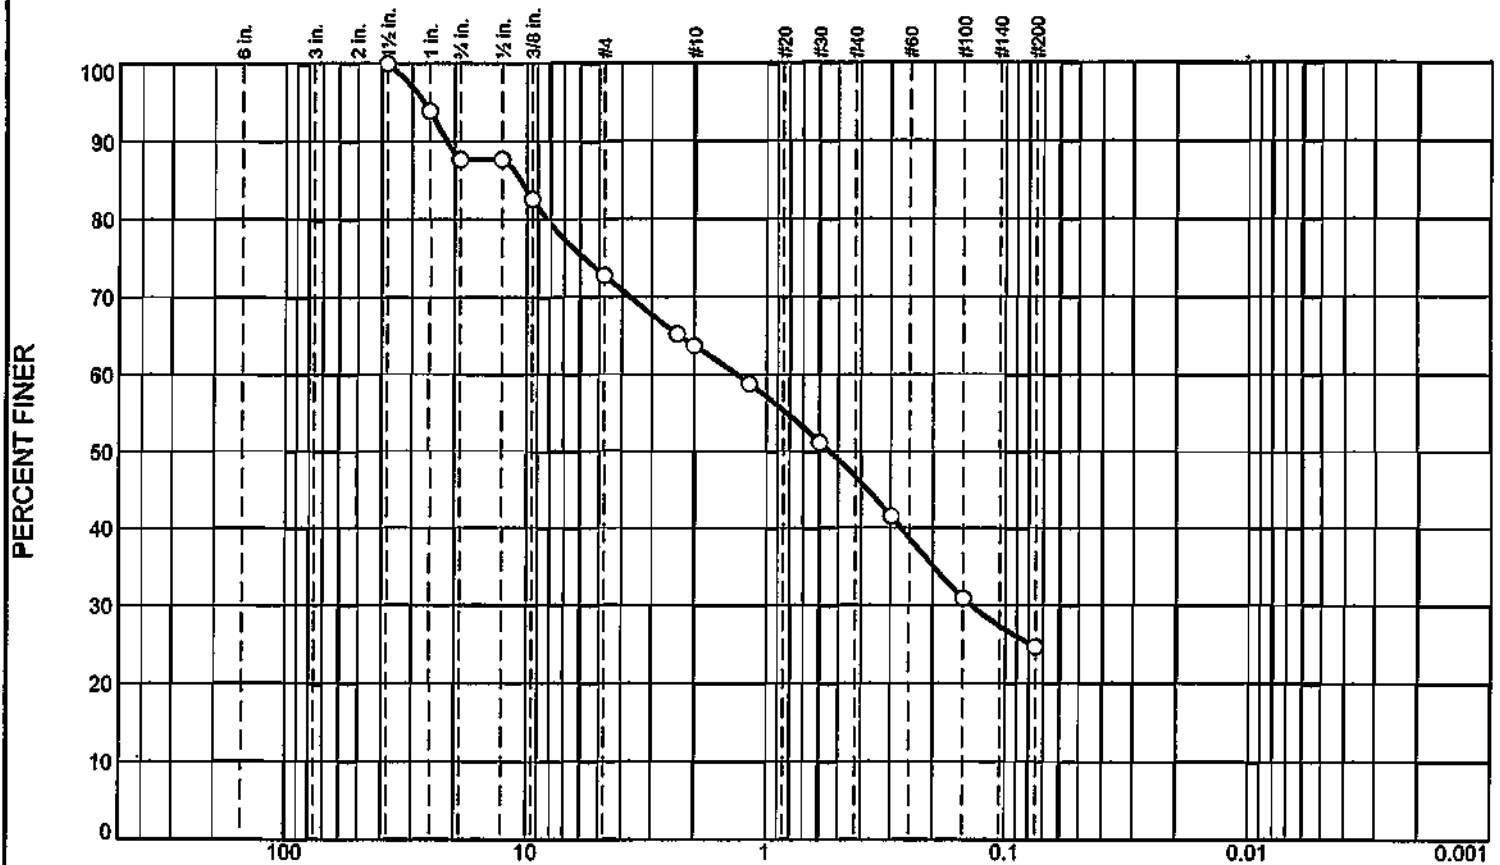

GRAIN SIZE - mm.

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	12.3	14.9	9.1	17.0	22.0	24.7	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1.5	100.0		
1	93.9		
3/4	87.7		
1/2	87.7		
3/8	82.6		
#4	72.8		
#8	65.2		
#10	63.7		
#16	58.8		
#30	51.2		
#50	41.6		
#100	30.9		
#200	24.7		

* (no specification provided)

Material Description

brown in color. silty sand with gravel

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 21.6696

D₈₅= 10.6461

D₆₀= 1.3349

D₅₀= 0.5441

D₃₀= 0.1389

D₁₅=

D₁₀=

C_u=

C_c=

Classification

USCS= SM

AASHTO= A-1-b

Remarks

Sample was collected on 08/20/24 and tested on 08/26/24. In-Situ
%MC=5.8
F.M.=3.09

Location: B-5A

Sample Number: S-5

Depth: 10'-12'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 5 F 1

Particle Size Distribution Report As per ASTM D 6913

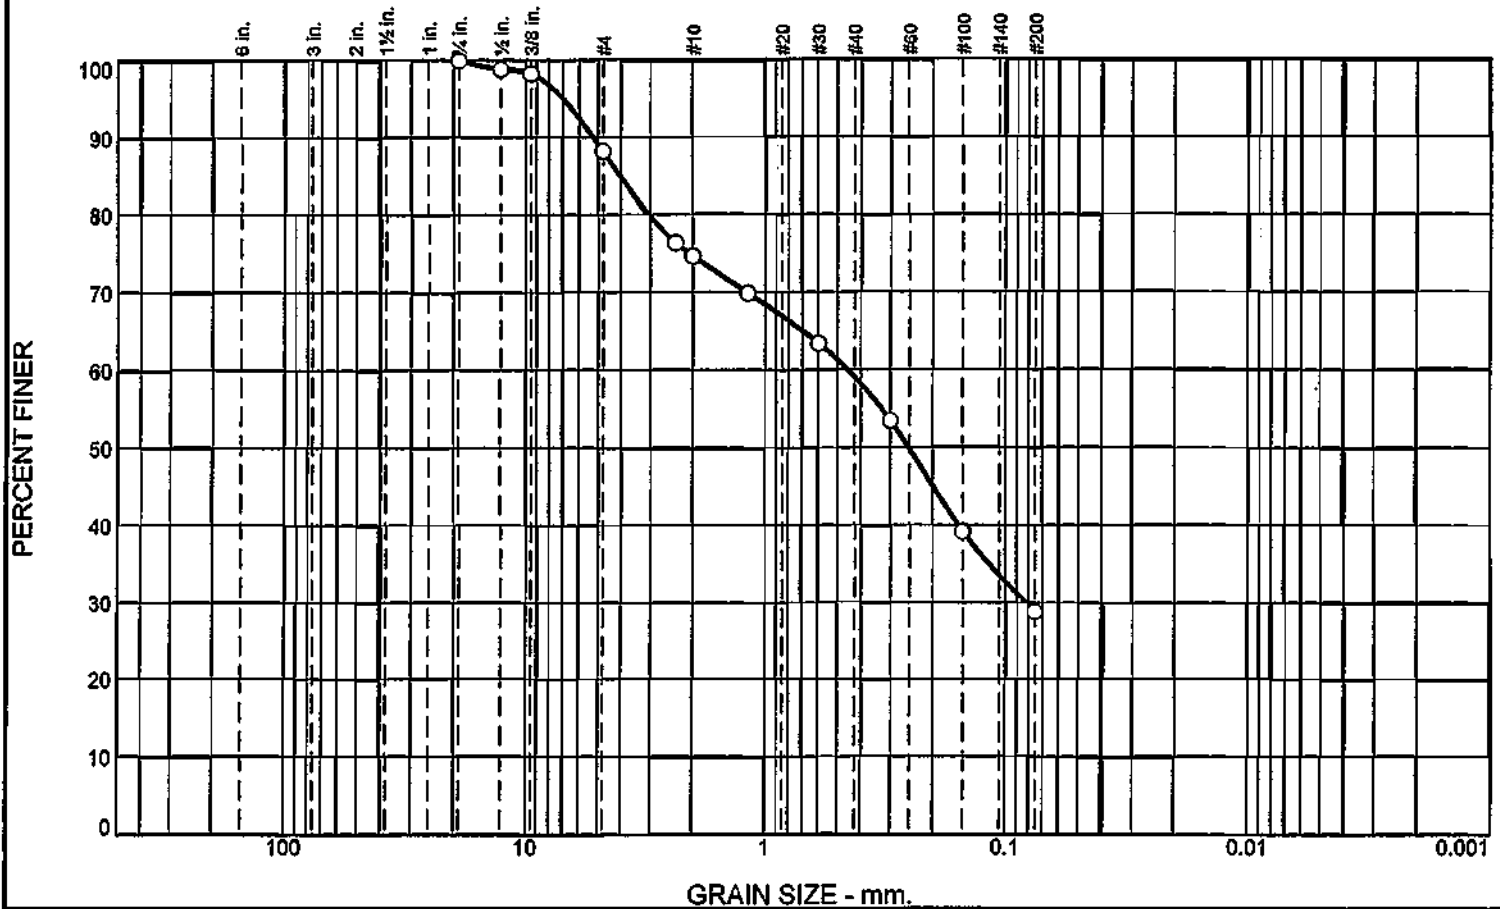

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	0.0	11.9	13.5	15.5	30.3	28.8	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
3/4	100.0		
1/2	98.8		
3/8	98.2		
#4	88.1		
#8	76.3		
#10	74.6		
#16	69.8		
#30	63.4		
#50	53.4		
#100	39.2		
#200	28.8		

* (no specification provided)

<u>Material Description</u>		
Brown in color. silty sand		
<u>Atterberg Limits</u>		
PL= NP	LL= NV	PI= NP
<u>Coefficients</u>		
D ₉₀ = 5.2325	D ₈₅ = 4.0345	D ₆₀ = 0.4539
D ₅₀ = 0.2524	D ₃₀ = 0.0820	D ₁₅ =
D ₁₀ =	C _u =	C _c =
<u>Classification</u>		
USCS= SM	AASHTO= A-2-4(0)	
<u>Remarks</u>		
Sample was collected on 08/20/24 and tested on 08/26/24. In-Situ %MC=13.3 F.M.=2.11		

Location: B-6
Sample Number: S-6 Depth: 15'-17'

Date: 08/26/2024

ANS CONSULTANTS, INC.

Client: Gomes Management


Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

South Plainfield, New Jersey

Project No: ANV-6549

Figure 6 F 1

Particle Size Distribution Report As per ASTM D 6913

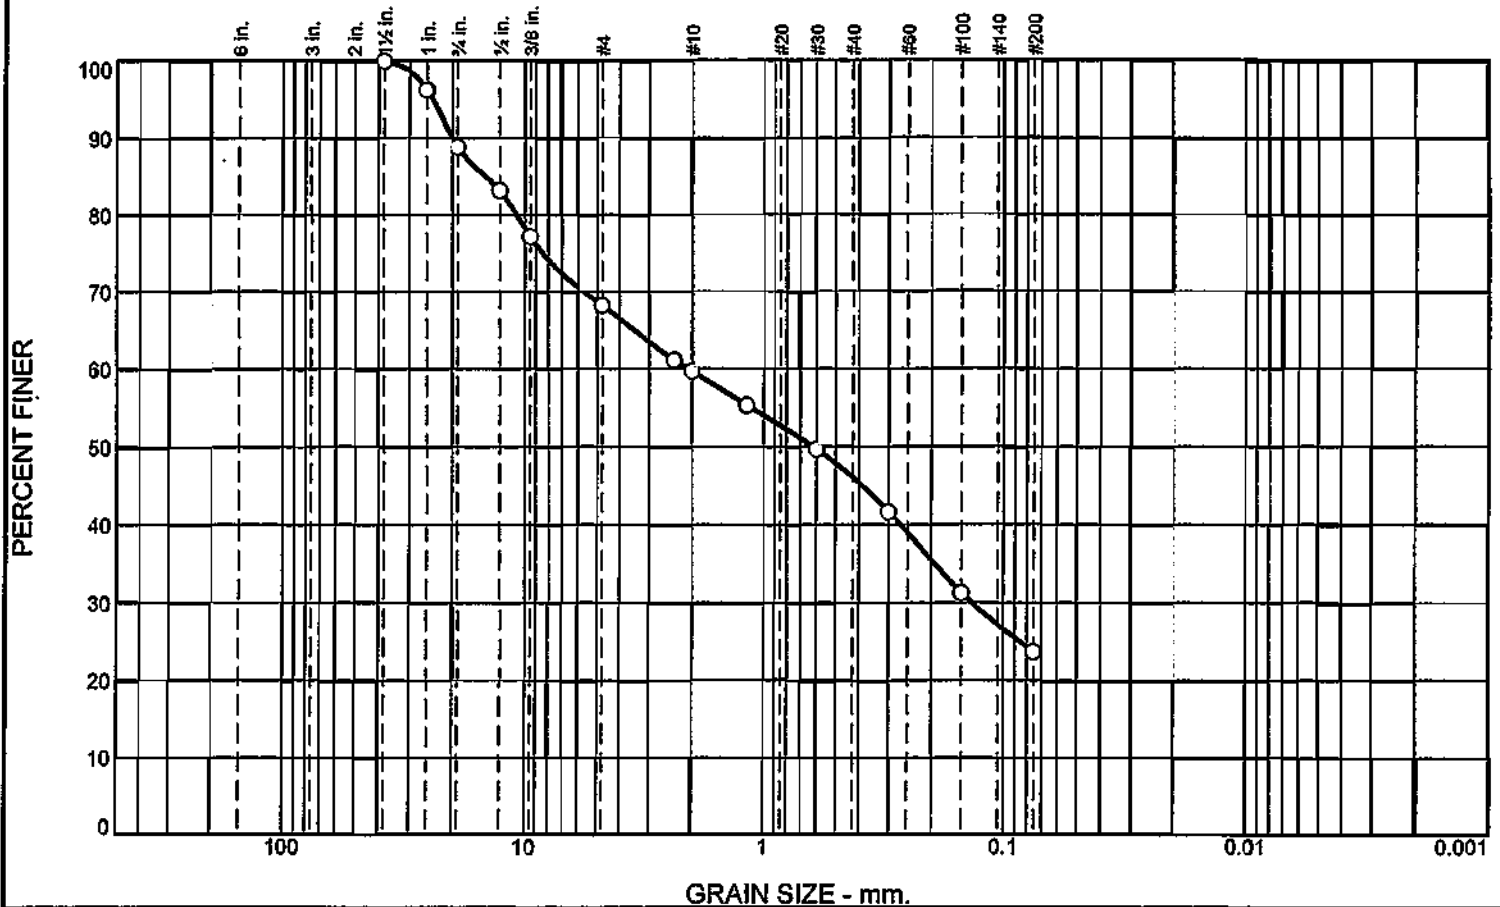

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	11.2	20.6	8.5	13.6	22.4	23.7	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1.5	100.0		
1	96.3		
3/4	88.8		
1/2	83.2		
3/8	77.2		
#4	68.2		
#8	61.1		
#10	59.7		
#16	55.3		
#30	49.7		
#50	41.6		
#100	31.3		
#200	23.7		

* (no specification provided)

<u>Material Description</u>		
Brown in color. silty sand with gravel		
<u>Atterberg Limits</u>		
PL= NP	LL= NV	PI= NP
<u>Coefficients</u>		
D ₉₀ = 20.0068	D ₈₅ = 14.5408	D ₆₀ = 2.0845
D ₅₀ = 0.6227	D ₃₀ = 0.1357	D ₁₅ =
D ₁₀ =	C _u =	C _c =
<u>Classification</u>		
USCS= SM	AASHTO= A-1-b	
<u>Remarks</u>		
Sample was collected on 08/19/24 and tested on 08/26/24. In-Situ %MC=7.5 F.M.=3.27		

Location: B-7

Sample Number: S-7

Depth: 4'-6'

Date: 08/26/2024

ANS CONSULTANTS, INC.

South Plainfield, New Jersey


Client: Gomes Management

Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

Project No: ANV-6549

Figure 7 F 1

Particle Size Distribution Report As per ASTM D 6913

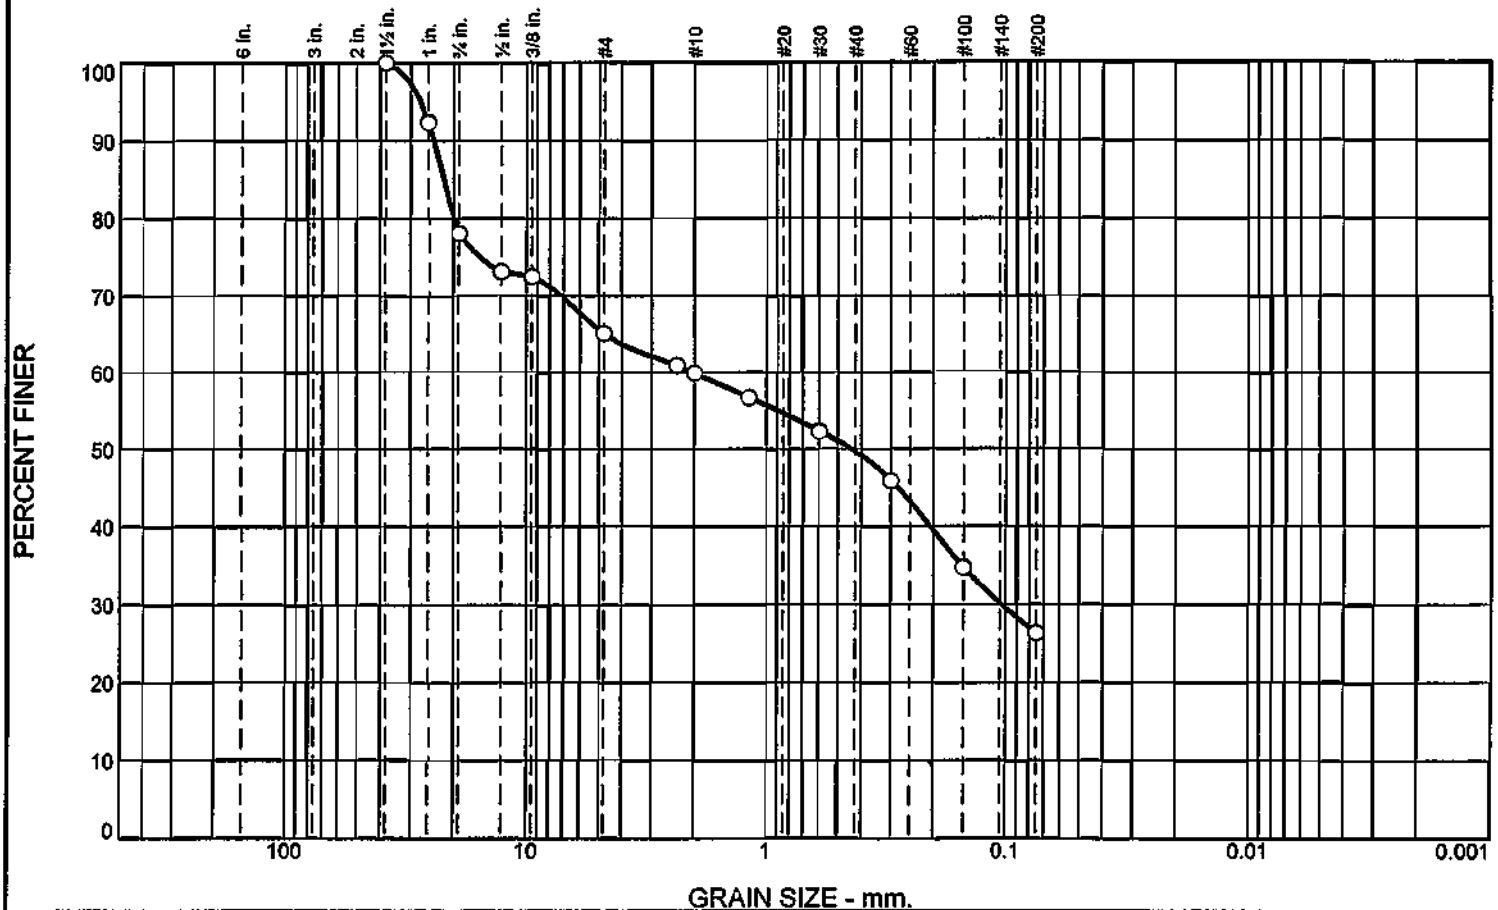

% +3"	% Gravel		% Sand			% Fines	
	Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
0.0	21.9	13.0	5.2	10.2	23.4	26.3	

SIEVE SIZE	PERCENT FINER	SPEC.* PERCENT	PASS? (X=NO)
1.5	100.0		
1	92.4		
3/4	78.1		
1/2	73.1		
3/8	72.5		
#4	65.1		
#8	60.9		
#10	59.9		
#16	56.7		
#30	52.3		
#50	45.9		
#100	34.8		
#200	26.3		

* (no specification provided)

Material Description

Brown in color. silty sand with gravel

Atterberg Limits

PL= NP

LL= NV

PI= NP

Coefficients

D₉₀= 24.1282

D₈₅= 21.9511

D₆₀= 2.0305

D₅₀= 0.4411

D₃₀= 0.1044

D₁₅=

D₁₀=

C_u=

C_c=

Classification

USCS= SM

AASHTO= A-2-4(0)

Remarks

Sample was collected on 08/19/24 and tested on 08/26/24. In-Situ
 %MC=14.2
 F.M.=3.34

Location: B-8

Sample Number: S-8

Depth: 6'-8'

Date: 08/26/2024

ANS CONSULTANTS, INC.

South Plainfield, New Jersey

Client: Gomes Management

Project: 625 Northfield Avenue, West Orange, NJ Block 159.04, Lot # 1.01, 1.02 & 1.03

Project No: ANV-6549

Figure 8 F 1

Appendix-C

Project: 525 Northfield Avenue, West Orange, NJ



Sample procurement using split spoon samplers and augurs



Sample recovery from split spoon samplers



CONSULTANTS INC.
4405 South Clinton Avenue
South Plainfield, NJ 07080

Client: Gomes Management

Project: 525 Northfield Avenue, West Orange, NJ



Sample procurement using split spoon samplers and augurs



Sample recovery from split spoon samplers



Sample procurement using split spoon samplers and augurs



Sample recovery from split spoon samplers



CONSULTANTS, INC.
4405 South Clinton Avenue
South Plainfield, NJ 07080

Client: Gomes Management

Project: 525 Northfield Avenue, West Orange, NJ



Sample procurement using split spoon samplers and augurs



Sample recovery from split spoon samplers

APPENDIX F

DRAINAGE AREA MAPS



Jarmel Kizel
ARCHITECTS AND ENGINEERS INC.

42 OKNER PARKWAY
LIVINGSTON, NEW JERSEY 07039
TEL: 973-994-9669
FAX: 973-994-4069

www.jarmelkizel.com

Architecture
Engineering
Interior Design
Implementation Services

NY State Board Of Architects Authorization No. 214000016100
NJ State Board Of Engineers & Land Surveyors Authorization No. 240429533000

ISSUE

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

PROGRESS DRAWINGS
NOT FOR CONSTRUCTION

REVISION

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

PRINCIPALS

MATTHEW B. JARMEL, AIA, MBA
RICHARD A. JARMEL, PE
IRWIN H. KIZEL, AIA, PP
ARCHITECTS & ENGINEERS
BEATRIZ BARBERIS, RA
JEREMY D. BRYER, AIA
ANDRZEJ B. BRODZOWSKI, PE
RICHARD CHEN, PE
SHANNON CROWDER, PE
THOMAS DAFINIECA, PE
ANDRZEJ E. DUBI, PE
ANTHONY FACCHINO, PE, PLS, PP
GERARDO F. GERMANO, PE
JONATHAN KUYVERA, AIA
KAROLINA PODKONCZAK, AIA
RENATA MALDONADO REZENDE, AIA, LEED AP
CHRISTY SCHWENKE, AIA
STEVEN J. VAZ, PE

Project:
525 NORTHFIELD AVENUE
PRELIMINARY / FINAL SITE PLAN
TOWNSHIP OF WEST ORANGE
ESSEX COUNTY, NEW JERSEY
TAX MAP #94, BLOCK 159.04 LOT 1.01

Scale:
1" = 20'

Project Number:
GOMESGR24-223

Drawn By:
AF

Approved By:
AF

Drawing Name:
EXISTING
DRAINAGE AREA
MAP


Drawing Number:
DA-1

1 OF 3

Initial Date: OCTOBER 22, 2025

ENGINEER OF RECORD

ANTHONY FACCHINO, PE, PLS
NJ Lic. 2408025300

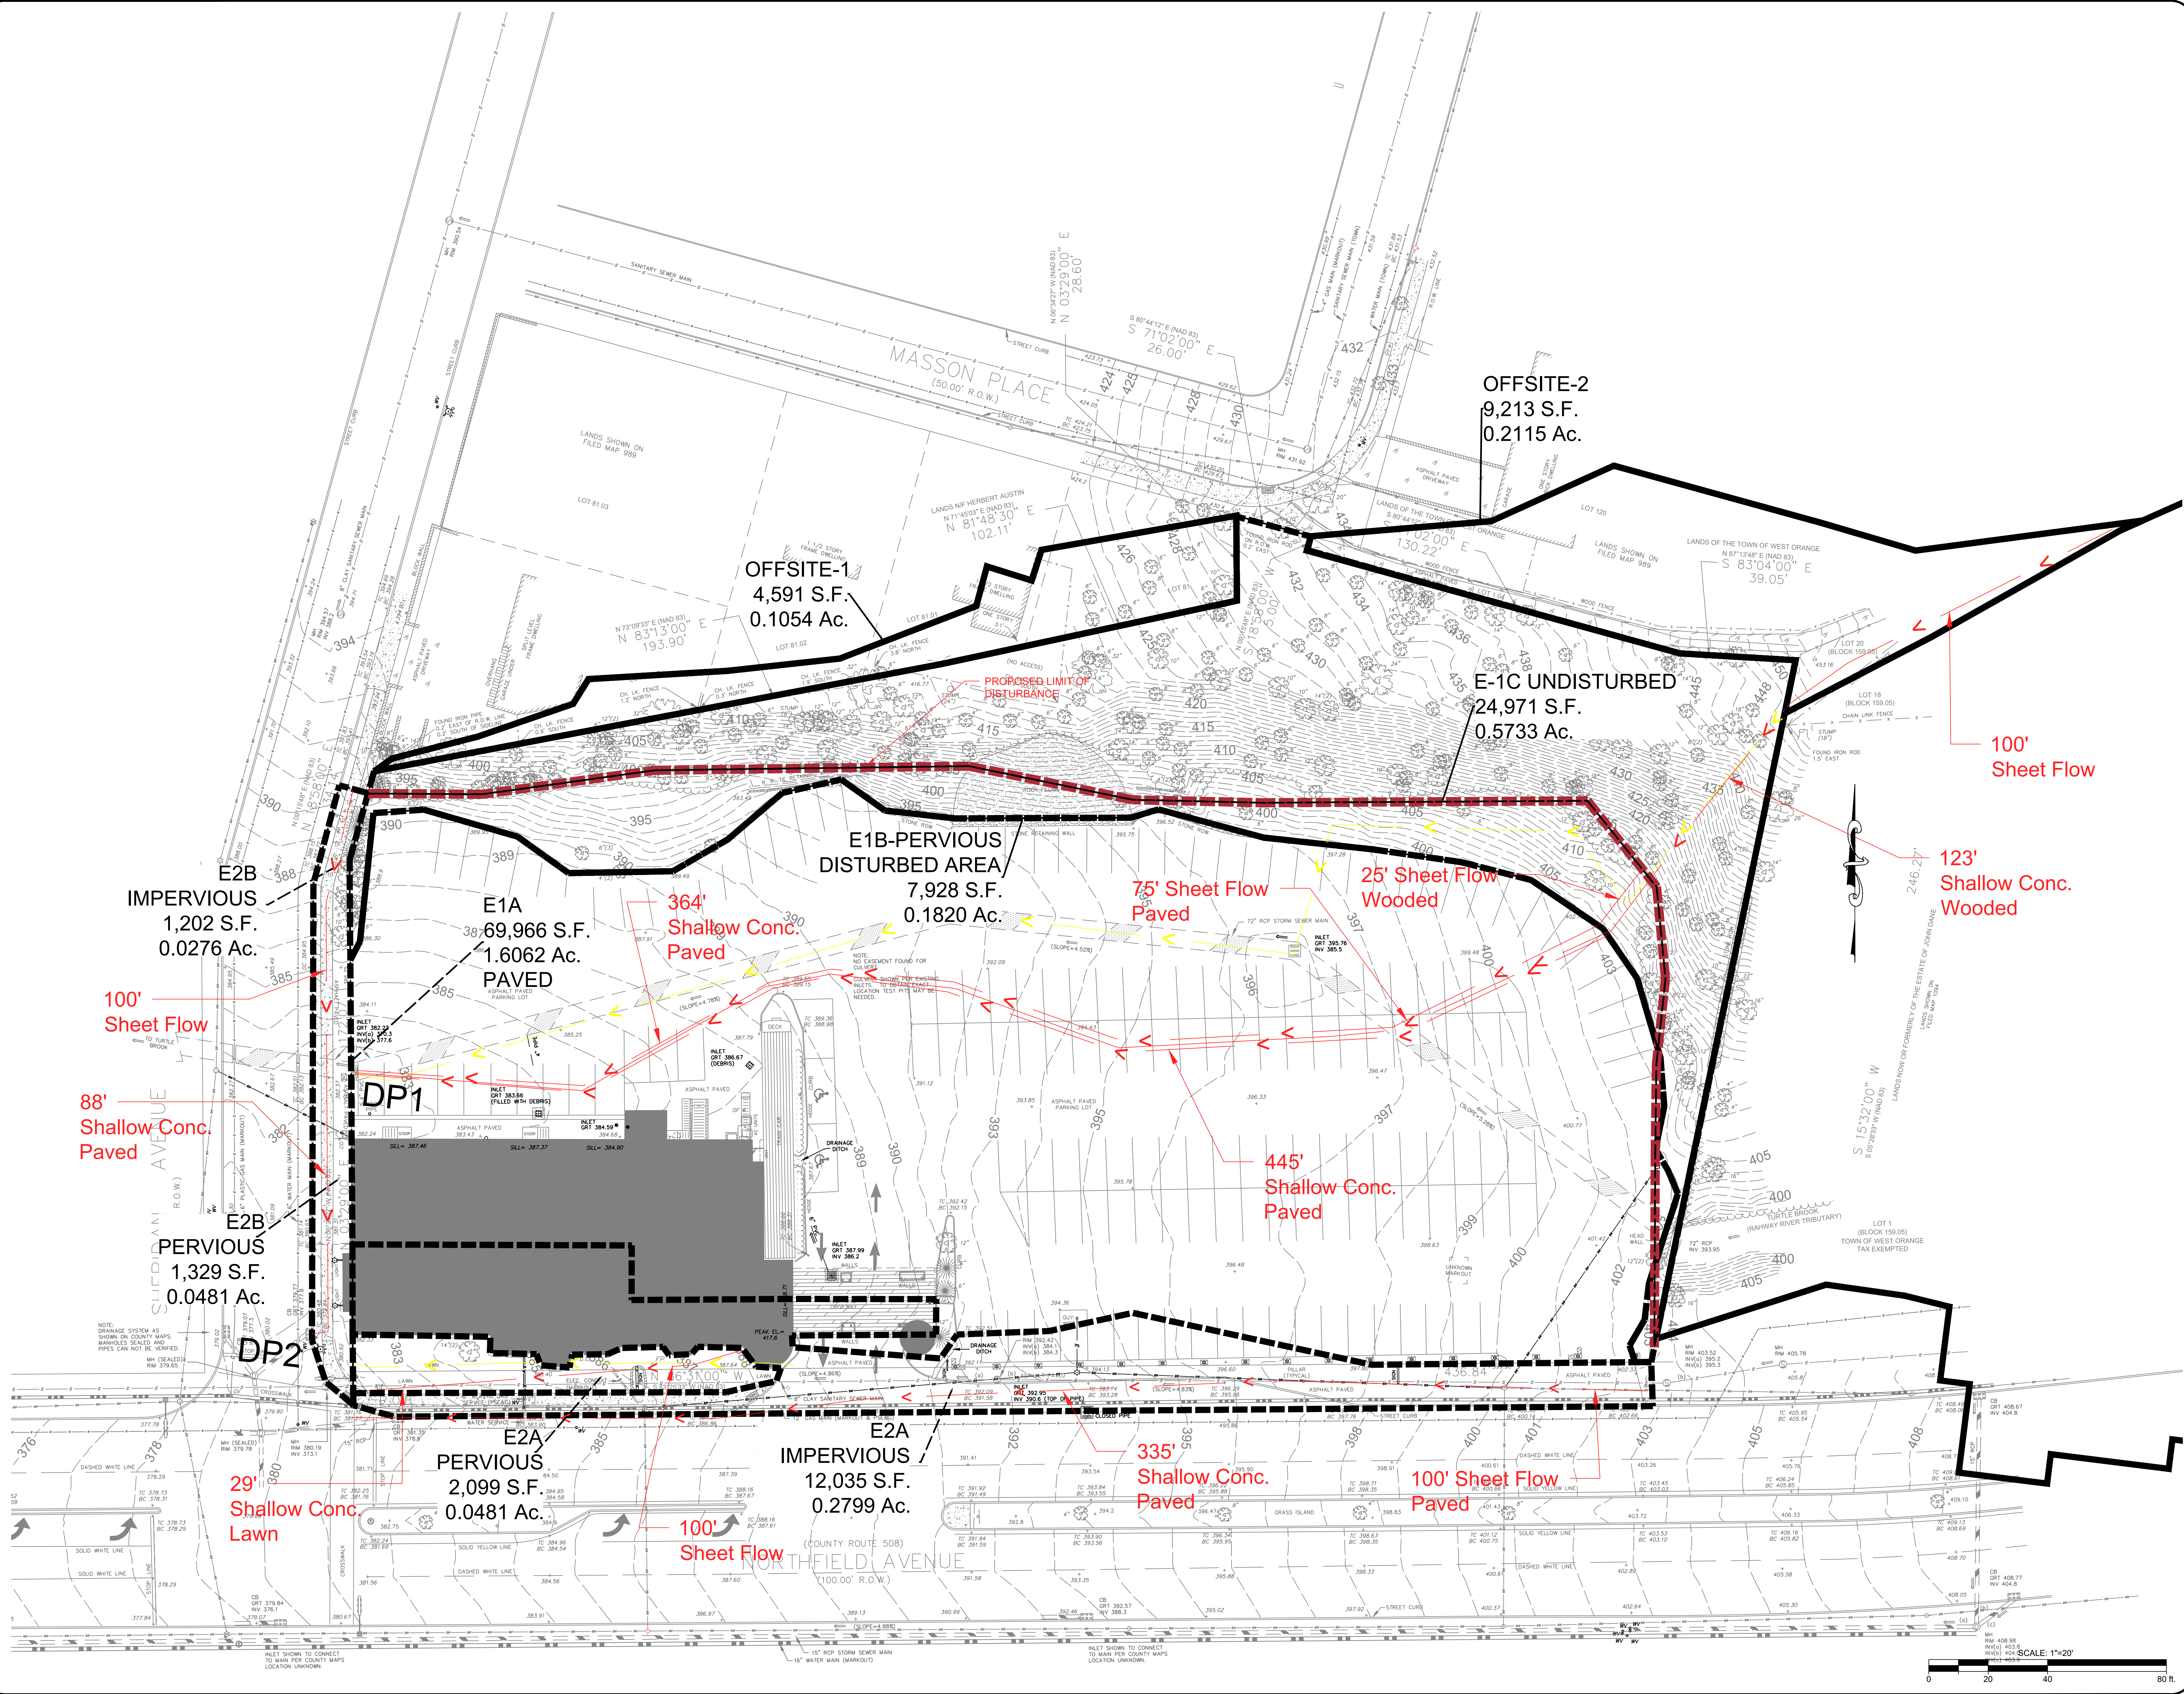



Jarmel Kizel
ARCHITECTS AND ENGINEERS INC.

42 OKNER PARKWAY
LIVINGSTON, NEW JERSEY 07039
TEL: 973-994-9669
FAX: 973-994-4069

www.jarmelkizel.com

Architecture
Engineering
Interior Design
Implementation Services

NY State Board of Architects: 21400016100
NJ State Board of Engineers & Land Surveyors: 24024953000

ISSUE

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

REVISION

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

PRINCIPALS

MATTHEW B. JARMEL, AIA, MBA
RICHARD A. JARMEL, PE
IRWIN H. KIZEL, AIA, PP
ARCHITECTS & ENGINEERS
BEATRIZ BARREIRA, RA
JEREMY D. ROYER, AIA
ANDREI B. BROZDOWSKI, PE
RICHARD CHEN, PE
SHANNON CROWDER, PE
THOMAS D'AMOREA, PE
ANDRE E. DUBI, PE
ANTHONY FACCHINO, PE, PLS, PP
GERARDO F. GEMELLI, PE
JONATHAN KUYER, AIA
KAROLINA PODKONCZNY, AIA
RENATA MALDONADO REZENDE, AIA, LEED AP
CHERYL SCHNEIDER, AIA
STEVEN J. VAZ, PE

Project:
525 NORTHFIELD AVENUE
PRELIMINARY / FINAL SITE PLAN
TOWNSHIP OF WEST ORANGE
ESSEX COUNTY, NEW JERSEY
TAX MAP #94, BLOCK 159.04 LOT 1.01

Scale: 1" = 20'

Project Number: GOMESGR24-223

Drawn By: AF

Approved By: AF

Drawing Name: PROPOSED DRAINAGE AREA MAP


Drawing Number: DA-2

2 OF 3

Initial Date: OCTOBER 22, 2025

ENGINEER OF RECORD

ANTHONY FACCHINO, PE, PLS
NY State Board of Architects: 21400016100
NJ State Board of Engineers & Land Surveyors: 24024953000

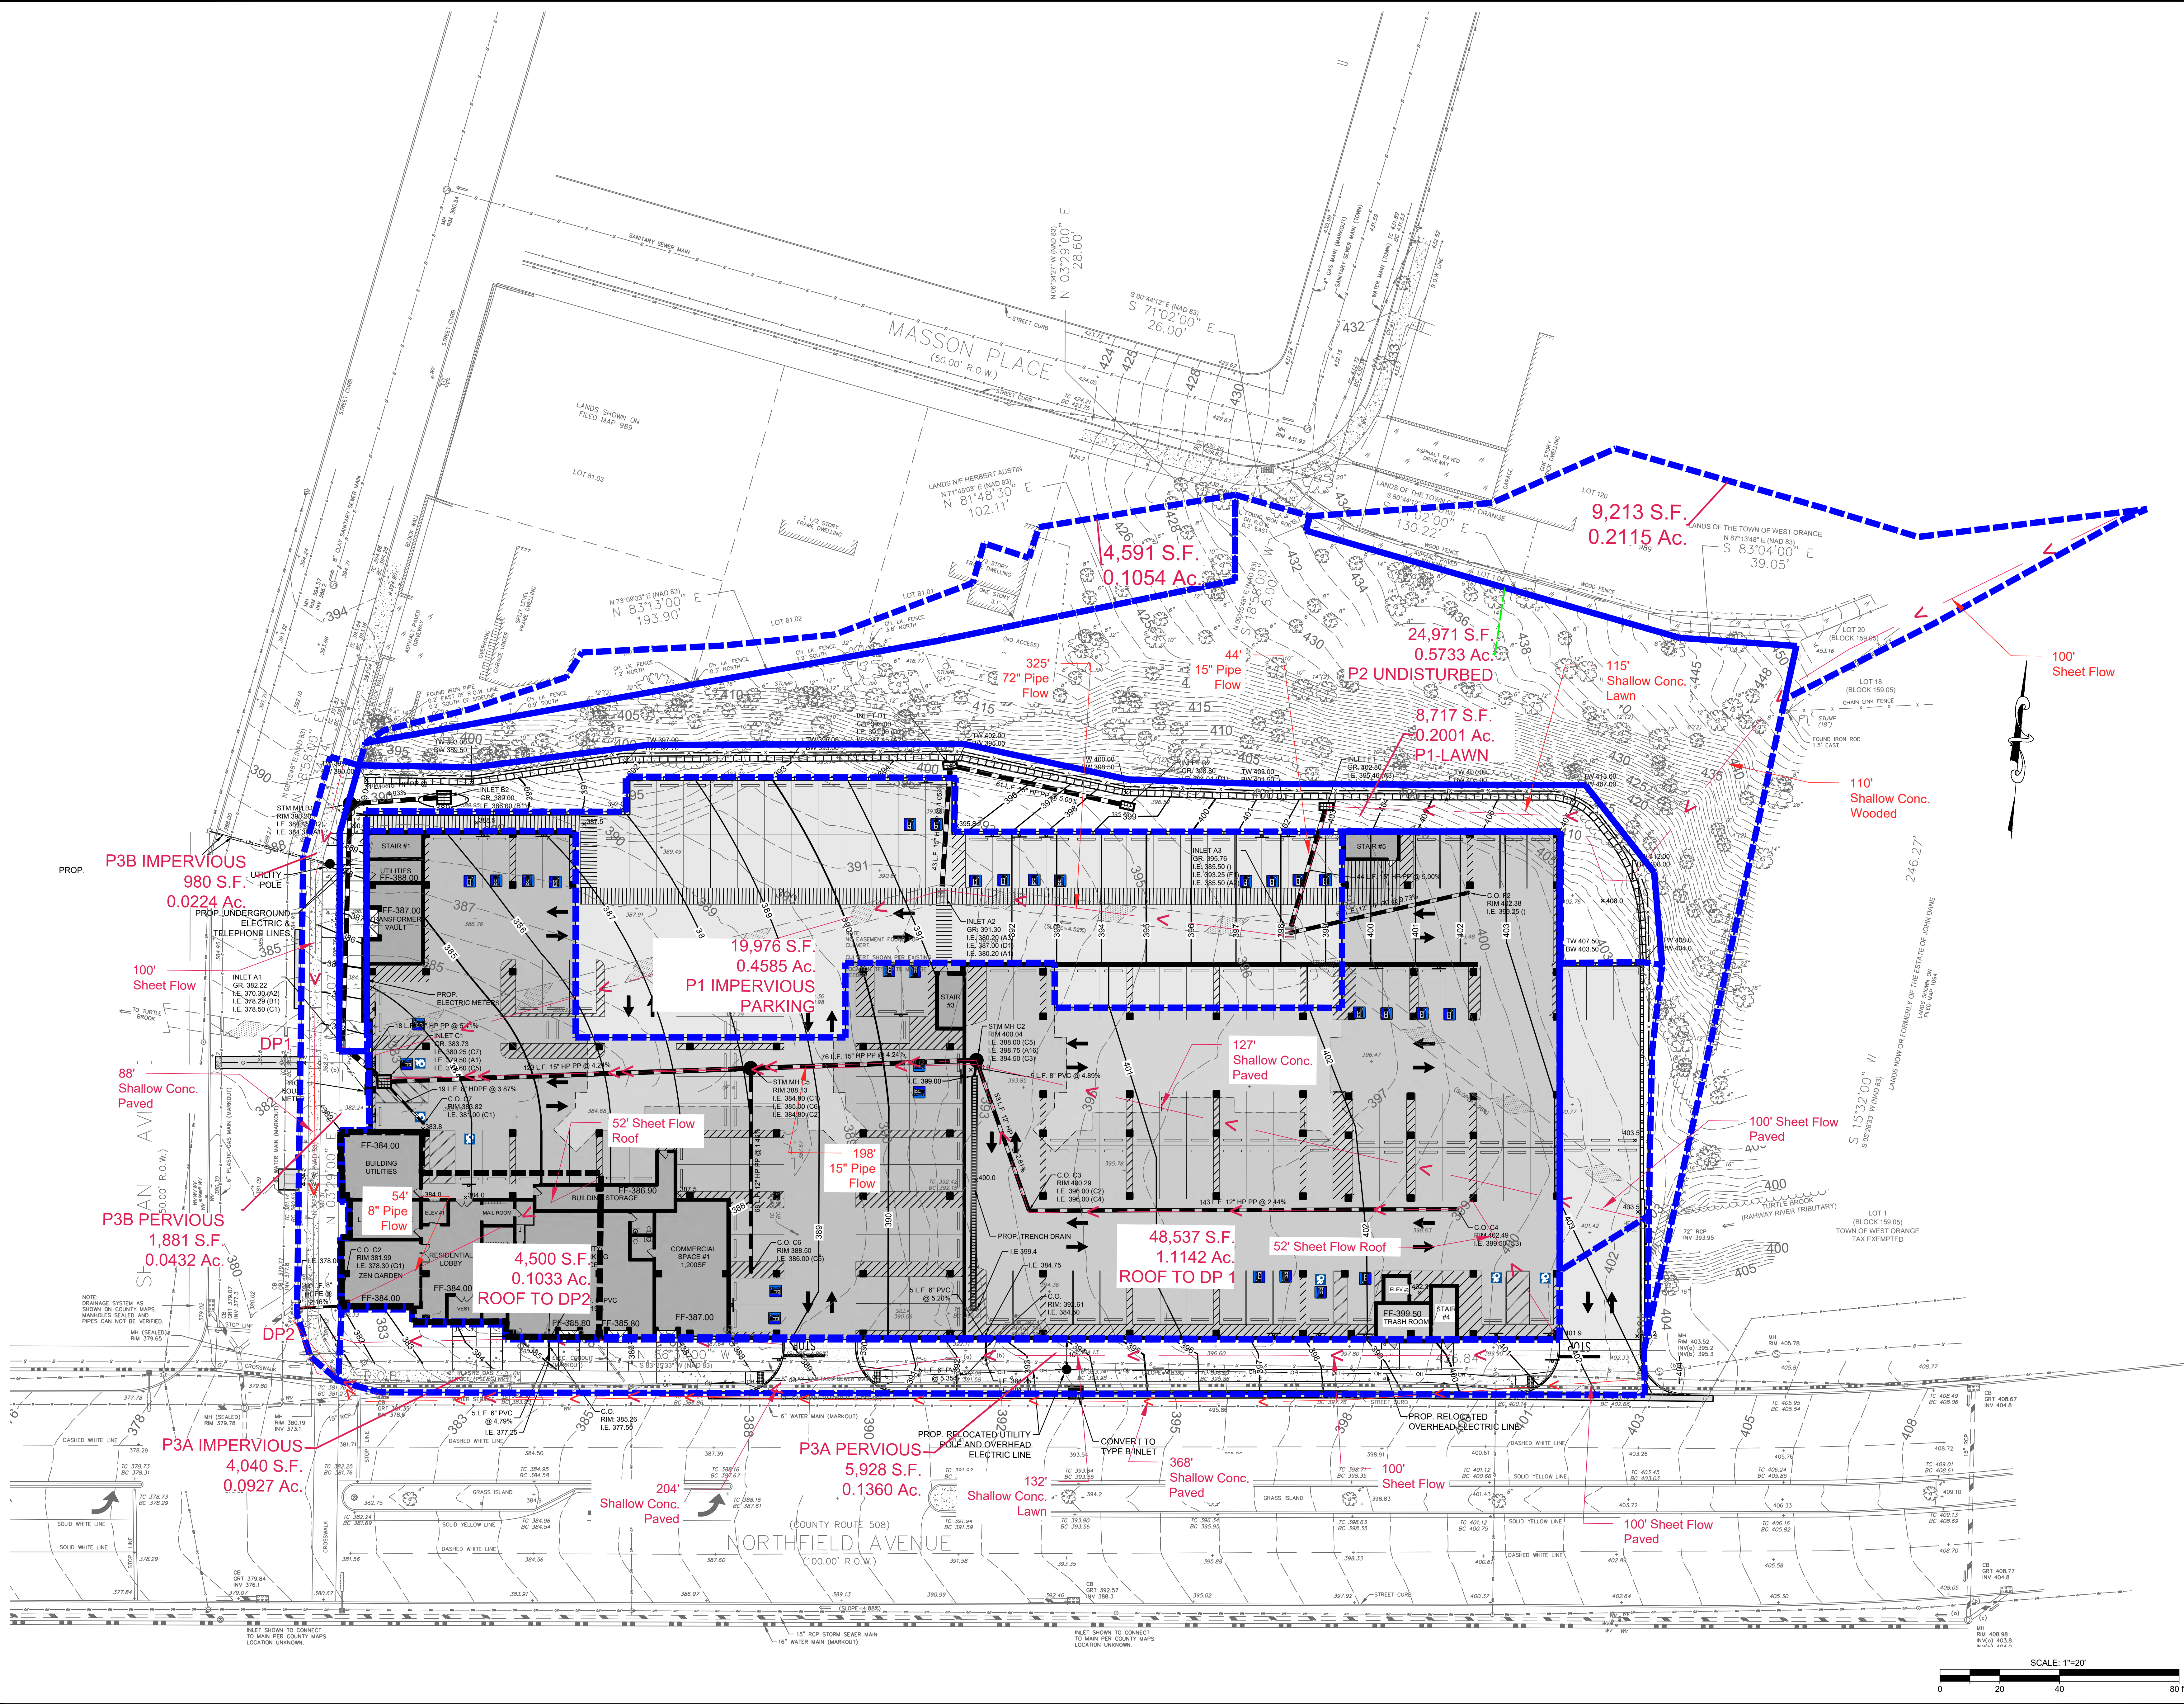

S:\Projects\GOMESGR24-223 - 525 Northfield Ave. West Orange\N\Design Data\SWMA\4223-PROPOSED DRAINAGE AREA MAP-NEW.DWG PLOTTED: 1/29/2026 9:34 AM ANTHONY FACCHINO



Jarmel Kizel
ARCHITECTS AND ENGINEERS INC.

42 OKNER PARKWAY
LIVINGSTON, NEW JERSEY 07039
TEL: 973-994-9669
FAX: 973-994-4069

www.jarmelkizel.com

Architecture
Engineering
Interior Design
Implementation Services

NJ State Board Of Architects Authorization No. 21A000016100
NJ State Board Of Engineers & Land Surveyors Authorization No. 240249533000

ISSUE

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

REVISION

NO.	DATE	DESCRIPTION	INT.
1	01-28-2026	PER TWP. REVIEW MEMOS	AF

PRINCIPALS

MATTHEW B. JARMEL, AIA, MBA

RICHARD A. JARMEL, PE

IRWIN H. KIZEL, AIA, PP

ARCHITECTS & ENGINEERS

BEATRIZ BARRERAS, RA

JEREMY D. BOYER, AIA

ANDREI B. BRODZOWSKI, PE

BLUEN CHEN, PE

SHANNON CROWDER, PE

THOMAS DAFRONECA, PE

ANDRE E. DUBI, PE

ANTHONY FACCHINO, PE, PLS, PP

GERARDO F. GEMARDO, PE

JONATHAN KUYVERA, AIA

KAROLINA PODKONCZNY, AIA

RENATA MALDONADO E REZENDE, AIA, LEED AP

CHEVY SCHWENGER, AIA

STEVEN J. VAZ, PE

Project:
525 NORTHFIELD AVENUE
PRELIMINARY / FINAL SITE PLAN
TOWNSHIP OF WEST ORANGE
ESSEX COUNTY, NEW JERSEY
TAX MAP #94, BLOCK 159.04 LOT 1.01

Scale: 1" = 20'

Project Number: GOMESGR24-223

Drawn By: AF

Approved By: AF

PROPOSED INLET
DRAINAGE AREA
MAP

Drawing Number:

DA-3

3 OF 3

Initial Date: OCTOBER 22, 2025

ENGINEER OF RECORD

ANTHONY FACCHINO, PE, PLS
NJ State Board Of Architects Authorization No. 21A000016100
NJ State Board Of Engineers & Land Surveyors Authorization No. 240249533000



S:\PROJECTS\GOMESGR24-223 - 525 NORTHFIELD AVE. WEST ORANGE\N\DESIGN DATA\SW\24-223-INLET.DWG ANTHONY FACCHINO PLOTTED: 1/29/2026 9:34 AM